

APPENDIX D: 2026 Local Capacity Technical Analysis

Intentionally left blank

**2026
LOCAL CAPACITY TECHNICAL
ANALYSIS**

**FINAL REPORT
AND STUDY RESULTS**

January 31, 2017

Local Capacity Technical Analysis Overview and Study Results

I. Executive Summary

This report documents the results and recommendations of the 2026 Long-Term Local Capacity Technical (LCT) Study. The LCT Study objectives, inputs, methodologies and assumptions are the same as those discussed in the 2017 LCT Study to be adopted by the CAISO and CPUC in their 2017 Local Resource Adequacy needs.

Overall, the LCR trend compared with 2021, is up by about 1200 MW mainly due to load forecast. It is worth mentioning the following areas: (1) North Coast/North Bay, Stockton, Bay Area, Fresno, Big Creek/Ventura and San Diego, where LCR has increased mostly due to load forecast; (2) Humboldt where LCR is steady; (3) Sierra where LCR has decreased due to implementation of new transmission projects; (4) Kern where LCR has increased due to new transmission projects and resulting area redefinition; (5) LA Basin where LCR has increased mainly due to transmission and resource configuration change in the CFE system.

This Valley Electric Association (VEA) area was eliminated last year due to new transmission projects, the incorporation of the VEA UVLS model into the contingency analysis, and the availability of ISO operating procedure 7910 that addresses some category C issues.

The load forecast used in this study is based on the final adopted California Energy Demand Updated Forecast, 2016-2026 developed by the CEC; namely the mid-demand baseline with low-mid additional achievable energy efficiency (AAEE), posted: http://www.energy.ca.gov/2015_energy/policy/documents/2016-01-27_load_serving_entity_and_Balancing_authority.php.

For comparison below you will find the 2021 and 2026 total LCR needs.

2021 Local Capacity Needs

Local Area Name	Qualifying Capacity			2021 LCR Need Based on Category B			2021 LCR Need Based on Category C with operating procedure		
	QF/ Muni (MW)	Market (MW)	Total (MW)	Existing Capacity Needed	Deficiency	Total (MW)	Existing Capacity Needed**	Deficiency	Total (MW)
Humboldt	20	198	218	121	0	121	169	0	169
North Coast/ North Bay	128	722	850	205	0	205	480	0	480
Sierra	1176	890	2066	1094	0	1094	1475	211*	1686
Stockton	197	532	729	146	0	146	364	40*	404
Greater Bay	933	5970	6903	2448	0	2448	5194	0	5194
Greater Fresno	231	3295	3526	731	0	731	1160	0	1160
Kern	15	106	121	91	0	91	105	0	105
LA Basin	1615	6180	7795	6697	0	6697	6898	0	6898
Big Creek/Ventura	517	3160	3677	2325	0	2325	2398	0	2398
San Diego/ Imperial Valley	263	4577	4840	4357	0	4357	4357	0	4357
Total	5095	25630	30725	18215	0	18215	22793	251	23044

2026 Local Capacity Needs

Local Area Name	Qualifying Capacity			2026 LCR Need Based on Category B			2026 LCR Need Based on Category C with operating procedure		
	QF/ Muni (MW)	Market (MW)	Total (MW)	Existing Capacity Needed	Deficiency	Total (MW)	Existing Capacity Needed**	Deficiency	Total (MW)
Humboldt	20	198	218	123	0	123	171	0	171
North Coast/ North Bay	128	722	850	201	0	201	547	0	547
Sierra	1176	890	2066	472	0	472	1004	0	1004
Stockton	172	532	704	183	0	183	516	0	516
Greater Bay	933	5970	6903	3226	0	3226	5544	188	5732
Greater Fresno	231	3295	3526	1474	0	1474	1474	0	1474
Kern	15	566	581	391	0	391	392	0	392
LA Basin	1615	6180	7795	7234	0	7234	7234	0	7234
Big Creek/Ventura	517	3160	3677	2310	0	2310	2528	0	2528
San Diego/ Imperial Valley	263	4577	4840	4649	0	4649	4649	0	4649
Total	5070	26090	31160	20263	0	20263	24059	188	24247

* No local area is “overall deficient”. Resource deficiency values result from a few deficient sub-areas; and since there are no resources that can mitigate this deficiency the numbers are carried forward into the total area needs. Resource deficient sub-area implies that in order to comply with the criteria, at summer peak, load may be shed immediately after the first contingency.

** Since “deficiency” cannot be mitigated by any available resource, the “Existing Capacity Needed” will be split among LSEs on a load share ratio during the assignment of local area resource responsibility.

The 2026 Fresno LCR base cases has been built with Path 15 at 1275 MW N-S due to historically seen overloads on Warnerville-Wilson 230 kV line. The overloads on the Panoche to Wilson 115 kV corridor are the worst at Path 15 high S-N flows; therefore the LCR requirement herein is understated. For future years, after the installation of the Wilson reactor, the ISO will develop LCR base cases with a stressed Path 15 in the S-N direction in order to correctly quantify local requirement needs.

The write-up for each Local Capacity Area lists important new projects included in the base cases as well as a description of reason for changes between the 2021 Long-Term LCR study and this 2026 Long-Term LCR study.

Table of Contents

I. Executive Summary	1
II. Overview of the Study: Inputs, Outputs and Options.....	5
A. Objectives.....	5
B. Key Study Assumptions	5
Inputs and Methodology	5
C. Grid Reliability	7
D. Application of N-1, N-1-1, and N-2 Criteria.....	8
E. Performance Criteria.....	8
F. The Two Options Presented In This LCT Report.....	15
1. Option 1- Meet Performance Criteria Category B.....	15
2. Option 2- Meet Performance Criteria Category C and Incorporate Suitable Operational Solutions	16
III. Assumption Details: How the Study was Conducted	17
A. System Planning Criteria.....	17
1. Power Flow Assessment:	18
2. Post Transient Load Flow Assessment:	19
3. Stability Assessment:	19
B. Load Forecast	19
1. System Forecast	19
2. Base Case Load Development Method.....	20
C. Power Flow Program Used in the LCR analysis.....	21
IV. Locational Capacity Requirement Study Results	22
A. Summary of Study Results.....	22
B. Summary of Results by Local Area	24
1. Humboldt Area.....	24
2. North Coast / North Bay Area	27
3. Sierra Area	33
4. Stockton Area.....	43
5. Greater Bay Area	48
6. Greater Fresno Area.....	58
7. Kern Area.....	65
8. LA Basin Area	69
9. Big Creek/Ventura Area	85
10. San Diego-Imperial Valley Area	96
11. Valley Electric Area.....	107

II. Overview of the Study: Inputs, Outputs and Options

A. Objectives

As was the objective of all previous LCT Studies, the intent of the 2026 Long-Term LCT Study is to identify specific areas within the CAISO Balancing Authority Area that have limited import capability and determine the minimum generation capacity (MW) necessary to mitigate the local reliability problems in those areas.

B. Key Study Assumptions

Inputs and Methodology

The CAISO used the same Inputs and Methodology as does agreed upon by interested parties previously incorporated into the 2017 LCR Study. The following table sets forth a summary of the approved inputs and methodology that have been used in the previous 2017 LCR Study as well as this 2026 LCR Study:

Summary Table of Inputs and Methodology Used in this LCR Study:

Issue:	HOW INCORPORATED INTO THIS LCR STUDY:
<u>Input Assumptions:</u>	
<ul style="list-style-type: none"> • Transmission System Configuration 	The existing transmission system has been modeled, including all projects operational on or before June 1, of the study year and all other feasible operational solutions brought forth by the PTOs and as agreed to by the CAISO.
<ul style="list-style-type: none"> • Generation Modeled 	The existing generation resources has been modeled and also includes all projects that will be on-line and commercial on or before June 1, of the study year
<ul style="list-style-type: none"> • Load Forecast 	Uses a 1-in-10 year summer peak load forecast
<u>Methodology:</u>	
<ul style="list-style-type: none"> • <u>Maximize Import Capability</u> 	Import capability into the load pocket has been maximized, thus minimizing the generation required in the load pocket to meet applicable reliability requirements.
<ul style="list-style-type: none"> • <u>QF/Nuclear/State/Federal Units</u> 	Regulatory Must-take and similarly situated units like QF/Nuclear/State/Federal resources have been modeled on-line at qualifying capacity output values for purposes of this LCR Study.
<ul style="list-style-type: none"> • <u>Maintaining Path Flows</u> 	Path flows have been maintained below all established path ratings into the load pockets, including the 500 kV. For clarification, given the existing transmission system configuration, the only 500 kV path that flows directly into a load pocket and will, therefore, be considered in this LCR Study is the South of Lugo transfer path flowing into the LA Basin.
<u>Performance Criteria:</u>	
<ul style="list-style-type: none"> • <u>Performance Level B & C, including incorporation of PTO operational solutions</u> 	This LCR Study is being published based on Performance Level B and Performance Level C criterion, yielding the low and high range LCR scenarios. In addition, the CAISO will incorporate all new projects and other feasible and CAISO-approved operational solutions brought forth by the PTOs that can be operational on or before June 1, of the study year. Any such solutions that can reduce the need for procurement to meet the Performance Level C criteria will be incorporated into the LCR Study.
<u>Load Pocket:</u>	
<ul style="list-style-type: none"> • <u>Fixed Boundary, including limited reference to published effectiveness factors</u> 	This LCR Study has been produced based on load pockets defined by a fixed boundary. The CAISO only publishes effectiveness factors where they are useful in facilitating procurement where excess capacity exists within a load pocket.

Further details regarding the 2017 as well as 2026 LCR Study methodology and assumptions are provided in Section III, below.

C. Grid Reliability

Service reliability builds from grid reliability because grid reliability is reflected in the planning standards of the Western Electricity Coordinating Council (“WECC”) that incorporate standards set by the North American Electric Reliability Council (“NERC”) (collectively “NERC Planning Standards”). The NERC Planning Standards apply to the interconnected electric system in the United States and are intended to address the reality that within an integrated network, whatever one Balancing Authority Area does can affect the reliability of other Balancing Authority Areas. Consistent with the mandatory nature of the NERC Planning Standards, the CAISO is under a statutory obligation to ensure efficient use and reliable operation of the transmission grid consistent with achievement of the NERC Planning Standards.¹ The CAISO is further under an obligation, pursuant to its FERC-approved Transmission Control Agreement, to secure compliance with all “Applicable Reliability Criteria.” Applicable Reliability Criteria consists of the NERC Planning Standards as well as reliability criteria adopted by the CAISO, in consultation with the CAISO’s Participating Transmission Owners (“PTOs”), which affect a PTO’s individual system.

The NERC Planning Standards define reliability on interconnected electric systems using the terms “adequacy” and “security.” “Adequacy” is the ability of the electric systems to supply the aggregate electrical demand and energy requirements of their customers at all times, taking into account physical characteristics of the transmission system such as transmission ratings and scheduled and reasonably expected unscheduled outages of system elements. “Security” is the ability of the electric systems to withstand sudden disturbances such as electric short circuits or unanticipated loss of system elements. The NERC Planning Standards are organized by Performance Categories. Certain categories require that the grid operator not only ensure that grid integrity is maintained under certain adverse system conditions (e.g.,

¹ Pub. Utilities Code § 345

security), but also that all customers continue to receive electric supply to meet demand (e.g., adequacy). In that case, grid reliability and service reliability would overlap. But there are other levels of performance where security can be maintained without ensuring adequacy.

D. Application of N-1, N-1-1, and N-2 Criteria

The CAISO will maintain the system in a safe operating mode at all times. This obligation translates into respecting the Reliability Criteria at all times, for example during normal operating conditions (N-0) the CAISO must protect for all single contingencies (N-1) and common mode (N-2) double line outages. Also, after a single contingency, the CAISO must re-adjust the system to support the loss of the next most stringent contingency. This is referred to as the N-1-1 condition.

The N-1-1 vs N-2 terminology was introduced only as a mere temporal differentiation between two existing NERC Category C events. N-1-1 represents NERC Category C3 (“category B contingency, manual system adjustment, followed by another category B contingency”). The N-2 represents NERC Category C5 (“any two circuits of a multiple circuit tower line”) as well as WECC-S2 (for 500 kV only) (“any two circuits in the same right-of-way”) with no manual system adjustment between the two contingencies.

E. Performance Criteria

As set forth on the Summary Table of Inputs and Methodology, this LCR Report is based on NERC Performance Level B and Performance Level C criterion. The NERC Standards refer mainly to thermal overloads. However, the CAISO also tests the electric system in regards to the dynamic and reactive margin compliance with the existing WECC standards for the same NERC performance levels. These Performance Levels can be described as follows:

a. Performance Criteria- Category B

Category B describes the system performance that is expected immediately following the loss of a single transmission element, such as a transmission circuit, a generator, or a transformer.

Category B system performance requires that all thermal and voltage limits must be within their “Applicable Rating,” which, in this case, are the emergency ratings as generally determined by the PTO or facility owner. Applicable Rating includes a temporal element such that emergency ratings can only be maintained for certain duration. Under this category, load cannot be shed in order to assure the Applicable Ratings are met however there is no guarantee that facilities are returned to within normal ratings or to a state where it is safe to continue to operate the system in a reliable manner such that the next element out will not cause a violation of the Applicable Ratings.

b. Performance Criteria- Category C

The NERC Planning Standards require system operators to “look forward” to make sure they safely prepare for the “next” N-1 following the loss of the “first” N-1 (stay within Applicable Ratings after the “next” N-1). This is commonly referred to as N-1-1. Because it is assumed that some time exists between the “first” and “next” element losses, operating personnel may make any reasonable and feasible adjustments to the system to prepare for the loss of the second element, including, operating procedures, dispatching generation, moving load from one substation to another to reduce equipment loading, dispatching operating personnel to specific station locations to manually adjust load from the substation site, or installing a “Special Protection Scheme” that would remove pre-identified load from service upon the loss of the “next “


element.² All Category C requirements in this report refer to situations when in real time (N-0) or after the first contingency (N-1) the system requires additional readjustment in order to prepare for the next worst contingency. In this time frame, load drop is not allowed per existing planning criteria.

Generally, Category C describes system performance that is expected following the loss of two or more system elements. This loss of two elements is generally expected to happen simultaneously, referred to as N-2. It should be noted that once the “next” element is lost after the first contingency, as discussed above under the Performance Criteria B, N-1-1 scenario, the event is effectively a Category C. As noted above, depending on system design and expected system impacts, the **planned and controlled** interruption of supply to customers (load shedding), the removal from service of certain generators and curtailment of exports may be utilized to maintain grid “security.”

c. CAISO Statutory Obligation Regarding Safe Operation

The CAISO will maintain the system in a safe operating mode at all times. This obligation translates into respecting the Reliability Criteria at all times, for example during normal operating conditions **A (N-0)** the CAISO must protect for all single contingencies **B (N-1)** and common mode **C5 (N-2)** double line outages. As a further example, after a single contingency the CAISO must readjust the system in order to be able to support the loss of the next most stringent contingency **C3 (N-1-1)**.

² A Special Protection Scheme is typically proposed as an operational solution that does not require additional generation and permits operators to effectively prepare for the next event as well as ensure security should the next event occur. However, these systems have their own risks, which limit the extent to which they could be deployed as a solution for grid reliability augmentation. While they provide the value of protecting against the next event without the need for pre-contingency load shedding, they add points of potential failure to the transmission network. This increases the potential for load interruptions because sometimes these systems will operate when not required and other times they will not operate when needed.

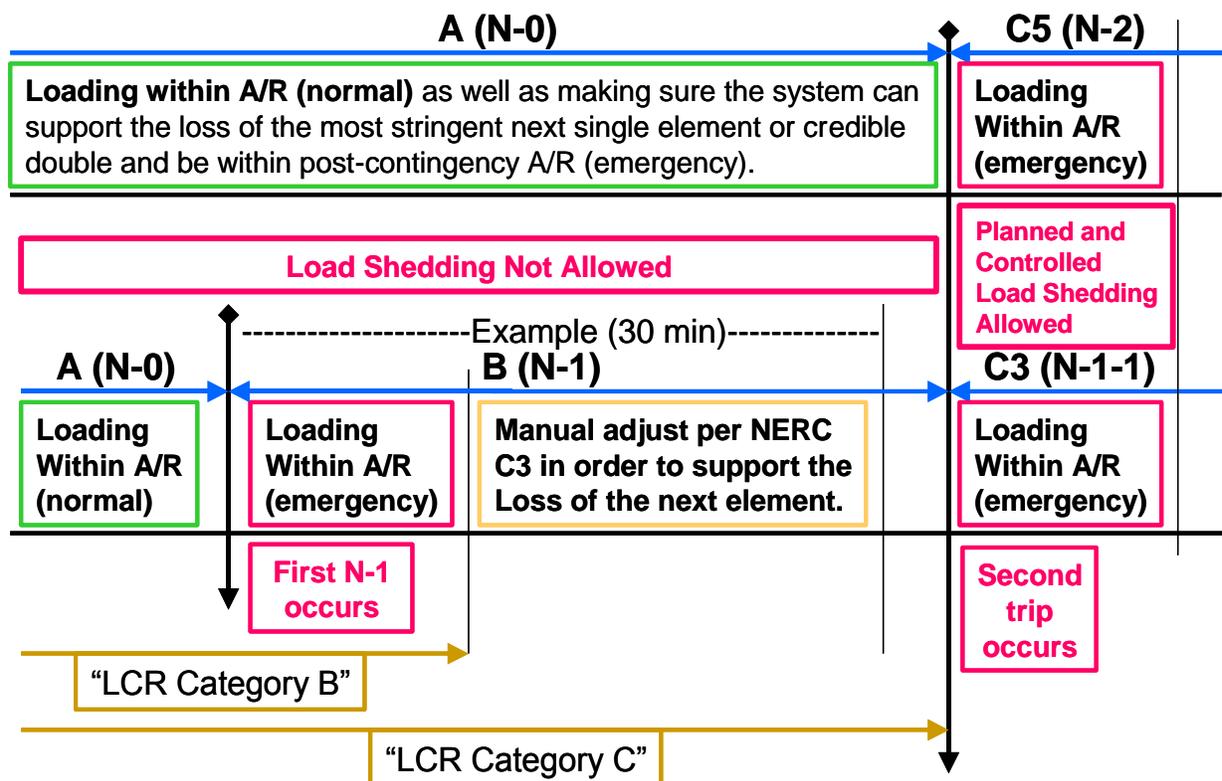

The following definitions guide the CAISO’s interpretation of the Reliability Criteria governing safe mode operation and are used in this LCT Study:

Applicable Rating:

This represents the equipment rating that will be used under certain contingency conditions.

Normal rating is to be used under normal conditions.

Long-term emergency ratings, if available, will be used in all emergency conditions as long as “system readjustment” is provided in the amount of time given (specific to each element) to reduce the flow to within the normal ratings. If not available normal rating is to be used.

Short-term emergency ratings, if available, can be used as long as “system readjustment” is provided in the “short-time” available in order to reduce the flow to within the long-term emergency ratings where the element can be kept for another

length of time (specific to each element) before the flow needs to be reduced the below the normal ratings. If not available long-term emergency rating should be used.

Temperature-adjusted ratings shall not be used because this is a year-ahead study not a real-time tool, as such the worst-case scenario must be covered. In case temperature-adjusted ratings are the only ratings available then the minimum rating (highest temperature) given the study conditions shall be used.

CAISO Transmission Register is the only official keeper of all existing ratings mentioned above.

Ratings for future projects provided by PTO and agree upon by the CAISO shall be used.

Other short-term ratings not included in the CAISO Transmission Register may be used as long as they are engineered, studied and enforced through clear operating procedures that can be followed by real-time operators.

Path Ratings need to be maintained in order for these studies to comply with the Minimum Operating Reliability Criteria and assure that proper capacity is available in order to operate the system in real-time.

Controlled load drop:

This is achieved with the use of a Special Protection Scheme.

Planned load drop:

This is achieved when the most limiting equipment has short-term emergency ratings AND the operators have an operating procedure that clearly describes the actions that need to be taken in order to shed load.

Special Protection Scheme:

All known SPS shall be assumed. New SPS must be verified and approved by the CAISO and must comply with the new SPS guideline described in the CAISO Planning Standards.

System Readjustment:

This represents the actions taken by operators in order to bring the system within a safe operating zone after any given contingency in the system.

Actions that can be taken as system readjustment after a single contingency (Category B):

1. System configuration change – based on validated and approved operating procedures
2. Generation re-dispatch
 - a. Decrease generation (up to 1150 MW) – limit given by single contingency SPS as part of the CAISO Grid Planning standards (ISO G4)
 - b. Increase generation – this generation will become part of the LCR need

Actions, which shall not be taken as system readjustment after a single contingency (Category B):

1. Load drop – based on the intent of the CAISO/WECC and NERC criteria for category B contingencies.

The NERC Transmission Planning Standards footnote mentions that load shedding can be done after a category B event in certain local areas in order to maintain compliance with performance criteria. However, the main body of the criteria spells out that no dropping of load should be done following a single contingency. All stakeholders and the CAISO agree that no involuntary interruption of load should be done immediately after a single contingency. Further, the CAISO and stakeholders now agree on the viability of dropping load as part of the system readjustment period – in order to protect for the next most limiting contingency. After a single contingency, it is understood that the system is in a Category B condition and the system should be planned based on the body of the criteria with no shedding of load regardless of whether it is done immediately or in 15-30 minute after the original contingency. Category C conditions only arrive after the second contingency has happened; at that point in time, shedding load is allowed in a planned and controlled manner.

A robust California transmission system should be, and under the LCT Study is being, planned based on the main body of the criteria, not the footnote regarding Category B contingencies. Therefore, if there are available resources in the area, they are looked to meet reliability needs (and included in the LCR requirement) before resorting to involuntary load curtailment. The footnote may be applied for criteria compliance issues only where there are no resources available in the area.

Time allowed for manual readjustment:

Tariff Section 40.3.1.1, requires the CAISO, in performing the Local Capacity Technical Study, to apply the following reliability criterion:

Time Allowed for Manual Adjustment: This is the amount of time required for the Operator to take all actions necessary to prepare the system for the next Contingency. The time should not be more than thirty (30) minutes.

The CAISO Planning Standards also impose this manual readjustment requirement. As a parameter of the Local Capacity Technical Study, the CAISO must assume that as the system operator the CAISO will have sufficient time to:

- (1) make an informed assessment of system conditions after a contingency has occurred;
- (2) identify available resources and make prudent decisions about the most effective system redispatch;
- (3) manually readjust the system within safe operating limits after a first contingency to be prepared for the next contingency; and
- (4) allow sufficient time for resources to ramp and respond according to the operator's redispatch instructions. This all must be accomplished within 30 minutes.

Local capacity resources can meet this requirement by either (1) responding with sufficient speed, allowing the operator the necessary time to assess and redispatch resources to effectively reposition the system within 30 minutes after the first contingency, or (2) have sufficient energy available for frequent dispatch on a pre-contingency basis to ensure the operator can meet minimum online commitment

constraints or reposition the system within 30 minutes after the first contingency occurs. Accordingly, when evaluating resources that satisfy the requirements of the CAISO Local Capacity Technical Study, the CAISO assumes that local capacity resources need to be available in no longer than 20 minutes so the CAISO and demand response providers have a reasonable opportunity to perform their respective and necessary tasks and enable the CAISO to reposition the system within the 30 minutes in accordance with applicable reliability criteria.

F. The Two Options Presented In This LCT Report

This LCT Study sets forth different solution “options” with varying ranges of potential service reliability consistent with CAISO’s Reliability Criteria. The CAISO applies Option 2 for its purposes of identifying necessary local capacity needs and the corresponding potential scope of its backstop authority. Nevertheless, the CAISO continues to provide Option 1 as a point of reference for the CPUC and Local Regulatory Authorities in considering procurement targets for their jurisdictional LSEs.

1. Option 1- Meet Performance Criteria Category B

Option 1 is a service reliability level that reflects generation capacity that must be available to comply with reliability standards immediately after a NERC Category B given that load cannot be removed to meet this performance standard under Reliability Criteria. However, this capacity amount implicitly relies on load interruption as the **only means** of meeting any Reliability Criteria that is beyond the loss of a single transmission element (N-1). These situations will likely require substantial load interruptions in order to maintain system continuity and alleviate equipment overloads prior to the actual occurrence of the second contingency.³

³ This potential for pre-contingency load shedding also occurs because real time operators must prepare for the loss of a common mode N-2 at all times.

Option 2- Meet Performance Criteria Category C and Incorporate Suitable Operational Solutions

Option 2 is a service reliability level that reflects generation capacity that is needed to readjust the system to prepare for the loss of a second transmission element (N-1-1) using generation capacity *after* considering all reasonable and feasible operating solutions (including those involving customer load interruption) developed and approved by the CAISO, in consultation with the PTOs. Under this option, there is no expected load interruption to end-use customers under normal or single contingency conditions as the CAISO operators prepare for the second contingency. However, the customer load may be interrupted in the event the second contingency occurs.

As noted, Option 2 is the local capacity level that the CAISO requires to reliably operate the grid per NERC, WECC and CAISO standards. As such, the CAISO recommends adoption of this Option to guide resource adequacy procurement.

III. Assumption Details: How the Study was Conducted

A. System Planning Criteria

The following table provides a comparison of system planning criteria, based on the NERC performance standards, used in the study:

Table 4: Criteria Comparison

Contingency Component(s)	ISO Grid Planning Criteria	Old RMR Criteria	Local Capacity Criteria
<u>A – No Contingencies</u>	X	X	X
<u>B – Loss of a single element</u>			
1. Generator (G-1)	X	X	X1
2. Transmission Circuit (L-1)	X	X	X1
3. Transformer (T-1)	X	X2	X1,2
4. Single Pole (dc) Line	X	X	X1
5. G-1 system readjusted L-1	X	X	X
<u>C – Loss of two or more elements</u>			
1. Bus Section	X		
2. Breaker (failure or internal fault)	X		
3. L-1 system readjusted G-1	X		X
3. G-1 system readjusted T-1 or T-1 system readjusted G-1	X		X
3. L-1 system readjusted T-1 or T-1 system readjusted L-1	X		X
3. G-1 system readjusted G-1	X		X
3. L-1 system readjusted L-1	X		X
3. T-1 system readjusted T-1	X		
4. Bipolar (dc) Line	X		X
5. Two circuits (Common Mode) L-2	X		X
6. SLG fault (stuck breaker or protection failure) for G-1	X		
7. SLG fault (stuck breaker or protection failure) for L-1	X		
8. SLG fault (stuck breaker or protection failure) for T-1	X		
9. SLG fault (stuck breaker or protection failure) for Bus section	X		
WECC-S3. Two generators (Common Mode) G-2	X3		X
<u>D – Extreme event – loss of two or more elements</u>			
Any B1-4 system readjusted (Common Mode) L-2	X4		X3
All other extreme combinations D1-14.	X4		
<p>1 System must be able to readjust to a safe operating zone in order to be able to support the loss of the next contingency.</p> <p>2 A thermal or voltage criterion violation resulting from a transformer outage may not be cause for a local area reliability requirement if the violation is considered marginal (e.g. acceptable loss of facility life or low voltage), otherwise, such a violation will necessitate creation of a requirement.</p> <p>3 Evaluate for risks and consequence, per NERC standards. No voltage collapse or dynamic instability allowed.</p> <p>4 Evaluate for risks and consequence, per NERC standards.</p>			

A significant number of simulations were run to determine the most critical contingencies within each Local Capacity Area. Using power flow, post-transient load flow, and stability assessment tools, the system performance results of all the contingencies that were studied were measured against the system performance requirements defined by the criteria shown in Table 4. Where the specific system performance requirements were not met, generation was adjusted such that the minimum amount of generation required to meet the criteria was determined in the Local Capacity Area. The following describes how the criteria were tested for the specific type of analysis performed.

1. Power Flow Assessment:

<u>Contingencies</u>	<u>Thermal Criteria</u> ³	<u>Voltage Criteria</u> ⁴
Generating unit ^{1, 6}	Applicable Rating	Applicable Rating
Transmission line ^{1, 6}	Applicable Rating	Applicable Rating
Transformer ^{1, 6}	Applicable Rating ⁵	Applicable Rating ⁵
(G-1)(L-1) ^{2, 6}	Applicable Rating	Applicable Rating
Overlapping ^{6, 7}	Applicable Rating	Applicable Rating

- 1 All single contingency outages (i.e. generating unit, transmission line or transformer) will be simulated on Participating Transmission Owners’ local area systems.
- 2 Key generating unit out, system readjusted, followed by a line outage. This overlapping outage is considered a single contingency within the ISO Grid Planning Criteria. Therefore, load dropping for an overlapping G-1, L-1 scenario is not permitted.
- 3 Applicable Rating – Based on CAISO Transmission Register or facility upgrade plans including established Path ratings.
- 4 Applicable Rating – CAISO Grid Planning Criteria or facility owner criteria as appropriate including established Path ratings.
- 5 A thermal or voltage criterion violation resulting from a transformer outage may not be cause for a local area reliability requirement if the violation is considered marginal (e.g. acceptable loss of facility life or low voltage), otherwise, such a violation will necessitate creation of a requirement.
- 6 Following the first contingency (N-1), the generation must be sufficient to allow the operators to bring the system back to within acceptable (normal) operating range (voltage and loading) and/or appropriate OTC following the studied outage conditions.
- 7 During normal operation or following the first contingency (N-1), the generation must be sufficient to allow the operators to prepare for the next worst N-1 or

common mode N-2 without pre-contingency interruptible or firm load shedding. SPS/RAS/Safety Nets may be utilized to satisfy the criteria after the second N-1 or common mode N-2 except if the problem is of a thermal nature such that short-term ratings could be utilized to provide the operators time to shed either interruptible or firm load. T-2s (two transformer bank outages) would be excluded from the criteria.

Post Transient Load Flow Assessment:

<u>Contingencies</u> Selected ¹	<u>Reactive Margin Criteria</u> ² Applicable Rating
--	--

- ¹ If power flow results indicate significant low voltages for a given power flow contingency, simulate that outage using the post transient load flow program. The post-transient assessment will develop appropriate Q/V and/or P/V curves.
- ² Applicable Rating – positive margin based on the higher of imports or load increase by 5% for N-1 contingencies, and 2.5% for N-2 contingencies.

Stability Assessment:

<u>Contingencies</u> Selected ¹	<u>Stability Criteria</u> ² Applicable Rating
--	--

- ¹ Base on historical information, engineering judgment and/or if power flow or post transient study results indicate significant low voltages or marginal reactive margin for a given contingency.
- ² Applicable Rating – CAISO Grid Planning Criteria or facility owner criteria as appropriate.

B. Load Forecast

1. System Forecast

The California Energy Commission (CEC) derives the load forecast at the system and Participating Transmission Owner (PTO) levels. This relevant CEC forecast is then distributed across the entire system, down to the local area, division and substation level. The PTOs use an econometric equation to forecast the system load. The predominant parameters affecting the system load are (1) number of households, (2)

economic activity (gross metropolitan products, GMP), (3) temperature and (4) increased energy efficiency and distributed generation programs.

Base Case Load Development Method

The method used to develop the load in the base case is a melding process that extracts, adjusts and modifies the information from the system, distribution and municipal utility forecasts. The melding process consists of two parts: Part 1 deals with the PTO load and Part 2 deals with the municipal utility load. There may be small differences between the methodologies used by each PTO to disaggregate the CEC load forecast to their level of local area as well as bar-bus model.

a. PTO Loads in Base Case

The methods used to determine the PTO loads are, for the most part, similar. One part of the method deals with the determination of the division⁴ loads that would meet the requirements of 1-in-5 or 1-in-10 system or area base cases and the other part deals with the allocation of the division load to the transmission buses.

i. Determination of division loads

The annual division load is determined by summing the previous year division load and the current division load growth. Thus, the key steps are the determination of the initial year division load and the annual load growth. The initial year for the base case development method is based heavily on recorded data. The division load growth in the system base case is determined in two steps. First, the total PTO load growth for the year is determined, as the product of the PTO load and the load growth rate from the system load forecast. Then this total PTO load growth is allocated to the division, based on the relative magnitude of the load growth projected for the divisions by the distribution planners. For example, for the 1-in-10 area base case, the division load growth determined for the system base case is adjusted to the 1-in-10 temperature

⁴ Each PTO divides its territory in a number of smaller area named divisions. These are usually smaller and compact areas that have the same temperature profile.

using the load temperature relation determined from the latest peak load and temperature data of the division.

ii. Allocation of division load to transmission bus level

Since the loads in the base case are modeled at the various transmission buses, the division loads developed must be allocated to those buses. The allocation process is different depending on the load types. For the most part, each PTO classifies its loads into four types: conforming, non-conforming, self-generation and generation-plant loads. Since the non-conforming and self-generation loads are assumed to not vary with temperature, their magnitude would be the same in the system or area base cases of the same year. The remaining load (the total division load developed above, less the quantity of non-conforming and self-generation load) is the conforming load. The remaining load is allocated to the transmission buses based on the relative magnitude of the distribution forecast. The summation of all base case loads is generally higher than the load forecast because some load, i.e., self-generation and generation-plant, are behind the meter and must be modeled in the base cases. However, for the most part, metered or aggregated data with telemetry is used to come up with the load forecast.

b. Municipal Loads in Base Case

The municipal utility forecasts that have been provided to the CEC and PTOs for the purposes of their base cases were also used for this study.

C. Power Flow Program Used in the LCR analysis

The technical studies were conducted using General Electric's Power System Load Flow (GE PSLF) program version 19.0. This GE PSLF program is available directly from GE or through the Western System Electricity Council (WECC) to any member.

To evaluate Local Capacity Areas, the starting base case was adjusted to reflect the latest generation and transmission projects as well as the one-in-ten-year peak load forecast for each Local Capacity Area as provided to the CAISO by the PTOs.

Electronic contingency files provided by the PTOs were utilized to perform the numerous contingencies required to identify the LCR. These contingency files include remedial action and special protection schemes that are expected to be in operation during the year of study. An CAISO created EPCL (a GE programming language contained within the GE PSLF package) routine was used to run the combination of contingencies; however, other routines are available from WECC with the GE PSFL package or can be developed by third parties to identify the most limiting combination of contingencies requiring the highest amount of generation within the local area to maintain power flows within applicable ratings.

IV. Locational Capacity Requirement Study Results

A. Summary of Study Results

LCR is defined as the amount of resource capacity that is needed within a Local Capacity Area to reliably serve the load located within this area. The results of the CAISO’s analysis are summarized in the Executive Summary Tables.

Table 5: 2021 Local Capacity Needs vs. Peak Load and Local Area Resources

	2021 Total LCR (MW)	Peak Load (1 in 10) (MW)	2021 LCR as % of Peak Load	Total Dependable Local Area Resources (MW)	2021 LCR as % of Total Area Resources
Humboldt	169	195	87%	218	78%
North Coast/North Bay	480	1318	36%	850	56%
Sierra	1686	1822	93%	2066	82%**
Stockton	404	1186	34%	729	55%**
Greater Bay	5194	9644	54%	6903	75%
Greater Fresno	1160	3240	36%	3526	33%
Kern	105	216	49%	121	87%
LA Basin	6898	19506	35%	7795	88%
Big Creek/Ventura	2398	3849	62%	3677	65%
San Diego/Imperial Valley	4357	4980	87%	4840	90%
Total	23044	45956*	50%*	30725	75%

Table 6: 2026 Local Capacity Needs vs. Peak Load and Local Area Resources

	2026 Total LCR (MW)	Peak Load (1 in10) (MW)	2026 LCR as % of Peak Load	Total Dependable Local Area Resources (MW)	2026 LCR as % of Total Area Resources
Humboldt	171	193	89%	218	78%
North Coast/North Bay	547	1491	37%	850	64%
Sierra	1004	2108	48%	2066	49%
Stockton	516	1269	41%	704	73%
Greater Bay	5732	10190	56%	6903	83%**
Greater Fresno	1474	3653	40%	3526	42%
Kern	392	1084	36%	581	67%
LA Basin	7234	19243	38%	7795	93%
Big Creek/Ventura	2528	3973	64%	3677	69%
San Diego/Imperial Valley	4649	5307	88%	4840	96%
Total	24247	48511*	50%*	31160	78%

* Value shown only illustrative, since each local area peaks at a different time.

** Resource deficient LCA (or with sub-area that are deficient) – deficiency included in LCR. Resource deficient area implies that in order to comply with the criteria, at summer peak, load must be shed immediately after the first contingency.

Tables 5 and 6 shows how much of the Local Capacity Area load is dependent on local resources and how many local resources must be available in order to serve the load in those Local Capacity Areas in a manner consistent with the Reliability Criteria. These tables also indicate where new transmission projects, new resource additions or demand side management programs would be most useful in order to reduce the dependency on existing, generally older and less efficient local area resources.

The term “Qualifying Capacity” used in this report is the “Net Qualifying Capacity” (“NQC”) posted on the CAISO web site at:

<http://www.caiso.com/planning/Pages/ReliabilityRequirements/Default.aspx>

The NQC list includes the area (if applicable) where each resource is located for units already operational. Neither the NQC list nor this report incorporates Demand Side Management programs and their related NQC. Units scheduled to become

operational before June 1 of 2026 have been included in this 2026 Long-Term LCR Report and added to the total NQC values for those respective areas (see detail write-up for each area).

Regarding the main tables up front (page 2), the first column, “Qualifying Capacity,” reflects two sets of resources. The first set is comprised of resources that would normally be expected to be on-line such as Municipal and Regulatory Must-take resources (state, federal, QFs, wind and nuclear units). The second set is “market” resources. The second column, “YEAR LCR Requirement Based on Category B” identifies the local capacity requirements, and deficiencies that must be addressed, in order to achieve a service reliability level based on Performance Criteria- Category B. The third column, “YEAR LCR Requirement Based on Category C with Operating Procedure”, sets forth the local capacity requirements, and deficiencies that must be addressed, necessary to attain a service reliability level based on Performance Criteria- Category C with operational solutions.

B. Summary of Results by Local Area

Each Local Capacity Area’s overall requirement is determined by also achieving each sub-area requirement. Because these areas are a part of the interconnected electric system, the total for each Local Capacity Area is not simply a summation of the sub-area needs. For example, some sub-areas may overlap and therefore the same units may count for meeting the needs in both sub-areas.

1. Humboldt Area

Area Definition

The transmission tie lines into the area include:

- 1) Bridgeville-Cottonwood 115 kV line #1
- 2) Humboldt-Trinity 115 kV line #1

- 3) Willits-Garberville 60 kV line #1
- 4) Trinity-Maple Creek 60 kV line #1

The substations that delineate the Humboldt Area are:

- 1) Bridgeville and Low Gap are in, Cottonwood is out
- 2) Humboldt is in Trinity is out
- 3) Willits is out, Kekawaka and Garberville are in
- 4) Trinity is out, Ridge Cabin and Maple Creek are in

Total 2026 busload within the defined area: 214 MW with -27 MW of AAEE and 6 MW of losses resulting in total load + losses of 193 MW.

Total units and qualifying capacity available in this area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
FAIRHV_6_UNIT	31150	FAIRHAVN	13.8	14.52	1	None	Aug NQC	Net Seller
FTSWRD_6_TRFORK				0.16		None	Not modeled Aug NQC	Market
FTSWRD_7_QFUNTS				0.00		None	Not modeled Aug NQC	QF/Selfgen
GRSCRK_6_BGCKWW				0.00		None	Energy Only	QF/Selfgen
HUMBPP_1_UNITS3	31180	HUMB_G1	13.8	16.25	1	None		Market
HUMBPP_1_UNITS3	31180	HUMB_G1	13.8	16.25	2	None		Market
HUMBPP_1_UNITS3	31180	HUMB_G1	13.8	16.25	3	None		Market
HUMBPP_1_UNITS3	31180	HUMB_G1	13.8	16.25	4	None		Market
HUMBPP_6_UNITS	31181	HUMB_G2	13.8	16.27	5	None		Market
HUMBPP_6_UNITS	31181	HUMB_G2	13.8	16.27	6	None		Market
HUMBPP_6_UNITS	31181	HUMB_G2	13.8	16.27	7	None		Market
HUMBPP_6_UNITS	31182	HUMB_G3	13.8	16.27	8	None		Market
HUMBPP_6_UNITS	31182	HUMB_G3	13.8	16.27	9	None		Market
HUMBPP_6_UNITS	31182	HUMB_G3	13.8	16.27	10	None		Market
HUMBSB_1_QF				0.00		None	Not modeled Aug NQC	QF/Selfgen
KEKAWK_6_UNIT	31166	KEKAWAK	9.1	0.00	1	None	Aug NQC	Net Seller
LAPAC_6_UNIT	31158	LP SAMOA	12.5	20.00	1	None		Market
LOWGAP_1_SUPHR				0.52		None	Not modeled Aug NQC	Market
PACLUM_6_UNIT	31152	PAC.LUMB	13.8	7.62	1	None	Aug NQC	QF/Selfgen
PACLUM_6_UNIT	31152	PAC.LUMB	13.8	7.62	2	None	Aug NQC	QF/Selfgen
PACLUM_6_UNIT	31153	PAC.LUMB	2.4	4.59	3	None	Aug NQC	QF/Selfgen
WLLWCR_6_CEDRFL				0.00		None	Not modeled Aug NQC	QF/Selfgen
BLULKE_6_BLUELK	31156	BLUELKPP	12.5	0.00	1	None	Retired	Market

Major new projects modeled:

1. Maple Creek Reactive Support
2. Garberville Reactive Support
3. Bridgeville 115/60 kV #1 transformer replacement

4. Bridgeville-Garberville 115 kV transmission line

Critical Contingency Analysis Summary

Humboldt Overall:

The most critical contingency for the Humboldt area is the outage of the Cottonwood-Bridgeville 115 kV line overlapping with an outage of the gen-tie from Humboldt Bay Power Plant to units 1-4. The local area limitation is potential overload on the Humboldt -Trinity 115 kV Line. This contingency establishes a local capacity need of 171 MW in 2026 (includes 20 MW of QF/Selfgen generation) as the minimum capacity necessary for reliable load serving capability within this area.

The single most critical contingency for the Humboldt area is the outage of the Cottonwood-Bridgeville 115 kV line with one of the Humboldt Bay Power Plant units already out of service, which could potentially overload the Humboldt -Trinity 115 kV line. This contingency establishes a local capacity need of 123 MW in 2026 (includes 20 MW of QF/Selfgen generation).

Effectiveness factors:

The following table has units at least 5% effective to the above-mentioned constraint:

Gen Bus	Gen Name	Gen ID	Eff Fctr (%)
31156	BLUELKPP	1	65
31180	HUMB_G1	4	64
31180	HUMB_G1	3	64
31180	HUMB_G1	2	64
31180	HUMB_G1	1	64
31150	FAIRHAVN	1	61
31158	LP SAMOA	1	61
31182	HUMB_G3	10	61
31182	HUMB_G3	9	61
31182	HUMB_G3	8	61
31181	HUMB_G2	7	61
31181	HUMB_G2	6	61
31181	HUMB_G2	5	61
31152	PAC.LUMB	1	57
31152	PAC.LUMB	2	57
31153	PAC.LUMB	3	57

Changes compared to last year's results:

The load and losses have decreased by 2 MW from 2021 to 2026 and the total LCR has increased by 2 MW.

Humboldt Overall Requirements:

	QF/Selfgen (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	20	198	218

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ⁵	123	0	123
Category C (Multiple) ⁶	171	0	171

2. North Coast / North Bay Area

Area Definition

The transmission tie facilities coming into the North Coast/North Bay area are:

- 1) Cortina-Mendocino 115 kV Line
- 2) Cortina-Eagle Rock 115 kV Line
- 3) Willits-Garberville 60 kV line #1
- 4) Vaca Dixon-Lakeville 230 kV line #1
- 5) Tulucay-Vaca Dixon 230 kV line #1
- 6) Lakeville-Sobrante 230 kV line #1
- 7) Ignacio-Sobrante 230 kV line #1

The substations that delineate the North Coast/North Bay area are:

- 1) Cortina is out, Mendocino and Indian Valley are in
- 2) Cortina is out, Eagle Rock, Highlands and Homestake are in

⁵ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

⁶ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 3) Willits and Lytonville are in, Kekawaka and Garberville are out
- 4) Vaca Dixon is out, Lakeville is in
- 5) Tulucay is in, Vaca Dixon is out
- 6) Lakeville is in, Sobrante is out
- 7) Ignacio is in, Sobrante and Crocket are out

Total 2026 busload within the defined area: 1546 MW with -88 MW of AAEE and 33 MW of losses resulting in total load + losses of 1491 MW.

Total units and qualifying capacity available in this area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
ADLIN_1_UNITS	31435	GEO.ENGY	9.1	8.00	1	Eagle Rock, Fulton, Lakeville		Market
ADLIN_1_UNITS	31435	GEO.ENGY	9.1	8.00	2	Eagle Rock, Fulton, Lakeville		Market
CLOVDL_1_SOLAR				1.03		Eagle Rock, Fulton, Lakeville	Not modeled Aug NQC	Market
CSTOGA_6_LNDFIL				0.00		Fulton, Lakeville	Not modeled Energy Only	Market
FULTON_1_QF				0.03		Fulton, Lakeville	Not modeled Aug NQC	QF/Selfgen
GEYS11_7_UNIT11	31412	GEYSER11	13.8	68.00	1	Eagle Rock, Fulton, Lakeville		Market
GEYS12_7_UNIT12	31414	GEYSER12	13.8	50.00	1	Fulton, Lakeville		Market
GEYS13_7_UNIT13	31416	GEYSER13	13.8	56.00	1	Lakeville		Market
GEYS14_7_UNIT14	31418	GEYSER14	13.8	50.00	1	Fulton, Lakeville		Market
GEYS16_7_UNIT16	31420	GEYSER16	13.8	49.00	1	Fulton, Lakeville		Market
GEYS17_7_UNIT17	31422	GEYSER17	13.8	53.00	1	Fulton, Lakeville		Market
GEYS18_7_UNIT18	31424	GEYSER18	13.8	45.00	1	Lakeville		Market
GEYS20_7_UNIT20	31426	GEYSER20	13.8	40.00	1	Lakeville		Market
GYS5X6_7_UNITS	31406	GEYSR5-6	13.8	42.50	1	Eagle Rock, Fulton, Lakeville		Market
GYS5X6_7_UNITS	31406	GEYSR5-6	13.8	42.50	2	Eagle Rock, Fulton, Lakeville		Market
GYS7X8_7_UNITS	31408	GEYSER78	13.8	38.00	1	Eagle Rock, Fulton, Lakeville		Market
GYS7X8_7_UNITS	31408	GEYSER78	13.8	38.00	2	Eagle Rock, Fulton, Lakeville		Market
GYSRVL_7_WSPRNG				1.48		Fulton, Lakeville	Not modeled Aug NQC	QF/Selfgen
HILAND_7_YOLOWD				0.00		Eagle Rock, Fulton, Lakeville	Energy Only	Market
HIWAY_7_ACANYN				0.18		Lakeville	Not modeled Aug NQC	QF/Selfgen
IGNACO_1_QF				0.00		Lakeville	Not modeled Aug NQC	QF/Selfgen
INDVLY_1_UNITS	31436	INDIAN V	9.1	1.11	1	Eagle Rock, Fulton, Lakeville	Aug NQC	Net Seller
MONTPH_7_UNITS	32700	MONTICLO	9.1	3.96	1	Fulton, Lakeville	Aug NQC	QF/Selfgen
MONTPH_7_UNITS	32700	MONTICLO	9.1	3.95	2	Fulton, Lakeville	Aug NQC	QF/Selfgen
MONTPH_7_UNITS	32700	MONTICLO	9.1	0.94	3	Fulton, Lakeville	Aug NQC	QF/Selfgen
NCPA_7_GP1UN1	38106	NCPA1GY1	13.8	31.00	1	Lakeville	Aug NQC	MUNI

NCPA_7_GP1UN2	38108	NCPA1GY2	13.8	28.00	1	Lakeville	Aug NQC	MUNI
NCPA_7_GP2UN3	38110	NCPA2GY1	13.8	0.77	1	Fulton, Lakeville	Aug NQC	MUNI
NCPA_7_GP2UN4	38112	NCPA2GY2	13.8	52.73	1	Fulton, Lakeville	Aug NQC	MUNI
POTTER_6_UNITS	31433	POTTRVLY	2.4	4.70	1	Eagle Rock, Fulton, Lakeville	Aug NQC	Market
POTTER_6_UNITS	31433	POTTRVLY	2.4	2.25	3	Eagle Rock, Fulton, Lakeville	Aug NQC	Market
POTTER_6_UNITS	31433	POTTRVLY	2.4	2.25	4	Eagle Rock, Fulton, Lakeville	Aug NQC	Market
POTTER_7_VECINO				0.01		Eagle Rock, Fulton, Lakeville	Not modeled Aug NQC	QF/Selfgen
SANTFG_7_UNITS	31400	SANTA FE	13.8	30.00	1	Lakeville		Market
SANTFG_7_UNITS	31400	SANTA FE	13.8	30.00	2	Lakeville		Market
SMUDGO_7_UNIT 1	31430	SMUDGE01	13.8	37.00	1	Lakeville		Market
SNMALF_6_UNITS	31446	SONMA LF	9.1	3.56	1	Fulton, Lakeville	Aug NQC	QF/Selfgen
UKIAH_7_LAKEMN	38020	CITY UKH	115	0.49	1	Eagle Rock, Fulton, Lakeville	Aug NQC	MUNI
UKIAH_7_LAKEMN	38020	CITY UKH	115	1.21	2	Eagle Rock, Fulton, Lakeville	Aug NQC	MUNI
WDFRDF_2_UNITS	31404	WEST FOR	13.8	12.51	1	Fulton, Lakeville		Market
WDFRDF_2_UNITS	31404	WEST FOR	13.8	12.49	2	Fulton, Lakeville		Market
BEARCN_2_UNITS	31402	BEAR CAN	13.8	0.00	1	Fulton, Lakeville	Retired	Market
BEARCN_2_UNITS	31402	BEAR CAN	13.8	0.00	2	Fulton, Lakeville	Retired	Market
GEYS17_2_BOTRCK	31421	BOTTLERK	13.8	0.00	1	Fulton, Lakeville	Retired	Market

Major new projects modeled:

1. Fulton 230/115 kV transformer
2. Vaca Dixon-Lakeville 230 kV reconductoring
3. Napa – Tulucay No. 1 60 kV Line Upgrades
4. Clear Lake 60 kV system reinforcement (Middle Town 115 kV project)
5. Ignacio – Alto 60 kV Line Voltage Conversion
6. Ignacio 230 kV Substation Shunt Reactor

Critical Contingency Analysis Summary

Eagle Rock Sub-area

The most critical overlapping contingency is an outage of the Geysers #3 - Geyser #5 115 kV line and the Cortina-Mendocino 115 kV line. The sub-area area limitation is thermal overloading of the Eagle Rock-Cortina 115 kV line. This limiting contingency establishes a local capacity need of 217 MW in 2026 (includes 0 MW of QF/MUNI generation) as the minimum capacity necessary for reliable load serving capability within this sub-area.

The most critical single contingency is an outage of the Cortina-Mendocino 115 kV transmission line with Geysers 11 unit out of service. The sub-area limitation is thermal overloading of the parallel Eagle Rock-Cortina 115 kV line. This limiting contingency establishes a local capacity need of 201 MW in 2026 (includes 0 MW of QF/Muni generation).

Effectiveness factors:

The following units have at least 5% effectiveness to the above-mentioned constraint:

Gen Bus	Gen Name	Gen ID	Eff Fctr (%)
31406	GEYSR5-6	1	36
31406	GEYSR5-6	2	36
31408	GEYSER78	1	36
31408	GEYSER78	2	36
31412	GEYSER11	1	37
31435	GEO.ENGY	1	35
31435	GEO.ENGY	2	35
31433	POTTRVLY	1	34
31433	POTTRVLY	3	34
31433	POTTRVLY	4	34
38020	CITY UKH	1	32
38020	CITY UKH	2	32

Fulton Sub-area

The most critical overlapping contingency is the outage of the Fulton-Ignacio 230 kV line #1 and the Fulton-Lakeville 230 kV line #1. The sub-area area limitation is thermal overloading of Lakeville # 2 60 kV line (Lakeville-Petaluma A – Cotati). This limiting contingency establishes a local capacity need of 363 MW in 2026 (includes 14 MW of QF and 55 MW of Muni generation) as the minimum capacity necessary for reliable load serving capability within this sub-area. All of the units required to meet the Eagle Rock pocket count towards the Fulton total requirement.

Effectiveness factors:

The following table has units within the Fulton pocket as well as units outside the pocket that are at least 5% effective to the above-mentioned constraint.

Gen Bus	Gen Name	Gen ID	Eff Fctr (%)
31466	SONMA LF	1	52
31422	GEYSER17	1	12
31404	WEST FOR	1	12
31404	WEST FOR	2	12
31414	GEYSER12	1	12
31418	GEYSER14	1	12
31420	GEYSER16	1	12
31402	BEAR CAN	1	12
31402	BEAR CAN	2	12
38110	NCPA2GY1	1	12
38112	NCPA2GY2	1	12
32700	MONTICLO	1	10
32700	MONTICLO	2	10
32700	MONTICLO	3	10
31435	GEO.ENGY	1	6
31435	GEO.ENGY	2	6
31408	GEYSER78	1	6
31408	GEYSER78	2	6
31412	GEYSER11	1	6
31406	GEYSR5-6	1	6
31406	GEYSR5-6	2	6

Lakeville Sub-area (North Coast/North Bay Overall)

The most limiting contingency for the North Coast/North Bay Area is a common mode outage of the Vaca Dixon-Lakeville and Vaca Dixon-Tulucay 230 kV lines. The area limitation is thermal overloading of the Eagle Rock-Cortina 115 kV line, the Bridgeville-Garberville 60 kV line and the Sobrante-Moraga 115 kV line. This limiting contingency establishes a local capacity need of 547 MW in 2026 (includes 14 MW of QF and 114 MW of Muni generation) as the minimum capacity necessary for reliable load serving capability within this area.

Local capacity requirement in the North Coast/North Bay area substantially depend on the generation in the Bay Area, especially Pittsburg sub-area.

The study assumed that the Vaca Dixon- Lakeville 230 kV line is reconducted. If it is not reconducted, than the limiting contingency will be single outage of the Vaca Dixon-Tulucay 230 kV line. This contingency may overload the Vaca Dixon- Lakeville

230 kV line. In this case, local capacity requirement will be 575 MW. If this line is not re-conducted, but re-rated, local capacity requirement will be 547 MW as described above.

Effectiveness factors:

The following units have at least 5% effectiveness to the Eagle Rock-Cortina constraint:

Gen Bus	Gen Name	Gen ID	Eff Fctr (%)
31406	GEYSR5-6	1	33
31406	GEYSR5-6	2	33
31408	GEYSER78	1	34
31408	GEYSER78	2	34
31412	GEYSER11	1	34
31435	GEO.ENGY	1	33
31435	GEO.ENGY	2	33
31433	POTTRVLY	1	23
31433	POTTRVLY	3	23
31433	POTTRVLY	4	23
32700	MONTICLO	1	15
32700	MONTICLO	2	15
32700	MONTICLO	3	15
31446	SONMA LF	1	11
31402	BEAR CAN	1	10
31402	BEAR CAN	1	10
31404	WEST FOR	1	10
31404	WEST FOR	2	10
31414	GEYSER12	1	10
31418	GEYSER14	1	10
31421	BOTTLERK	1	10
31420	GEYSER16	1	10
31422	GEYSER17	1	10
38110	NCPA2GY1	1	10
38112	NCPA2GY2	1	10
31400	SANTA FE	2	8
31400	SANTA FE	1	8
31430	SMUDGE01	1	8
31416	GEYSER13	1	8
31424	GEYSER18	1	8
31426	GEYSER20	1	8
38106	NCPA1GY1	1	8
38108	NCPA1GY2	1	8

Changes compared to last year's results:

Overall the load and losses forecast went up by 173 MW compared to 2021 and the overall LCR requirement went up by 67 MW.

North Coast/North Bay Overall Requirements:

2026	QF/Selfgen (MW)	Muni (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	14	114	722	850

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ⁷	201	0	201
Category C (Multiple) ⁸	547	0	547

3. Sierra Area

Area Definition

The transmission tie lines into the Sierra Area are:

- 1) Table Mountain-Rio Oso 230 kV line
- 2) Table Mountain-Palermo 230 kV line
- 3) Table Mt-Pease 60 kV line
- 4) Caribou-Palermo 115 kV line
- 5) Drum-Summit 115 kV line #1
- 6) Drum-Summit 115 kV line #2
- 7) Spaulding-Summit 60 kV line
- 8) Brighton-Bellota 230 kV line
- 9) Rio Oso-Lockeford 230 kV line
- 10) Gold Hill-Eight Mile Road 230 kV line
- 11) Lodi-Eight Mile Road 230 kV line
- 12) Gold Hill-Lake 230 kV line
- 13) Vaca Dixon-Davis #1 115kV line

⁷ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

⁸ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

14) Vaca Dixon–Davis #2 115kV line

The substations that delineate the Sierra Area are:

- 1) Table Mountain is out Rio Oso is in
- 2) Table Mountain is out Palermo is in
- 3) Table Mt is out Pease is in
- 4) Caribou is out Palermo is in
- 5) Drum is in Summit is out
- 6) Drum is in Summit is out
- 7) Spaulding is in Summit is out
- 8) Brighton is in Bellota is out
- 9) Rio Oso is in Lockeford is out
- 10) Gold Hill is in Eight Mile is out
- 11) Lodi is in Eight Mile is out
- 12) Gold Hill is in Lake is out
- 13) Vaca Dixon is out Vaca Dixon Junction 1 is in
- 14) Vaca Dixon is out Vaca Dixon Junction 2 is in

Total 2026 busload within the defined area: 2133 MW with -102 MW of AEE and 77 MW of losses resulting in total load + losses of 2108 MW.

Total units and qualifying capacity available in this area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
ALLGNY_6_HYDRO1				0.26		South of Table Mountain	Not modeled Aug NQC	Market
APLHIL_1_SLABCK				0.00	1	Placerville, South of Rio Oso, South of Palermo, South of Table Mountain	Not modeled Energy Only	Market
BANGOR_6_HYDRO				0.54		South of Table Mountain	Not modeled Aug NQC	Market
BELDEN_7_UNIT 1	31784	BELDEN	13.8	115.00	1	South of Palermo, South of Table Mountain	Aug NQC	Market
BIOMAS_1_UNIT 1	32156	WOODLAND	9.11	23.92	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Net Seller
BNNIEN_7_ALTAPH	32376	BONNIE N	60	0.72		Weimer, Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Not modeled Aug NQC	Market
BOGUE_1_UNITA1	32451	FREC	13.8	45.00	1	Bogue, Drum-Rio Oso, South of Table Mountain	Aug NQC	Market
BOWMN_6_HYDRO	32480	BOWMAN	9.11	2.19	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
BUCKCK_7_OAKFLT				0.84		South of Palermo, South of Table Mountain	Not modeled Aug NQC	Market
BUCKCK_7_PL1X2	31820	BCKS CRK	11	29.00	1	South of Palermo, South of Table Mountain	Aug NQC	Market
BUCKCK_7_PL1X2	31820	BCKS CRK	11	29.00	2	South of Palermo, South of Table Mountain	Aug NQC	Market

CAMPFW_7_FARWST	32470	CMP.FARW	9.11	2.90	1	South of Table Mountain	Aug NQC	MUNI
CHICPK_7_UNIT 1	32462	CHI.PARK	11.5	38.00	1	Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
COLGAT_7_UNIT 1	32450	COLGATE1	13.8	161.65	1	South of Table Mountain	Aug NQC	MUNI
COLGAT_7_UNIT 2	32452	COLGATE2	13.8	161.68	1	South of Table Mountain	Aug NQC	MUNI
CRESTA_7_PL1X2	31812	CRESTA	11.5	35.00	1	South of Palermo, South of Table Mountain	Aug NQC	Market
CRESTA_7_PL1X2	31812	CRESTA	11.5	35.00	2	South of Palermo, South of Table Mountain	Aug NQC	Market
DAVIS_1_SOLAR1				0.82		Drum-Rio Oso, South of Palermo, South of Table Mountain	Not modeled Aug NQC	Market
DAVIS_1_SOLAR2				0.88		Drum-Rio Oso, South of Palermo, South of Table Mountain	Not modeled Aug NQC	Market
DAVIS_7_MNMETH				2.06		Drum-Rio Oso, South of Palermo, South of Table Mountain	Not modeled Aug NQC	Market
DEADCK_1_UNIT	31862	DEADWOOD	9.11	0.00	1	Drum-Rio Oso, South of Table Mountain	Aug NQC	MUNI
DEERCR_6_UNIT 1	32474	DEER CRK	9.11	3.74	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
DRUM_7_PL1X2	32504	DRUM 1-2	6.6	13.00	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
DRUM_7_PL1X2	32504	DRUM 1-2	6.6	13.00	2	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
DRUM_7_PL3X4	32506	DRUM 3-4	6.6	13.70	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
DRUM_7_PL3X4	32506	DRUM 3-4	6.6	13.70	2	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
DRUM_7_UNIT 5	32454	DRUM 5	13.8	49.50	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
DUTCH1_7_UNIT 1	32464	DTCHFLT1	11	22.00	1	Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
DUTCH2_7_UNIT 1	32502	DTCHFLT2	6.9	26.00	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
ELDORO_7_UNIT 1	32513	ELDRADO1	21.6	11.00	1	Placerville, South of Rio Oso, South of Palermo, South of Table Mountain		Market
ELDORO_7_UNIT 2	32514	ELDRADO2	21.6	11.00	1	Placerville, South of Rio Oso, South of Palermo, South of Table Mountain		Market
FMEADO_6_HELLHL	32486	HELLHOLE	9.11	0.26	1	South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
FMEADO_7_UNIT	32508	FRNCH MD	4.2	16.01	1	South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
FORBST_7_UNIT 1	31814	FORBSTWN	11.5	37.50	1	Drum-Rio Oso, South of Table Mountain	Aug NQC	MUNI

GOLDHL_1_QF				0.00		Placerville, South of Rio Oso, South of Palermo, South of Table Mountain	Not modeled	QF/Selfgen
GRIDLY_6_SOLAR	38054	GRIDLEY	60	0.00	1	Pease, South of Palermo, South of Table Mountain	Energy Only	Market
GRNLF1_1_UNITS	32490	GRNLEAF1	13.8	7.69	1	Bogue, Drum-Rio Oso, South of Table Mountain	Aug NQC	Market
GRNLF1_1_UNITS	32491	GRNLEAF1	13.8	39.27	2	Bogue, Drum-Rio Oso, South of Table Mountain	Aug NQC	Market
GRNLF2_1_UNIT	32492	GRNLEAF2	13.8	35.01	1	Pease, South of Palermo, Drum-Rio Oso, South of Table Mountain	Aug NQC	QF/Selfgen
HALSEY_6_UNIT	32478	HALSEY F	9.11	6.44	1	Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
HAYPRS_6_QFUNTS	32488	HAYPRES+	9.11	0.00	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	QF/Selfgen
HAYPRS_6_QFUNTS	32488	HAYPRES+	9.11	0.00	2	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	QF/Selfgen
HIGGNS_1_COMBIE				0.00		Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Not modeled Energy Only	Market
HIGGNS_7_QFUNTS				0.24		Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Not modeled Aug NQC	QF/Selfgen
KANAKA_1_UNIT				0.00		Drum-Rio Oso, South of Table Mountain	Not modeled Aug NQC	MUNI
KELYRG_6_UNIT	31834	KELLYRDG	9.11	10.00	1	Drum-Rio Oso, South of Table Mountain	Aug NQC	MUNI
LIVEOK_6_SOLAR				0.87		Pease, South of Palermo, South of Table Mountain	Not modeled Aug NQC	Market
LODIEC_2_PL1X2	38123	LODI CT1	18	166.00	1	South of Rio Oso, South of Palermo, South of Table Mountain		MUNI
LODIEC_2_PL1X2	38124	LODI ST1	18	114.00	1	South of Rio Oso, South of Palermo, South of Table Mountain		MUNI
MDFKRL_2_PROJCT	32456	MIDLFORK	13.8	62.18	1	South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
MDFKRL_2_PROJCT	32456	MIDLFORK	13.8	62.18	2	South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
MDFKRL_2_PROJCT	32458	RALSTON	13.8	84.32	1	South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
NAROW1_2_UNIT	32466	NARROWS1	9.1	9.59	1	South of Table Mountain	Aug NQC	Market
NAROW2_2_UNIT	32468	NARROWS2	9.1	28.51	1	South of Table Mountain	Aug NQC	MUNI
NWCSTL_7_UNIT 1	32460	NEWCASTLE	13.2	0.00	1	Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
OROVIL_6_UNIT	31888	OROVILLE	9.11	7.50	1	Drum-Rio Oso, South of Table Mountain	Aug NQC	Market
OXBOW_6_DRUM	32484	OXBOW F	9.11	6.00	1	Weimer, Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI

PACORO_6_UNIT	31890	PO POWER	9.11	2.58	1	Drum-Rio Oso, South of Table Mountain	Aug NQC	QF/Selfgen
PACORO_6_UNIT	31890	PO POWER	9.11	2.59	2	Drum-Rio Oso, South of Table Mountain	Aug NQC	QF/Selfgen
PLACVL_1_CHILIB	32510	CHILIBAR	4.2	3.88	1	Placerville, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
PLACVL_1_RCKCRE				0.00		Placerville, South of Rio Oso, South of Palermo, South of Table Mountain	Not modeled Aug NQC	Market
PLSNTG_7_LNCLND	32408	PLSNT GR	60	2.79		Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Not modeled Aug NQC	Market
POEPH_7_UNIT 1	31790	POE 1	13.8	60.00	1	South of Palermo, South of Table Mountain	Aug NQC	Market
POEPH_7_UNIT 2	31792	POE 2	13.8	60.00	1	South of Palermo, South of Table Mountain	Aug NQC	Market
RCKCRK_7_UNIT 1	31786	ROCK CK1	13.8	57.00	1	South of Palermo, South of Table Mountain	Aug NQC	Market
RCKCRK_7_UNIT 2	31788	ROCK CK2	13.8	56.90	1	South of Palermo, South of Table Mountain	Aug NQC	Market
RIOOSO_1_QF				1.14		Drum-Rio Oso, South of Palermo, South of Table Mountain	Not modeled Aug NQC	QF/Selfgen
ROLLIN_6_UNIT	32476	ROLLINSF	9.11	11.09	1	Weimer, Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	MUNI
SLYCRK_1_UNIT 1	31832	SLY.CR.	9.11	10.36	1	Drum-Rio Oso, South of Table Mountain	Aug NQC	MUNI
SPAULD_6_UNIT 3	32472	SPAULDG	9.11	5.74	3	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
SPAULD_6_UNIT12	32472	SPAULDG	9.11	4.96	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
SPAULD_6_UNIT12	32472	SPAULDG	9.11	4.96	2	Drum-Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
SPI LI_2_UNIT 1	32498	SPILINCF	12.5	9.73	1	Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Net Seller
STIGCT_2_LODI	38114	Stig CC	13.8	49.50	1	South of Rio Oso, South of Palermo, South of Table Mountain		MUNI
ULTRCK_2_UNIT	32500	ULTR RCK	9.11	20.89	1	Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	QF/Selfgen
WDLEAF_7_UNIT 1	31794	WOODLEAF	13.8	60.00	1	Drum-Rio Oso, South of Table Mountain	Aug NQC	MUNI
WHEATL_6_LNDFIL	32350	WHEATLND	60	3.00		South of Table Mountain	Not modeled Aug NQC	Market
WISE_1_UNIT 1	32512	WISE	12	10.68	1	Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
WISE_1_UNIT 2	32512	WISE	12	0.00	1	Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain	Aug NQC	Market
YUBACT_1_SUNSWT	32494	YUBA CTY	9.11	23.98	1	Pease, South of Palermo, Drum-Rio Oso, South of	Aug NQC	Net Seller

						Table Mountain		
YUBACT_6_UNITA1	32496	YCEC	13.8	46.00	1	Pease, South of Palermo, Drum-Rio Oso, South of Table Mountain		Market
NA	32162	RIV.DLTA	9.11	0.00	1	Drum-Rio Oso, South of Palermo, South of Table Mountain	No NQC - hist. data	QF/Selfgen
UCDAVS_1_UNIT	32166	UC DAVIS	9.11	3.50	RN	Drum-Rio Oso, South of Palermo, South of Table Mountain	No NQC - hist. data	QF/Selfgen

Major new projects modeled:

1. Gold Hill-Missouri Flat #1 and #2 115 kV line reconductoring
2. Rio Oso #1 and #2 230/115 kV transformer replacement
3. New Rio Oso-Atlantic 230 kV line
4. South of Palermo 115 kV reinforcement
5. New Atlantic-Placer 115 kV line
6. Pease 115/60 kV transformer addition
7. Pease-Marysville #2 60 kV line
8. Rio Oso Area 230 kV Voltage Support
9. Vaca Dixon-Davis Voltage Conversion

Critical Contingency Analysis Summary

Placerville Sub-area

No requirements due to the Missouri Flat-Gold Hill 115 kV lines reconductoring project.

Placer Sub-area

No requirements due to New Atlantic-Placer 115 kV line project.

Pease Sub-area

The most critical contingency is the loss of the Palermo-Pease 115 kV line followed by Pease-Rio Oso 115 kV line. The area limitation is thermal overloading of the Table Mountain-Pease 60 kV line. This limiting contingency establishes a LCR of 82 MW (includes 35 MW of QF generation) in 2026 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Bogue Sub-area

No requirements due to the Palermo-Rio Oso 115 kV reconductoring project.

Drum-Rio Oso Sub-area

No requirement due to Rio Oso 230/115 kV Transformer Upgrade and lower load forecast.

South of Rio Oso Sub-area

The most critical contingency is the loss of the Rio Oso-Gold Hill 230 kV line followed by loss of the Rio Oso-Atlantic #1 or #2 230 kV line or vice versa. The area limitation is thermal overloading of the remaining Rio Oso-Atlantic 230 kV line. This limiting contingency establishes a LCR of 282 MW (includes 21 MW of QF and 593 MW of MUNI generation) in 2026 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

The following table has all units in South of Rio Oso sub-area and their effectiveness factor to the above-mentioned constraint.

Gen Bus	Gen Name	Gen ID	Eff Fctr. (%)
32456	MIDLFORK	1	30
32456	MIDLFORK	2	30
32458	RALSTON	1	30
32486	HELLHOLE	1	30
32508	FRNCH MD	1	30
32510	CHILIBAR	1	30
32513	ELDRADO1	1	30
32514	ELDRADO2	1	30
32460	NEWCASTLE	1	29
32478	HALSEY F	1	28
32512	WISE	1	28
32500	ULTR RCK	1	26
38114	STIG CC	1	13

38123	LODI CT1	1	13
38124	LODI ST1	1	13
32462	CHI.PARK	1	13
32498	SPILINCF	1	10
32464	DTCHFLT1	1	9

South of Palermo Sub-area

No requirements due to the South of Palermo reinforcement project.

South of Table Mountain Sub-area

The most critical contingency is the loss of the Table Mountain-Rio Oso and Table Mountain-Palermo 230 kV double circuit tower line outage. The area limitation is thermal overloading of the Table Mountain-Pease 60 kV line. This limitation establishes a local capacity need of 1004 MW in 2026 (includes 66 MW of QF and 1110 MW of MUNI generation) as the minimum capacity necessary for reliable load serving capability within this area.

The most critical single contingency is the loss of the Table Mountain-Rio Oso 230 kV line with Belden unit out of service. The area limitation is thermal overloading of the Table Mountain-Palermo 230 kV line. This limiting contingency establishes a local capacity need of 472 MW (includes 66 MW of QF and 1110 MW of MUNI generation) in 2026.

Effectiveness factors:

The following table has effectiveness factor to the most critical contingency.

Gen Bus #	Gen Name	Gen ID	Eff Fctr (%)
31814	FORBSTWN	1	7
31794	WOODLEAF	1	7
31832	SLY.CR.	1	7
31862	DEADWOOD	1	7
31890	PO POWER	1	6
31890	PO POWER	2	6
31888	OROVILLE	1	6
31834	KELLYRDG	1	6
32450	COLGATE1	1	4
32466	NARROWS1	1	4

32468	NARROWS2	1	4
32452	COLGATE2	1	4
32470	CMP.FARW	1	4
32451	FREC	1	4
32490	GRNLEAF1	1	4
32490	GRNLEAF1	2	4
32496	YCEC	1	4
32494	YUBA CTY	1	4
32492	GRNLEAF2	1	4
32498	SPILINCF	1	2
31788	ROCK CK2	1	2
31812	CRESTA	1	2
31812	CRESTA	2	2
31820	BCKS CRK	1	2
31820	BCKS CRK	2	2
31786	ROCK CK1	1	2
31790	POE 1	1	2
31792	POE 2	1	2
31784	BELDEN	1	2
32500	ULTR RCK	1	2
32156	WOODLAND	1	2
32510	CHILIBAR	1	2
32513	ELDRADO1	1	2
32514	ELDRADO2	1	2
32478	HALSEY F	1	2
32460	NEWCASTLE	1	1
32458	RALSTON	1	1
32512	WISE	1	1
32456	MIDLFORK	1	1
32456	MIDLFORK	2	1
32486	HELLHOLE	1	1
32508	FRNCH MD	1	1
32162	RIV.DLTA	1	1
32502	DTCHFLT2	1	1
32462	CHI.PARK	1	1
32464	DTCHFLT1	1	1
32454	DRUM 5	1	1
32476	ROLLINSF	1	1
32484	OXBOW F	1	1
32474	DEER CRK	1	1
32504	DRUM 1-2	1	1
32504	DRUM 1-2	2	1
32506	DRUM 3-4	1	1

32506	DRUM 3-4	2	1
32166	UC DAVIS	1	1
32472	SPAULDG	1	1
32472	SPAULDG	2	1
32472	SPAULDG	3	1
32480	BOWMAN	1	1
32488	HAYPRES+	1	1
32488	HAYPRES+	2	1
38124	LODI ST1	1	1
38123	LODI CT1	1	1
38114	STIG CC	1	1

Changes compared to last year’s results:

The load forecast went up by 286 MW as compared to 2021. Overall the total LCR for 2026 for the Sierra area has decreased by 682 MW mainly due to implementation of transmission projects.

Sierra Overall Requirements:

2026	QF (MW)	Muni (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	66	1110	890	2066

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ⁹	472	0	472
Category C (Multiple) ¹⁰	1004	0	1004

⁹ LCR requirement for a single contingency means that there wouldn’t be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹⁰ LCR requirement for multiple contingencies means that not only there wouldn’t be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

4. Stockton Area

Area Definition

Tesla-Bellota Sub-Area Definition

The transmission facilities that establish the boundary of the Tesla-Bellota sub-area are:

- 1) Bellota 230/115 kV Transformer #1
- 2) Bellota 230/115 kV Transformer #2
- 3) Tesla-Tracy 115 kV Line
- 4) Tesla-Salado 115 kV Line
- 5) Tesla-Salado-Manteca 115 kV line
- 6) Tesla-Schulte #1 115 kV Line
- 7) Tesla-Schulte #2 115kV line
- 8) Tesla-Vierra 115 kV Line

The substations that delineate the Tesla-Bellota Sub-area are:

- 1) Bellota 230 kV is out Bellota 115 kV is in
- 2) Bellota 230 kV is out Bellota 115 kV is in
- 3) Tesla is out Tracy is in
- 4) Tesla is out Salado is in
- 5) Tesla is out Salado and Manteca are in
- 6) Tesla is out Schulte is in
- 7) Tesla is out Schulte is in
- 8) Tesla is out Thermal Energy is in

Lockeford Sub-Area Definition

The transmission facilities that establish the boundary of the Lockeford sub-area are:

- 1) Lockeford-Industrial 60 kV line
- 2) Lockeford-Lodi #1 60 kV line
- 3) Lockeford-Lodi #2 60 kV line
- 4) Lockeford-Lodi #3 60 kV line

The substations that delineate the Lockeford Sub-area are:

- 1) Lockeford is out Industrial is in
- 2) Lockeford is out Lodi is in
- 3) Lockeford is out Lodi is in
- 4) Lockeford is out Lodi is in

Weber Sub-Area Definition

The transmission facilities that establish the boundary of the Weber Sub-area are:

- 1) Weber 230/60 kV Transformer #1
- 2) Weber 230/60 kV Transformer #2

The substations that delineate the Weber Sub-area are:

- 1) Weber 230 kV is out Weber 60 kV is in
- 2) Weber 230 kV is out Weber 60 kV is in

Total 2026 busload within the defined area: 1346 MW with -95 MW of AAEE and 18 MW of losses resulting in total load + losses of 1269 MW.

Total units and qualifying capacity available in this area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
BEARDS_7_UNIT 1	34074	BEARDSLY	6.9	8.36	1	Tesla-Bellota, Stanislaus	Aug NQC	MUNI
CAMCHE_1_PL1X3	33850	CAMANCHE	4.2	0.41	1	Tesla-Bellota	Aug NQC	MUNI
CAMCHE_1_PL1X3	33850	CAMANCHE	4.2	0.41	2	Tesla-Bellota	Aug NQC	MUNI
CAMCHE_1_PL1X3	33850	CAMANCHE	4.2	0.42	3	Tesla-Bellota	Aug NQC	MUNI
COGNAT_1_UNIT	33818	COG.NTNL	12	38.42	1	Weber	Aug NQC	Net Seller
CURIS_1_QF				0.33		Tesla-Bellota	Not modeled Aug NQC	QF/Selfgen
DONNLS_7_UNIT	34058	DONNELLS	13.8	72.00	1	Tesla-Bellota, Stanislaus	Aug NQC	MUNI
FROGTN_7_UTICA				0.00		Tesla-Bellota, Stanislaus	Energy Only	Market
LOCKFD_1_BEARCK				0.00		Tesla-Bellota	Not modeled Energy Only	Market
LOCKFD_1_KSOLAR				0.00		Tesla-Bellota	Not modeled Energy Only	Market
PEORIA_1_SOLAR				0.97		Tesla-Bellota, Stanislaus	Not modeled Aug NQC	Market
PHOENX_1_UNIT				1.35		Tesla-Bellota, Stanislaus	Not modeled Aug NQC	Market
RIVRBK_1_LNDFIL				0.00		Tesla-Bellota, Stanislaus	Not modeled Energy Only	Market
SCHLTE_1_PL1X3	33805	GWFTRCY1	13.8	83.56	1	Tesla-Bellota		Market
SCHLTE_1_PL1X3	33807	GWFTRCY2	13.8	82.88	1	Tesla-Bellota		Market
SCHLTE_1_PL1X3	33811	GWFTRCY3	13.8	132.96	1	Tesla-Bellota		Market
SNDBAR_7_UNIT 1	34060	SANDBAR	13.8	6.29	1	Tesla-Bellota, Stanislaus	Aug NQC	MUNI
SPIFBD_1_PL1X2	33917	FBERBORD	115	1.57	1	Tesla-Bellota, Stanislaus	Aug NQC	Market
SPRGAP_1_UNIT 1	34078	SPRNG GP	6	0.00	1	Tesla-Bellota, Stanislaus	Aug NQC	Market
STANIS_7_UNIT 1	34062	STANISLS	13.8	91.00	1	Tesla-Bellota, Stanislaus	Aug NQC	Market
STNRES_1_UNIT	34056	STNSLSRP	13.8	12.19	1	Tesla-Bellota	Aug NQC	Net Seller
TULLCK_7_UNITS	34076	TULLOCH	6.9	6.16	1	Tesla-Bellota	Aug NQC	MUNI
TULLCK_7_UNITS	34076	TULLOCH	6.9	6.16	2	Tesla-Bellota	Aug NQC	MUNI
TULLCK_7_UNITS	34076	TULLOCH	6.9	4.54	3	Tesla-Bellota	Aug NQC	MUNI
ULTPCH_1_UNIT 1	34050	CH.STN.	13.8	15.89	1	Tesla-Bellota, Stanislaus	Aug NQC	QF/Selfgen
VLYHOM_7_SSJID				1.09		Tesla-Bellota, Stanislaus	Not modeled Aug NQC	MUNI

WEBER_6_FORWRD				4.20		Weber	Not modeled Aug NQC	Market
NA	33687	STKTN WW	60	1.50	1	Weber	No NQC - hist. data	QF/Selfgen
New Unit	34051	Q539	34.5	20.00	1	Tesla-Bellota	No NQC - Pmax	Market
SANJOA_1_UNIT 1	33808	SJ COGEN	13.8	48	1	Tesla-Bellota		QF/Selfgen
SMPRIP_1_SMPSON	33810	SP CMPNY	13.8	45.6	1	Tesla-Bellota	Aug NQC	Market
THMENG_1_UNIT 1	33806	TH.E.DV.	13.8	17.32	1	Tesla-Bellota	Aug NQC	Net Seller
STOKCG_1_UNIT 1	33814	CPC STCN	12.5	0.00		Tesla-Bellota	Retired	QF/Selfgen

Major new projects modeled:

1. Ripon 115 kV New Line Reconfiguration
2. Stockton 'A' - Weber 60 kV Line Nos. 1 and 2 Reconductor
3. Mosher Transmission Project
4. West Point - Valley Springs 60 kV Line (Reconductor)
5. Vierra 115 kV Looping
6. Lockeford - Lodi Area 230 kV Development

Critical Contingency Analysis Summary

Stanislaus Sub-area

The critical contingency for the Stanislaus sub-area is the loss of Bellota-Riverbank-Melones 115 kV circuit and the River Bank Jct.-Manteca 115 kV line. The area limitation is thermal overloading of the Melones Jct to Avena tap 115 kV line. This limiting contingency establishes a local capacity need of 70 MW (including 16 MW of QF and 88 MW of MUNI generation) in 2026 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Tesla-Bellota Sub-area

The most critical contingency for the Tesla-Bellota pocket is the loss of Tesla-Vierra 115 kV and the Tesla-Schulte #2 115 kV lines. The area limitation is thermal overload of the Tesla-Schulte #1 115 kV line above its emergency rating. This limiting contingency establishes a local capacity need of 484 MW (includes 64 MW of QF and 106 MW of MUNI generation) in 2026 as the minimum capacity necessary for reliable load serving

capability within this sub-area. All of the resources needed to meet the Stanislaus sub-area count towards the Tesla-Bellota sub-area LCR need.

The most critical single contingency for the Tesla-Bellota pocket is the loss of the Tesla-Schulte #2 115 kV line and the loss of the GWF Tracy unit #3. The area limitation is the thermal overload of the Tesla-Schulte #1 115 kV line. This single contingency establishes a local capacity need of 183 MW (includes 64 MW of QF and 106 MW of MUNI generation) in 2026.

Effectiveness factors:

The effectiveness factors for the most critical contingency are listed below:

Gen Bus#	Gen Name	Gen ID	Eff Fctr (%)
33805	GWFTRCY1	1	71
33807	GWFTRCY2	1	71
33811	Q268ST1	1	71
33808	SJ COGEN	1	35
33810	SP CMPNY	1	31
34062	STANISLS	1	28
34050	CH.STN.	1	23
33917	FBERBORD	1	22
34078	SPRNG GP	1	20
34060	SANDBAR	1	20
34074	BEARDSLY	1	20
34058	DONNELLS	1	20
34076	TULLOCH	1	18
34076	TULLOCH	2	18
33806	TH.E.DV.	1	9
34056	STNSLSRP	1	8
33814	CPC STCN	1	3
33850	CAMANCHE	1	3
33850	CAMANCHE	2	3
33850	CAMANCHE	3	3

Lockeford Sub-area

No requirements due to the Lockeford-Lodi area 230 kV development project.

Weber Sub-area

The critical contingency for the Weber area is the loss of Stockton A-Weber #1 & #2 60 kV lines. The area limitation is thermal overloading of the Stockton A-Weber #3 60 kV line. This limiting contingency establishes a local capacity need of 32 MW (including 2 MW of QF generation) in 2026 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Stockton Overall

The requirement for this area is driven by the sum of requirements for the Tesla-Bellota, Lockeford and Weber sub-areas.

Changes compared to last year's results:

The 2026 load forecast went up by 83 MW and the overall LCR has increased by 112 MW as compared to the 2021. Lockeford sub-area has been eliminated due to Lockeford-Lodi area 230 kV development transmission project.

Stockton Overall Requirements:

2026	QF (MW)	Muni (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	66	106	532	704

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ¹¹	183	0	183
Category C (Multiple) ¹²	516	0	516

¹¹ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹² LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating

5. Greater Bay Area

Area Definition

The transmission tie lines into the Greater Bay Area are:

- 1) Lakeville-Sobrante 230 kV
- 2) Ignacio-Sobrante 230 kV
- 3) Parkway-Moraga 230 kV
- 4) Bahia-Moraga 230 kV
- 5) Lambie SW Sta-Vaca Dixon 230 kV
- 6) Peabody-Contra Costa P.P. 230 kV
- 7) Tesla-Kelso 230 kV
- 8) Tesla-Delta Switching Yard 230 kV
- 9) Tesla-Pittsburg #1 230 kV
- 10) Tesla-Pittsburg #2 230 kV
- 11) Tesla-Newark #1 230 kV
- 12) Tesla-Newark #2 230 kV
- 13) Tesla-Ravenswood 230 kV
- 14) Tesla-Metcalf 500 kV
- 15) Moss Landing-Metcalf 500 kV
- 16) Moss Landing-Metcalf #1 230 kV
- 17) Moss Landing-Metcalf #2 230 kV
- 18) Oakdale TID-Newark #1 115 kV
- 19) Oakdale TID-Newark #2 115 kV

The substations that delineate the Greater Bay Area are:

- 1) Lakeville is out Sobrante is in
- 2) Ignacio is out Sobrante is in
- 3) Parkway is out Moraga is in
- 4) Bahia is out Moraga is in
- 5) Lambie SW Sta is in Vaca Dixon is out
- 6) Peabody is out Contra Costa P.P. is in
- 7) Tesla is out Kelso is in
- 8) Tesla is out Delta Switching Yard is in
- 9) Tesla is out Pittsburg is in
- 10) Tesla is out Pittsburg is in
- 11) Tesla is out Newark is in

procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 12) Tesla is out Newark is in
- 13) Tesla is out Ravenswood is in
- 14) Tesla is out Metcalf is in
- 15) Moss Landing is out Metcalf is in
- 16) Moss Landing is out Metcalf is in
- 17) Moss Landing is out Metcalf is in
- 18) Oakdale TID is out Newark is in
- 19) Oakdale TID is out Newark is in

Total 2026 busload within the defined area: 10416 MW with -707 MW of AAEE, 213 MW of losses and 268 MW of pumps resulting in total load + losses + pumps of 10190 MW.

Total units and qualifying capacity available in this area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
ALMEGT_1_UNIT 1	38118	ALMDACT1	13.8	23.80	1	Oakland		MUNI
ALMEGT_1_UNIT 2	38119	ALMDACT2	13.8	24.40	1	Oakland		MUNI
BANKPP_2_NSPIN	38760	DELTA E	13.2	13.47	10	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38760	DELTA E	13.2	13.47	11	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38765	DELTA D	13.2	13.47	8	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38765	DELTA D	13.2	13.47	9	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38770	DELTA C	13.2	13.47	6	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38770	DELTA C	13.2	13.47	7	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38815	DELTA B	13.2	13.47	4	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38815	DELTA B	13.2	13.47	5	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38820	DELTA A	13.2	3.37	1	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38820	DELTA A	13.2	3.37	2	Contra Costa	Pumps	MUNI
BANKPP_2_NSPIN	38820	DELTA A	13.2	12.51	3	Contra Costa	Pumps	MUNI
BLHVN_7_MENLOP				0.56			Not modeled	Net Seller
BRDSLD_2_HIWIND	32172	HIGHWINDS	34.5	36.37	1	Contra Costa	Aug NQC	Wind
BRDSLD_2_MTZUM2	32179	MNTZUMA2	0.69	20.14	1	Contra Costa	Aug NQC	Wind
BRDSLD_2_MTZUMA	32188	HIGHWIND3	0.69	8.03	1	Contra Costa	Aug NQC	Wind
BRDSLD_2_SHILO1	32176	SHILOH	34.5	45.80	1	Contra Costa	Aug NQC	Wind
BRDSLD_2_SHILO2	32177	SHILOH 2	34.5	35.83	1	Contra Costa	Aug NQC	Wind
BRDSLD_2_SHLO3A	32191	SHILOH3	0.58	22.98	1	Contra Costa	Aug NQC	Wind
BRDSLD_2_SHLO3B	32194	SHILOH4	0.58	29.14	1	Contra Costa	Aug NQC	Wind
CALPIN_1_AGNEW	35860	OLS-AGNE	9.11	28.00	1	San Jose, South Bay-Moss Landing	Aug NQC	Market
CAYTNO_2_VASCO	30531	0162-WD	230	4.30	FW	Contra Costa	Aug NQC	Market
CLRMTK_1_QF				0.00		Oakland	Not modeled	QF/Selfgen
COCOPP_2_CTG1	33188	MARSHCT1	16.4	191.35	1	Contra Costa	Aug NQC	Market
COCOPP_2_CTG2	33188	MARSHCT2	16.4	189.30	2	Contra Costa	Aug NQC	Market
COCOPP_2_CTG3	33189	MARSHCT3	16.4	191.45	3	Contra Costa	Aug NQC	Market
COCOPP_2_CTG4	33189	MARSHCT4	16.4	191.44	4	Contra Costa	Aug NQC	Market
COCOSB_6_SOLAR				0.00		Contra Costa	Not modeled Energy Only	Market
CONTAN_1_UNIT	36856	CCA100	13.8	27.70	1	San Jose, South Bay-Moss Landing	Aug NQC	MUNI

CROKET_7_UNIT	32900	CRCKTCOG	18	184.26	1	Pittsburg	Aug NQC	QF/Selfgen
CSCCOG_1_UNIT 1	36859	Laf300	12	3.00	1	San Jose, South Bay-Moss Landing		MUNI
CSCCOG_1_UNIT 1	36859	Laf300	12	3.00	2	San Jose, South Bay-Moss Landing		MUNI
CSCGNR_1_UNIT 1	36858	Gia100	13.8	24.00	1	San Jose, South Bay-Moss Landing		MUNI
CSCGNR_1_UNIT 2	36895	Gia200	13.8	24.00	2	San Jose, South Bay-Moss Landing		MUNI
CUMBIA_1_SOLAR	33102	COLUMBIA	0.38	0.00	1	Pittsburg	Aug NQC	Market
DELTA_2_PL1X4	33107	DEC STG1	24	269.61	1	Pittsburg	Aug NQC	Market
DELTA_2_PL1X4	33108	DEC CTG1	18	181.13	1	Pittsburg	Aug NQC	Market
DELTA_2_PL1X4	33109	DEC CTG2	18	181.13	1	Pittsburg	Aug NQC	Market
DELTA_2_PL1X4	33110	DEC CTG3	18	181.13	1	Pittsburg	Aug NQC	Market
DUANE_1_PL1X3	36863	DVRaGT1	13.8	49.27	1	San Jose, South Bay-Moss Landing		MUNI
DUANE_1_PL1X3	36864	DVRbGT2	13.8	49.27	1	San Jose, South Bay-Moss Landing		MUNI
DUANE_1_PL1X3	36865	DVRaST3	13.8	49.26	1	San Jose, South Bay-Moss Landing		MUNI
FLOWD1_6_ALTPP1	35318	FLOWDPTR	9.11	0.00	1	Contra Costa	Aug NQC	Wind
GATWAY_2_PL1X3	33118	GATEWAY1	18	190.12	1	Contra Costa	Aug NQC	Market
GATWAY_2_PL1X3	33119	GATEWAY2	18	186.19	1	Contra Costa	Aug NQC	Market
GATWAY_2_PL1X3	33120	GATEWAY3	18	186.19	1	Contra Costa	Aug NQC	Market
GILROY_1_UNIT	35850	GLRY COG	13.8	69.30	1	Lagas, South Bay-Moss Landing	Aug NQC	Market
GILROY_1_UNIT	35850	GLRY COG	13.8	35.70	2	Lagas, South Bay-Moss Landing	Aug NQC	Market
GILRPP_1_PL1X2	35851	GROYPKR1	13.8	45.50	1	Lagas, South Bay-Moss Landing	Aug NQC	Market
GILRPP_1_PL1X2	35852	GROYPKR2	13.8	45.50	1	Lagas, South Bay-Moss Landing	Aug NQC	Market
GILRPP_1_PL3X4	35853	GROYPKR3	13.8	46.00	1	Lagas, South Bay-Moss Landing	Aug NQC	Market
GRZZLY_1_BERKLY	32741	HILLSIDE_12	12.5	24.02	1	None	Aug NQC	QF/Selfgen
KELSO_2_UNITS	33813	MARIPCT1	13.8	47.08	1	Contra Costa	Aug NQC	Market
KELSO_2_UNITS	33815	MARIPCT2	13.8	47.07	2	Contra Costa	Aug NQC	Market
KELSO_2_UNITS	33817	MARIPCT3	13.8	47.07	3	Contra Costa	Aug NQC	Market
KELSO_2_UNITS	33819	MARIPCT4	13.8	47.07	4	Contra Costa	Aug NQC	Market
KIRKER_7_KELCYN				3.27		Pittsburg	Not modeled	Market
LAWRNC_7_SUNYVL				0.12		None	Not modeled Aug NQC	Market
LECEF_1_UNITS	35854	LECEFGT1	13.8	46.50	1	San Jose, South Bay-Moss Landing	Aug NQC	Market
LECEF_1_UNITS	35855	LECEFGT2	13.8	46.50	1	San Jose, South Bay-Moss Landing	Aug NQC	Market
LECEF_1_UNITS	35856	LECEFGT3	13.8	46.50	1	San Jose, South Bay-Moss Landing	Aug NQC	Market
LECEF_1_UNITS	35857	LECEFGT4	13.8	46.50	1	San Jose, South Bay-Moss Landing	Aug NQC	Market
LECEF_1_UNITS	35858	LECEfst1	13.8	107.88	1	San Jose, South Bay-Moss Landing		Market

LFC 51_2_UNIT 1	35310	PPASSWND	21	2.02	1	None	Aug NQC	Wind
LMBEPK_2_UNITA1	32173	LAMBGT1	13.8	47.00	1	Contra Costa	Aug NQC	Market
LMBEPK_2_UNITA2	32174	GOOSEHGT	13.8	46.00	2	Contra Costa	Aug NQC	Market
LMBEPK_2_UNITA3	32175	CREEDGT1	13.8	47.00	3	Contra Costa	Aug NQC	Market
LMEC_1_PL1X3	33111	LMECCT2	18	163.20	1	Pittsburg	Aug NQC	Market
LMEC_1_PL1X3	33112	LMECCT1	18	163.20	1	Pittsburg	Aug NQC	Market
LMEC_1_PL1X3	33113	LMECST1	18	229.60	1	Pittsburg	Aug NQC	Market
MARTIN_1_SUNSET				1.88		None	Not modeled Aug NQC	QF/Selfgen
METCLF_1_QF				0.00		None	Not modeled Aug NQC	QF/Selfgen
METEC_2_PL1X3	35881	MEC CTG1	18	178.43	1	South Bay-Moss Landing	Aug NQC	Market
METEC_2_PL1X3	35882	MEC CTG2	18	178.43	1	South Bay-Moss Landing	Aug NQC	Market
METEC_2_PL1X3	35883	MEC STG1	18	213.14	1	South Bay-Moss Landing	Aug NQC	Market
MILBRA_1_QF				0.00		None	Not modeled	QF/Selfgen
MISSIX_1_QF				0.16		None	Not modeled Aug NQC	QF/Selfgen
MLPTAS_7_QFUNTS				0.02		San Jose, South Bay-Moss Landing	Not modeled Aug NQC	QF/Selfgen
MOSSLD_2_PSP1	36221	DUKMOSS1	18	138.72	1	South Bay-Moss Landing	85% of existing	Market
MOSSLD_2_PSP1	36222	DUKMOSS2	18	138.72	1	South Bay-Moss Landing	85% of existing	Market
MOSSLD_2_PSP1	36223	DUKMOSS3	18	156.06	1	South Bay-Moss Landing	85% of existing	Market
MOSSLD_2_PSP2	36224	DUKMOSS4	18	138.72	1	South Bay-Moss Landing	85% of existing	Market
MOSSLD_2_PSP2	36225	DUKMOSS5	18	138.72	1	South Bay-Moss Landing	85% of existing	Market
MOSSLD_2_PSP2	36226	DUKMOSS6	18	156.06	1	South Bay-Moss Landing	85% of existing	Market
NEWARK_1_QF				0.02		None	Not modeled Aug NQC	QF/Selfgen
OAK C_1_EBMUD				0.73		Oakland	Not modeled Aug NQC	MUNI
OAK C_7_UNIT 1	32901	OAKLND 1	13.8	55.00	1	Oakland		Market
OAK C_7_UNIT 2	32902	OAKLND 2	13.8	55.00	1	Oakland		Market
OAK C_7_UNIT 3	32903	OAKLND 3	13.8	55.00	1	Oakland		Market
OXMTN_6_LNDFIL	33469	OX_MTN	4.16	1.44	1	Ames		Market
OXMTN_6_LNDFIL	33469	OX_MTN	4.16	1.45	2	Ames		Market
OXMTN_6_LNDFIL	33469	OX_MTN	4.16	1.45	3	Ames		Market
OXMTN_6_LNDFIL	33469	OX_MTN	4.16	1.45	4	Ames		Market
OXMTN_6_LNDFIL	33469	OX_MTN	4.16	1.45	5	Ames		Market
OXMTN_6_LNDFIL	33469	OX_MTN	4.16	1.45	6	Ames		Market
OXMTN_6_LNDFIL	33469	OX_MTN	4.16	1.45	7	Ames		Market
PALALT_7_COBUG				4.50		None	Not modeled	MUNI
RICHMN_7_BAYENV				2.00		None	Not modeled Aug NQC	Market
RUSCTY_2_UNITS	35304	RUSELCT1	15	172.35	1	Ames	No NQC - Pmax	Market

RUSCTY_2_UNITS	35305	RUSELCT2	15	172.35	1	Ames	No NQC - Pmax	Market
RUSCTY_2_UNITS	35306	RUSELST1	15	241.00	1	Ames	No NQC - Pmax	Market
RVRVEW_1_UNITA1	33178	RVEC_GEN	13.8	46.00	1	Contra Costa	Aug NQC	Market
SEAWST_6_LAPOS	35312	FOREBAYW	22	0.14	1	Contra Costa	Aug NQC	Wind
SRINTL_6_UNIT	33468	SRI INTL	9.11	0.82	1	None	Aug NQC	QF/Selfgen
STAUFF_1_UNIT	33139	STAUFER	9.11	0.09	1	None	Aug NQC	QF/Selfgen
STOILS_1_UNITS	32921	CHEVGEN1	13.8	0.70	1	Pittsburg	Aug NQC	Market
STOILS_1_UNITS	32922	CHEVGEN2	13.8	0.70	1	Pittsburg	Aug NQC	Market
STOILS_1_UNITS	32923	CHEVGEN3	13.8	0.32	3	Pittsburg	Aug NQC	Market
TIDWTR_2_UNITS	33151	FOSTER W	12.5	7.01	1	Pittsburg	Aug NQC	Net Seller
TIDWTR_2_UNITS	33151	FOSTER W	12.5	7.00	2	Pittsburg	Aug NQC	Net Seller
TIDWTR_2_UNITS	33151	FOSTER W	12.5	7.00	3	Pittsburg	Aug NQC	Net Seller
UNCHEM_1_UNIT	32920	UNION CH	9.11	10.45	1	Pittsburg	Aug NQC	QF/Selfgen
UNOCAL_1_UNITS	32910	UNOCAL	12	0.38	1	Pittsburg	Aug NQC	QF/Selfgen
UNOCAL_1_UNITS	32910	UNOCAL	12	0.38	2	Pittsburg	Aug NQC	QF/Selfgen
UNOCAL_1_UNITS	32910	UNOCAL	12	0.38	3	Pittsburg	Aug NQC	QF/Selfgen
USWNR_2_SMUD	32169	SOLANOWP	21	21.94	1	Contra Costa	Aug NQC	Wind
USWNR_2_SMUD2	32186	SOLANO	34.5	42.60	1	Contra Costa	Aug NQC	Wind
USWNR_2_UNITS	32168	EXNCO	9.11	4.18	1	Contra Costa	Aug NQC	Wind
USWPFK_6_FRICK	35320	USW FRIC	12	0.78	1	Contra Costa	Aug NQC	Wind
USWPFK_6_FRICK	35320	USW FRIC	12	0.78	2	Contra Costa	Aug NQC	Wind
USWJR_2_UNITS	39233	GRNRDG	0.69	15.66	1	Contra Costa	Aug NQC	Wind
WINDMAS_2_UNIT 1	33170	WINDMSTR	9.11	3.42	1	Contra Costa	Aug NQC	Wind
ZOND_6_UNIT	35316	ZOND SYS	9.11	1.45	1	Contra Costa	Aug NQC	Wind
IBMCTL_1_UNIT 1	35637	IBM-CTLE	115	0.00	1	San Jose, South Bay-Moss Landing	No NQC - hist. data	Market
IMHOFF_1_UNIT 1	33136	CCCSD	12.5	4.40	1	Pittsburg	No NQC - hist. data	QF/Selfgen
MARKHM_1_CATLST	35863	CATALYST	9.11	0.00	1	San Jose, South Bay-Moss Landing		QF/Selfgen
NA	36209	SLD ENRG	12.5	0.00	1	South Bay-Moss Landing		QF/Selfgen
SHELRF_1_UNITS	33141	SHELL 1	12.5	20.00	1	Pittsburg	No NQC - hist. data	Net Seller
SHELRF_1_UNITS	33142	SHELL 2	12.5	40.00	1	Pittsburg	No NQC - hist. data	Net Seller
SHELRF_1_UNITS	33143	SHELL 3	12.5	40.00	1	Pittsburg	No NQC - hist. data	Net Seller
ZANKER_1_UNIT 1	35861	SJ-SCL W	4.3	5.00	RN	San Jose, South Bay-Moss Landing	No NQC - hist. data	QF/Selfgen
New Unit	30524	0354-WD	230	1.83	EW	Contra Costa	No NQC - Pmax	Market
New Unit	35622	SWIFT	115	4.00	BT	South Bay-Moss Landing	No NQC - Pmax	Market
New Unit	35302	NUMMI-LV	12.6	0.00	RN		Energy Only	Market
New Unit	35307	A100US-L	12.6	0.00	RN		Energy Only	Market
New Unit	35859	HGST-LV	12.4	0.00	RN		Energy Only	Market
CARDCG_1_UNITS	33463	CARDINAL	12.5	0.00	R1	None	Retired	QF/Selfgen
CARDCG_1_UNITS	33463	CARDINAL	12.5	0.00	R2	None	Retired	QF/Selfgen
COCOPP_7_UNIT 6	33116	C.COS 6	18	0.00	RT	Contra Costa	Retired	Market
COCOPP_7_UNIT 7	33117	C.COS 7	18	0.00	RT	Contra Costa	Retired	Market
GWFPW1_6_UNIT	33131	GW F #1	9.11	0.00	1	Pittsburg, Contra Costa	Retired	QF/Selfgen
GWFPW2_1_UNIT 1	33132	GW F #2	13.8	0.00	1	Pittsburg	Retired	QF/Selfgen
GWFPW3_1_UNIT 1	33133	GW F #3	13.8	0.00	1	Pittsburg, Contra Costa	Retired	QF/Selfgen

GWFPW4_6_UNIT 1	33134	GWF #4	13.8	0.00	1	Pittsburg, Contra Costa	Retired	QF/Selfgen
GWFPW5_6_UNIT 1	33135	GWF #5	13.8	0.00	1	Pittsburg	Retired	QF/Selfgen
MOSSLD_7_UNIT 6	36405	MOSSLND6	22	0.00	1	South Bay-Moss Landing	Retired by 2021	Market
MOSSLD_7_UNIT 7	36406	MOSSLND7	22	0.00	1	South Bay-Moss Landing	Retired by 2021	Market
PITTSP_7_UNIT 5	33105	PTSB 5	18	0.00	1	Pittsburg	Retired by 2019	Market
PITTSP_7_UNIT 6	33106	PTSB 6	18	0.00	1	Pittsburg	Retired by 2019	Market
PITTSP_7_UNIT 7	30000	PTSB 7	20	0.00	1	Pittsburg	Retired by 2019	Market
UNTDQF_7_UNITS	33466	UNTED CO	9.11	0.00	1	None	Retired	QF/Selfgen

Major new projects modeled:

1. Vaca Dixon-Lakeville 230 kV line reconductoring
2. East Shore-Oakland J 115 kV reconductoring project
3. Evergreen-Mabury Conversion to 115 kV
4. Metcalf-Evergreen 115 kV line reconductoring
5. Metcalf-Piercy & Swift and Newark-Dixon Landing 115 kV upgrade
6. Embarcadero-Potrero 230 kV transmission project
7. Morgan Hill Area Reinforcement
8. Tesla-Newark 230 kV Path upgrade
9. A few small renewable resources
10. Pittsburg Power Plant retirement

Critical Contingency Analysis Summary

Oakland Sub-area

The critical contingency for the Oakland pocket is the loss of both C-X #2 and C-X #3 115 kV Cables. The area limitation is thermal overloading of the remaining Moraga-Claremont 115 kV lines above their emergency rating. This limiting contingency establishes a local capacity need of 76 MW in 2026 (includes 49 MW of MUNI generation) as minimum capacity necessary for reliable load serving capability within this sub-area.

The Oakland resources are required in order to meet local reliability requirements in the Oakland sub-area based on actual real-time data that shows a need of at least 98 MW

for a 1 in 3 heat wave (2015/16). Further, the real-time data also showed that at times all three Oakland generators are on-line simultaneously in order to maintain local reliability. The local capacity technical study was intended to model a 1 in 10 heat wave resulting in an increased local capacity need beyond that observed in real-time. The discrepancy is due to load forecast distribution among substations in the area. ISO will work with PG&E and CEC to correct this discrepancy in future base cases.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Llagas Sub-area

The most critical contingency is an outage of Metcalf D-Morgan Hill 115 kV line with the Spring 230/115kV Bank #1. The area limitation is the thermal overloading of the Metcalf - Green Valley – Llagas 115 kV line above their emergency rating. This limiting contingency establishes a local capacity need of 30 MW in 2026 (includes 0 MW of QF and MUNI generation) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

San Jose Sub-area

The most critical contingency in the San Jose sub-area is the Metcalf - Evergreen #1 and #2 115 kV lines. The limiting element is the San Jose STA “A”-“B” 115 kV line and establishes a local capacity 257 MW in 2026 (includes 5 MW of QF and 230 MW of MUNI generation) as minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

South Bay-Moss Landing Sub-area

The most critical contingency is an outage of the Tesla-Metcalf 500 kV and Moss Landing-Los Banos 500 kV. The area limitation is thermal overloading of the Las Aguilas-Moss Landing 230 kV. This limiting contingency establishes a LCR of 2427 MW in 2026 (includes 5 MW of QF, 230 MW of MUNI generation as well as 188 MW of deficiency) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Resources in San Jose and Llagas sub-areas are also included in this sub-area.

Effectiveness factors:

For thermal overloads, resources in the Moss Landing area are more effective than the resources in the South Bay. For voltage support, resources in the South Bay are more effective than the resources in the Moss Landing area. Minimum requirement assumes at least two blocks of Combined Cycle at Moss Landing.

Ames and Pittsburg Sub-areas Combined

The need for OTC generation in this sub-area is eliminated after the following projects are operational: Tesla-Pittsburg 230 kV Reconductoring, Moraga 230/115 kV Banks Replacement, Contra Costa-Moraga 230 kV Reconductoring and the Vaca Dixon-Lakeville 230 kV Reconductoring.

The two most critical contingencies listed below together establish a local capacity need of 2649 MW in 2026 as follows: 547 MW in NCNB (includes 14 MW of QF and 114 MW of Muni generation) and 2102 MW in the Bay Area – 407 MW in Ames (includes 0 MW of QF and MUNI generation) and 1695 MW in Pittsburg (includes 200 MW of QF generation) as the minimum capacity necessary for reliable load serving capability within these sub-areas.

The most critical contingency in the Bay Area is an outage of DCTL Newark-Ravenswood & Tesla-Ravenswood 230 kV. The area limitation is thermal overloading of Newark-Ames #1, #2, #3 and Newark- Ames Distribution 115 kV lines.

The most critical contingency in North Coast/North Bay area is an outage of Vaca Dixon-Lakeville 230 kV line overlapped with the outage of Vaca Dixon-Tulucay 230 kV lines. The limiting element is the Moraga-Sobrante 115 kV line.

Effectiveness factors:

Resources must satisfy both constraints simultaneously, therefore no effectiveness factor is provided.

Contra Costa Sub-area

The most critical contingency is an outage of Kelso-Tesla 230 kV with Gateway out of service. The area limitation is thermal overloading of the Delta Switching Yard-Tesla 230 kV line. This limiting contingency establishes a LCR of 1105 MW in 2026 (includes 264 MW of MUNI pumps and 289 MW of wind generation) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

The following table has units within the Bay Area that are at least 10% effective.

Gen Bus	Gen Name	Gen ID	Eff Fctr (%)
33175	ALTAMONT	1	83
38760	DELTA E	10	71
38760	DELTA E	11	71
38765	DELTA D	8	71
38765	DELTA D	9	71
38770	DELTA C	6	71
38770	DELTA C	7	71
38815	DELTA B	4	71
38815	DELTA B	5	71
38820	DELTA A	3	71
33170	WINDMSTR	1	68
33118	GATEWAY1	1	23
33119	GATEWAY2	1	23
33120	GATEWAY3	1	23
33116	C.COS 6	1	23
33117	C.COS 7	1	23
33133	GWF #3	1	23
33134	GWF #4	1	23
33178	RVEC_GEN	1	23

33131	GWF #1	1	22
32179	T222	1	18
32188	P0611G	1	18
32190	Q039	1	18
32186	P0609	1	18
32171	HIGHWND3	1	18
32177	Q0024	1	18
32168	ENXCO	2	18
32169	SOLANOWP	1	18
32172	HIGHWNDS	1	18
32176	SHILOH	1	18
33838	USWP_#3	1	18
32173	LAMBGT1	1	14
32174	GOOSEHGT	2	14
32175	CREEDGT1	3	14
35312	SEAWESTF	1	11
35316	ZOND SYS	1	11
35320	USW FRIC	1	11

Bay Area overall

The most critical need is the aggregate of sub-area requirements. This establishes a LCR of 5732 MW in 2026 (including 232 MW of QF, 410 MW of MUNI and 291 MW of wind generation) as the minimum capacity necessary for reliable load serving capability within this area.

The most critical single contingency is the loss of the Tesla-Metcalf 500 kV with Delta Energy Center out of service. The area limitation is reactive margin. This limiting contingency establishes a local capacity need of 3226 MW in 2026 (includes 232 MW of QF, 291 MW of wind and 410 MW of MUNI generation).

Effectiveness factors:

For most helpful procurement information please read procedure M-2210Z effectiveness factors at: <http://www.caiso.com/Documents/2210Z.pdf>

Changes compared to last year's results:

Compared with 2021 the load forecast went up by 546 MW and the LCR has increased by 538 MW.

Bay Area Overall Requirements:

2026	Wind (MW)	QF/Selfgen (MW)	Muni (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	291	232	410	5970	6903

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ¹³	3226	0	3226
Category C (Multiple) ¹⁴	5544	188	5732

6. Greater Fresno Area

Area Definition

The transmission facilities coming into the Greater Fresno area are:

- 1) Gates-Mustang #1 230 kV
- 2) Gates-Mustang #2 230 kV
- 3) Gates-Gregg 230kV
- 4) Gates #5 230/70 kV Transformer Bank
- 5) Mercy Spring 230 /70 Bank # 1
- 6) Los Banos #3 230/70 Transformer Bank
- 7) Los Banos #4 230/70 Transformer Bank
- 8) Warnerville-Wilson 230kV
- 9) Melones-North Merced 230 kV line
- 10) Panoche-Tranquility #1 230 kV
- 11) Panoche- Tranquility #2 230 kV
- 12) Panoche #1 230/115 kV Transformer Bank
- 13) Panoche #2 230/115 kV Transformer Bank
- 14) Corcoran-Smyrna 115kV
- 15) Coalinga #1-San Miguel 70 kV

The substations that delineate the Greater Fresno area are:

¹³ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹⁴ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 1) Gates is out Henrietta is in
- 2) Gates is out Henrietta is in
- 3) Gates 230 is out Gates 70 is in
- 4) Mercy Springs 230 is out Mercy Springs 70 is in
- 5) Los Banos 230 is out Los Banos 70 is in
- 6) Los Banos 230 is out Los Banos 70 is in
- 7) Warnerville is out Wilson is in
- 8) Melones is out North Merced is in
- 9) Panoche is out Tranquility #1 is in
- 10) Panoche is out Tranquility #2 is in
- 11) Panoche 230 is out Panoche 115 is in
- 12) Panoche 230 is out Panoche 115 is in
- 13) Corcoran is in Smyrna is out
- 14) Coalinga is in San Miguel is out

Total 2026 busload within the defined area: 3715 MW with -165 MW of AAEE and 103 MW of losses resulting in total load + losses of 3653 MW.

Total units and qualifying capacity available in this area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
ADMEST_6_SOLAR	34315	ADAMS_E	12.5	0.00	1	Wilson, Herndon	Energy Only	Market
AGRICO_6_PL3N5	34608	AGRICO	13.8	20.00	3	Wilson, Herndon		Market
AGRICO_7_UNIT	34608	AGRICO	13.8	7.45	4	Wilson, Herndon		Market
AGRICO_7_UNIT	34608	AGRICO	13.8	43.05	2	Wilson, Herndon		Market
AVENAL_6_AVPARK	34265	AVENAL P	12	0.00	1	Wilson, Coalinga	Energy Only	Market
AVENAL_6_SANDDG	34263	SANDDRAG	12	0.00	1	Wilson, Coalinga	Energy Only	Market
AVENAL_6_SUNCTY	34257	SUNCTY D	12	0.00	1	Wilson, Coalinga	Energy Only	Market
BALCHS_7_UNIT 1	34624	BALCH	13.2	33.00	1	Wilson, Herndon	Aug NQC	Market
BALCHS_7_UNIT 2	34612	BLCH	13.8	52.50	1	Wilson, Herndon	Aug NQC	Market
BALCHS_7_UNIT 3	34614	BLCH	13.8	52.50	1	Wilson, Herndon	Aug NQC	Market
BORDEN_2_QF	34253	BORDEN D	12.5	0.78	QF	Wilson	Aug NQC	Net Seller
CANTUA_1_SOLAR	34349	CANTUA_D	12.5	7.15	1	Wilson	Aug NQC	Market
CANTUA_1_SOLAR	34349	CANTUA_D	12.5	7.15	2	Wilson	Aug NQC	Market
CAPMAD_1_UNIT 1	34179	MADERA_G	13.8	4.29	1	Wilson		Market
CHEVCO_6_UNIT 1	34652	CHV.COAL	9.11	1.30	1	Wilson, Coalinga	Aug NQC	QF/Selfgen
CHEVCO_6_UNIT 2	34652	CHV.COAL	9.11	0.85	2	Wilson, Coalinga	Aug NQC	QF/Selfgen
CHWCHL_1_BIOMAS	34305	CHWCHLA2	13.8	8.60	1	Wilson, Herndon	Aug NQC	Market
CHWCHL_1_UNIT	34301	CHOWCOGN	13.8	48.00	1	Wilson, Herndon		Market
COLGA1_6_SHELLW	34654	COLNGAGN	9.11	34.58	1	Wilson, Coalinga	Aug NQC	Net Seller
CORCAN_1_SOLAR1				13.80		Wilson, Herndon, Hanford	Not Modeled Aug NQC	Market
CORCAN_1_SOLAR2				7.59		Wilson, Herndon, Hanford	Not Modeled Aug NQC	Market
CRESSY_1_PARKER	34140	CRESSEY	115	1.21		Wilson	Not modeled Aug NQC	MUNI
CRNEVL_6_CRNVA	34634	CRANEVLY	12	0.71	1	Wilson, Borden	Aug NQC	Market

CRNEVL_6_SJQN 2	34631	SJ2GEN	9.11	3.20	1	Wilson, Borden	Aug NQC	Market
CRNEVL_6_SJQN 3	34633	SJ3GEN	9.11	4.20	1	Wilson, Borden	Aug NQC	Market
DINUBA_6_UNIT	34648	DINUBA E	13.8	9.87	1	Wilson, Herndon, Reedley		Market
ELCAP_1_SOLAR				1.04		Wilson	Not Modeled Aug NQC	Market
ELNIDP_6_BIOMAS	34330	ELNIDO	13.8	8.71	1	Wilson	Aug NQC	Market
EXCHEC_7_UNIT 1	34306	EXCHQUER	13.8	94.20	1	Wilson	Aug NQC	MUNI
FRIANT_6_UNITS	34636	FRIANTDM	6.6	0.66	4	Wilson, Borden	Aug NQC	Net Seller
FRIANT_6_UNITS	34636	FRIANTDM	6.6	2.49	3	Wilson, Borden	Aug NQC	Net Seller
FRIANT_6_UNITS	34636	FRIANTDM	6.6	4.66	2	Wilson, Borden	Aug NQC	Net Seller
GUERNS_6_SOLAR	34461	GUERNSEY	12.5	7.37	1	Wilson	Aug NQC	Market
GUERNS_6_SOLAR	34461	GUERNSEY	12.5	7.37	2	Wilson	Aug NQC	Market
GWFPWR_1_UNITS	34431	GWFPWR_1_UNITS	13.8	42.20	1	Wilson, Herndon, Hanford		Market
GWFPWR_1_UNITS	34433	GWFPWR_1_UNITS	13.8	42.20	1	Wilson, Herndon, Hanford		Market
HAASPH_7_PL1X2	34610	HAAS	13.8	72.00	1	Wilson, Herndon	Aug NQC	Market
HAASPH_7_PL1X2	34610	HAAS	13.8	72.00	2	Wilson, Herndon	Aug NQC	Market
HELMPG_7_UNIT 1	34600	HELMS	18	407.00	1	Wilson	Aug NQC	Market
HELMPG_7_UNIT 2	34602	HELMS	18	407.00	2	Wilson	Aug NQC	Market
HELMPG_7_UNIT 3	34604	HELMS	18	404.00	3	Wilson	Aug NQC	Market
HENRTA_6_UNITA1	34539	GWFPWR_1_UNITS	13.8	45.33	1	Wilson		Market
HENRTA_6_UNITA2	34541	GWFPWR_1_UNITS	13.8	45.23	1	Wilson		Market
HURON_6_SOLAR	34557	HURON_DI	12.5	6.87	1	Wilson, Coalinga	Aug NQC	Market
HURON_6_SOLAR	34557	HURON_DI	12.5	6.87	2	Wilson, Coalinga	Aug NQC	Market
INTTRB_6_UNIT	34342	INT.TURB	9.11	2.94	1	Wilson	Aug NQC	QF/Selfgen
JAYNE_6_WLSLR	34639	WESTLND	0.48	0.00	1	Wilson, Coalinga	Energy Only	Market
KANSAS_6_SOLAR	34666	KANSASS_S	12.5	0.00	F	Wilson	Energy Only	Market
KERKH1_7_UNIT 1	34344	KERCK1-1	6.6	13.00	1	Wilson, Herndon	Aug NQC	Market
KERKH1_7_UNIT 2	34343	KERCK1-2	6.6	0.00	2	Wilson, Herndon	Aug NQC	Market
KERKH1_7_UNIT 3	34345	KERCK1-3	6.6	12.80	3	Wilson, Herndon	Aug NQC	Market
KERKH2_7_UNIT 1	34308	KERCKHOF	13.8	153.90	1	Wilson, Herndon	Aug NQC	Market
KINGCO_1_KINGBR	34642	KINGSBUR	9.11	23.71	1	Wilson, Herndon, Hanford	Aug NQC	Net Seller
KINGRV_7_UNIT 1	34616	KINGSRIV	13.8	51.20	1	Wilson, Herndon	Aug NQC	Market
KNGBRG_1_KBSLR1				0.00		Wilson	Not modeled Energy Only	Market
KNGBRG_1_KBSLR2				0.00		Wilson	Not modeled Energy Only	Market
KNTSTH_6_SOLAR	34694	KENT_S	0.8	0.00	1	Wilson	Energy Only	Market
LEPRFD_1_KANSAS	34680	Q636	12.5	13.85	1	Wilson, Hanford	Aug NQC	Market
MALAGA_1_PL1X2	34671	KRCDPCT1	13.8	48.00	1	Wilson, Herndon		Market
MALAGA_1_PL1X2	34672	KRCDPCT2	13.8	48.00	1	Wilson, Herndon		Market
MCCALL_1_QF	34219	MCCALL 4	12.5	0.58	QF	Wilson, Herndon	Aug NQC	QF/Selfgen
MCSWAN_6_UNITS	34320	MCSWAIN	9.11	5.82	1	Wilson	Aug NQC	MUNI
MENBIO_6_RENEW1	34339	CALRENEW	12.5	4.02	1	Wilson, Herndon	Aug NQC	Net Seller
MENBIO_6_UNIT	34334	BIO PWR	9.11	20.11	1	Wilson	Aug NQC	QF/Selfgen
MERCED_1_SOLAR1				0.00		Wilson	Not modeled Energy Only	Market
MERCED_1_SOLAR2				0.00		Wilson	Not modeled Energy Only	Market

MERCFL_6_UNIT	34322	MERCEDFL	9.11	2.15	1	Wilson	Aug NQC	Market
MNDOTA_1_SOLAR1	34311	NORTHSTAR	0.2	41.40	1	Wilson	Aug NQC	Market
ONLLPP_6_UNITS	34316	ONEILPMP	9.11	0.37	1	Wilson	Aug NQC	MUNI
PINFLT_7_UNITS	38720	PINEFLAT	13.8	22.00	1	Wilson, Herndon	Aug NQC	MUNI
PINFLT_7_UNITS	38720	PINEFLAT	13.8	22.00	2	Wilson, Herndon	Aug NQC	MUNI
PINFLT_7_UNITS	38720	PINEFLAT	13.8	22.00	3	Wilson, Herndon	Aug NQC	MUNI
PNCHPP_1_PL1X2	34328	STARGT1	13.8	55.58	1	Wilson		Market
PNCHPP_1_PL1X2	34329	STARGT2	13.8	55.58	1	Wilson		Market
PNOCHE_1_PL1X2	34142	WHD_PAN2	13.8	49.97	1	Wilson, Herndon		Market
PNOCHE_1_UNITA1	34186	DG_PAN1	13.8	48.00	1	Wilson		Market
REEDLY_6_SOLAR				0.00		Wilson, Herndon, Reedley	Not modeled Energy Only	Market
S_RITA_6_SOLAR1				0.00		Wilson	Not modeled Energy Only	Market
SCHNDR_1_FIVPTS	34353	SCHINDLER_D	12.5	2.13	2	Wilson, Coalinga	Aug NQC	Market
SCHNDR_1_FIVPTS	34353	SCHINDLER_D	12.5	4.24	1	Wilson, Coalinga	Aug NQC	Market
SCHNDR_1_WSTSDE	34353	SCHINDLER_D	12.5	3.09	4	Wilson, Coalinga	Aug NQC	Market
SCHNDR_1_WSTSDE	34353	SCHINDLER_D	12.5	6.17	3	Wilson, Coalinga	Aug NQC	Market
SGREGY_6_SANGER	34646	SANGERCO	13.8	5.51	2	Wilson	Aug NQC	Market
SGREGY_6_SANGER	34646	SANGERCO	13.8	24.44	1	Wilson	Aug NQC	Market
STOREY_7_MDRCHW	34209	STOREY D	12.5	0.20	1	Wilson	Aug NQC	Net Seller
STROUD_6_SOLAR	34563	STROUD_D	12.5	6.57	1	Wilson, Herndon	Aug NQC	Market
STROUD_6_SOLAR	34563	STROUD_D	12.5	6.57	2	Wilson, Herndon	Aug NQC	Market
ULTPFR_1_UNIT 1	34640	ULTR.PWR	9.11	22.72	1	Wilson, Herndon	Aug NQC	QF/Selfgen
VEGA_6_SOLAR1	34314	Q548	34.5	0.00	1	Wilson	Energy Only	Market
WAUKNA_1_SOLAR	34696	CORCORANPV_S	21	18.00	1	Wilson, Herndon, Hanford	Aug NQC	Market
WAUKNA_1_SOLAR2	34677	Q558	21	14.78	1	Wilson, Herndon, Hanford	No NQC - Pmax	Market
WFRESN_1_SOLAR				0.00		Wilson	Energy Only	Market
WISHON_6_UNITS	34658	WISHON	2.3	0.36	5	Wilson, Borden	Aug NQC	Market
WISHON_6_UNITS	34658	WISHON	2.3	4.51	1	Wilson, Borden	Aug NQC	Market
WISHON_6_UNITS	34658	WISHON	2.3	4.51	2	Wilson, Borden	Aug NQC	Market
WISHON_6_UNITS	34658	WISHON	2.3	4.51	3	Wilson, Borden	Aug NQC	Market
WISHON_6_UNITS	34658	WISHON	2.3	4.51	4	Wilson, Borden	Aug NQC	Market
WRGHTP_7_AMENGY	34207	WRIGHT D	12.5	0.30	QF	Wilson	Aug NQC	QF/Selfgen
BULLRD_7_SAGNES	34213	BULLD 12	12.5	0.06	1	Wilson	Aug NQC	QF/Selfgen
GATES_6_PL1X2	34553	WHD_GAT2	13.8	0.00	1	Wilson, Coalinga		Market
JRWOOD_1_UNIT 1	34332	JRWCOGEN	9.11	7.80	1	Wilson		QF/Selfgen
NA	34485	FRESNOWW	12.5	1.10	3	Wilson	No NQC - hist. data	QF/Selfgen
NA	34485	FRESNOWW	12.5	3.10	1	Wilson	No NQC - hist. data	QF/Selfgen
NA	34485	FRESNOWW	12.5	3.10	2	Wilson	No NQC - hist. data	QF/Selfgen
New Unit	34603	JGBSWLT	12.5	0.00	ST	Wilson, Herndon	Energy Only	Market
New Unit	34653	Q526	33	0.00	1	Wilson, Coalinga	Energy Only	Market
New Unit	34699	RPS-N-034	0.39	0.00	1	Wilson, Herndon	Energy Only	Market
New Unit	34673	Q532	13.8	0.00	1	Wilson, Coalinga	Energy Only	Market
New Unit	34467	GIFFEN_DIST	12.5	10.00	1	Wilson, Herndon	No NQC - Pmax	Market
New Unit	34420	CORCORAN	115	19.00	WD	Wilson, Herndon, Hanford	No NQC - Pmax	Market
New Unit	34319	CHWCHLASLR	0.42	20.00	1	Wilson, Herndon	No NQC - Pmax	Market

New Unit	34335	Q723	0.32	50.00	1	Wilson, Borden	No NQC - Pmax	Market
New Unit	34683	RPS-N-055	0.8	100.00	1	Wilson	No NQC - Pmax	Market
New Unit	34340	RPS-N-059	0.8	200.00	1	Wilson	No NQC - Pmax	Market
New Unit	34300	Q550	36	0.00	1	Wilson	Energy Only	Market
New Unit	36205	Q648	36	0.00	1	Wilson	Energy Only	Market
New Unit	39604	PATRIOTB	0.32	0.00	1	Wilson	Energy Only	Market
New Unit	39601	PATRIOTA	0.32	0.00	1	Wilson	Energy Only	Market
New Unit	34644	Q679	0.48	20.00	1	Wilson	No NQC - Pmax	Market
New Unit	34649	Q965	0.36	20.00	1	Wilson	No NQC - Pmax	Market
New Unit	34623	Q678	0.5	60.00	1	Wilson, Coalinga	No NQC - Pmax	Market
New Unit	34688	Q272	0.56	123.00	1	Wilson	No NQC - Pmax	Market

Major new projects modeled:

1. Kerchhoff PH #2 - Oakhurst 115 kV Line
2. Warnerville-Wilson 230 kV reactor
3. Oro Loma 70 kV Area Reinforcement
4. New E2 substation
5. New North Merced 230/115 kV substation
6. New Mercy Spring 230/70 kV substation
7. Le Grand-Chowchilla 115 kV reconductoring
8. Panoche-Oro Loma 115kV Reconductoring Project
9. Gates-Gregg 230kV line

Critical Contingency Analysis Summary

Hanford Sub-area

The most critical contingency for the Hanford sub-area is the loss of the McCall-Kingsburg #2 115 kV line and Henrietta #3 230/115 kV transformer, which would thermally overload the McCall-Kingsburg #1 115 kV line . This limiting contingency establishes a local capacity need of 17 MW in 2026 (including 0 MW of QF generation) as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Coalinga Sub-area

The most critical contingency for the Coalinga sub-area is the loss of the Gates #5 230/70 kV transformer followed by the Panoche-Schindler #1 and #2 common tower contingency, which could cause voltage instability in the pocket. This limiting contingency establishes a local capacity need of 83 MW (including 2 MW of QF generation) in 2026 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Borden Sub-area

The most critical contingency for the Borden sub-area is the loss of the Borden #4 230/70 kV transformer followed by the Friant-Coppermine 70 kV line, which could cause overload on the Borden #1 230/70 kV transformer. This limiting contingency establishes a local capacity need of 5 MW (including 0 MW of QF generation) in 2026 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Reedley Sub-area

This sub-area has been eliminated due to New McCall-Reedley #2 115 kV line project.

Herndon Sub-area

This sub-area has been eliminated due to the new E2 substation that loops the Helms-Gregg #1 & #2 230kV lines and now injects Helms generation into Sanger, eliminating the need for this sub-area.

Wilson Sub-area

The most critical contingency for the Wilson sub-area is the loss of Melones-North Merced 230 kV line with one Helms generating unit out of service which can cause voltage instability. This limiting contingency establishes a local capacity need of 1474 MW in 2026 (includes 114 MW of QF and 168 MW of Muni generation) as the generation capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

The following table has units within Fresno that are at least 4% effective.

Gen Bus	Gen Name	Gen ID	Eff Factor %
34330	ELNIDO	1	8
34314	Q548	1	8
34322	MERCEDFL	1	8
34301	CHOWCOGN	1	7
34305	CHWCHLA2	1	7
34311	Q607	1	7
34631	SJ2GEN	1	5
34633	SJ3GEN	1	5
34634	CRANEVLY	1	5
34658	WISHON	1	5
34658	WISHON	2	5
34658	WISHON	3	5
34658	WISHON	4	5
34658	WISHON	SJ	5
34600	HELMS 1	1	5
34602	HELMS 2	1	5
34604	HELMS 3	1	5
34308	KERCKHOF	1	5
34343	KERCK1-2	1	5
34344	KERCK1-1	1	5
34345	KERCK1-3	1	5
34632	HERNDN2T	1	5
34630	HERNDN1T	1	4
34207	WRIGHT D	QF	4

Additional helpful effectiveness factors for Fresno area:

For most helpful procurement information please read procedure M-2210Z effectiveness factors at: <http://www.caiso.com/Documents/2210Z.pdf>

Changes compared to 2021 results:

Overall the load forecast increased by 413 MW. The LCR need has increased by 314 MW due to load increase and new identified limiting condition.

Fresno Area Overall Requirements:

2026	QF/Selfgen (MW)	Muni (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	64	167	3295	3526

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ¹⁵	1474	0	1474
Category C (Multiple) ¹⁶	1474	0	1474

7. Kern Area

Area Definition

The transmission facilities coming into the Kern PP sub-area are:

- 1) Corcoran-Smyrna 115 kV line (Normally Open at Corocoran)
- 2) New Wheeler Ridge-Magunden 115 kV line
- 3) Midway-Semitropic 115 kV line
- 4) Midway-Smyrna-Semitropic 115 kV line
- 5) Copus-Old River 70 kV line
- 6) Wheeler Ridge-Lakeview 70 kV line
- 7) Weed Patch-Magunden-Kern Canyon 70 kV line
- 8) Kern PP 230/115 kV Bank # 3, 4 & 5

The substations that delineate the Kern-PP sub-area are:

- 1) Corcoran is out Quebec tap is in

¹⁵ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹⁶ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 2) Wheeler Ridge is out Magunden is is in
- 3) Midway 115 kV is out Semitropic 115 kV is in
- 4) Midway 115 kV is out Ganso 115 kV are in
- 5) Copus 70 kV is out South Kern 70 kV is in
- 6) Emidio Junction 70 kV is out Lakeview 70 kV is in
- 7) Weedpatch is out Magunden Junction is in
- 8) Kern PP 230 kV is out Kern PP 115 kV is in

Total 2026 busload within the defined area: 1127 MW with -44 MW of AAEE and 1 MW of losses resulting in total load + losses of 1084 MW.

Total units and qualifying capacity available in this Kern PP sub-area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
7STDRD_1_SOLAR1	34709	7STNDRD	115	13.80		South Kern PP, Kern Oil	Not modeled Aug NQC	Market
DEXZEL_1_UNIT	35024	DEXEL +	9.11	20.00	1	South Kern PP, Kern Oil	Aug NQC	Net Seller
DISCOV_1_CHEVRN	35062	DISCOVERY	9.11	3.21	1	South Kern PP, Kern Oil	Aug NQC	QF/Selfgen
LIVOK_1_UNIT 1	35058	PSE-LVOK	9.11	41.14	1	South Kern PP, Kern Oil	Aug NQC	Net Seller
MTNPOS_1_UNIT	35036	MT POSO	9.11	31.12	1	South Kern PP, Kern Oil	Aug NQC	Net Seller
VEDDER_1_SEKERN	35046	SEKR	9.11	11.96	1	South Kern PP, Kern Oil	Aug NQC	QF/Selfgen
ALPSLR_1_NTHSLR	35012	ALPAUGHN_20S	21	20.00	1	South Kern PP	Aug NQC	Market
ALPSLR_1_SPSSLR	35001	ALPAUGHN_50S	21	50.00	1	South Kern PP	Aug NQC	Market
ATWEL2_1_SOLAR1	35034	Q482	0.39	17.74	1	South Kern PP	Aug NQC	Market
ATWELL_1_SOLAR	35000	ATWELL_ISL	21	13.85	1	South Kern PP	Aug NQC	Market
BDGRCK_1_UNITS	35029	BADGERCK	9.11	36.29	1	South Kern PP	Aug NQC	Net Seller
BEARMT_1_UNIT	35066	PSE-BEAR	9.11	44.58	1	South Kern PP, West Park	Aug NQC	Net Seller
DOUBL_1_UNITS	35023	DOUBLE C	9.11	52.23	1	South Kern PP	Aug NQC	Net Seller
GOOSLK_1_SOLAR1	35084	GOSE LKE	12.5	11.00	1	South Kern PP	Aug NQC	Market
KERNFT_1_UNITS	35026	KERNFRNT	9.11	47.00	1	South Kern PP	Aug NQC	Net Seller
KRNCNY_6_UNIT	35018	KERNCNYN	11	11.50	1	South Kern PP	Aug NQC	Market
OLDRIV_6_BIOGAS				1.51		South Kern PP	Not modeled Aug NQC	Market
OLDRV1_6_SOLAR	35091	OLD_RVR1	12.5	13.85	1	South Kern PP	Aug NQC	Market
OLIVEP_1_SOLAR	35013	WHITERIVER_S	21	19.80	1	South Kern PP	Aug NQC	Market
OLIVEP_1_SOLAR2	35098	Q557	0.48	17.19	1	South Kern PP	Aug NQC	Market
RIOBRV_6_UNIT 1	35020	RIOBRAVO	11	0.20	1	South Kern PP	Aug NQC	Market
SIERRA_1_UNITS	35027	HISIERRA	9.11	52.43	1	South Kern PP	Aug NQC	Net Seller
SKERN_6_SOLAR1	35089	S_KERN	0.48	13.80	1	South Kern PP	Aug NQC	Market
WLDWD_1_SOLAR1	39184	WILDWOOD	0.8	16.36	FT	South Kern PP	Aug NQC	Market
WLDWD_1_SOLAR2	35047	WILDWOOD	0.39	12.05	1	South Kern PP	Aug NQC	Market
New Unit	35099	WASCO-LV	12.5	0.00	1	South Kern PP	Energy Only	Market

New Unit	34650	QUEBEC-L	12.5	0.00	1	South Kern PP	Energy Only	Market
New Unit	35069	Q885	0.36	8.00	1	South Kern PP	No NQC - est. data	Market
OILDAL_1_UNIT 1	35028	OILDALE	9.11	0.00	1	South Kern PP, Kern Oil	Aug NQC	Net Seller
ULTOGL_1_POSO	35035	ULTR PWR	9.11	0.00	1	South Kern PP, Kern Oil	Retired	QF/Selfgen

Major new projects modeled:

1. Kern PP 230 kV area reinforcement project
2. Kern PP 115 kV area reinforcement project
3. Wheeler Ridge Junction Substation Project
4. Semitropic – Wasco – Famoso – Kern Oil – Kern 70 kV Voltage Conversion project
5. Midway-Kern PP 1, 3 & 4 230 kV line capacity increase project

Critical Contingency Analysis Summary

West Park Sub-area

The West Park Sub area has been eliminated due to Kern PP 115 kV area reinforcement project.

Kern Oil Sub-area

The Kern Oil Sub area has been eliminated due to Semitropic– Wasco – Famoso – Kern Oil – Kern 70 kV Voltage Conversion project.

South Kern PP Sub-area

The most critical contingency is the outage of Midway-Semitropic-Smyrna 115 kV line with the Lerdo-Kern Oil-7th Standard 115 kV line being out of service resulting in potential thermal overload of the Semitropic D to Semitropic E 115 kV bus section. This limiting contingency establishes a LCR of 392 MW in 2026 (includes 15 MW of QF generation).

The single most critical contingency is the loss of Midway-Semitropic-Smyrna 115 kV line with Mount Poso generating unit out of service resulting in potential thermal

overload of Semitropic D to Semitropic E 115 kV bus section. This limiting contingency establishes a local capacity requirement of 391 MW in 2026 (includes 15 MW of QF generation).

Effectiveness factors:

The following table has units within Kern that are at least 4% effective.

Gen Bus	Gen Name	Gen ID	Eff Factor %
35047	WILDWOOD2	1	58
35084	GOSE LKE_1	FW	58
39184	WILDWOOD1	FT	58
35099	WASCO-LV	RN	55
35036	MT POSO	1	29
35024	DEXEL +	1	11
35046	SEKR	1	10
35062	DISCOVERY	1	10
35065	7STNDRD_1	FW	10
35058	PSE-LVOK	1	8
35018	KERNCNYN	1	6
35020	RIOBRAVO	1	6
35023	DOUBLE C	1	6
35026	KERNFRNT	1	6
35027	HISIERRA	1	6
35029	BADGERCK	1	6
35069	RPS-N-038	1	6
35089	S_KERN	1	6
35091	OLD_RVR1	1	6
35066	PSE-BEAR	1	6
35019	REGULUS	1	4
35054	RPS-N-117	1	4
35059	RPS-N-120	2	4
35087	RPS-N-123	3	4
35092	RPS-N-126	4	4
35021	RPS-N-005	1	2
35082	ORION	1	2
35083	LAKEVIEW_2	FW	2

Changes compared to 2021 results:

Overall the load went up by 868 MW, the maximum qualifying capacity went up by 460 MW and the LCR requirement have gone up by 287 MW mostly due to area redefinition caused by the new transmission projects in the area.

Kern Area Overall Requirements:

2026	QF/Selfgen (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	15	566	581

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ¹⁷	391	0	391
Category C (Multiple) ¹⁸	392	0	392

8. LA Basin Area

Area Definition

The transmission tie lines into the LA Basin Area are:

- 1) San Onofre - San Luis Rey #1, #2, and #3 230 kV Lines
- 2) San Onofre - Talega #2 230 kV Lines
- 3) San Onofre - Capistrano #1 230 kV Lines
- 4) Lugo - Mira Loma #2 & #3 500 kV Lines
- 5) Lugo - Rancho Vista #1 500 kV Line
- 6) Sylmar - Eagle Rock 230 kV Line
- 7) Sylmar - Gould 230 kV Line
- 8) Vincent – Mira Loma #1 500 kV Line
- 9) Vincent - Mesa Cal #1 230 kV Line
- 10) Vincent - Rio Hondo #1 & #2 230 kV Lines
- 11) Devers - Red Bluff 500 kV #1 and #2 Lines

¹⁷ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹⁸ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 12) Mirage - Coachelv # 1 230 kV Line
- 13) Mirage - Ramon # 1 230 kV Line
- 14) Mirage - Julian Hinds 230 kV Line

The substations that delineate the LA Basin Area are:

- 1) San Onofre is in San Luis Rey is out
- 2) San Onofre is in Talega is out
- 3) San Onofre is in Capistrano is out
- 4) Mira Loma is in Lugo is out
- 5) Rancho Vista is in Lugo is out
- 6) Eagle Rock is in Sylmar is out
- 7) Gould is in Sylmar is out
- 8) Mira Loma is in Vincent is out
- 9) Mesa Cal is in Vincent is out
- 10) Rio Hondo is in Vincent is out
- 11) Devers is in Red Bluff is out
- 12) Mirage is in Coachelv is out
- 13) Mirage is in Ramon is out
- 14) Mirage is in Julian Hinds is out

The CEC-adopted demand forecast for 2026 is 18,541 MW¹⁹ (this includes loads & losses and 1,550 MW AAEE). The total adjusted demand after including 696 MW peak shift adjustment²⁰ is 19,237 MW. A total of 19,243 MW of adjusted peak demand with 696 MW of peak shift adjustment was modeled for the study.

Total units and qualifying capacity available in the LA Basin area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
ANAHM_2_CANYN1	25211	CanyonGT 1	13.8	49.40	1	Western		MUNI
ANAHM_2_CANYN2	25212	CanyonGT 2	13.8	48.00	2	Western		MUNI
ANAHM_2_CANYN3	25213	CanyonGT 3	13.8	48.00	3	Western		MUNI
ANAHM_2_CANYN4	25214	CanyonGT 4	13.8	49.40	4	Western		MUNI
ANAHM_7_CT	25208	DowlingCTG	13.8	40.64	1	Western	Aug NQC	MUNI
ARCOGN_2_UNITS	24163	ARCO 5G	13.8	26.85	5	Western	Aug NQC	Net Seller
ARCOGN_2_UNITS	24164	ARCO 6G	13.8	26.86	6	Western	Aug NQC	Net Seller
ARCOGN_2_UNITS	24011	ARCO 1G	13.8	53.69	1	Western	Aug NQC	Net Seller

¹⁹ CEC-adopted 2015 IEPR demand forecast for 2016-2026, January 2016, for Mid Demand Baseline Case with Low AAEE Savings.

²⁰ The CEC provided a total of 1,010 MW of peak shift for all of SCE area. It is estimated that about 696 MW is for the LA Basin based on the ratio of the behind-the-meter PV modeled in the LA Basin vs. entire SCE area (i.e., 1195 MW / 1735 MW). The CEC provided the amount of peak shift adjustment for all of SCE area for the 2015 IEPR demand forecast to the ISO in November 2016.

ARCOGN_2_UNITS	24012	ARCO 2G	13.8	53.69	2	Western	Aug NQC	Net Seller
ARCOGN_2_UNITS	24013	ARCO 3G	13.8	53.69	3	Western	Aug NQC	Net Seller
ARCOGN_2_UNITS	24014	ARCO 4G	13.8	53.69	4	Western	Aug NQC	Net Seller
BARRE_2_QF	24016	BARRE	230	0.00		Western	Not modeled	QF/Selfgen
BARRE_6_PEAKER	29309	BARPKGEN	13.8	47.00	1	Western		Market
BLAST_1_WIND	24839	BLAST	115	5.01	1	Eastern, Valley-Devers	Aug NQC	Wind
BRDWAY_7_UNIT 3	29007	BRODWYSC	13.8	65.00	1	Western		MUNI
BUCKWD_1_NPALM1	25634	BUCKWIND	115	1.36		Eastern, Valley-Devers	Not modeled Aug NQC	Wind
BUCKWD_1_QF	25634	BUCKWIND	115	1.94	QF	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
BUCKWD_7_WINTCV	25634	BUCKWIND	115	0.10	W5	Eastern, Valley-Devers	Aug NQC	Wind
CABZON_1_WINDA1	29290	CABAZON	33	5.98	1	Eastern, Valley-Devers	Aug NQC	Wind
CENTER_2_QF	24203	CENTER S	66	17.98		Western	Not modeled Aug NQC	QF/Selfgen
CENTER_2_RHONDO	24203	CENTER S	66	1.91		Western	Not modeled	QF/Selfgen
CENTER_6_PEAKER	29308	CTRPKGEN	13.8	47.00	1	Western		Market
CENTRY_6_PL1X4	25302	CLTNCTRY	13.8	36.00	1	Eastern, Eastern Metro	Aug NQC	MUNI
CHEVMN_2_UNITS	24022	CHEVGEN1	13.8	4.97	1	Western, El Nido	Aug NQC	Net Seller
CHEVMN_2_UNITS	24023	CHEVGEN2	13.8	4.98	2	Western, El Nido	Aug NQC	Net Seller
CHINO_2_JURUPA				0.00		Eastern, Eastern Metro	Not modeled Energy Only	Market
CHINO_2_QF	24024	CHINO	66	5.35		Eastern, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
CHINO_2_SASOLAR				0.00		Eastern, Eastern Metro	Not modeled Energy Only	Market
CHINO_2_SOLAR	24024	CHINO	66	0.47		Eastern, Eastern Metro	Not modeled Energy Only	Market
CHINO_2_SOLAR2				0.00		Eastern, Eastern Metro	Not modeled Energy Only	Market
CHINO_6_CIMGEN	24026	CIMGEN	13.8	26.11	D1	Eastern, Eastern Metro	Aug NQC	QF/Selfgen
CHINO_6_SMPPAP	24140	SIMPSON	13.8	26.63	D1	Eastern, Eastern Metro	Aug NQC	QF/Selfgen
CHINO_7_MILIKN	24024	CHINO	66	1.19		Eastern, Eastern Metro	Not modeled Aug NQC	Market
COLTON_6_AGUAM1	25303	CLTNAGUA	13.8	43.00	1	Eastern, Eastern Metro	Aug NQC	MUNI
CORONS_2_SOLAR				0.00		Eastern, Eastern Metro	Not modeled Energy Only	Market
CORONS_6_CLRWTR	24210	MIRALOMA	66	14.00		Eastern, Eastern Metro	Not modeled	MUNI
CORONS_6_CLRWTR	24210	MIRALOMA	66	14.00		Eastern, Eastern Metro	Not modeled	MUNI
DELAMO_2_SOLAR1				1.12		Western	Not modeled Aug NQC	Market
DELAMO_2_SOLAR2				1.31		Western	Not modeled Aug NQC	Market
DELAMO_2_SOLRC1				0.00		Western	Not modeled Energy Only	Market
DELAMO_2_SOLRD				0.00		Western	Not modeled Energy Only	Market
DEVERS_1_QF	25636	RENWIND	115	0.22	W1	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25633	CAPWIND	115	0.46	QF	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25636	RENWIND	115	0.49	Q1	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25646	SANWIND	115	0.66	Q1	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25635	ALTWIND	115	1.11	Q1	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	24815	GARNET	115	1.24	QF	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25645	VENWIND	115	1.26	EU	Eastern, Valley-Devers	Aug NQC	QF/Selfgen

DEVERS_1_QF	25639	SEAWIND	115	1.65	QF	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25645	VENWIND	115	1.98	Q2	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25635	ALTWIND	115	2.06	Q2	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25632	TERAWND	115	2.42	QF	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_QF	25645	VENWIND	115	2.94	Q1	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
DEVERS_1_SEPV05				0.00		Eastern, Valley-Devers	Energy Only	Market
DEVERS_1_SOLAR				0.00		Eastern, Valley-Devers	Not modeled Energy Only	Market
DEVERS_1_SOLAR1				0.00		Eastern, Valley-Devers	Not modeled Energy Only	Market
DEVERS_1_SOLAR2				0.00		Eastern, Valley-Devers	Not modeled Energy Only	Market
DMDVLY_1_UNITS	25425	ESRP P2	6.9	7.51		Eastern, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
DREWS_6_PL1X4	25301	CLTNDREW	13.8	36.00	1	Eastern, Eastern Metro	Aug NQC	MUNI
DVLCYN_1_UNITS	25648	DVLCYN1G	13.8	50.34	1	Eastern, Eastern Metro	Aug NQC	MUNI
DVLCYN_1_UNITS	25649	DVLCYN2G	13.8	50.34	2	Eastern, Eastern Metro	Aug NQC	MUNI
DVLCYN_1_UNITS	25604	DVLCYN4G	13.8	67.14	4	Eastern, Eastern Metro	Aug NQC	MUNI
DVLCYN_1_UNITS	25603	DVLCYN3G	13.8	67.15	3	Eastern, Eastern Metro	Aug NQC	MUNI
ELLIS_2_QF	24197	ELLIS	66	0.01		Western	Not modeled Aug NQC	QF/Selfgen
ELSEGN_2_UN1011	28903	ELSEG6ST	18	68	6	Western, El Nido	Aug NQC	Market
ELSEGN_2_UN1011	28904	ELSEG5ST	18	195	5	Western, El Nido	Aug NQC	Market
ELSEGN_2_UN2021	28901	ELSEG8ST	18	68.68	8	Western, El Nido	Aug NQC	Market
ELSEGN_2_UN2021	28902	ELSEG7GT	18	195	7	Western, El Nido	Aug NQC	Market
ETIWND_2_CHMPNE				0.00		Eastern, Eastern Metro	Not modeled Energy Only	Market
ETIWND_2_FONTNA	24055	ETIWANDA	66	0.40		Eastern, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
ETIWND_2_RTS010	24055	ETIWANDA	66	0.92		Eastern, Eastern Metro	Not modeled Aug NQC	Market
ETIWND_2_RTS015	24055	ETIWANDA	66	1.17		Eastern, Eastern Metro	Not modeled Aug NQC	Market
ETIWND_2_RTS017	24055	ETIWANDA	66	1.72		Eastern, Eastern Metro	Not modeled Aug NQC	Market
ETIWND_2_RTS018	24055	ETIWANDA	66	0.92		Eastern, Eastern Metro	Not modeled Aug NQC	Market
ETIWND_2_RTS023	24055	ETIWANDA	66	1.09		Eastern, Eastern Metro	Not modeled Aug NQC	Market
ETIWND_2_RTS026	24055	ETIWANDA	66	1.50		Eastern, Eastern Metro	Not modeled Aug NQC	Market
ETIWND_2_RTS027	24055	ETIWANDA	66	1.50		Eastern, Eastern Metro	Not modeled Aug NQC	Market
ETIWND_2_SOLAR	24055	ETIWANDA	66	0.00		Eastern, Eastern Metro	Not modeled Energy Only	Market
ETIWND_2_UNIT1	24055	ETIWANDA	66	14.71		Eastern, Eastern Metro	Not modeled Aug NQC	Market
ETIWND_6_GRPLND	29305	ETWPKGEN	13.8	46.00	1	Eastern, Eastern Metro		Market
ETIWND_6_MWDETI	25422	ETI MWDG	13.8	1.62	1	Eastern, Eastern Metro	Aug NQC	Market
ETIWND_7_MIDVLY	24055	ETIWANDA	66	1.67		Eastern, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
GARNET_1_SOLAR	24815	GARNET	115	0.00		Eastern, Valley-Devers	Not modeled Energy Only	Market

GARNET_1_SOLAR2	24815	GARNET	115	2.77		Eastern, Valley-Devers	Not modeled Aug NQC	Market
GARNET_1_UNITS	24815	GARNET	115	0.23	G2	Eastern, Valley-Devers	Aug NQC	Market
GARNET_1_UNITS	24815	GARNET	115	0.48	G3	Eastern, Valley-Devers	Aug NQC	Market
GARNET_1_UNITS	24815	GARNET	115	0.66	G1	Eastern, Valley-Devers	Aug NQC	Market
GARNET_1_WIND	24815	GARNET	115	0.29	PC	Eastern, Valley-Devers	Aug NQC	Wind
GARNET_1_WINDS	24815	GARNET	115	1.46	W2	Eastern, Valley-Devers	Aug NQC	Wind
GARNET_1_WINDS	24815	GARNET	115	1.46	W3	Eastern, Valley-Devers	Aug NQC	Wind
GARNET_1_WT3WIND	24815	GARNET	115	0.00		Eastern, Valley-Devers	Not modeled Energy Only	Market
GARNET_2_WIND1				1.79		Eastern, Valley-Devers	Not modeled Aug NQC	Wind
GARNET_2_WIND4				1.54		Eastern, Valley-Devers	Not modeled Aug NQC	Wind
GLNARM_7_UNIT 1	29005	PASADNA1	13.8	22.07	1	Western		MUNI
GLNARM_7_UNIT 2	29006	PASADNA2	13.8	22.30	1	Western		MUNI
GLNARM_7_UNIT 3	29005	PASADNA1	13.8	44.83		Western	Not modeled	MUNI
GLNARM_7_UNIT 4	29006	PASADNA2	13.8	42.42		Western	Not modeled	MUNI
HARBGN_7_UNITS	24062	HARBOR G	13.8	0.00	1	Western	Mothballed	Market
HARBGN_7_UNITS	24062	HARBOR G	13.8	0.00	HP	Western	Mothballed	Market
HARBGN_7_UNITS	25510	HARBORG4	4.16	0.00	LP	Western	Mothballed	Market
HINSON_6_CARBG	24020	CARBGEN1	13.8	14.68	1	Western	Aug NQC	Market
HINSON_6_CARBG	24328	CARBGEN2	13.8	14.68	1	Western	Aug NQC	Market
HINSON_6_LBECH1	24170	LBEACH12	13.8	65.00	1	Western		Market
HINSON_6_LBECH2	24170	LBEACH12	13.8	65.00	2	Western		Market
HINSON_6_LBECH3	24171	LBEACH34	13.8	65.00	3	Western		Market
HINSON_6_LBECH4	24171	LBEACH34	13.8	65.00	4	Western		Market
HINSON_6_SERRGN	24139	SERRFGEN	13.8	25.73	D1	Western	Aug NQC	QF/Selfgen
INDIGO_1_UNIT 1	29190	WINTECX2	13.8	42.00	1	Eastern, Valley-Devers		Market
INDIGO_1_UNIT 2	29191	WINTECX1	13.8	42.00	1	Eastern, Valley-Devers		Market
INDIGO_1_UNIT 3	29180	WINTEC8	13.8	42.00	1	Eastern, Valley-Devers		Market
INLDEM_5_UNIT 1	29041	IEEC-G1	19.5	335.00	1	Eastern, Valley, Valley-Devers	Aug NQC	Market
INLDEM_5_UNIT 2	29042	IEEC-G2	19.5	335.00	1	Eastern, Valley, Valley-Devers	Aug NQC	Market
JOHANN_6_QFA1	24072	JOHANNA	230	0.00		Western	Not modeled Aug NQC	QF/Selfgen
LACIEN_2_VENICE	24337	VENICE	13.8	1.38	1	Western, El Nido	Aug NQC	MUNI
LAFRES_6_QF	24073	LA FRESA	66	0.00		Western, El Nido	Not modeled Aug NQC	QF/Selfgen
LAGBEL_6_QF	24075	LAGUBELL	66	9.79		Western	Not modeled Aug NQC	QF/Selfgen
LGHTHP_6_ICEGEN	24070	ICEGEN	13.8	48.00	1	Western	Aug NQC	QF/Selfgen
LGHTHP_6_QF	24083	LITEHIPE	66	0.30		Western	Not modeled Aug NQC	QF/Selfgen
MESAS_2_QF	24209	MESA CAL	66	0.04		Western	Not modeled Aug NQC	QF/Selfgen
MIRLOM_2_CORONA				2.03		Eastern, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
MIRLOM_2_ONTARO				2.38		Eastern, Eastern Metro	Energy Only	Market
MIRLOM_2_RTS032				0.75		Eastern, Eastern Metro	Not modeled Aug NQC	Market

MIRLOM_2_RTS033				0.75		Eastern, Eastern Metro	Not modeled Aug NQC	Market
MIRLOM_2_TEMESC				2.13		Eastern, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
MIRLOM_6_DELGEN	24030	DELGEN	13.8	27.66	1	Eastern, Eastern Metro	Aug NQC	QF/Selfgen
MIRLOM_6_PEAKER	29307	MRLPKGEN	13.8	46.00	1	Eastern, Eastern Metro		Market
MIRLOM_7_MWDLKM	24210	MIRALOMA	66	4.60		Eastern, Eastern Metro	Not modeled Aug NQC	MUNI
MOJAVE_1_SIPHON	25658	MJVSPHN1	13.8	4.19	2	Eastern, Eastern Metro	Aug NQC	MUNI
MOJAVE_1_SIPHON	25659	MJVSPHN1	13.8	4.19	3	Eastern, Eastern Metro	Aug NQC	MUNI
MOJAVE_1_SIPHON	25657	MJVSPHN1	13.8	4.20	1	Eastern, Eastern Metro	Aug NQC	MUNI
MTWIND_1_UNIT 1	29060	MOUNTWND	115	4.07	S1	Eastern, Valley-Devers	Aug NQC	Wind
MTWIND_1_UNIT 2	29060	MOUNTWND	115	1.88	S2	Eastern, Valley-Devers	Aug NQC	Wind
MTWIND_1_UNIT 3	29060	MOUNTWND	115	1.64	S3	Eastern, Valley-Devers	Aug NQC	Wind
OLINDA_2_COYCRK	24211	OLINDA	66	3.13		Western	Not modeled	QF/Selfgen
OLINDA_2_LNDFL2	29011	BREAPWR2	13.8	3.88	C1	Western	Aug NQC	Market
OLINDA_2_LNDFL2	29011	BREAPWR2	13.8	3.88	C2	Western	Aug NQC	Market
OLINDA_2_LNDFL2	29011	BREAPWR2	13.8	3.88	C3	Western	Aug NQC	Market
OLINDA_2_LNDFL2	29011	BREAPWR2	13.8	3.88	C4	Western	Aug NQC	Market
OLINDA_2_LNDFL2	29011	BREAPWR2	13.8	6.98	S1	Western	Aug NQC	Market
OLINDA_2_QF	24211	OLINDA	66	0.11	1	Western	Aug NQC	QF/Selfgen
OLINDA_7_LNDFIL	24211	OLINDA	66	0.05		Western	Not modeled Aug NQC	QF/Selfgen
PADUA_2_ONTARO	24111	PADUA	66	0.19		Eastern, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
PADUA_2_SOLAR1	24111	PADUA	66	0.00		Eastern, Eastern Metro	Not modeled Energy Only	Market
PADUA_6_MWDSDM	24111	PADUA	66	3.71		Eastern, Eastern Metro	Not modeled Aug NQC	MUNI
PADUA_6_QF	24111	PADUA	66	0.48		Eastern, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
PADUA_7_SDIMAS	24111	PADUA	66	1.05		Eastern, Eastern Metro	Not modeled Aug NQC	Market
PANSEA_1_PANARO	25640	PANAERO	115	0.26	QF	Eastern, Valley-Devers	Aug NQC	Wind
PWEST_1_UNIT				0.12		Western	Not modeled Aug NQC	Market
RENWD_1_QF	25636	RENWIND	115	2.47	Q2	Eastern, Valley-Devers	Aug NQC	QF/Selfgen
RHONDO_2_QF	24213	RIOHONDO	66	0.40		Western	Not modeled Aug NQC	QF/Selfgen
RHONDO_6_PUENTE	24213	RIOHONDO	66	0.00		Western	Not modeled Aug NQC	Net Seller
RVSIDE_2_RERCU3	24299	RERC2G3	13.8	48.50	1	Eastern, Eastern Metro		MUNI
RVSIDE_2_RERCU4	24300	RERC2G4	13.8	48.50	1	Eastern, Eastern Metro		MUNI
RVSIDE_6_RERCU1	24242	RERC1G	13.8	48.35	1	Eastern, Eastern Metro		MUNI
RVSIDE_6_RERCU2	24243	RERC2G	13.8	48.50	1	Eastern, Eastern Metro		MUNI
RVSIDE_6_SOLAR1	24244	SPRINGEN	13.8	7.02		Eastern, Eastern Metro	Not modeled Aug NQC	Market
RVSIDE_6_SPRING	24244	SPRINGEN	13.8	36.00	1	Eastern, Eastern Metro		Market
SANTGO_6_COYOTE	24133	SANTIAGO	66	5.63	1	Western	Aug NQC	Market
SANWD_1_QF	25646	SANWIND	115	1.75	Q2	Eastern, Valley-Devers	Aug NQC	Wind
SBERDO_2_PSP3	24921	MNTV-CT1	18	129.71	1	Eastern, West of Devers, Eastern Metro		Market
SBERDO_2_PSP3	24922	MNTV-CT2	18	129.71	1	Eastern, West of Devers, Eastern Metro		Market

SBERDO_2_PSP3	24923	MNTV-ST1	18	225.08	1	Eastern, West of Devers, Eastern Metro		Market
SBERDO_2_PSP4	24924	MNTV-CT3	18	129.71	1	Eastern, West of Devers, Eastern Metro		Market
SBERDO_2_PSP4	24925	MNTV-CT4	18	129.71	1	Eastern, West of Devers, Eastern Metro		Market
SBERDO_2_PSP4	24926	MNTV-ST2	18	225.08	1	Eastern, West of Devers, Eastern Metro		Market
SBERDO_2_QF	24214	SANBRDNO	66	0.06		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
SBERDO_2_REDLND	24214	SANBRDNO	66	0.66		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	Market
SBERDO_2_RTS005	24214	SANBRDNO	66	1.28		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	Market
SBERDO_2_RTS007	24214	SANBRDNO	66	1.15		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	Market
SBERDO_2_RTS011	24214	SANBRDNO	66	2.62		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	Market
SBERDO_2_RTS013	24214	SANBRDNO	66	2.62		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	Market
SBERDO_2_RTS016	24214	SANBRDNO	66	1.12		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	Market
SBERDO_2_RTS048	24214	SANBRDNO	66	0.00		Eastern, West of Devers, Eastern Metro	Not modeled Energy Only	Market
SBERDO_2_SNTANA	24214	SANBRDNO	66	0.00		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
SBERDO_6_MILLCK	24214	SANBRDNO	66	0.64		Eastern, West of Devers, Eastern Metro	Not modeled Aug NQC	QF/Selfgen
SENTNL_2_CTG1	29101	TOT032G1	13.8	91	1	Eastern, Valley-Devers		Market
SENTNL_2_CTG2	29102	TOT032G2	13.8	91	1	Eastern, Valley-Devers		Market
SENTNL_2_CTG3	29103	TOT032G3	13.8	91	1	Eastern, Valley-Devers		Market
SENTNL_2_CTG4	29104	TOT032G4	13.8	91	1	Eastern, Valley-Devers		Market
SENTNL_2_CTG5	29105	TOT032G5	13.8	91	1	Eastern, Valley-Devers		Market
SENTNL_2_CTG6	29106	TOT032G6	13.8	91	1	Eastern, Valley-Devers		Market
SENTNL_2_CTG7	29107	TOT032G7	13.8	91	1	Eastern, Valley-Devers		Market
SENTNL_2_CTG8	29108	TOT032G8	13.8	91	1	Eastern, Valley-Devers		Market
TIFFNY_1_DILLON				4.01		Western	Not modeled Aug NQC	Wind
TRNSWD_1_QF	25637	TRANWIND	115	4.66	QF	Eastern, Valley-Devers	Aug NQC	Wind
VALLEY_5_PERRIS	24160	VALLEYSC	115	7.94		Eastern, Valley, Valley-Devers	Not modeled Aug NQC	QF/Selfgen
VALLEY_5_REDMTN	24160	VALLEYSC	115	1.52		Eastern, Valley, Valley-Devers	Not modeled Aug NQC	QF/Selfgen
VALLEY_5_RTS044	24160	VALLEYSC	115	3.90		Eastern, Valley, Valley-Devers	Not modeled Aug NQC	Market
VALLEY_5_SOLAR1	24160	VALLEYSC	115	0.00		Eastern, Valley, Valley-Devers	Not modeled Energy Only	Market
VALLEY_5_SOLAR2	24160	VALLEYSC	115	14.97		Eastern, Valley, Valley-Devers	Not modeled Aug NQC	Market
VALLEY_7_BADLND	24160	VALLEYSC	115	0.30		Eastern, Valley, Valley-Devers	Not modeled Aug NQC	Market
VALLEY_7_UNITA1	24160	VALLEYSC	115	2.30		Eastern, Valley, Valley-Devers	Not modeled Aug NQC	Market
VERNON_6_GONZL1				5.75		Western	Not modeled	MUNI
VERNON_6_GONZL2				5.75		Western	Not modeled	MUNI
VERNON_6_MALBRG	24239	MALBRG1G	13.8	42.37	C1	Western		MUNI
VERNON_6_MALBRG	24240	MALBRG2G	13.8	42.37	C2	Western		MUNI

VERNON_6_MALBRG	24241	MALBRG3G	13.8	49.26	S3	Western		MUNI
VILLPK_2_VALLYV	24216	VILLA PK	66	4.10		Western	Not modeled Aug NQC	QF/Selfgen
VILLPK_6_MWDYOR	24216	VILLA PK	66	3.40		Western	Not modeled Aug NQC	MUNI
VISTA_2_RIALTO	24901	VSTA	230	0.00		Eastern, Eastern Metro	Energy Only	Market
VISTA_2_RTS028	24901	VSTA	230	2.25		Eastern, Eastern Metro	Not modeled Aug NQC	Market
VISTA_6_QF	24902	VSTA	66	0.11	1	Eastern, Eastern Metro	Aug NQC	QF/Selfgen
WALCRK_2_CTG1	29201	EME WCG1	13.8	96	1	Western		Market
WALCRK_2_CTG2	29202	EME WCG2	13.8	96	1	Western		Market
WALCRK_2_CTG3	29203	EME WCG3	13.8	96	1	Western		Market
WALCRK_2_CTG4	29204	EME WCG4	13.8	96	1	Western		Market
WALCRK_2_CTG5	29205	EME WCG5	13.8	96.65	1	Western		Market
WALNUT_2_SOLAR				0.00		Western	Not modeled Energy Only	Market
WALNUT_6_HILLGEN	24063	HILLGEN	13.8	47.73	D1	Western	Aug NQC	QF/Selfgen
WALNUT_7_WCOVCT	24157	WALNUT	66	0.00		Western	Not modeled Aug NQC	Market
WALNUT_7_WCOVST	24157	WALNUT	66	5.08		Western	Not modeled Aug NQC	Market
WHTWTR_1_WINDA1	29061	WHITEWTR	33	3.97	1	Eastern, Valley-Devers	Aug NQC	Wind
ARCOGN_2_UNITS	24018	BRIGEN	13.8	0.00	1	Western	No NQC - hist. data	Net Seller
HINSON_6_QF	24064	HINSON	66	0.00	1	Western	No NQC - hist. data	QF/Selfgen
INLAND_6_UNIT	24071	INLAND	13.8	15.20	1	Eastern, Eastern Metro	No NQC - hist. data	QF/Selfgen
MOBGEN_6_UNIT 1	24094	MOBGEN	13.8	0.00	1	Western, El Nido	No NQC - hist. data	QF/Selfgen
NA	24325	ORCOGEN	13.8	0.00	1	Western	No NQC - hist. data	QF/Selfgen
NA	24327	THUMSGEN	13.8	0.00	1	Western	No NQC - hist. data	QF/Selfgen
NA	24329	MOBGEN2	13.8	0.00	1	Western, El Nido	No NQC - hist. data	QF/Selfgen
NA	24330	OUTFALL1	13.8	0.00	1	Western, El Nido	No NQC - hist. data	QF/Selfgen
NA	24331	OUTFALL2	13.8	0.00	1	Western, El Nido	No NQC - hist. data	QF/Selfgen
NA	29021	WINTEC6	115	0.00	1	Eastern, Valley-Devers	No NQC - hist. data	Wind
NA	29260	ALTAMSA4	115	0.00	1	Eastern, Valley-Devers	No NQC - hist. data	Wind
NA	29340	CLRWTRST	13.8	0.00	S1	Eastern, Eastern Metro	No NQC - hist. data	QF/Selfgen
NA	24324	SANIGEN	13.8	1.40	D1	Eastern, Eastern Metro	No NQC - hist. data	QF/Selfgen
NA	24332	PALOGEN	13.8	1.40	D1	Western, El Nido	No NQC - hist. data	QF/Selfgen
NA	24342	FEDGEN	13.8	5.80	1	Western	No NQC - hist. data	QF/Selfgen
NA	24341	COYGEN	13.8	6.30	1	Western	No NQC - hist. data	QF/Selfgen
NA	29951	REFUSE	13.8	9.80	D1	Western	No NQC - Pmax	QF/Selfgen

NA	29953	SIGGEN	13.8	18.60	D1	Western	No NQC - Pmax	QF/Selfgen
NA	29338	CLRWTRCT	13.8	20.70	G1	Eastern, Eastern Metro	No NQC - hist. data	QF/Selfgen
NA	29339	DELGEN	13.8	29.50	1	Eastern, Eastern Metro	No NQC - hist. data	QF/Selfgen
New	90000	ALMT-GT1	18	200.00	X1	Western	No NQC - Pmax	Market
New	90001	ALMT-GT2	18	200.00	X2	Western	No NQC - Pmax	Market
New	90003	HUNT-GT1	18	202.00	X1	Western	No NQC - Pmax	Market
New	90004	HUNT-GT2	18	202.00	X2	Western	No NQC - Pmax	Market
New	90002	ALMT-ST1	18	240.00	X3	Western	No NQC - Pmax	Market
New	90005	HUNT-ST1	18	240.00	X3	Western	No NQC - Pmax	Market
ALAMIT_7_UNIT 1	24001	ALAMT1 G	18	0.00	1	Western	Retired by 2021	Market
ALAMIT_7_UNIT 2	24002	ALAMT2 G	18	0.00	2	Western	Retired by 2021	Market
ALAMIT_7_UNIT 3	24003	ALAMT3 G	18	0.00	3	Western	Retired by 2021	Market
ALAMIT_7_UNIT 4	24004	ALAMT4 G	18	0.00	4	Western	Retired by 2021	Market
ALAMIT_7_UNIT 5	24005	ALAMT5 G	20	0.00	5	Western	Retired by 2021	Market
ALAMIT_7_UNIT 6	24161	ALAMT6 G	20	0.00	6	Western	Retired by 2021	Market
ELSEGN_7_UNIT 4	24048	ELSEG4 G	18	0.00	4	Western, El Nido	Retired	Market
ETIWND_7_UNIT 3	24052	MTNVIST3	18	0.00	3	Eastern, Eastern Metro	Assumed retirement by age	Market
ETIWND_7_UNIT 4	24053	MTNVIST4	18	0.00	4	Eastern, Eastern Metro	Assumed retirement by age	Market
HNTGBH_7_UNIT 1	24066	HUNT1 G	13.8	0.00	1	Western	Retired by 2021	Market
HNTGBH_7_UNIT 2	24067	HUNT2 G	13.8	0.00	2	Western	Retired by 2021	Market
REDOND_7_UNIT 5	24121	REDON5 G	18	0.00	5	Western	Retired by 2021	Market
REDOND_7_UNIT 6	24122	REDON6 G	18	0.00	6	Western	Retired by 2021	Market
REDOND_7_UNIT 7	24123	REDON7 G	20	0.00	7	Western	Retired by 2021	Market
REDOND_7_UNIT 8	24124	REDON8 G	20	0.00	8	Western	Retired by 2021	Market
SONGS_7_UNIT 2	24129	S.ONOFR2	22	0.00	R2	None	Retired	Nuclear
SONGS_7_UNIT 3	24130	S.ONOFR3	22	0.00	R3	None	Retired	Nuclear

Major new projects modeled:

1. Vincent-Mira Loma 500 kV (part of Tehachapi Upgrade)
2. East County 500kV Substation (ECO)
3. Mesa Loop-In Project and South of Mesa 230 kV line upgrades
4. Imperial Valley Phase Shifting Transformers (2x400 MVA)
5. Delaney – Colorado River 500 kV Line
6. Hassayampa – North Gila #2 500 kV Line (APS)
7. Bay Blvd. Substation Project
8. Sycamore – Pecos 230 kV Line
9. Talega Synchronous Condensers (2x225 MVAR)
10. San Luis Rey Synchronous Condensers (2x225 MVAR)
11. San Onofre Synchronous Condenser (225 MVAR)

- 12. Santiago Synchronous Condenser (225 MVAR)
- 13. Bypass series capacitors on the ECO-Miguel and Ocotillo-Suncrest 500kV lines
- 14. West of Devers 230 kV line upgrades
- 15. Carlsbad Energy Center (500 MW)
- 16. Pio Pico peakers (300 MW)
- 17. Battery energy storage system projects in the LA Basin and San Diego area
(CPUC-approved projects related to the Aliso Canyon gas storage constraint)

Critical Contingency Analysis Summary

El Nido Sub-area:

The most critical contingency could be the loss of La Fresa - Redondo #1 and #2 230 kV lines followed by the loss of Hinson - La Fresa 230 kV line, which would result in voltage collapse. This limiting contingency establishes a local capacity need of 305 MW (includes 1 MW of QF, 1 MW of MUNI generation, 7 MW of 20-minute demand response and 20 MW of long-term procurement plan preferred resources) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

The following table has effectiveness factors for resources in this sub-area.

Gen Bus	Gen Name	MW Eff Fctr (%)
24022	CHEVGEN1	100
24023	CHEVGEN2	100
28903	ELSEG6ST	100
28904	ELSEG5ST	100
28901	ELSEG8ST	100
28902	ELSEG7GT	100
24337	VENICE	100
24094	MOBGEN	0
24329	MOBGEN2	0
24330	OUTFALL1	0
24331	OUTFALL2	0
24332	PALOGEN	0

Western LA Basin Sub-area:

The most critical contingency is the loss of one of the Serrano - Villa Park 230 kV #2 line followed by the loss of the Serrano - Lewis 230 kV line, which would result in thermal overload of the Serrano - Villa Park 230 kV line #1. This limiting contingency establishes a local capacity need of 4136 MW (includes 201 MW of QF, 4 MW of wind and 582 MW of MUNI generation, 432 MW preferred resources and 162 MW of 20-minute “fast” demand response) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

The following table has units that have at least 5% effectiveness factors.

Resource Locations Effectiveness Factor (%)

REFUSE	13.8 #D1	-34.52
MALBRG1G	13.8 #C1	-34.42
ELSEG6ST	13.8 #6	-26.66
ELSEG5GT	16.5 #5	-26.64
VENICE	13.8 #1	-26.22
MOBGEN1	13.8 #1	-26.18
PALOGEN	13.8 #D1	-26.18
ARCO 1G	13.8 #1	-23.13
HARBOR G	13.8 #1	-23.03
THUMSGEN	13.8 #1	-23.03
CARBGEN1	13.8 #1	-23.02
SERRFGEN	13.8 #D1	-23.02
ICEGEN	13.8 #D1	-22.33
ALMITOSW	66.0 #I3	-18.01
ALAMTX1	18.0 #X1	-17.93
CTRPKGEN	13.8 #1	-17.51
SIGGEN	13.8 #D1	-17.51
BARRE	66.0 #m3	-12.76
BARPKGEN	13.8 #1	-12.71
RIOHONDO	66.0 #I8	-12.5
WALNUT	66.0 #I3	-12.29
OLINDA	66.0 #1	-12.07
EME WCG1	13.8 #1	-12
BREAPWR2	13.8 #C4	-11.98
ELLIS	66.0 #I7	-11.98
JOHANNA	66.0 #I5	-11.42
SANTIAGO	66.0 #I8	-10.63

DowlingCTG 13.8 #1	-9.62
CanyonGT 1 13.8 #1	-9.58
VILLA PK 66.0 #12	-9.29

There are numerous other combinations of contingencies in the area that could overload a significant number of 230 kV lines in this sub-area/area and have slightly less LCR need. As such, anyone of them (combination of contingencies) could become binding for any given set of procured resources. As a result, these effectiveness factors may not facilitate more informed procurement.

West of Devers Sub-area:

There are no local capacity requirements due to implementation of the Mesa Loop-in as well as West of Devers reconductoring projects.

Valley-Devers Sub-area:

There are no local capacity requirements due to implementation of the Colorado River-Delany 500 kV line project.

Valley Sub-area:

There are no local capacity requirements due to implementation of the Colorado River-Delany 500 kV line project.

Eastern LA Basin Sub-area:

The most critical contingency is the loss of the Alberhill - Serrano 500 kV line, followed by an N-2 of Red Bluff-Devers #1 and #2 500 kV lines, which would result in voltage instability. This limiting contingency establishes a local capacity need of about 2841 MW (this includes 198 MW of QF, 37 MW of wind and 593 MW of Muni generation, as well as 160 MW of 20-minute demand response in the area) as the minimum capacity necessary for reliable load serving capability within this subarea. The available resources in the Eastern LA Basin subarea are sufficient to meet this local capacity requirement.

LA Basin Overall:

The critical contingency is driven by the combined LA Basin and San Diego sub-area.

Combined LA Basin and San Diego:

The local capacity requirements for the combined LA Basin and San Diego sub-area is the same as the LA Basin/San Diego/Imperial Valley need; the overlapping G-1/N-1 outage (NERC P3 category) of Termoelectrica de Mexicali (TDM) combined cycle plant (593 MW), followed by an N-1 contingency of the Imperial Valley – North Gila 500 kV line. This overlapping contingency could causes thermal overload on the “S” line (El Centro – Imperial Valley 230 kV line) between Imperial Irrigation District (IID) and SDG&E. This limiting contingency establishes a total local capacity need for the combined LA Basin/San Diego sub-area of 10,041 MW in the 2026 time frame as follows: 7,234 MW in the LA Basin (includes 399 MW of QF, 41 MW of wind and 1175 MW of MUNI generation, 432 MW of long-term procurement plan preferred resources, as well as 322 MW of 20-minute demand response) and 2,807 MW in the San Diego sub-area (includes 103 MW of QF generation, 5 MW of wind, 19 MW of 20-minute demand response and 38 MW of CPUC-approved battery energy storage) as the minimum capacity necessary for reliable load serving capability within these areas.

The second most critical contingency (N-1-1 or NERC P6) resulting in thermal limiting constraint, with slightly lower LCR need, for the combined LA Basin and San Diego sub-area is the overlapping outage of ECO-Miguel 500 kV line, system readjustment, followed by Ocotillo-Suncrest 500 kV line. This contingency could cause loading concern for the CFE/CENACE’s La Rosita-Rumorosa 230 kV line. This limiting contingency establishes a total local capacity need for the combined LA Basin/San Diego sub-area of 9,729 MW in 2026 time as follows: 7,122 MW in the LA Basin (includes 399 MW of QF, 41 MW of wind and 1175 MW of MUNI generation, 432 MW of long-term procurement plan preferred resources, as well as 322 MW of 20-minute demand response) and 2,607 MW in the San Diego sub-area (includes 103 MW of QF generation, 5 MW of wind, 19 MW of 20-minute demand response and 38 MW of CPUC-approved battery energy storage).

Effectiveness factors:

The following table has LA Basin resources.

<u>Resource Locations</u>	<u>Effectiveness Factor (%)</u>
SANTIAGO 66.0 #DG	-6.93
COYGEN 13.8 #1	-6.92
WDT1406_G 0.5 #1	-6.66
JOHANNA 66.0 #I4	-5.98
ELLIS 66.0 #I3	-5.22
HUNT-GT1 18.0 #X1	-4.9
HUNT-GT2 18.0 #X2	-4.9
HUNT-ST1 18.0 #X3	-4.9
BARPKGEN 13.8 #1	-4
BARRE 1G 13.8 #X1	-3.77
BARRE 2G 13.8 #X2	-3.77
VILLA PK 66.0 #I2	-3.77
VILLA PK 66.0 #DG	-3.77
DowlingCTG 13.8 #1	-3.6
CanyonGT 1 13.8 #1	-3.58
CanyonGT 2 13.8 #2	-3.58
CanyonGT 3 13.8 #3	-3.58
CanyonGT 4 13.8 #4	-3.58
ALMT-GT1 18.0 #X1	-3.27
SANIGEN 13.8 #D1	-3.18
CIMGEN 13.8 #D1	-3.14
SIMPSON 13.8 #D1	-3.12
ALMT-GT2 18.0 #X2	-3.11
ALMT-ST1 18.0 #X3	-3.11
SIGGEN 13.8 #D1	-2.96
ICEGEN 13.8 #D1	-2.92
WDT1250BES 0.5 #1	-2.9
CTRPKGEN 13.8 #1	-2.87
WDT1429_BA 0.5 #1	-2.86
LCIENEGA 66.0 #I4	-2.85
VENICE 13.8 #1	-2.85
CARBGEN1 13.8 #1	-2.83
CARBGEN2 13.8 #1	-2.83

PALOGEN	13.8 #D1	-2.83
THUMSGEN	13.8 #1	-2.83
SERRFGEN	13.8 #D1	-2.82
ARCO 1G	13.8 #1	-2.81
ARCO 2G	13.8 #2	-2.81
ARCO 3G	13.8 #3	-2.81
ARCO 4G	13.8 #4	-2.81
MOBGEN1	13.8 #1	-2.81
MOBGEN2	13.8 #1	-2.81
OUTFALL1	13.8 #1	-2.81
OUTFALL2	13.8 #1	-2.81
ARCO 6G	13.8 #6	-2.8
CHEVGEN 1	13.8 #1	-2.79
CHEVGEN 2	13.8 #2	-2.79
CHEVGEN 5	13.8 #1	-2.79
CHEVGEN 5	13.8 #2	-2.79
ARCO 5G	13.8 #5	-2.78
LBEACH34	13.8 #3	-2.75
LBEACH34	13.8 #4	-2.75
LBEACH12	13.8 #2	-2.74
LBEACH12	13.8 #1	-2.74
ELSEG7GT	16.5 #7	-2.7
ELSEG5GT	16.5 #5	-2.68
ELSEG6ST	13.8 #6	-2.68
ELSEG8ST	13.8 #8	-2.67
CLRWTRST	12.5 #S1	-2.65
DELGEN	13.8 #1	-2.65
CLRWTRCT	12.5 #G1	-2.63
WDT1425_G1	0.5 #1	-2.62
WDT1426_G2	0.5 #1	-2.62
FEDGEN	13.8 #1	-2.61
MRLPKGGEN	13.8 #1	-2.61
WALNUT	66.0 #13	-2.6
WALNUT	66.0 #12	-2.6
REFUSE	13.8 #D1	-2.58
HILLGEN	13.8 #D1	-2.56
MALBRG2G	13.8 #C2	-2.56

BREAPWR2	13.8 #C1	-2.53
MALBRG1G	13.8 #C1	-2.53
WALCRKG4	13.8 #1	-2.44
WALCRKG5	13.8 #1	-2.44
WALCRKG1	13.8 #1	-2.39
WALCRKG2	13.8 #1	-2.39
WALCRKG3	13.8 #1	-2.39
RIOHONDO	66.0 #DG	-2.38
RIOHONDO	66.0 #17	-2.38
RIOHONDO	66.0 #12	-2.38
RIOHONDO	66.0 #18	-2.38
RIOHONDO	66.0 #m2	-2.38
PASADNA1	13.8 #1	-2.24
PASADNA3	13.8 #1	-2.21
PASADNA4	13.8 #1	-2.21
PASADNA2	13.8 #1	-2.2
PADUA	66.0 #18	-1.95
ETI MWDG	13.8 #1	-1.78
APPGEN1G	13.8 #1	-1.76
APPGEN2G	13.8 #2	-1.76
APPGEN3G	13.8 #3	-1.76
WDT1430_BA	0.5 #1	-1.76
ETWPKGEN	13.8 #1	-1.75
MTNVIST3	18.0 #3	-1.67
MTNVIST4	18.0 #4	-1.67
RERC1G	13.8 #1	-1.53
RERC2G	13.8 #1	-1.53
RERC2G3	16.5 #1	-1.51
RERC2G4	16.5 #1	-1.51
ALPINE_G	0.5 #EQ	-1.44
LUZ8 G	13.8 #8	-1.31
KERRMGEE	13.8 #1	-1.3
LUZ9 G	13.8 #9	-1.29
CLTNAGUA	13.8 #1	-1.18
SPRINGS1	13.8 #1	-1.16
SPRINGS2	13.8 #1	-1.16
SPRINGS3	13.8 #1	-1.16

SPRINGS4	13.8 #1	-1.16
DVLCYN1G	13.8 #1	-1.03
DVLCYN2G	13.8 #2	-1.03
DVLCYN3G	13.8 #3	-1.02
DVLCYN4G	13.8 #4	-1.02

Changes compared to last year's results:

Compared with 2021 the load forecast has decreased by 263 MW. The LA Basin LCR need has increased by 630 MW, mainly due to transmission and resource configuration change in the CFE system.

LA Basin Overall Requirements:

2026	QF (MW)	Wind (MW)	Muni (MW)	Battery St. (MW)	Preffered Res. (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	399	41	1175	62	431	5408	7795

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ²¹	7234	0	7234
Category C (Multiple) ²²	7234	0	7234

9. Big Creek/Ventura Area

Area Definition

The transmission tie lines into the Big Creek/Ventura Area are:

- 1) Antelope #1 500/230 kV Transformer
- 2) Antelope #2 500/230 kV Transformer
- 3) Sylmar - Pardee 230 kV #1 and #2 Lines

²¹ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

²² LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 4) Vincent - Pardee 230 kV #2 Line
- 5) Vincent - Santa Clara 230 kV Line

The substations that delineate the Big Creek/Ventura Area are:

- 1) Antelope 500 kV is out Antelope 230 kV is in
- 2) Antelope 500 kV is out Antelope 230 kV is in
- 3) Sylmar is out Pardee is in
- 4) Vincent is out Pardee is in
- 5) Vincent is out Santa Clara is in

The CEC-adopted demand forecast for 2026 is 3,807 MW²³ (this includes loads & losses and 305 MW AAEE). The total adjusted demand after including 200 MW peak shift adjustment²⁴ is 4,007 MW. A total of 3,973 MW of adjusted peak demand was modeled for the study.

Total units and qualifying capacity available in the Big Creek/Ventura area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
ACACIA_6_SOLAR	29878	ACACIA_G	0.48	0.00	EQ	Big Creek	Energy Only	Market
ALAMO_6_UNIT	25653	ALAMO SC	13.8	15.07	1	Big Creek	Aug NQC	MUNI
BIGCRK_2_EXESWD	24323	PORTAL	4.8	9.35	1	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24310	B CRK2-3	7.2	16.55	5	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24310	B CRK2-3	7.2	18.02	6	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24309	B CRK2-2	7.2	18.22	3	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24309	B CRK2-2	7.2	19.19	4	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24306	B CRK1-1	7.2	19.38	1	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24306	B CRK1-1	7.2	21.03	2	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24307	B CRK1-2	13.8	21.03	3	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24315	B CRK 8	13.8	23.76	81	Big Creek, Rector, Vestal	Aug NQC	Market

²³ CEC-adopted 2015 IEPR demand forecast for 2016-2026, January 2016, for Mid Demand Baseline Case with Low AAEE Savings.

²⁴ The CEC provided a total of 1,010 MW of peak shift for all of SCE area. It is estimated that about 696 MW is for the LA Basin based on the ratio of the behind-the-meter PV modeled in the LA Basin vs. entire SCE area (i.e., 1195 MW / 1735 MW). The CEC provided the amount of peak shift adjustment for all of SCE area for the 2015 IEPR demand forecast to the ISO in November 2016.

BIGCRK_2_EXESWD	24307	B CRK1-2	13.8	30.39	4	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24311	B CRK3-1	13.8	34.09	1	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24311	B CRK3-1	13.8	34.09	2	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24312	B CRK3-2	13.8	34.09	3	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24313	B CRK3-3	13.8	37.99	5	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24312	B CRK3-2	13.8	39.93	4	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24315	B CRK 8	13.8	42.85	82	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24314	B CRK 4	11.5	49.09	41	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24314	B CRK 4	11.5	49.28	42	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24308	B CRK2-1	13.8	49.48	1	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24308	B CRK2-1	13.8	50.64	2	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24317	MAMOTH1G	13.8	91.07	1	Big Creek, Rector, Vestal	Aug NQC	Market
BIGCRK_2_EXESWD	24318	MAMOTH2G	13.8	91.07	2	Big Creek, Rector, Vestal	Aug NQC	Market
DELSUR_6_DRYFRB				3.46		Big Creek	Not modeled Aug NQC	Market
DELSUR_6_SOLAR1				4.49		Big Creek	Not modeled Aug NQC	Market
EASTWD_7_UNIT	24319	EASTWOOD	13.8	199.00	1	Big Creek, Rector, Vestal		Market
EDMONS_2_NSPIN	25605	EDMON1AP	14.4	16.86	1	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25606	EDMON2AP	14.4	16.86	2	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25607	EDMON3AP	14.4	16.86	3	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25607	EDMON3AP	14.4	16.86	4	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25608	EDMON4AP	14.4	16.86	5	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25608	EDMON4AP	14.4	16.86	6	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25609	EDMON5AP	14.4	16.86	7	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25609	EDMON5AP	14.4	16.86	8	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25610	EDMON6AP	14.4	16.86	9	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25610	EDMON6AP	14.4	16.86	10	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25611	EDMON7AP	14.4	16.86	11	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25611	EDMON7AP	14.4	16.86	12	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25612	EDMON8AP	14.4	16.86	13	Big Creek	Pumps	MUNI
EDMONS_2_NSPIN	25612	EDMON8AP	14.4	16.86	14	Big Creek	Pumps	MUNI
GLOW_6_SOLAR	29896	APPINV	0.42	0.00	EQ	Big Creek	Energy Only	Market
GOLETA_2_QF	24057	GOLETA	66	0.08		Ventura, S.Clara, Moorpark	Not modeled Aug NQC	QF/Selfgen
GOLETA_6_ELLWOD	29004	ELLWOOD	13.8	54.00	1	Ventura, S.Clara, Moorpark		Market

GOLETA_6_EXGEN	24326	EXGEN1	13.8	0.32	S1	Ventura, S.Clara, Moorpark	Aug NQC	QF/Selfgen
GOLETA_6_EXGEN	24362	EXGEN2	13.8	0.47	G1	Ventura, S.Clara, Moorpark	Aug NQC	QF/Selfgen
GOLETA_6_GAVOTA	24057	GOLETA	66	0.68		Ventura, S.Clara, Moorpark	Not modeled Aug NQC	Market
GOLETA_6_TAJIGS	24057	GOLETA	66	2.90		Ventura, S.Clara, Moorpark	Not modeled Aug NQC	Market
LEBECS_2_UNITS	29055	PSTRIAS2	18	78.90	S2	Big Creek	Aug NQC	Market
LEBECS_2_UNITS	29051	PSTRIAG1	18	157.90	G1	Big Creek	Aug NQC	Market
LEBECS_2_UNITS	29052	PSTRIAG2	18	157.90	G2	Big Creek	Aug NQC	Market
LEBECS_2_UNITS	29054	PSTRIAG3	18	157.90	G3	Big Creek	Aug NQC	Market
LEBECS_2_UNITS	29053	PSTRIAS1	18	162.40	S1	Big Creek	Aug NQC	Market
LITLRK_6_SEPV01				0.00		Big Creek	Not modeled Energy Only	Market
LITLRK_6_SOLAR1				3.45		Big Creek	Not modeled Aug NQC	Market
LITLRK_6_SOLAR4				2.08		Big Creek	Not modeled Aug NQC	Market
LNCSTR_6_SOLAR				7.02		Big Creek	Not modeled Aug NQC	Market
MNDALY_6_MCGRTH	29306	MCGPKGEN	13.8	47.20	1	Ventura, S.Clara, Moorpark		Market
MOORPK_2_CALABS	24099	MOORPARK	230	4.19		Ventura, Moorpark	Not modeled	Market
MOORPK_6_QF	29952	CAMGEN	13.8	26.81	D1	Ventura, S.Clara, Moorpark	Aug NQC	QF/Selfgen
MOORPK_7_UNITA1	24098	MOORPARK	66	2.12		Ventura, Moorpark	Not modeled Aug NQC	QF/Selfgen
NEENCH_6_SOLAR	29900	ALPINE_G	0.48	50.05	EQ	Big Creek	Aug NQC	Market
OASIS_6_SOLAR2				13.85		Big Creek	Not modeled Aug NQC	Market
OMAR_2_UNIT 1	24102	OMAR 1G	13.8	77.10	1	Big Creek		Net Seller
OMAR_2_UNIT 2	24103	OMAR 2G	13.8	77.25	2	Big Creek		Net Seller
OMAR_2_UNIT 3	24104	OMAR 3G	13.8	77.25	3	Big Creek		Net Seller
OMAR_2_UNIT 4	24105	OMAR 4G	13.8	77.25	4	Big Creek		Net Seller
OSO_6_NSPIN	25614	OSO A P	13.2	2.25	1	Big Creek	Pumps	MUNI
OSO_6_NSPIN	25614	OSO A P	13.2	2.25	2	Big Creek	Pumps	MUNI
OSO_6_NSPIN	25614	OSO A P	13.2	2.25	3	Big Creek	Pumps	MUNI
OSO_6_NSPIN	25614	OSO A P	13.2	2.25	4	Big Creek	Pumps	MUNI
OSO_6_NSPIN	25615	OSO B P	13.2	2.25	5	Big Creek	Pumps	MUNI
OSO_6_NSPIN	25615	OSO B P	13.2	2.25	6	Big Creek	Pumps	MUNI
OSO_6_NSPIN	25615	OSO B P	13.2	2.25	7	Big Creek	Pumps	MUNI
OSO_6_NSPIN	25615	OSO B P	13.2	2.25	8	Big Creek	Pumps	MUNI
PANDOL_6_UNIT	24113	PANDOL	13.8	20.94	2	Big Creek, Vestal	Aug NQC	Market
PANDOL_6_UNIT	24113	PANDOL	13.8	25.70	1	Big Creek, Vestal	Aug NQC	Market
PLAINV_6_BSOLAR				0.00		Big Creek	Not modeled Energy Only	Market
RECTOR_2_KAWEAH	24212	RECTOR	66	0.00		Big Creek, Rector, Vestal	Not modeled Aug NQC	Market
RECTOR_2_KAWH 1	24212	RECTOR	66	0.31		Big Creek, Rector, Vestal	Not modeled Aug NQC	Market

RECTOR_2_QF	24212	RECTOR	66	0.41		Big Creek, Rector, Vestal	Not modeled Aug NQC	QF/Selfgen
RECTOR_7_TULARE	24212	RECTOR	66	0.00		Big Creek, Rector, Vestal	Not modeled	Market
RSMSLR_6_SOLAR1				16.81		Big Creek	Not modeled Aug NQC	Market
RSMSLR_6_SOLAR2				15.57		Big Creek	Not modeled Aug NQC	Market
SAUGUS_2_TOLAND	24135	SAUGUS	66	0.00		Big Creek	Not modeled Energy Only	Market
SAUGUS_6_MWDFTH	24135	SAUGUS	66	7.36		Big Creek	Not modeled Aug NQC	MUNI
SAUGUS_6_PTCHGN	24118	PITCHGEN	13.8	19.47	D1	Big Creek	Aug NQC	MUNI
SAUGUS_6_QF	24135	SAUGUS	66	0.78		Big Creek	Not modeled Aug NQC	QF/Selfgen
SAUGUS_7_CHIQCN	24135	SAUGUS	66	3.96		Big Creek	Not modeled Aug NQC	Market
SAUGUS_7_LOPEZ	24135	SAUGUS	66	5.34		Big Creek	Not modeled Aug NQC	QF/Selfgen
SNCLRA_6_OXGEN	24110	OXGEN	13.8	34.62	D1	Ventura, S.Clara, Moorpark	Aug NQC	QF/Selfgen
SNCLRA_6_PROCGN	24119	PROCGEN	13.8	44.22	D1	Ventura, S.Clara, Moorpark	Aug NQC	Market
SNCLRA_6_QF				0.00		Ventura, S.Clara, Moorpark	Not modeled Aug NQC	QF/Selfgen
SNCLRA_6_WILLMT	24159	WILLAMET	13.8	13.61	D1	Ventura, S.Clara, Moorpark	Aug NQC	QF/Selfgen
SPRGVL_2_QF	24215	SPRINGVL	66	0.23		Big Creek, Rector, Vestal	Not modeled Aug NQC	QF/Selfgen
SPRGVL_2_TULE	24215	SPRINGVL	66	0.00		Big Creek, Rector, Vestal	Not modeled Aug NQC	Market
SPRGVL_2_TULESC	24215	SPRINGVL	66	0.29		Big Creek, Rector, Vestal	Not modeled Aug NQC	Market
SUNSHN_2_LNDFL	29954	WDT273	13.7	3.04	4	Big Creek	Aug NQC	Market
SUNSHN_2_LNDFL	29954	WDT273	13.7	3.04	5	Big Creek	Aug NQC	Market
SUNSHN_2_LNDFL	29954	WDT273	13.7	3.05	1	Big Creek	Aug NQC	Market
SUNSHN_2_LNDFL	29954	WDT273	13.7	3.05	2	Big Creek	Aug NQC	Market
SUNSHN_2_LNDFL	29954	WDT273	13.7	3.05	3	Big Creek	Aug NQC	Market
SYCAMR_2_UNIT 1	24143	SYCCYN1G	13.8	75.52	1	Big Creek	Aug NQC	Net Seller
SYCAMR_2_UNIT 2	24144	SYCCYN2G	13.8	85.00	2	Big Creek	Aug NQC	Net Seller
SYCAMR_2_UNIT 3	24145	SYCCYN3G	13.8	75.25	3	Big Creek	Aug NQC	Net Seller
SYCAMR_2_UNIT 4	24146	SYCCYN4G	13.8	85.00	4	Big Creek	Aug NQC	Net Seller
TENGEN_2_PL1X2	24148	TENNGEN1	13.8	18.12	D1	Big Creek	Aug NQC	Net Seller
TENGEN_2_PL1X2	24149	TENNGEN2	13.8	18.12	D2	Big Creek	Aug NQC	Net Seller
VESTAL_2_KERN	24372	KR 3-1	11	0.22	1	Big Creek, Vestal	Aug NQC	QF/Selfgen
VESTAL_2_KERN	24373	KR 3-2	11	0.22	1	Big Creek, Vestal	Aug NQC	QF/Selfgen
VESTAL_2_RTS042				0.00		Big Creek, Vestal	Not modeled Energy Only	Market
VESTAL_2_WELLHD	24116	WELLGEN	13.8	49.00	1	Big Creek, Vestal		Market
VESTAL_6_QF	24152	VESTAL	66	0.31		Big Creek, Vestal	Not modeled Aug NQC	QF/Selfgen
VESTAL_6_ULTRGN	24150	ULTRAGEN	13.8	27.87	1	Big Creek, Vestal	Aug NQC	QF/Selfgen

VESTAL_6_WDFIRE	24152	VESTAL	66	5.63		Big Creek, Vestal	Not modeled Aug NQC	QF/Selfgen
WARNE_2_UNIT	25651	WARNE1	13.8	38.00	1	Big Creek	Aug NQC	MUNI
WARNE_2_UNIT	25652	WARNE2	13.8	38.00	1	Big Creek	Aug NQC	MUNI
APPGEN_6_UNIT 1	24009	APPGEN1G	13.8	0.00	1	Big Creek	No NQC - hist. data	Market
APPGEN_6_UNIT 1	24010	APPGEN2G	13.8	0.00	2	Big Creek	No NQC - hist. data	Market
APPGEN_6_UNIT 1	24361	APPGEN3G	13.8	0.00	3	Big Creek	No NQC - hist. data	Market
NA	24422	PALMDALE	66	0.00	1	Big Creek	No NQC - hist. data	Market
NA	24340	CHARMIN	13.8	15.00	1	Ventura, S.Clara, Moorpark	No NQC - hist. data	QF/Selfgen
NA	24370	KAWGEN	13.8	17.00	1	Big Creek, Rector, Vestal	No NQC - hist. data	Market
VESTAL_6_WDFIRE	29008	LAKEGEN	13.8	11.00	1	Big Creek, Vestal	Aug NQC	QF/Selfgen
New Unit	29884	DAWNGEN	0.82	20.00	EQ	Big Creek	No NQC - Pmax	Market
New Unit	29888	TWILGHTG	0.82	20.00	EQ	Big Creek	No NQC - Pmax	Market
New Unit	29918	VLFLR_G	0.2	20.00	EQ	Big Creek	No NQC - Pmax	Market
New Unit	29954	WDT273	66	10.00	EQ	Big Creek	No NQC - Pmax	Market
New Unit	29952	CAMGEN	14.2	28.00	D1	Ventura, S.Clara, Moorpark	No NQC - Pmax	Market
New Unit	24089	MANDLY1G	13.8	131.00	X1	Ventura, S.Clara, Moorpark	No NQC - Pmax	Market
New Unit	24090	MANDLY2G	13.8	131.00	X2	Ventura, S.Clara, Moorpark	No NQC - Pmax	Market
MNDALY_7_UNIT 1	24089	MANDLY1G	13.8	0.00	1	Ventura, S.Clara, Moorpark	Retired by 2021	Market
MNDALY_7_UNIT 2	24090	MANDLY2G	13.8	0.00	2	Ventura, S.Clara, Moorpark	Retired by 2021	Market
MNDALY_7_UNIT 3	24222	MANDLY3G	16	0.00	3	Ventura, S.Clara, Moorpark	Retired by 2021	Market
ORMOND_7_UNIT 1	24107	ORMOND1G	26	0.00	1	Ventura, Moorpark	Retired by 2021	Market
ORMOND_7_UNIT 2	24108	ORMOND2G	26	0.00	2	Ventura, Moorpark	Retired by 2021	Market

Major new projects modeled:

None

Critical Contingency Analysis Summary

Rector Sub-area:

The most critical contingency is the loss of the Rector - Vestal 230 kV line with the Eastwood unit out of service, which could thermally overload the remaining Rector - Vestal 230 kV line. This limiting contingency establishes a local capacity need of 476 MW (includes 1 MW of QF generation) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

The following table has units that have at least 5% effectiveness to the above-mentioned constraint within Rector sub-area:

Gen Bus	Gen Name	Gen ID	MW Eff Fctr (%)
24370	KAWGEN	1	51
24306	B CRK1-1	1	46
24306	B CRK1-1	2	46
24307	B CRK1-2	3	46
24307	B CRK1-2	4	46
24319	EASTWOOD	1	46
24323	PORTAL	1	46
24308	B CRK2-1	1	45
24308	B CRK2-1	2	45
24309	B CRK2-2	3	45
24309	B CRK2-2	4	45
24310	B CRK2-3	5	45
24310	B CRK2-3	6	45
24315	B CRK 8	81	45
24315	B CRK 8	82	45
24311	B CRK3-1	1	45
24311	B CRK3-1	2	45
24312	B CRK3-2	3	45
24312	B CRK3-2	4	45
24313	B CRK3-3	5	45
24317	MAMOTH1G	1	45
24318	MAMOTH2G	2	45
24314	B CRK 4	41	43
24314	B CRK 4	42	43

Vestal Sub-area:

The most critical contingency is the loss of the Magunden - Vestal 230 kV line with the Eastwood unit out of service, which could thermally overload the remaining Magunden - Vestal 230 kV line. This limiting contingency establishes a local capacity need of 693 MW (includes 46 MW of QF generation) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

The following table has units that have at least 5% effectiveness to the above-mentioned constraint within Vestal sub-area:

Gen Bus	Gen Name	Gen ID	MW Eff Fctr (%)
24113	PANDOL	1	65
24113	PANDOL	2	65
24116	WELLGEN	1	65
24150	ULTRAGEN	1	65
24372	KR 3-1	1	65
24373	KR 3-2	2	65
28019	WDT190G	1	65
29008	LAKEGEN	1	65
24370	KAWGEN	1	50
24306	B CRK1-1	1	44
24306	B CRK1-1	2	44
24307	B CRK1-2	3	44
24307	B CRK1-2	4	44
24319	EASTWOOD	1	44
24323	PORTAL	1	44
24308	B CRK2-1	1	44
24308	B CRK2-1	2	44
24309	B CRK2-2	3	44
24309	B CRK2-2	4	44
24310	B CRK2-3	5	44
24310	B CRK2-3	6	44
24315	B CRK 8	81	44
24315	B CRK 8	82	44
24311	B CRK3-1	1	44
24311	B CRK3-1	2	44
24312	B CRK3-2	3	44
24312	B CRK3-2	4	44
24313	B CRK3-3	5	44
24317	MAMOTH1G	1	44
24318	MAMOTH2G	2	44
24314	B CRK 4	41	42
24314	B CRK 4	42	42

Santa Clara Sub-area:

The most critical contingency is the loss of the Pardee - Santa Clara 230 kV line followed by the loss of Moorpark - Santa Clara 230 kV #1 and #2 lines, which would cause voltage collapse. This limiting contingency establishes a local capacity need of 250 MW (includes 91 MW QF generation, 5 MW of battery storage and 2 MW of preferred resources) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this area have the same effectiveness factor.

Moorpark Sub-area:

The most critical contingency is the loss of the Moorpark - Pardee 230 kV #3 line followed by the loss of the Moorpark - Pardee 230 kV #1 and #2 lines, which will cause voltage collapse. This limiting contingency establishes a local capacity need of 536 MW (includes 93 MW QF generation, 5 MW of battery storage and 12 MW of preferred resources) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this area have the same effectiveness factor.

Big Creek/Ventura overall:

The most critical contingency is the loss of the Lugo - Victorville 500 kV line followed by loss of one of the Sylmar - Pardee 230 kV line, which would thermally overload the remaining Sylmar - Pardee 230 kV line. This limiting contingency establishes a local capacity need of 2528 MW (includes 145 MW of QF and 372 MW of MUNI generation, 5 MW of battery storage and 12 MW of preferred resources) as the minimum capacity necessary for reliable load serving capability within this area.

The single most critical contingency is the loss of Sylmar - Pardee #1 (or # 2) line with Pastoria power plant (CCGT) out of service, which could thermally overload the remaining Sylmar - Pardee #2 or #1 230 kV line. This limiting contingency establishes a local capacity need of 2310 MW (includes 145 MW of QF and 372 MW of MUNI generation, 5 MW of battery storage and 12 MW of preferred resources).

Effectiveness factors:

The following table has effectiveness factors to the most critical contingency.

Gen Bus	Gen Name	Gen ID	MW Eff Fctr (%)
24009	APPGEN1G	1	31
24010	APPGEN2G	2	31
24118	PITCHGEN	D1	31
24148	TENNGEN1	D1	31
24149	TENNGEN2	D2	31
24361	APPGEN3G	3	31
29954	WDT273	EQ	31
24107	ORMOND1G	1	30
24108	ORMOND2G	2	30
25651	WARNE1	1	28
25652	WARNE2	1	28
24089	MANDLY1G	1	26
24090	MANDLY2G	2	26
24110	OXGEN	D1	26
24119	PROCGEN	D1	26
24127	S.CLARA	1	26
24159	WILLAMET	D1	26
24222	MANDLY3G	3	26
24326	EXGEN1	S1	26
24340	CHARMIN	1	26
24362	EXGEN2	G1	26
29004	ELLWOOD	1	26
29306	MCGPKGEN	1	26
29952	CAMGEN	D1	26
25653	ALAMO SC	1	26
29051	PSTRIAG1	G1	25
29052	PSTRIAG2	G2	25
29053	PSTRIAS1	S1	25
29054	PSTRIAG3	G3	25
29055	PSTRIAS2	S2	25
24102	OMAR 1G	1	21
24103	OMAR 2G	2	21
24104	OMAR 3G	3	21
24105	OMAR 4G	4	21
24113	PANDOL	1	21
24113	PANDOL	2	21
24116	WELLGEN	1	21
24143	SYCCYN1G	1	21
24144	SYCCYN2G	2	21
24145	SYCCYN3G	3	21
24146	SYCCYN4G	4	21
24150	ULTRAGEN	1	21
24306	B CRK1-1	1	21
24306	B CRK1-1	2	21

24307	B CRK1-2	3	21
24307	B CRK1-2	4	21
24308	B CRK2-1	1	21
24308	B CRK2-1	2	21
24309	B CRK2-2	3	21
24309	B CRK2-2	4	21
24310	B CRK2-3	5	21
24310	B CRK2-3	6	21
24311	B CRK3-1	1	21
24311	B CRK3-1	2	21
24312	B CRK3-2	3	21
24312	B CRK3-2	4	21
24313	B CRK3-3	5	21
24314	B CRK 4	41	21
24314	B CRK 4	42	21
24315	B CRK 8	81	21
24315	B CRK 8	82	21
24317	MAMOTH1G	1	21
24318	MAMOTH2G	2	21
24319	EASTWOOD	1	21
24323	PORTAL	1	21
24370	KAWGEN	1	21
24372	KR 3-1	1	21
24373	KR 3-2	2	21
28019	WDT190G	1	21
29008	LAKEGEN	1	21
29900	ALPINE_G	EQ	17
24422	PALMDALE	1	8
29884	DAWNGEN	EQ	8
29888	TWILGHTG	EQ	8
29896	APPINV	EQ	8
29918	VLYFLR_G	EQ	8

Changes compared to last year's results:

Compared with 2021 the load forecast is up by 124 MW and the LCR need has increased by 231 MW, due to load increase.

Big Creek/Ventura Overall Requirements:

2026	QF (MW)	Muni (MW)	Battery St. (MW)	Preferred Res. (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	145	372	5	12	3143	3677

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ²⁵	2310	0	2310
Category C (Multiple) ²⁶	2528	0	2528

10. San Diego-Imperial Valley Area

Area Definition

The transmission tie lines forming a boundary around the Greater San Diego-Imperial Valley area include:

- 1) Imperial Valley – North Gila 500 kV Line
- 2) Otay Mesa – Tijuana 230 kV Line
- 3) San Onofre - San Luis Rey #1 230 kV Line
- 4) San Onofre - San Luis Rey #2 230 kV Line
- 5) San Onofre - San Luis Rey #3 230 kV Line
- 6) San Onofre – Talega 230 kV Line
- 7) San Onofre – Capistrano 230 kV Line
- 8) Imperial Valley – El Centro 230 kV Line
- 9) Imperial Valley PFC – La Rosita 230 kV Line

The substations that delineate the Greater San Diego-Imperial Valley area are:

- 1) Imperial Valley is in North Gila is out
- 2) Otay Mesa is in Tijuana is out
- 3) San Onofre is out San Luis Rey is in
- 4) San Onofre is out San Luis Rey is in
- 5) San Onofre is out San Luis Rey is in
- 6) San Onofre is out Talega is in
- 7) San Onofre is out Talega is in
- 8) Imperial Valley is in El Centro is out
- 9) Imperial Valley PFC is in La Rosita is out

²⁵ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

²⁶ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

The CEC-adopted demand forecast for 2026 is 4,580 MW²⁷ (this includes loads & losses and 451 MW AAEE). The total adjusted demand after including 720 MW peak shift adjustment²⁸ is 5,300 MW. A total of 5,307 MW of adjusted peak demand with this peak shift was modeled for the study.

Total units and qualifying capacity available in this area:

MKT/SCHED RESOURCE ID	BUS #	BUS NAME	kV	NQC	UNIT ID	LCR SUB-AREA NAME	NQC Comments	CAISO Tag
BORDER_6_UNITA1	22149	CALPK_BD	13.8	48.00	1	San Diego, Border		Market
BREGGO_6_DEGRSL				4.36		San Diego	Not modeled Aug NQC	Market
BREGGO_6_SOLAR	22082	BR GEN1	0.21	20.46	1	San Diego	Aug NQC	Market
CBRLLO_6_PLSTP1	22092	CABRILLO	69	2.83	1	San Diego	Aug NQC	Market
CCRITA_7_RPPCHF	22124	CHCARITA	138	3.25	1	San Diego	Aug NQC	Market
CHILLS_1_SYCENG	22120	CARLTNHS	138	0.54	1	San Diego	Aug NQC	QF/Selfgen
CHILLS_1_SYCLFL	22120	CARLTNHS	138	0.54		San Diego	Not modeled Aug NQC	Net Seller
CHILLS_7_UNITA1	22120	CARLTNHS	138	1.52	2	San Diego	Aug NQC	QF/Selfgen
CNTNLA_2_SOLAR1	23463	DW GEN3&4	0.33	97.02	1	None	Aug NQC	Market
CNTNLA_2_SOLAR2	23463	DW GEN3&4	0.33	0.00	2	None	Energy Only	Market
CPSTNO_7_PRMA DS	22112	CAPSTRNO	138	5.12	1	San Diego	Aug NQC	Market
CPVERD_2_SOLAR	23301	IV GEN3 G2	0.31	48.54	G2	None	Aug NQC	Market
CPVERD_2_SOLAR	23309	IV GEN3 G1	0.31	48.54	G1	None	Aug NQC	Market
CRELMN_6_RAMON1				1.53		San Diego	Not modeled Aug NQC	Market
CRELMN_6_RAMON2				3.89		San Diego	Not modeled Aug NQC	Market
CRSTWD_6_KUMYAY	22915	KUMEYAAY	0.69	5.00	1	San Diego	Aug NQC	Wind
CSLR4S_2_SOLAR	23299	DW GEN1 G2	0.32	42.32	G2	None	Aug NQC	Market
CSLR4S_2_SOLAR	23298	DW GEN1 G1	0.32	42.33	G1	None	Aug NQC	Market
DIVSON_6_NSQF	22172	DIVISION	69	41.54	1	San Diego	Aug NQC	QF/Selfgen
EGATE_7_NOCITY	22204	EASTGATE	69	0.24	1	San Diego	Aug NQC	QF/Selfgen
ELCAJN_6_LM6K	23320	EC GEN2	13.8	48.10	1	San Diego, El Cajon		Market
ELCAJN_6_UNITA1	22150	EC GEN1	13.8	45.42	1	San Diego, El Cajon		Market
ENERSJ_2_WIND				24.82		None	Aug NQC	Wind
ESCND0_6_PL1X2	22257	ESGEN	13.8	48.71	1	San Diego, Escondido		Market
ESCND0_6_UNITB1	22153	CALPK_ES	13.8	48.00	1	San Diego, Escondido		Market
ESCO_6_GLMQF	22332	GOALLINE	69	36.41	1	San Diego, Esco, Escondido	Aug NQC	Net Seller
IVSLRP_2_SOLAR1	23441	DW GEN2 G2	0.36	50.27	1	None	Aug NQC	Market

²⁷ CEC-adopted 2015 IEPR demand forecast for 2016-2026, January 2016, for Mid Demand Baseline Case with Low AAEE Savings.

²⁸ The CEC provided this amount of peak shift adjustment for the 2015 IEPR demand forecast to the ISO in November 2016.

IVSLRP_2_SOLAR1	23442	DW GEN2 G3	0.36	50.27	1	None		Aug NQC	Market
IVSLRP_2_SOLAR1	23440	DW GEN2 G1	0.36	50.28	1	None		Aug NQC	Market
LAKHDG_6_UNIT 1	22625	LKHODG1	13.8	20.00	1	San Diego			Market
LAKHDG_6_UNIT 2	22626	LKHODG2	13.8	20.00	2	San Diego			Market
LARKSP_6_UNIT 1	22074	LRKSPBD1	13.8	46.00	1	San Diego, Border			Market
LARKSP_6_UNIT 2	22075	LRKSPBD2	13.8	46.00	1	San Diego, Border			Market
LAROA1_2_UNITA1	20187	LRP-U1	16	165	1	None			Market
LAROA2_2_UNITA1	22996	INTBST	18	157	1	None			Market
LAROA2_2_UNITA1	22997	INTBCT	16	165	1	None			Market
MRGT_6_MEF2	22487	MEF_MR2	13.8	47.90	1	San Diego, Miramar			Market
MRGT_6_MMAREF	22486	MEF_MR1	13.8	48.00	1	San Diego, Miramar			Market
MSHGTS_6_MMARLF	22448	MESAHGTS	69	3.36	1	San Diego, Mission		Aug NQC	Market
MSSION_2_QF	22496	MISSION	69	0.73	1	San Diego		Aug NQC	QF/Selfgen
NIMTG_6_NIQF	22576	NOISLMTR	69	34.47	1	San Diego		Aug NQC	QF/Selfgen
OCTILO_5_WIND	23314	OCO GEN G1	0.69	12.21	G1	None		Aug NQC	Wind
OCTILO_5_WIND	23318	OCO GEN G2	0.69	12.21	G2	None		Aug NQC	Wind
OGROVE_6_PL1X2	22628	PA GEN1	13.8	48.00	1	San Diego, Pala			Market
OGROVE_6_PL1X2	22629	PA GEN2	13.8	48.00	2	San Diego, Pala			Market
OTAY_6_LNDFL5	22604	OTAY	69	0.00		San Diego, Border		Not modeled Energy Only	Market
OTAY_6_LNDFL6	22604	OTAY	69	0.00		San Diego, Border		Not modeled Energy Only	Market
OTAY_6_PL1X2	22617	OYGEN	13.8	35.50	1	San Diego, Border			Market
OTAY_6_UNITB1	22604	OTAY	69	2.90	1	San Diego, Border		Aug NQC	Market
OTAY_7_UNITC1	22604	OTAY	69	2.29	3	San Diego, Border		Aug NQC	QF/Selfgen
OTMESA_2_PL1X3	22605	OTAYMGT1	18	185.06	1	San Diego			Market
OTMESA_2_PL1X3	22606	OTAYMGT2	18	185.06	1	San Diego			Market
OTMESA_2_PL1X3	22607	OTAYMST1	16	233.48	1	San Diego			Market
PALOMR_2_PL1X3	22262	PEN_CT1	18	162.39	1	San Diego			Market
PALOMR_2_PL1X3	22263	PEN_CT2	18	162.39	1	San Diego			Market
PALOMR_2_PL1X3	22265	PEN_ST	18	240.83	1	San Diego			Market
PTLOMA_6_NTCCGN	22660	POINTLMA	69	2.06	2	San Diego		Aug NQC	QF/Selfgen
PTLOMA_6_NTCQF	22660	POINTLMA	69	18.41	1	San Diego		Aug NQC	QF/Selfgen
SAMPSN_6_KELCO1	22704	SAMPSON	12.5	0.60	1	San Diego		Aug NQC	Net Seller
SMRCOS_6_LNDFIL	22724	SANMRCOS	69	1.40	1	San Diego		Aug NQC	QF/Selfgen
TERMEX_2_PL1X3	22982	TDM CTG2	18	156	1	None			Market
TERMEX_2_PL1X3	22983	TDM CTG3	18	156	1	None			Market
TERMEX_2_PL1X3	22981	TDM STG	21	281	1	None			Market
VLCNTR_6_VCCLR1				1.82		San Diego, Pala		Not modeled Aug NQC	Market
VLCNTR_6_VCCLR2				4.02		San Diego, Pala		Not modeled Aug NQC	Market
NA	22916	PFC-AVC	0.6	0.00	1	San Diego		No NQC - hist. data	QF/Selfgen
New Unit	22942	BUE GEN 1 G1	0.69	15.40	G1	None		No NQC - est. data	Wind
New Unit	22945	BUE GEN 1 G2	0.69	15.40	G2	None		No NQC - est. data	Wind
New Unit	23352	Q644G	0.31	20.00	1	None		No NQC - P max	Market
New Unit	23487	Q653EDG	0.31	20.00	1	None		No NQC - P max	Market
New Unit	23120	BULLMOOS	13.8	27.00	1	San Diego, Border		No NQC - P max	Market
New Unit	23100	ECO GEN1 G1	0.69	51.00	G1	None		No NQC - est. data	Wind

New Unit	23155	c608 G1	0.36	75.00	G1	None	No NQC - P max	Market
New Unit	23156	c608_G2	0.36	75.00	G2	None	No NQC - P max	Market
New Unit	23162	PIO PICO CT1	13.8	100.00	1	San Diego	No NQC - Pmax	Market
New Unit	23163	PIO PICO CT2	13.8	100.00	1	San Diego	No NQC - Pmax	Market
New Unit	23164	PIO PICO CT3	13.8	100.00	1	San Diego	No NQC - Pmax	Market
New Unit	23287	Q429 G1	0.31	100.00	1	None	No NQC - P max	Market
New Unit	23131	Q183_G1	0.69	0.00	G1	None	Energy Only	Market
New Unit	23134	Q183_G2	0.69	0.00	G2	None	Energy Only	Market
New Unit	23105	ECO GEN1 G1	0.69	23.73	G2	None	No NQC - est. data	Wind
New Unit	22783	EA5 REPOWER1	13.8	100.00	1	San Diego	No NQC - Pmax	Market
New Unit	22784	EA5 REPOWER2	13.8	100.00	1	San Diego	No NQC - Pmax	Market
New Unit	22786	EA5 REPOWER4	13.8	100.00	1	San Diego	No NQC - Pmax	Market
New Unit	22787	EA5 REPOWER5	13.8	100.00	1	San Diego	No NQC - Pmax	Market
New Unit	22788	EA5 REPOWER3	13.8	100.00	1	San Diego	No NQC - Pmax	Market
ELCAJN_7_GT1	22212	ELCAJNGT	12.5	0.00	1	San Diego, El Cajon	Retired by 2021	Market
ENCINA_7_EA1	22233	ENCINA 1	14.4	0.00	1	San Diego, Encina	Retired by 2021	Market
ENCINA_7_EA2	22234	ENCINA 2	14.4	0.00	1	San Diego, Encina	Retired by 2021	Market
ENCINA_7_EA3	22236	ENCINA 3	14.4	0.00	1	San Diego, Encina	Retired by 2021	Market
ENCINA_7_EA4	22240	ENCINA 4	22	0.00	1	San Diego, Encina	Retired by 2021	Market
ENCINA_7_EA5	22244	ENCINA 5	24	0.00	1	San Diego, Encina	Retired by 2021	Market
ENCINA_7_GT1	22248	ENCINAGT	12.5	0.00	1	San Diego, Encina	Retired by 2021	Market
KEARNY_7_KY3	22375	KEARN3AB	12.5	0.00	2	San Diego, Mission	Retired by 2021	Market
KEARNY_7_KY3	22375	KEARN3AB	12.5	0.00	1	San Diego, Mission	Retired by 2021	Market
KEARNY_7_KY3	22376	KEARN3CD	12.5	0.00	1	San Diego, Mission	Retired by 2021	Market
KEARNY_7_KY3	22376	KEARN3CD	12.5	0.00	2	San Diego, Mission	Retired by 2021	Market
MRGT_7_UNITS	22488	MIRAMRGT	12.5	0.00	1	San Diego, Miramar	Retired by 2021	Market
MRGT_7_UNITS	22488	MIRAMRGT	12.5	0.00	2	San Diego, Miramar	Retired by 2021	Market
KEARNY_7_KY2	22373	KEARN2AB	12.5	0.00	1	San Diego, Mission	Retired	Market
KEARNY_7_KY2	22373	KEARN2AB	12.5	0.00	2	San Diego, Mission	Retired	Market
KEARNY_7_KY2	22374	KEARN2CD	12.5	0.00	1	San Diego, Mission	Retired	Market
KEARNY_7_KY2	22374	KEARN2CD	12.5	0.00	2	San Diego, Mission	Retired	Market

Major new projects modeled:

1. Imperial Valley Phase Shifting Transformers (2x400 MVA)
2. Hassayampa – North Gila #2 500 kV Line (APS)
3. Bay Blvd. Substation Project
4. Sycamore – Penasquitos 230 kV Line
5. Talega Synchronous Condensers (2x225 MVAR)
6. San Luis Rey Synchronous Condensers (2x225 MVAR)

7. San Onofre Synchronous Condenser (225 MVAR)
8. Bypass series capacitors on the ECO-Miguel and Ocotillo-Suncrest 500 kV lines
9. Battery energy storage system projects in the San Diego area (3x10 MW at Escondido and 7.5 MW at El Cajon substations)
10. Reconductor of Mission – Clairmont 69 kV line
11. Reconductor of Mission – Kearny 69 kV line
12. Second Miguel – Bay Blvd. 230 kV line
13. Mesa Heights Loop-In 69 kV Project
14. Second Poway-Pomerado 69 kV line
15. TL632 Granite Loop-In and TL6914 reconfiguration
16. Artesian 230/69 kV Sub and loop-in
17. Pio Pico Power Plant (309 MW)
18. Encina Repower (600 MW)

Critical Contingency Analysis Summary

El Cajon Sub-area

The most critical contingency for the El Cajon sub-area is the loss of the El Cajon-Jamacha 69 kV line (TL624) followed by the loss of Murray-Garfield 69 kV line (TL620), which could thermally overload the El Cajon-Los Coches 69 kV (TL631). This limiting contingency establishes a LCR of 14 MW (including 0 MW of QF generation) in 2026 as the minimum generation capacity necessary for reliable load serving capability within this sub-area after the TL632 Granite Loop-In and TL6914 reconfiguration project are completed.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Mission Sub-area

The LCR need for the Mission sub-area is eliminated by implementing the ISO Board-approved “The Mesa Heights Loop-In 69 kV Project” with an in-service date of June 2018.

It is recommended to retain at least 52 MW of the Kearny peakers as part of the minimum generation capacity necessary for reliable load serving capability within this sub-area until project is operational.

Effectiveness factors:

All Kearny Peakers have the same effectiveness factor.

Esco Sub-area

The ISO approved Artesian 230 kV substation project and the 2nd Poway-Pomerado 69 kV line will eliminate the local capacity need in this sub-area.

Pala Sub-area

The most critical contingency for the Pala sub-area is the loss of Pendleton – San Luis Rey 69 kV line (TL6912) followed by the loss of Lilac - Pala 69 kV line (TL6932), which could thermally overload the Monserate – Morro Hill Tap 69 kV line (TL694). This limiting contingency establishes a local capacity need of 34 MW in 2026 (includes 0 MW of QF generation) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this area (Pala) have the same effectiveness factor.

Border Sub-area

The most critical contingency for the Border sub-area is the loss of Bay Boulevard – Otay 69 kV line #1 (TL645) followed by Bay Boulevard Otay – 69 kV line #2 (TL646), which could thermally overload the Imperial Beach – Bay Boulevard 69 kV line (TL647). This limiting contingency establishes a local capacity need of 84 MW in 2026 (includes 2 MW of QF generation) as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this area have the same effectiveness factor.

Miramar Sub-area

With the implementation of the second Miguel – Bay Blvd. 230 kV line, this sub-area local capacity requirement is eliminated.

It is recommended to retain the Miramar GTs (Cabrillo Power II) until the most limiting contingency is mitigated.

San Diego Sub-area:

The local capacity requirements for the combined LA Basin and San Diego sub-area is the same as the LA Basin/San Diego/Imperial Valley need; the overlapping G-1/N-1 outage (NERC P3 category) of Termoelectrica de Mexicali (TDM) combined cycle plant (593 MW), followed by an N-1 contingency of the Imperial Valley – North Gila 500 kV line. This overlapping contingency could causes thermal overload on the “S” line (El Centro – Imperial Valley 230 kV line) between Imperial Irrigation District (IID) and SDG&E. This limiting contingency establishes a total local capacity need for the combined LA Basin/San Diego sub-area of 10,041 MW in the 2026 time frame as follows: 7,234 MW in the LA Basin (includes 399 MW of QF, 41 MW of wind and 1175 MW of MUNI generation, 432 MW of long-term procurement plan preferred resources, as well as 322 MW of 20-minute demand response) and 2,807 MW in the San Diego sub-area (includes 103 MW of QF generation, 5 MW of wind, 19 MW of 20-minute demand response and 38 MW of CPUC-approved battery energy storage) as the minimum capacity necessary for reliable load serving capability within these areas.

The second most critical contingency (N-1-1 or NERC P6) resulting in thermal limiting constraint, with slightly lower LCR need, for the combined LA Basin and San Diego sub-area is the overlapping outage of ECO-Miguel 500 kV line, system readjustment, followed by Ocotillo-Suncrest 500 kV line. This contingency could cause loading concern for the CFE/CENACE’s La Rosita-Rumorosa 230 kV line. This limiting

contingency establishes a total local capacity need for the combined LA Basin/San Diego sub-area of 9,729 MW in 2026 time as follows: 7,122 MW in the LA Basin (includes 399 MW of QF, 41 MW of wind and 1175 MW of MUNI generation, 432 MW of long-term procurement plan preferred resources, as well as 322 MW of 20-minute demand response) and 2,607 MW in the San Diego sub-area (includes 103 MW of QF generation, 5 MW of wind, 19 MW of 20-minute demand response and 38 MW of CPUC-approved battery energy storage).

Effectiveness factors:

The following table has San Diego-Imperial Valley resources.

<u>Resource Locations</u>	<u>Effectiveness Factor (%)</u>
INTBCT 16.0 #1	-24.87
INTBST 18.0 #1	-24.87
IV GEN2-U1 16.0 #1	-24.82
DU GEN1 G2 0.2 #G2	-24.8
DW GEN1 G2 0.3 #G2	-24.8
DW GEN1 G1 0.3 #G1	-24.79
DU GEN1 G1 0.2 #G1	-24.78
DW GEN3&4 0.3 #2	-24.64
DW GEN3&4 0.3 #1	-24.64
DW GEN2 G3 0.4 #1	-24.63
DW GEN2 G1 0.4 #1	-24.55
DW GEN2 G2 0.4 #1	-24.54
OCO GEN G1 0.7 #G1	-21.82
OCO GEN G2 0.7 #G2	-21.82
Q653EDG 0.3 #1	-21.13
ECO GEN1 G 0.7 #G1	-21.05
Q644G 0.3 #1	-20.56
OTAYMGT1 18.0 #1	-17.17
OTAYMGT2 18.0 #1	-17.17
OTAYMST1 16.0 #1	-17.17
PIO PICO C 13.8 #C1	-16.86
PIO PICO C 13.8 #C2	-16.86
PIO PICO C 13.8 #C3	-16.86
CAMERON 69.0 #DG	-16.44

KUMEYAAY	0.7 #1	-16.43
GLENCLIF	69.0 #DG	-16.42
LOVELAND	69.0 #DG	-16.35
DESCANSO	69.0 #DG	-16.26
OY GEN	13.8 #1	-16.19
OTAY	69.0 #3	-16.18
OTAY	69.0 #1	-16.18
EC GEN2	13.8 #1	-16.17
EC GEN1	13.8 #1	-16.15
DIVISION	69.0 #1	-16.14
NOISLMTR	69.0 #1	-16.11
LOSCOCHS	69.0 #DG	-16.08
MURRAY	69.0 #DG	-16.08
SAMPSON	12.5 #1	-16.03
BORDER	69.0 #DG	-16.02
CABRILLO	69.0 #1	-15.94
LRKSPBD1	13.8 #1	-15.92
LRKSPBD2	13.8 #1	-15.92
CALPK_BD	13.8 #1	-15.9
POINTLMA	69.0 #2	-15.88
POINTLMA	69.0 #1	-15.88
CREELMAN	69.0 #DG	-15.84
MESAHGTS	69.0 #1	-15.73
MISSION	69.0 #1	-15.66
SANTYSBL	69.0 #DG	-15.65
CARLTNHS	138.0 #2	-15.63
CARLTNHS	138.0 #1	-15.63
EASTGATE	69.0 #1	-15.3
MEF MR1	13.8 #1	-15.28
GENESEE	69.0 #DG	-15.25
WARNERS	69.0 #DG	-15.22
CHCARITA	138.0 #1	-15.15
MEF MR2	13.8 #1	-15.1
LkHodG1	13.8 #1	-14.35
LkHodG2	13.8 #1	-14.35
VALCNTR	69.0 #DG	-14.06
GOALLINE	69.0 #1	-13.94

BORREGO	12.5 #DG	-13.83
LILAC	69.0 #DG	-13.67
ES GEN	13.8 #1	-13.66
CALPK_ES	13.8 #1	-13.65
PEN_CT1	18.0 #1	-13.62
PEN_CT2	18.0 #1	-13.57
PEN_ST	18.0 #1	-13.56
SANMRCOS	69.0 #1	-13.55
Q189 GEN1	13.8 #1	-13.52
AVOCADO	69.0 #DG	-13.12
PALA	69.0 #DG	-13.1
BR GEN1	0.2 #1	-13.03
PA GEN1	13.8 #1	-12.99
PA GEN2	13.8 #1	-12.99
EA5 REPOWE	13.8 #1	-12.86
EA5 REPOWE	13.8 #1	-12.86
Q137 GEN1	13.8 #1	-12.86
Q137 GEN2	13.8 #1	-12.86
MELROSE	69.0 #DG	-12.72
CAPSTRNO	138.0 #1	-10.24

San Diego Sub-area Requirements:

2026	QF (MW)	Wind (MW)	Battery St. (MW)	Preffered Res. (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	103	5	38	55	2685	2886

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ²⁹	2807	0	2807
Category C (Multiple) ³⁰	2807	0	2807

²⁹ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

³⁰ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

San Diego-Imperial Valley overall:

The critical Category B contingency for the San Diego-Imperial Valley overall is the same as the LA Basin/San Diego/Imperial Valley need; the overlapping G-1/N-1 outage (NERC P3 category) of Termoelectrica de Mexicali (TDM) combined cycle plant (593 MW), followed by an N-1 contingency of the Imperial Valley – North Gila 500 kV line. This overlapping contingency could cause thermal overload on the “S” line (El Centro – Imperial Valley 230 kV line) between Imperial Irrigation District (IID) and SDG&E. This limiting contingency establishes a total local capacity need 11883 MW of which 7234 MW in the LA Basin (includes 399 MW of QF, 41 MW of wind and 1175 MW of MUNI generation, 432 MW of long-term procurement plan preferred resources, as well as 322 MW of 20-minute demand response) and 4649 MW is located in the San Diego-Imperial Valley area (includes 103 MW of QF generation, 160 MW of wind, 19 MW of 20-minute demand response and 38 MW of CPUC-approved battery energy storage) as the minimum capacity necessary for reliable load serving capability within these areas.

Effectiveness factors:

The effectiveness factors are in addition to the effectiveness factors for generating resources in the San Diego subarea in response to the G-1/N-1 contingency.

<u>Resource Locations</u>		<u>Effectiveness Factor (%)</u>
INTBCT	16.0 #1	-24.87
INTBST	18.0 #1	-24.87
IV GEN2-U1	16.0 #1	-24.82
DU GEN1 G2	0.2 #G2	-24.8
DW GEN1 G2	0.3 #G2	-24.8
DW GEN1 G1	0.3 #G1	-24.79
DU GEN1 G1	0.2 #G1	-24.78
DW GEN3&4	0.3 #2	-24.64
DW GEN3&4	0.3 #1	-24.64
DW GEN2 G3	0.4 #1	-24.63
DW GEN2 G1	0.4 #1	-24.55
DW GEN2 G2	0.4 #1	-24.54
OCO GEN G1	0.7 #G1	-21.82
OCO GEN G2	0.7 #G2	-21.82
Q653EDG	0.3 #1	-21.13

ECO GEN1 G 0.7 #G1 -21.05
 Q644G 0.3 #1 -20.56

Changes compared to last year’s results:

Compared with 2021 the load forecast increased by 327 MW and the LCR need increased by about 292 MW.

San Diego-Imperial Valley Overall Requirements:

2026	QF (MW)	Wind (MW)	Battery St. (MW)	Preferred Res. (MW)	Market (MW)	Max. Qualifying Capacity (MW)
Available generation	103	160	38	55	4484	4840

2026	Existing Generation Capacity Needed (MW)	Deficiency (MW)	Total MW Requirement
Category B (Single) ³¹	4649	0	4649
Category C (Multiple) ³²	4649	0	4649

11. Valley Electric Area

Valley Electric Association LCR area has been eliminated on the basis of the following:

- No generation exists in this area
- No category B issues were observed in this area
- Category C and beyond –
 - No common-mode N-2 issues were observed
 - No issues were observed for category B outage followed by a common-mode N-2 outage

³¹ LCR requirement for a single contingency means that there wouldn’t be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

³² LCR requirement for multiple contingencies means that not only there wouldn’t be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- All the N-1-1 issues that were observed can either be mitigated by the existing UVLS or by an operating procedure