

**2023
LOCAL CAPACITY TECHNICAL
ANALYSIS**

**DRAFT REPORT
AND STUDY RESULTS**

April 26, 2018

Local Capacity Technical Analysis Overview and Study Results

I. Executive Summary

This report documents the results of the 2023 Long-Term Local Capacity Technical (LCT) Study. The LCT Study objectives, inputs, methodologies and assumptions are the same as those discussed in the 2019 LCT Study to be adopted by the CAISO and submitted to the CPUC for adoption in their 2019 Local Resource Adequacy process.

Overall, the LCR trend compared with 2022, is down by about 414 MW or about 1.7%. It is worth mentioning the following areas: (1) Humboldt, Fresno and San Diego-Imperial Valley where LCR has decreased mostly due to load forecast and new transmission projects; (2) Sierra, Stockton and Bay Area where LCR has decreased mostly due to new transmission projects; (3) North Coast/North Bay, LA Basin and Big Creek/Ventura where LCR has increased mainly due to load forecast increase; (4) Kern, where the LCR has increased due to new requirements in the Wespark sub-area.

The load forecast used in this study is based on the final adopted California Energy Demand Updated Forecast, 2018-2030 developed by the CEC; namely the load serving entity (LSE and balancing authority (BA) mid baseline demand with low additional achievable energy efficiency and photo voltaic (AAEE-AAPV), re-posted on 2/21/2018:

http://www.energy.ca.gov/2017_energy_policy/documents/index.html#02212018.

For comparison below you will find the 2019 and 2023 total LCR needs.

2019 Local Capacity Needs

| Local Area Name | Qualifying Capacity | | | 2019 LCR Need Based on Category B | | | 2019 LCR Need Based on Category C with operating procedure | | |
|----------------------------|---------------------|-------------|------------|-----------------------------------|------------|------------|------------------------------------------------------------|------------|------------|
| | QF/ Muni (MW) | Market (MW) | Total (MW) | Existing Capacity Needed | Deficiency | Total (MW) | Existing Capacity Needed** | Deficiency | Total (MW) |
| Humboldt | 0 | 202 | 202 | 116 | 0 | 116 | 165 | 0 | 165 |
| North Coast/ North Bay | 119 | 771 | 890 | 689 | 0 | 689 | 689 | 0 | 689 |
| Sierra | 1146 | 1004 | 2150 | 1362 | 0 | 1362 | 1964 | 283* | 2247 |
| Stockton | 144 | 489 | 633 | 405 | 5* | 410 | 427 | 350* | 777 |
| Greater Bay | 628 | 6448 | 7076 | 3670 | 0 | 3670 | 4461 | 0 | 4461 |
| Greater Fresno | 340 | 3177 | 3517 | 1406 | 0 | 1406 | 1670 | 1* | 1671 |
| Kern | 13 | 462 | 475 | 148 | 6* | 154 | 472 | 6* | 478 |
| LA Basin | 1445 | 9421 | 10866 | 7968 | 0 | 7968 | 8116 | 0 | 8116 |
| Big Creek/Ventura | 424 | 4649 | 5073 | 2333 | 0 | 2333 | 2614 | 0 | 2614 |
| San Diego/ Imperial Valley | 106 | 4285 | 4391 | 4026 | 0 | 4026 | 4026 | 0 | 4026 |
| Total | 4365 | 30908 | 35273 | 22123 | 11 | 22134 | 24604 | 640 | 25244 |

2023 Local Capacity Needs

| Local Area Name | Qualifying Capacity | | | 2023 LCR Need Based on Category B | | | 2023 LCR Need Based on Category C with operating procedure | | |
|----------------------------|---------------------|-------------|------------|-----------------------------------|------------|------------|------------------------------------------------------------|------------|------------|
| | QF/ Muni (MW) | Market (MW) | Total (MW) | Existing Capacity Needed | Deficiency | Total (MW) | Existing Capacity Needed** | Deficiency | Total (MW) |
| Humboldt | 0 | 202 | 202 | 111 | 0 | 111 | 169 | 0 | 169 |
| North Coast/ North Bay | 119 | 771 | 890 | 553 | 0 | 553 | 553 | 0 | 553 |
| Sierra | 1146 | 1004 | 2150 | 1268 | 0 | 1268 | 1924 | 0 | 1924 |
| Stockton | 144 | 540 | 684 | 225 | 20* | 245 | 333 | 106* | 439 |
| Greater Bay | 627 | 6427 | 7054 | 3676 | 0 | 3676 | 4752 | 0 | 4752 |
| Greater Fresno | 340 | 3177 | 3517 | 1688 | 0 | 1688 | 1688 | 0 | 1688 |
| Kern | 13 | 462 | 475 | 152 | 6* | 158 | 174 | 8* | 182 |
| LA Basin | 1443 | 6868 | 8311 | 6793 | 0 | 6793 | 6793 | 0 | 6793 |
| Big Creek/Ventura | 424 | 3082 | 3506 | 2212 | 0 | 2212 | 2690 | 102* | 2792 |
| San Diego/ Imperial Valley | 106 | 4414 | 4520 | 4132 | 0 | 4132 | 4132 | 0 | 4132 |
| Total | 4362 | 26947 | 31309 | 20810 | 26 | 20836 | 23208 | 216 | 23424 |

* No local area is “overall deficient”. Resource deficiency values result from a few deficient sub-areas; and since there are no resources that can mitigate this deficiency the numbers are carried forward into the total area needs. Resource deficient sub-area implies that in order to comply with the criteria, at summer peak, load may be shed immediately after the first contingency.

** Since “deficiency” cannot be mitigated by any available resource, the “Existing Capacity Needed” will be split among LSEs on a load share ratio during the assignment of local area resource responsibility.

The narrative for each Local Capacity Area lists important new projects included in the base cases as well as a description of reason for changes between the 2022 Long-Term LCR study and this 2023 Long-Term LCR study.

Table of Contents

| | | |
|-------------|--------------------------------------------------------------------------------------------------------|------------|
| I. | Executive Summary | 1 |
| II. | Overview of the Study: Inputs, Outputs and Options..... | 5 |
| | A. <i>Objectives</i> | 5 |
| | B. <i>Key Study Assumptions</i> | 5 |
| | 1. Inputs and Methodology | 5 |
| | C. <i>Grid Reliability</i> | 7 |
| | D. <i>Application of N-1, N-1-1, and N-2 Criteria</i> | 8 |
| | E. <i>Performance Criteria</i> | 8 |
| | F. <i>The Two Options Presented In This LCT Report</i> | 15 |
| | 1. Option 1- Meet Performance Criteria Category B..... | 15 |
| | 2. Option 2- Meet Performance Criteria Category C and Incorporate Suitable Operational Solutions | 16 |
| III. | Assumption Details: How the Study was Conducted | 17 |
| | A. <i>System Planning Criteria</i> | 17 |
| | 1. Power Flow Assessment: | 18 |
| | 2. Post Transient Load Flow Assessment: | 19 |
| | 3. Stability Assessment: | 19 |
| | B. <i>Load Forecast</i> | 19 |
| | 1. System Forecast | 19 |
| | 2. Base Case Load Development Method..... | 20 |
| | C. <i>Power Flow Program Used in the LCR analysis</i> | 21 |
| IV. | Locational Capacity Requirement Study Results | 22 |
| | A. <i>Summary of Study Results</i> | 22 |
| | B. <i>Summary of Results by Local Area</i> | 24 |
| | 1. Humboldt Area..... | 24 |
| | 2. North Coast / North Bay Area | 26 |
| | 3. Sierra Area | 29 |
| | 4. Stockton Area..... | 33 |
| | 5. Greater Bay Area | 37 |
| | 6. Greater Fresno Area..... | 42 |
| | 7. Kern Area..... | 46 |
| | 8. LA Basin Area | 49 |
| | 9. Big Creek/Ventura Area | 57 |
| | 10. San Diego-Imperial Valley Area | 61 |
| | 11. Valley Electric Area..... | 69 |
| V. | Appendix A – List of physical resources by PTO, local area and market ID | 70 |
| VI. | Appendix B – Effectiveness factors for procurement guidance..... | 118 |

II. Overview of the Study: Inputs, Outputs and Options

A. Objectives

As was the objective of all previous LCT Studies, the intent of the 2023 Long-Term LCT Study is to identify specific areas within the CAISO Balancing Authority Area that have limited import capability and determine the minimum generation capacity (MW) necessary to mitigate the local reliability problems in those areas.

B. Key Study Assumptions

1. Inputs and Methodology

The CAISO used the same Inputs and Methodology as does agreed upon by interested parties previously incorporated into the 2019 LCR Study. The following table sets forth a summary of the approved inputs and methodology that have been used in the previous 2019 LCR Study as well as this 2023 LCR Study:

Summary Table of Inputs and Methodology Used in this LCR Study:

| Issue: | How Incorporated into THIS LCR Study: |
|---------------------------------------------------------------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| <u>Input Assumptions:</u> | |
| <ul style="list-style-type: none"> • Transmission System Configuration | The existing transmission system has been modeled, including all projects operational on or before June 1, of the study year and all other feasible operational solutions brought forth by the PTOs and as agreed to by the CAISO. |
| <ul style="list-style-type: none"> • Generation Modeled | The existing generation resources has been modeled and also includes all projects that will be on-line and commercial on or before June 1, of the study year |
| <ul style="list-style-type: none"> • Load Forecast | Uses a 1-in-10 year summer peak load forecast |
| <u>Methodology:</u> | |
| <ul style="list-style-type: none"> • Maximize Import Capability | Import capability into the load pocket has been maximized, thus minimizing the generation required in the load pocket to meet applicable reliability requirements. |
| <ul style="list-style-type: none"> • QF/Nuclear/State/Federal Units | Regulatory Must-take and similarly situated units like QF/Nuclear/State/Federal resources have been modeled on-line at qualifying capacity output values for purposes of this LCR Study. |
| <ul style="list-style-type: none"> • Maintaining Path Flows | Path flows have been maintained below all established path ratings into the load pockets, including the 500 kV. For clarification, given the existing transmission system configuration, the only 500 kV path that flows directly into a load pocket and will, therefore, be considered in this LCR Study is the South of Lugo transfer path flowing into the LA Basin. |
| <u>Performance Criteria:</u> | |
| <ul style="list-style-type: none"> • Performance Level B & C, including incorporation of PTO operational solutions | This LCR Study is being published based on Performance Level B and Performance Level C criterion, yielding the low and high range LCR scenarios. In addition, the CAISO will incorporate all new projects and other feasible and CAISO-approved operational solutions brought forth by the PTOs that can be operational on or before June 1, of the study year. Any such solutions that can reduce the need for procurement to meet the Performance Level C criteria will be incorporated into the LCR Study. |
| <u>Load Pocket:</u> | |
| <ul style="list-style-type: none"> • Fixed Boundary, including limited reference to published effectiveness factors | This LCR Study has been produced based on load pockets defined by a fixed boundary. The CAISO only publishes effectiveness factors where they are useful in facilitating procurement where excess capacity exists within a load pocket. |

Further details regarding the 2019 as well as 2023 LCR Study methodology and assumptions are provided in Section III, below.

C. Grid Reliability

Service reliability builds from grid reliability because grid reliability is reflected in the Reliability Standards of the North American Electric Reliability Council (NERC) and the Western Electricity Coordinating Council (“WECC”) Regional Criteria (collectively “Reliability Standards”). The Reliability Standards apply to the interconnected electric system in the United States and are intended to address the reality that within an integrated network, whatever one Balancing Authority Area does can affect the reliability of other Balancing Authority Areas. Consistent with the mandatory nature of the Reliability Standards, the CAISO is under a statutory obligation to ensure efficient use and reliable operation of the transmission grid consistent with achievement of the Reliability Standards.¹ The CAISO is further under an obligation, pursuant to its FERC-approved Transmission Control Agreement, to secure compliance with all “Applicable Reliability Criteria.” Applicable Reliability Criteria consists of the Reliability Standards as well as reliability criteria adopted by the CAISO (Grid Planning Standards).

The Reliability Standards define reliability on interconnected electric systems using the terms “adequacy” and “security.” “Adequacy” is the ability of the electric systems to supply the aggregate electrical demand and energy requirements of their customers at all times, taking into account physical characteristics of the transmission system such as transmission ratings and scheduled and reasonably expected unscheduled outages of system elements. “Security” is the ability of the electric systems to withstand sudden disturbances such as electric short circuits or unanticipated loss of system elements. The Reliability Standards are organized by Performance Categories. Certain categories require that the grid operator not only ensure that grid integrity is maintained under certain adverse system conditions (e.g., security), but also that all customers continue to receive electric supply to meet demand (e.g., adequacy). In that case, grid reliability and service reliability would overlap. But there are other levels of performance where security can be maintained without ensuring adequacy.

¹ Pub. Utilities Code § 345

D. Application of N-1, N-1-1, and N-2 Criteria

The CAISO will maintain the system in a safe operating mode at all times. This obligation translates into respecting the Reliability Criteria at all times, for example during normal operating conditions (N-0) the CAISO must protect for all single contingencies (N-1) and common mode (N-2) double line outages. Also, after a single contingency, the CAISO must re-adjust the system to support the loss of the next most stringent contingency. This is referred to as the N-1-1 condition.

The N-1-1 vs N-2 terminology was introduced only as a temporal differentiation between two existing NERC Category C events. N-1-1 represents NERC Category C3 (“category B contingency, manual system adjustment, followed by another category B contingency”). The N-2 represents NERC Category C5 (“any two circuits of a multiple circuit tower line”) as well as WECC-S2 (for 500 kV only) (“any two circuits in the same right-of-way”) with no manual system adjustment between the two contingencies.

E. Performance Criteria

As set forth on the Summary Table of Inputs and Methodology, this LCR Report is based on NERC Performance Level B and Performance Level C criterion. The NERC Standards refer mainly to thermal overloads. However, the CAISO also tests the electric system in regards to the dynamic and reactive margin compliance with the existing WECC standards for the same NERC performance levels. These Performance Levels can be described as follows:

a. Performance Criteria- Category B

Category B describes the system performance that is expected immediately following the loss of a single transmission element, such as a transmission circuit, a generator, or a transformer.

Category B system performance requires that all thermal and voltage limits must be within their “Applicable Rating,” which, in this case, are the emergency ratings as generally determined by the PTO or facility owner. Applicable Rating includes a temporal element such that emergency ratings can only be maintained for certain duration. Under this category, load cannot be shed in order to assure the Applicable Ratings are met however there is no guarantee that facilities are returned to within normal ratings or to a state where it is safe to continue to operate the system in a reliable manner such that the next element out will not cause a violation of the Applicable Ratings.

b. Performance Criteria- Category C

The NERC Planning Standards require system operators to “look forward” to make sure they safely prepare for the “next” N-1 following the loss of the “first” N-1 (stay within Applicable Ratings after the “next” N-1). This is commonly referred to as N-1-1. Because it is assumed that some time exists between the “first” and “next” element losses, operating personnel may make any reasonable and feasible adjustments to the system to prepare for the loss of the second element, including, operating procedures, dispatching generation, moving load from one substation to another to reduce equipment loading, dispatching operating personnel to specific station locations to manually adjust load from the substation site, or installing a “Special Protection Scheme” that would remove pre-identified load from service upon the loss of the “next” element.² All Category C requirements in this report refer to situations when in real time (N-0) or after the first contingency (N-1) the system requires additional readjustment in


² A Special Protection Scheme is typically proposed as an operational solution that does not require additional generation and permits operators to effectively prepare for the next event as well as ensure security should the next event occur. However, these systems have their own risks, which limit the extent to which they could be deployed as a solution for grid reliability augmentation. While they provide the value of protecting against the next event without the need for pre-contingency load shedding, they add points of potential failure to the transmission network. This increases the potential for load interruptions because sometimes these systems will operate when not required and other times they will not operate when needed.

order to prepare for the next worst contingency. In this time frame, load drop is not allowed per existing planning criteria.

Generally, Category C describes system performance that is expected following the loss of two or more system elements. This loss of two elements is generally expected to happen simultaneously, referred to as N-2. It should be noted that once the “next” element is lost after the first contingency, as discussed above under the Performance Criteria B, N-1-1 scenario, the event is effectively a Category C. As noted above, depending on system design and expected system impacts, the **planned and controlled** interruption of supply to customers (load shedding), the removal from service of certain generators and curtailment of exports may be utilized to maintain grid “security.”

c. **CAISO Statutory Obligation Regarding Safe Operation**

The CAISO will maintain the system in a safe operating mode at all times. This obligation translates into respecting the Reliability Criteria at all times, for example during normal operating conditions **A (N-0)** the CAISO must protect for all single contingencies **B (N-1)** and common mode **C5 (N-2)** double line outages. As a further example, after a single contingency the CAISO must readjust the system in order to be able to support the loss of the next most stringent contingency **C3 (N-1-1)**.

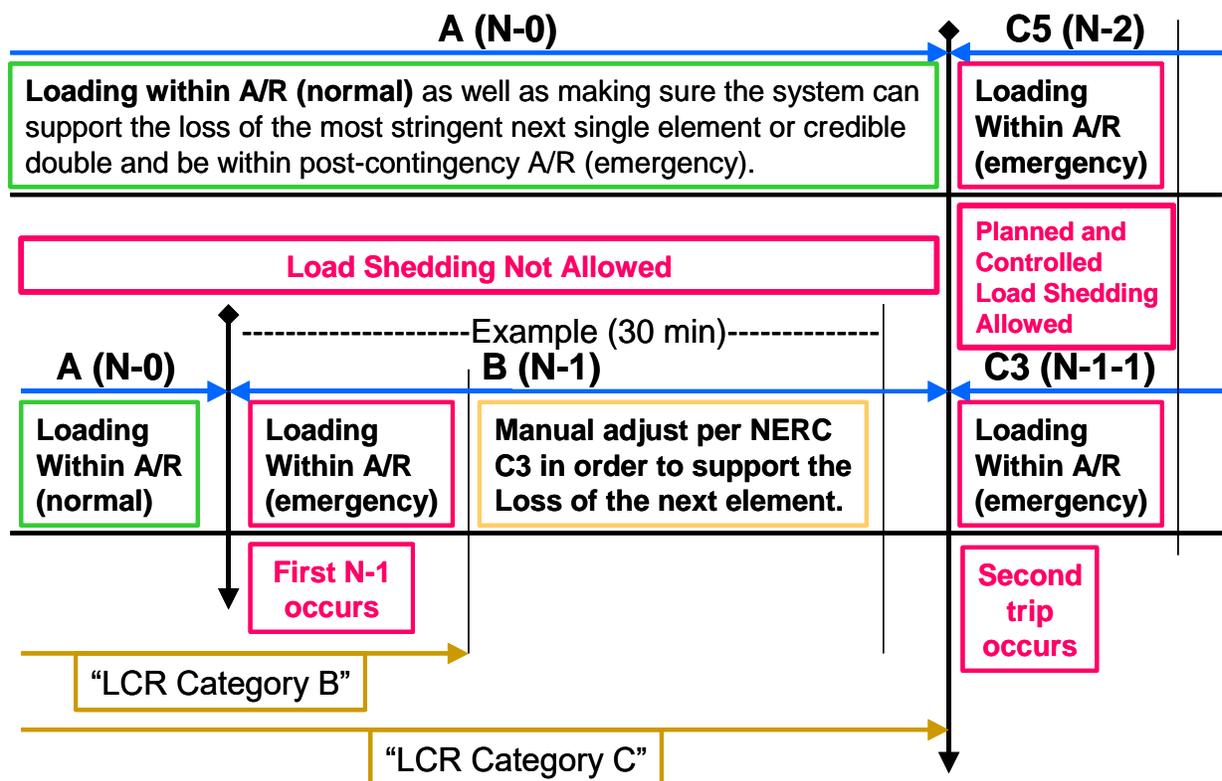

The following definitions guide the CAISO's interpretation of the Reliability Criteria governing safe mode operation and are used in this LCT Study:

Applicable Rating:

This represents the equipment rating that will be used under certain contingency conditions.

Normal rating is to be used under normal conditions.

Long-term emergency ratings, if available, will be used in all emergency conditions as long as "system readjustment" is provided in the amount of time given (specific to each element) to reduce the flow to within the normal ratings. If not available, the normal rating is to be used.

Short-term emergency ratings, if available, can be used as long as "system readjustment" is provided in the "short-time" available in order to reduce the flow to within the long-term emergency ratings where the element can be kept for another

length of time (specific to each element) before the flow needs to be reduced the below the normal ratings. If not available long-term emergency rating should be used.

Temperature-adjusted ratings shall not be used because this is a year-ahead study, not a real-time tool, and as such the worst-case scenario must be covered. In case temperature-adjusted ratings are the only ratings available then the minimum rating (highest temperature) given the study conditions shall be used.

CAISO Transmission Register is the only official keeper of all existing ratings mentioned above.

Ratings for future projects provided by PTO and agreed upon by the CAISO shall be used.

Other short-term ratings not included in the CAISO Transmission Register may be used as long as they are engineered, studied and enforced through clear operating procedures that can be followed by real-time operators.

Path Ratings need to be maintained within their limits in order to assure that proper capacity is available in order to operate the system in real-time in a safe operating zone.

Controlled load drop:

This is achieved with the use of a Special Protection Scheme.

Planned load drop:

This is achieved when the most limiting equipment has short-term emergency ratings AND the operators have an operating procedure that clearly describes the actions that need to be taken in order to shed load.

Special Protection Scheme:

All known SPS shall be assumed. New SPS must be verified and approved by the CAISO and must comply with the new SPS guideline described in the CAISO Planning Standards.

System Readjustment:

This represents the actions taken by operators in order to bring the system within a safe operating zone after any given contingency in the system.

Actions that can be taken as system readjustment after a single contingency (Category B):

1. System configuration change – based on validated and approved operating procedures
2. Generation re-dispatch
 - a. Decrease generation (up to 1150 MW) – limit given by single contingency SPS as part of the CAISO Grid Planning standards (ISO G4)
 - b. Increase generation – this generation will become part of the LCR need

Actions, which shall not be taken as system readjustment after a single contingency (Category B):

1. Load drop – based on the intent of the CAISO/WECC and NERC criteria for category B contingencies.

The NERC Transmission Planning Standards footnote mentions that load shedding can be done after a category B event in certain local areas in order to maintain compliance with performance criteria. However, the main body of the criteria spells out that no dropping of load should be done following a single contingency. All stakeholders and the CAISO agree that no involuntary interruption of load should be done immediately after a single contingency. Further, the CAISO and stakeholders now agree on the viability of dropping load as part of the system readjustment period – in order to protect for the next most limiting contingency. After a single contingency, it is understood that the system is in a Category B condition and the system should be planned based on the body of the criteria with no shedding of load regardless of whether it is done immediately or in 15-30 minute after the original contingency. Category C conditions only arrive after the second contingency has happened; at that point in time, shedding load is allowed in a planned and controlled manner.

A robust California transmission system should be, and under the LCT Study is being, planned based on the main body of the criteria, not the footnote regarding Category B

contingencies. Therefore, if there are available resources in the area, they are looked to meet reliability needs (and included in the LCR requirement) before resorting to involuntary load curtailment. The footnote may be applied for criteria compliance issues only where there are no resources available in the area.

Time allowed for manual readjustment:

Tariff Section 40.3.1.1, requires the CAISO, in performing the Local Capacity Technical Study, to apply the following reliability criterion:

Time Allowed for Manual Adjustment: This is the amount of time required for the Operator to take all actions necessary to prepare the system for the next Contingency. The time should not be more than thirty (30) minutes.

The CAISO Planning Standards also impose this manual readjustment requirement. As a parameter of the Local Capacity Technical Study, the CAISO must assume that as the system operator the CAISO will have sufficient time to:

- (1) make an informed assessment of system conditions after a contingency has occurred;
- (2) identify available resources and make prudent decisions about the most effective system redispatch;
- (3) manually readjust the system within safe operating limits after a first contingency to be prepared for the next contingency; and
- (4) allow sufficient time for resources to ramp and respond according to the operator's redispatch instructions. This all must be accomplished within 30 minutes.

Local capacity resources can meet this requirement by either (1) responding with sufficient speed, allowing the operator the necessary time to assess and redispatch resources to effectively reposition the system within 30 minutes after the first contingency, or (2) have sufficient energy available for frequent dispatch on a pre-contingency basis to ensure the operator can meet minimum online commitment constraints or reposition the system within 30 minutes after the first contingency occurs.

Accordingly, when evaluating resources that satisfy the requirements of the CAISO Local Capacity Technical Study, the CAISO assumes that local capacity resources need to be available in no longer than 20 minutes so the CAISO and demand response providers have a reasonable opportunity to perform their respective and necessary tasks and enable the CAISO to reposition the system within the 30 minutes in accordance with applicable reliability criteria.

F. The Two Options Presented In This LCT Report

This LCT Study sets forth different solution “options” with varying ranges of potential service reliability consistent with CAISO’s Reliability Criteria. The CAISO applies Option 2 for its purposes of identifying necessary local capacity needs and the corresponding potential scope of its backstop authority. Nevertheless, the CAISO continues to provide Option 1 as a point of reference for the CPUC and Local Regulatory Authorities in considering procurement targets for their jurisdictional LSEs.

1. Option 1- Meet Performance Criteria Category B

Option 1 is a service reliability level that reflects generation capacity that must be available to comply with reliability standards immediately after a NERC Category B given that load cannot be removed to meet this performance standard under Reliability Criteria. However, this capacity amount implicitly relies on load interruption as the **only means** of meeting any Reliability Criteria that is beyond the loss of a single transmission element (N-1). These situations will likely require substantial load interruptions in order to maintain system continuity and alleviate equipment overloads prior to the actual occurrence of the second contingency.³

³ This potential for pre-contingency load shedding also occurs because real time operators must prepare for the loss of a common mode N-2 at all times.

2. Option 2- Meet Performance Criteria Category C and Incorporate Suitable Operational Solutions

Option 2 is a service reliability level that reflects generation capacity that is needed to readjust the system to prepare for the loss of a second transmission element (N-1-1) using generation capacity *after* considering all reasonable and feasible operating solutions (including those involving customer load interruption) developed and approved by the CAISO, in consultation with the PTOs. Under this option, there is no expected load interruption to end-use customers under normal or single contingency conditions as the CAISO operators prepare for the second contingency. However, the customer load may be interrupted in the event the second contingency occurs.

As noted, Option 2 is the local capacity level that the CAISO requires to reliably operate the grid per NERC, WECC and CAISO standards. As such, the CAISO recommends adoption of this Option to guide resource adequacy procurement.

III. Assumption Details: How the Study was Conducted

A. System Planning Criteria

The following table provides a comparison of system planning criteria, based on the NERC performance standards, used in the study:

Table 4: Criteria Comparison

| Contingency Component(s) | ISO Grid Planning Criteria | Old RMR Criteria | Local Capacity Criteria |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------|------------------|-------------------------|
| <u>A – No Contingencies</u> | X | X | X |
| <u>B – Loss of a single element</u> | | | |
| 1. Generator (G-1) | X | X | X ¹ |
| 2. Transmission Circuit (L-1) | X | X | X ¹ |
| 3. Transformer (T-1) | X | X ² | X ^{1,2} |
| 4. Single Pole (dc) Line | X | X | X ¹ |
| 5. G-1 system readjusted L-1 | X | X | X |
| <u>C – Loss of two or more elements</u> | | | |
| 1. Bus Section | X | | |
| 2. Breaker (failure or internal fault) | X | | |
| 3. L-1 system readjusted G-1 | X | | X |
| 3. G-1 system readjusted T-1 or T-1 system readjusted G-1 | X | | X |
| 3. L-1 system readjusted T-1 or T-1 system readjusted L-1 | X | | X |
| 3. G-1 system readjusted G-1 | X | | X |
| 3. L-1 system readjusted L-1 | X | | X |
| 3. T-1 system readjusted T-1 | X | | |
| 4. Bipolar (dc) Line | X | | X |
| 5. Two circuits (Common Mode) L-2 | X | | X |
| 6. SLG fault (stuck breaker or protection failure) for G-1 | X | | |
| 7. SLG fault (stuck breaker or protection failure) for L-1 | X | | |
| 8. SLG fault (stuck breaker or protection failure) for T-1 | X | | |
| 9. SLG fault (stuck breaker or protection failure) for Bus section | X | | |
| WECC-S3. Two generators (Common Mode) G-2 | X ³ | | X |
| <u>D – Extreme event – loss of two or more elements</u> | | | |
| Any B1-4 system readjusted (Common Mode) L-2 | X ⁴ | | X ³ |
| All other extreme combinations D1-14. | X ⁴ | | |
| ¹ System must be able to readjust to a safe operating zone in order to be able to support the loss of the next contingency. ² A thermal or voltage criterion violation resulting from a transformer outage may not be cause for a local area reliability requirement if the violation is considered marginal (e.g. acceptable loss of facility life or low voltage), otherwise, such a violation will necessitate creation of a requirement. ³ Evaluate for risks and consequence, per NERC standards. No voltage collapse or dynamic instability allowed. ⁴ Evaluate for risks and consequence, per NERC standards. | | | |

A significant number of simulations were run to determine the most critical contingencies within each Local Capacity Area. Using power flow, post-transient load flow, and stability assessment tools, the system performance results of all the contingencies that were studied were measured against the system performance requirements defined by the criteria shown in Table 4. Where the specific system performance requirements were not met, generation was adjusted such that the minimum amount of generation required to meet the criteria was determined in the Local Capacity Area. The following describes how the criteria were tested for the specific type of analysis performed.

1. Power Flow Assessment:

| <u>Contingencies</u> | <u>Thermal Criteria</u> ³ | <u>Voltage Criteria</u> ⁴ |
|-----------------------------------|--------------------------------------|--------------------------------------|
| Generating unit ^{1, 6} | Applicable Rating | Applicable Rating |
| Transmission line ^{1, 6} | Applicable Rating | Applicable Rating |
| Transformer ^{1, 6} | Applicable Rating ⁵ | Applicable Rating ⁵ |
| (G-1)(L-1) ^{2, 6} | Applicable Rating | Applicable Rating |
| Overlapping ^{6, 7} | Applicable Rating | Applicable Rating |

- 1 All single contingency outages (i.e. generating unit, transmission line or transformer) will be simulated on Participating Transmission Owners’ local area systems.
- 2 Key generating unit out, system readjusted, followed by a line outage. This overlapping outage is considered a single contingency within the ISO Grid Planning Criteria. Therefore, load dropping for an overlapping G-1, L-1 scenario is not permitted.
- 3 Applicable Rating – Based on CAISO Transmission Register or facility upgrade plans including established Path ratings.
- 4 Applicable Rating – CAISO Grid Planning Criteria or facility owner criteria as appropriate including established Path ratings.
- 5 A thermal or voltage criterion violation resulting from a transformer outage may not be cause for a local area reliability requirement if the violation is considered marginal (e.g. acceptable loss of facility life or low voltage), otherwise, such a violation will necessitate creation of a requirement.
- 6 Following the first contingency (N-1), the generation must be sufficient to allow the operators to bring the system back to within acceptable (normal) operating range (voltage and loading) and/or appropriate OTC following the studied outage conditions.
- 7 During normal operation or following the first contingency (N-1), the generation must be sufficient to allow the operators to prepare for the next worst N-1 or

common mode N-2 without pre-contingency interruptible or firm load shedding. SPS/RAS/Safety Nets may be utilized to satisfy the criteria after the second N-1 or common mode N-2 except if the problem is of a thermal nature such that short-term ratings could be utilized to provide the operators time to shed either interruptible or firm load. T-2s (two transformer bank outages) would be excluded from the criteria.

2. Post Transient Load Flow Assessment:

| | |
|------------------------------------------------------|--------------------------------------------------------------------------|
| <u>Contingencies</u> Selected ¹ | <u>Reactive Margin Criteria</u> ² Applicable Rating |
|------------------------------------------------------|--------------------------------------------------------------------------|

- ¹ If power flow results indicate significant low voltages for a given power flow contingency, simulate that outage using the post transient load flow program. The post-transient assessment will develop appropriate Q/V and/or P/V curves.
- ² Applicable Rating – positive margin based on the higher of imports or load increase by 5% for N-1 contingencies, and 2.5% for N-2 contingencies.

3. Stability Assessment:

| | |
|------------------------------------------------------|--------------------------------------------------------------------|
| <u>Contingencies</u> Selected ¹ | <u>Stability Criteria</u> ² Applicable Rating |
|------------------------------------------------------|--------------------------------------------------------------------|

- ¹ Base on historical information, engineering judgment and/or if power flow or post transient study results indicate significant low voltages or marginal reactive margin for a given contingency.
- ² Applicable Rating – CAISO Grid Planning Criteria or facility owner criteria as appropriate.

B. Load Forecast

1. System Forecast

The California Energy Commission (CEC) derives the load forecast at the system and Participating Transmission Owner (PTO) levels. This relevant CEC forecast is then distributed across the entire system, down to the local area, division and substation level. The PTOs use an econometric equation to forecast the system load. The predominant parameters affecting the system load are (1) number of households, (2) economic activity (gross metropolitan products, GMP), (3) temperature and (4) increased energy efficiency and distributed generation programs.

2. Base Case Load Development Method

The method used to develop the load in the base case is a melding process that extracts, adjusts and modifies the information from the system, distribution and municipal utility forecasts. The melding process consists of two parts: Part 1 deals with the PTO load and Part 2 deals with the municipal utility load. There may be small differences between the methodologies used by each PTO to disaggregate the CEC load forecast to their level of local area as well as bar-bus model.

a. PTO Loads in Base Case

The methods used to determine the PTO loads are, for the most part, similar. One part of the method deals with the determination of the division⁴ loads that would meet the requirements of 1-in-5 or 1-in-10 system or area base cases and the other part deals with the allocation of the division load to the transmission buses.

i. Determination of division loads

The annual division load is determined by summing the previous year division load and the current division load growth. Thus, the key steps are the determination of the initial year division load and the annual load growth. The initial year for the base case development method is based heavily on recorded data. The division load growth in the system base case is determined in two steps. First, the total PTO load growth for the year is determined, as the product of the PTO load and the load growth rate from the system load forecast. Then this total PTO load growth is allocated to the division, based on the relative magnitude of the load growth projected for the divisions by the distribution planners. For example, for the 1-in-10 area base case, the division load growth determined for the system base case is adjusted to the 1-in-10 temperature using the load temperature relation determined from the latest peak load and temperature data of the division.

ii. Allocation of division load to transmission bus level

⁴ Each PTO divides its territory in a number of smaller area named divisions. These are usually smaller and compact areas that have the same temperature profile.

Since the loads in the base case are modeled at the various transmission buses, the division loads developed must be allocated to those buses. The allocation process is different depending on the load types. For the most part, each PTO classifies its loads into four types: conforming, non-conforming, self-generation and generation-plant loads. Since the non-conforming and self-generation loads are assumed to not vary with temperature, their magnitude would be the same in the system or area base cases of the same year. The remaining load (the total division load developed above, less the quantity of non-conforming and self-generation load) is the conforming load. The remaining load is allocated to the transmission buses based on the relative magnitude of the distribution forecast. The summation of all base case loads is generally higher than the load forecast because some load, i.e., self-generation and generation-plant, are behind the meter and must be modeled in the base cases. However, for the most part, metered or aggregated data with telemetry is used to come up with the load forecast.

b. Municipal Loads in Base Case

The municipal utility forecasts that have been provided to the CEC and PTOs for the purposes of their base cases were also used for this study.

C. Power Flow Program Used in the LCR analysis

The technical studies were conducted using General Electric's Power System Load Flow (GE PSLF) program version 21.04 and PowerGem's Transmission Adequacy and Reliability Assessment (TARA) program version 1702. This GE PSLF program is available directly from GE or through the Western System Electricity Council (WECC) to any member and TARA program is commercially available.

To evaluate Local Capacity Areas, the starting base case was adjusted to reflect the latest generation and transmission projects as well as the one-in-ten-year peak load forecast for each Local Capacity Area as provided to the CAISO by the PTOs.

Electronic contingency files provided by the PTOs were utilized to perform the numerous contingencies required to identify the LCR. These contingency files include remedial action and special protection schemes that are expected to be in operation

during the year of study. A CAISO created EPCL (a GE programming language contained within the GE PSLF package) routine and/or TARA software were used to run the combination of contingencies; however, other routines are available from WECC with the GE PSFL package or can be developed by third parties to identify the most limiting combination of contingencies requiring the highest amount of generation within the local area to maintain power flows within applicable ratings.

IV. Locational Capacity Requirement Study Results

A. Summary of Study Results

LCR is defined as the amount of resource capacity that is needed within a Local Capacity Area to reliably serve the load located within this area. The results of the CAISO’s analysis are summarized in the Executive Summary Tables.

Table 5: 2019 Local Capacity Needs vs. Peak Load and Local Area Resources

| | 2019 Total LCR (MW) | Peak Load (1 in10) (MW) | 2019 LCR as % of Peak Load | Total Dependable Local Area Resources (MW) | 2019 LCR as % of Total Area Resources |
|---------------------------|---------------------|-------------------------|----------------------------|--------------------------------------------|---------------------------------------|
| Humboldt | 165 | 187 | 88% | 202 | 82% |
| North Coast/North Bay | 689 | 1465 | 47% | 890 | 77% |
| Sierra | 2247 | 1758 | 128% | 2150 | 105%** |
| Stockton | 777 | 1174 | 66% | 633 | 123%** |
| Greater Bay | 4461 | 10230 | 44% | 7076 | 63% |
| Greater Fresno | 1671 | 3070 | 54% | 3517 | 48%** |
| Kern | 478 | 1088 | 44% | 475 | 101%** |
| LA Basin | 8116 | 19266 | 42% | 10866 | 75% |
| Big Creek/Ventura | 2614 | 5162 | 51% | 5073 | 52% |
| San Diego/Imperial Valley | 4026 | 4412 | 91% | 4391 | 92% |
| Total | 25244 | 47812* | 53%* | 35273 | 72% |

Table 6: 2023 Local Capacity Needs vs. Peak Load and Local Area Resources

| | 2023 Total LCR (MW) | Peak Load (1 in10) (MW) | 2023 LCR as % of Peak Load | Total Dependable Local Area Resources (MW) | 2023 LCR as % of Total Area Resources |
|------------------------------|------------------------------------|----------------------------------------|-------------------------------------------|-----------------------------------------------------------|------------------------------------------------------|
| Humboldt | 169 | 188 | 90% | 202 | 84% |
| North Coast/North Bay | 553 | 1524 | 36% | 890 | 62% |
| Sierra | 1924 | 1822 | 106% | 2150 | 89% |
| Stockton | 439 | 1227 | 36% | 684 | 64%** |
| Greater Bay | 4752 | 10441 | 46% | 7054 | 67% |
| Greater Fresno | 1688 | 3231 | 52% | 3517 | 48% |
| Kern | 182 | 1140 | 16% | 475 | 38%** |
| LA Basin | 6793 | 20072 | 34% | 8311 | 82% |
| Big Creek/Ventura | 2792 | 5169 | 54% | 3506 | 80%** |
| San Diego/Imperial Valley | 4132 | 4554 | 91% | 4520 | 91% |
| Total | 23424 | 49368* | 47%* | 31309 | 75% |

* Value shown only illustrative, since each local area peaks at a different time.

** Resource deficient LCA (or with sub-area that are deficient) – deficiency included in LCR. Resource deficient area implies that in order to comply with the criteria, at summer peak, load must be shed immediately after the first contingency.

Tables 5 and 6 shows how much of the Local Capacity Area load is dependent on local resources and how many local resources must be available in order to serve the load in those Local Capacity Areas in a manner consistent with the Reliability Criteria. These tables also indicate where new transmission projects, new resource additions or demand side management programs would be most useful in order to reduce the dependency on existing, generally older and less efficient local area resources.

The term “Qualifying Capacity” used in this report is the “Net Qualifying Capacity” (“NQC”) posted on the CAISO web site at:

<http://www.caiso.com/planning/Pages/ReliabilityRequirements/Default.aspx>

The NQC list includes the area (if applicable) where each resource is located for units already operational. Neither the NQC list nor this report incorporates Demand Side Management programs and their related NQC. Units scheduled to become

operational before June 1 of 2023 have been included in this 2023 Long-Term LCR Report and added to the total NQC values for those respective areas (see detail write-up for each area).

Regarding the main tables up front (page 2), the first column, “Qualifying Capacity,” reflects two sets of resources. The first set is comprised of resources that would normally be expected to be on-line such as Municipal and Regulatory Must-take resources (state, federal, QFs, wind and nuclear units). The second set is “market” resources. The second column, “YEAR LCR Requirement Based on Category B” identifies the local capacity requirements, and deficiencies that must be addressed, in order to achieve a service reliability level based on Performance Criteria- Category B. The third column, “YEAR LCR Requirement Based on Category C with Operating Procedure”, sets forth the local capacity requirements, and deficiencies that must be addressed, necessary to attain a service reliability level based on Performance Criteria- Category C with operational solutions.

B. Summary of Results by Local Area

Each Local Capacity Area’s overall requirement is determined by also achieving each sub-area requirement. Because these areas are a part of the interconnected electric system, the total for each Local Capacity Area is not simply a summation of the sub-area needs. For example, some sub-areas may overlap and therefore the same units may count for meeting the needs in both sub-areas.

1. Humboldt Area

Area Definition:

The transmission tie lines into the area include:

- 1) Bridgeville-Cottonwood 115 kV line #1
- 2) Humboldt-Trinity 115 kV line #1

- 3) Willits-Garberville 60 kV line #1
- 4) Trinity-Maple Creek 60 kV line #1

The substations that delineate the Humboldt Area are:

- 1) Bridgeville and Low Gap are in, Cottonwood is out
- 2) Humboldt is in Trinity is out
- 3) Willits is out, Kekawaka and Garberville are in
- 4) Trinity is out, Ridge Cabin and Maple Creek are in

Load:

Total 2022 busload within the defined area: 196 MW with -19 MW of AAEE and 12 MW of losses resulting in total load + losses of 188 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Maple Creek Reactive Support
2. Garberville Reactive Support
3. Bridgeville 115/60 kV #1 transformer replacement

Critical Contingency Analysis Summary:

Humboldt Overall:

The most critical contingency for the Humboldt area is the outage of the Cottonwood-Bridgeville 115 kV line overlapping with an outage of the gen-tie (Humboldt-Humboldt Bay 115 kV Line) from Humboldt Bay Power Plant to units 1-4. The local area limitation is potential overload on the Humboldt -Trinity 115 kV Line. This contingency establishes a local capacity need of 169 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this area.

The single most critical contingency for the Humboldt area is the outage of the Cottonwood-Bridgeville 115 kV line with one of the Humboldt Bay Power Plant units already out of service, which could potentially overload the Humboldt -Trinity 115 kV line. This contingency establishes a local capacity need of 111 MW in 2023.

Effectiveness factors:

For most helpful procurement information please read procedure 2210Z Effectiveness Factors under 7110 (T-138Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Changes compared to last year’s results:

The load forecast decreased by 2 MW from 2022 to 2023 and the total LCR has remained the same.

Humboldt Overall Requirements:

| 2023 | QF/Selfgen (MW) | Market (MW) | Max. Qualifying Capacity (MW) |
|----------------------|-----------------|-------------|-------------------------------|
| Available generation | 0 | 202 | 202 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|------------------------------------|------------------------------------------|-----------------|----------------------|
| Category B (Single) ⁵ | 111 | 0 | 111 |
| Category C (Multiple) ⁶ | 169 | 0 | 169 |

2. North Coast / North Bay Area

Area Definition:

The transmission tie facilities coming into the North Coast/North Bay area are:

- 1) Cortina-Mendocino 115 kV Line
- 2) Cortina-Eagle Rock 115 kV Line
- 3) Willits-Garberville 60 kV line #1
- 4) Vaca Dixon-Lakeville 230 kV line #1
- 5) Tulucay-Vaca Dixon 230 kV line #1

⁵ LCR requirement for a single contingency means that there wouldn’t be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

⁶ LCR requirement for multiple contingencies means that not only there wouldn’t be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 6) Lakeville-Sobrante 230 kV line #1
- 7) Ignacio-Sobrante 230 kV line #1

The substations that delineate the North Coast/North Bay area are:

- 1) Cortina is out, Mendocino and Indian Valley are in
- 2) Cortina is out, Eagle Rock, Highlands and Homestake are in
- 3) Willits and Lytonville are in, Kekawaka and Garberville are out
- 4) Vaca Dixon is out, Lakeville is in
- 5) Tulucay is in, Vaca Dixon is out
- 6) Lakeville is in, Sobrante is out
- 7) Ignacio is in, Sobrante and Crocket are out

Load:

Total 2023 busload within the defined area: 1557 MW with -60 MW of AAEE, -15 MW BTM-PV, and 42 MW of losses resulting in total load + losses of 1524 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Vaca Dixon-Lakeville 230 kV Corridor Series Compensation

Critical Contingency Analysis Summary:

Eagle Rock Sub-area

The most critical overlapping contingency is an outage of the Geysers #3 - Geysers #5 115 kV line and the Cortina-Mendocino 115 kV line. The sub-area area limitation is thermal overloading of the Eagle Rock-Cortina 115 kV line. This limiting contingency establishes a local capacity need of 257 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

The most critical single contingency is an outage of the Cortina-Mendocino 115 kV transmission line with Geysers 11 unit out of service. The sub-area limitation is thermal overloading of the parallel Eagle Rock-Cortina 115 kV line. This limiting contingency establishes a local capacity need of 238 MW in 2023.

Effectiveness factors:

See Appendix B - Table titled [Eagle Rock](#).

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7120 (T-151Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Fulton Sub-area

The most critical overlapping contingency is the outage of the Fulton-Ignacio 230 kV line #1 and the Fulton-Lakeville 230 kV line #1. The sub-area area limitation is thermal overloading of Lakeville # 2 60 kV line (Lakeville-Petaluma A – Cotati 60 kV). This limiting contingency establishes a local capacity need of 553 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area. All of the units required to meet the Eagle Rock pocket count towards the Fulton total requirement.

Effectiveness factors:

See Appendix B – Table titled [Fulton](#).

Lakeville Sub-area (North Coast/North Bay Overall)

The most limiting non-binding contingency for the North Coast/North Bay Area is an outage of Vaca Dixon-Tulucay 230 kV line and Delta Energy Center power plant being out of service. The area limitation is thermal overloading of the Vaca Dixon-Lakeville 230 kV line with series compensation included.

Effectiveness factors:

See Appendix B – Table titled [Lakeville](#).

Changes compared to last year's results:

Overall the load forecast went up by 275 MW compared to 2022. The overall LCR requirement went up by 113 MW as a result of load increase in the Fulton sub-area.

North Coast/North Bay Overall Requirements:

| 2023 | QF/Selfgen (MW) | Muni (MW) | Market (MW) | Max. Qualifying Capacity (MW) |
|----------------------|-----------------|-----------|-------------|-------------------------------|
| Available generation | 6 | 113 | 771 | 890 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|-------------------------------------|------------------------------------------|-----------------|----------------------|
| Category P1 (Single) ⁷ | 553 | 0 | 553 |
| Category P7 (Multiple) ⁸ | 553 | 0 | 553 |

3. Sierra Area

Area Definition:

The transmission tie lines into the Sierra Area are:

- 1) Table Mountain-Rio Oso 230 kV line
- 2) Table Mountain-Palermo 230 kV line
- 3) Table Mt-Pease 60 kV line
- 4) Caribou-Palermo 115 kV line
- 5) Drum-Summit 115 kV line #1
- 6) Drum-Summit 115 kV line #2
- 7) Spaulding-Summit 60 kV line
- 8) Brighton-Bellota 230 kV line
- 9) Rio Oso-Lockeford 230 kV line
- 10) Gold Hill-Eight Mile Road 230 kV line
- 11) Lodi-Eight Mile Road 230 kV line
- 12) Gold Hill-Lake 230 kV line

The substations that delineate the Sierra Area are:

- 1) Table Mountain is out Rio Oso is in
- 2) Table Mountain is out Palermo is in
- 3) Table Mt is out Pease is in
- 4) Caribou is out Palermo is in
- 5) Drum is in Summit is out
- 6) Drum is in Summit is out

⁷ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

⁸ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 7) Spaulding is in Summit is out
- 8) Brighton is in Bellota is out
- 9) Rio Oso is in Lockeford is out
- 10) Gold Hill is in Eight Mile is out
- 11) Lodi is in Eight Mile is out
- 12) Gold Hill is in Lake is out

Load:

Total 2023 busload within the defined area: 1819 MW with -66 MW of AAEE, -18 MW of BTM-PV, and 87 MW of losses resulting in total load + losses of 1822 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Gold Hill-Missouri Flat #1 and #2 115 kV line reconductoring
2. Rio Oso #1 and #2 230/115 kV transformer replacement
3. Pease 115/60 kV transformer addition
4. South of Palermo 115 kV Reinforcement

Critical Contingency Analysis Summary:

Placerville Sub-area

No requirements due to the Missouri Flat-Gold Hill 115 kV lines reconductoring project.

Placer Sub-area

The most critical contingency is the loss of the Gold Hill-Placer #1 115 kV line with Chicago Park unit out of service. The area limitation is thermal overloading of the Drum-Higgins 115 kV line. This limiting contingency establishes a local capacity need of 89 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area (Chicago Park, Dutch Flat #1, Wise units 1&2, Newcastle, and Halsey) have the same effectiveness factor.

Pease Sub-area

The most critical contingency is the loss of the Palermo-Pease 115 kV line followed by Pease-Rio Oso 115 kV line. The area limitation is thermal overloading of the Table Mountain-Pease 60 kV line. This limiting contingency establishes a LCR of 75 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

There is no single contingency requirement.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Drum-Rio Oso Sub-area

No requirement due to the Rio Oso 230/115 kV Transformer Upgrade project.

South of Rio Oso Sub-area

The most critical contingency is the loss of the Rio Oso-Gold Hill 230 kV line followed by loss of the Rio Oso-Brighton #1 230 kV line. The sub-area limitation is thermal overloading of the Rio Oso-Atlantic 230 kV line. This limiting contingency establishes a LCR of 554 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

The single most critical contingency is the loss of the Rio Oso-Gold Hill 230 kV line with Ralston unit out of service. The area limitation is thermal overloading of the Rio Oso-Atlantic 230 kV line. This limiting contingency establishes a LCR of 416 MW in 2023.

Effectiveness factors:

See Appendix B - Table titled [Rio Oso](#).

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7230 (T-165Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

South of Palermo Sub-area

No additional requirement beyond those established by Pease and South of Rio Oso.

South of Table Mountain Sub-area

The most critical contingency is the loss of the Table Mountain-Rio Oso and Table Mountain-Palermo 230 kV double circuit tower line potentially overloading the Caribou-Palermo 115 kV line. This limitation establishes an LCR of 1924 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this area.

The most critical single contingency is the loss of the Table Mountain-Palermo 230 kV line with Belden unit out of service potentially overloading the Table Mountain-Rio Oso 230 kV line. This limiting contingency establishes a local capacity need of 1268 MW.

Effectiveness factors:

See Appendix B - Table titled [South of Table Mountain](#).

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7230 (T-165Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Changes compared to last year's results:

The load forecast went up by 8 MW as compared to 2022. Overall the total LCR for the Sierra area has decreased by 43 MW due to new transmission projects.

Sierra Overall Requirements:

| 2023 | QF (MW) | Muni (MW) | Market (MW) | Max. Qualifying Capacity (MW) |
|----------------------|---------|-----------|-------------|-------------------------------|
| Available generation | 38 | 1108 | 1004 | 2150 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|----------------------------------|------------------------------------------|-----------------|----------------------|
| Category B (Single) ⁹ | 1268 | 0 | 1268 |

⁹ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

| | | | |
|-------------------------------------|------|---|------|
| Category C (Multiple) ¹⁰ | 1924 | 0 | 1924 |
|-------------------------------------|------|---|------|

4. Stockton Area

The LCR requirement for the Stockton Area is driven by the sum of the requirements for the Tesla-Bellota, Lockeford and Weber sub-areas.

Area Definition:

Tesla-Bellota Sub-Area Definition

The transmission facilities that establish the boundary of the Tesla-Bellota sub-area are:

- 1) Bellota 230/115 kV Transformer #1
- 2) Bellota 230/115 kV Transformer #2
- 3) Tesla-Tracy 115 kV Line
- 4) Tesla-Salado 115 kV Line
- 5) Tesla-Salado-Manteca 115 kV line
- 6) Tesla-Schulte #1 115 kV Line
- 7) Tesla-Schulte #2 115kV line
- 8) Tesla-Vierra 115 kV Line

The substations that delineate the Tesla-Bellota Sub-area are:

- 1) Bellota 230 kV is out Bellota 115 kV is in
- 2) Bellota 230 kV is out Bellota 115 kV is in
- 3) Tesla is out Tracy is in
- 4) Tesla is out Salado is in
- 5) Tesla is out Salado and Manteca are in
- 6) Tesla is out Schulte is in
- 7) Tesla is out Schulte is in
- 8) Tesla is out Thermal Energy is in

Lockeford Sub-Area Definition

The transmission facilities that establish the boundary of the Lockeford sub-area are:

- 1) Lockeford-Industrial 60 kV line
- 2) Lockeford-Lodi #1 60 kV line

¹⁰ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 3) Lockeford-Lodi #2 60 kV line
- 4) Lockeford-Lodi #3 60 kV line

The substations that delineate the Lockeford Sub-area are:

- 1) Lockeford is out Industrial is in
- 2) Lockeford is out Lodi is in
- 3) Lockeford is out Lodi is in
- 4) Lockeford is out Lodi is in

Weber Sub-Area Definition

The transmission facilities that establish the boundary of the Weber Sub-area are:

- 1) Weber 230/60 kV Transformer #1
- 2) Weber 230/60 kV Transformer #2

The substations that delineate the Weber Sub-area are:

- 1) Weber 230 kV is out Weber 60 kV is in
- 2) Weber 230 kV is out Weber 60 kV is in

Load:

Total 2023 busload within the defined area: 1278 MW with -63 MW of AAEE, -8 MW of BTM-PV, and 20 MW of losses resulting in total load + losses of 1227 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Weber-Stockton "A" #1 and #2 60 kV Reconductoring
2. Ripon 115 kV line
3. Vierra 115 kV Looping Project

Critical Contingency Analysis Summary:

Stanislaus Sub-area

The critical contingency for the Stanislaus sub-area is the loss of Bellota-Riverbank-Melones 115 kV circuit with Stanislaus PH out of service. The area limitation is thermal overloading of the River Bank Jct.-Manteca 115 kV line. This limiting contingency establishes a local capacity need of 147 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Tesla-Bellota Sub-area

The most critical contingency for the Tesla-Bellota pocket is the loss of Schulte-Kasson-Manteca 115 kV and Schulte-Lammers 115 kV. The area limitation is thermal overload of the Tesla-Tracy 115 kV line above its emergency rating. This limiting contingency establishes a local capacity need of 319 MW (includes 27 MW of deficiency) in 2023.

The single most critical contingency for the Tesla-Bellota pocket is the loss of Tesla-Schulte #2 115 kV line and the loss of the GWF Tracy unit #3. The area limitation is thermal overload of the Tesla-Schulte #1 115 kV line. This single contingency establishes a local capacity need of 201 MW in 2023.

All of the resources needed to meet the Stanislaus sub-area count towards the Tesla-Bellota sub-area LCR need.

Effectiveness factors:

All units within this sub-area are needed therefore no effectiveness factor is required.

Lockeford Sub-area

The critical contingency for the Lockeford area is the loss of Lockeford-Industrial 60 kV circuit and Lockeford-Lodi #2 60 kV circuit. The area limitation is thermal overloading of the Lockeford-Lodi #3 60 kV circuit. This limiting contingency establishes a local capacity need of 103 MW (including 79 MW of deficiency) in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

The most critical single contingency is the loss of the Lockeford-Industrial 60 kV line with Lodi CT unit out of service. The area limitation is thermal overloading of the

Lockeford-Lodi 60 kV line and establishes a local capacity need of 44 MW (including 20 MW of deficiency) in 2023.

Effectiveness factors:

All units within this sub-area are needed therefore no effectiveness factor is required.

Weber Sub-area

The critical contingency is the loss of Stockton A-Weber #1 & #2 60 kV lines. The area limitation is thermal overloading of the Stockton A-Weber #3 60 kV line. This limiting contingency establishes a local capacity need of 17 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Stockton Overall

The requirement for this area is driven by the sum of requirements for the Tesla-Bellota, Lockeford and Weber sub-areas.

Changes compared to last year's results:

The 2023 load forecast went up by 192 MW and the overall LCR has decreased by 263 MW compared to the 2022 due to transmission project implementation.

Stockton Overall Requirements:

| 2023 | QF (MW) | Muni (MW) | Market (MW) | Max. Qualifying Capacity (MW) |
|----------------------|---------|-----------|-------------|-------------------------------|
| Available generation | 18 | 126 | 540 | 684 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|-----------------------------------|------------------------------------------|-----------------|----------------------|
| Category B (Single) ¹¹ | 225 | 20 | 245 |

¹¹ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in

| | | | |
|-------------------------------------|-----|-----|-----|
| Category C (Multiple) ¹² | 333 | 106 | 439 |
|-------------------------------------|-----|-----|-----|

5. Greater Bay Area

Area Definition:

The transmission tie lines into the Greater Bay Area are:

- 1) Lakeville-Sobrante 230 kV
- 2) Ignacio-Sobrante 230 kV
- 3) Parkway-Moraga 230 kV
- 4) Bahia-Moraga 230 kV
- 5) Lambie SW Sta-Vaca Dixon 230 kV
- 6) Peabody-Contra Costa P.P. 230 kV
- 7) Tesla-Kelso 230 kV
- 8) Tesla-Delta Switching Yard 230 kV
- 9) Tesla-Pittsburg #1 230 kV
- 10) Tesla-Pittsburg #2 230 kV
- 11) Tesla-Newark #1 230 kV
- 12) Tesla-Newark #2 230 kV
- 13) Tesla-Ravenswood 230 kV
- 14) Tesla-Metcalf 500 kV
- 15) Moss Landing-Metcalf 500 kV
- 16) Moss Landing-Metcalf #1 230 kV
- 17) Moss Landing-Metcalf #2 230 kV
- 18) Oakdale TID-Newark #1 115 kV
- 19) Oakdale TID-Newark #2 115 kV

The substations that delineate the Greater Bay Area are:

- 1) Lakeville is out Sobrante is in
- 2) Ignacio is out Sobrante is in
- 3) Parkway is out Moraga is in
- 4) Bahia is out Moraga is in
- 5) Lambie SW Sta is in Vaca Dixon is out
- 6) Peabody is out Contra Costa P.P. is in
- 7) Tesla is out Kelso is in
- 8) Tesla is out Delta Switching Yard is in

order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹² LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 9) Tesla is out Pittsburg is in
- 10) Tesla is out Pittsburg is in
- 11) Tesla is out Newark is in
- 12) Tesla is out Newark is in
- 13) Tesla is out Ravenswood is in
- 14) Tesla is out Metcalf is in
- 15) Moss Landing is out Metcalf is in
- 16) Moss Landing is out Metcalf is in
- 17) Moss Landing is out Metcalf is in
- 18) Oakdale TID is out Newark is in
- 19) Oakdale TID is out Newark is in

Load:

Total 2023 busload within the defined area: 10,502 MW with -465 MW of AAEE, -61 MW of Behind the meter DG, 245 MW of losses and 220 MW of pumps resulting in total load + losses + pumps of 10,441 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Oakland Clean Energy Initiative Project (Oakland CTs are assumed retired)
2. Morgan Hill Area Reinforcement (revised scope)
3. Metcalf-Piercy & Swift and Newark-Dixon Landing 115 kV Upgrade
4. East Shore-Oakland J 115 kV Reconductoring Project
5. Vaca Dixon-Lakeville 230 kV Corridor Series Compensation
6. Metcalf-Evergreen 115 kV Line Reconductoring

Critical Contingency Analysis Summary:

Oakland Sub-area

No requirement.

Llagas Sub-area

The most critical contingency is an outage of Metcalf D-Morgan Hill 115 kV line with the Morgan Hill-Green Valley 115 kV line. The area limitation is the thermal overloading of

the Morgan Hill-Llagas 115 kV line above its emergency rating. This limiting contingency establishes a local capacity need of 13 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

San Jose Sub-area

The most critical contingency is the Newark-Los Esteros 230 kV line overlapped with Metcalf-Los Esteros 230 kV line. The limiting element is the Newark-NRS 115 kV line and establishes a local capacity 293 MW in 2023 as minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

See Appendix B – Table titled [San Jose](#).

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7320 (T-133Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

South Bay-Moss Landing Sub-area

The most critical contingency is an outage of the Tesla-Metcalf 500 kV and Moss Landing-Los Banos 500 kV. The area limitation is thermal overloading of the Las Aguilas-Moss Landing 230 kV. This limiting contingency establishes a LCR of 1977 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Resources in San Jose and Llagas sub-areas are also included in this sub-area.

Effectiveness factors:

See Appendix B – Table titled [South Bay-Moss Landing](#).

Ames/Pittsburg/Oakland Sub-areas Combined

The one critical contingency in NCNB and two most critical contingencies in Ames/Pittsburg/Oakland listed below together establish a local capacity need of 2430 MW in 2023 as follows: 553 MW in NCNB and 1630 MW in the Ames/Pittsburg/Oakland as the minimum capacity necessary for reliable load serving capability within these sub-areas.

The most critical contingencies in the Bay Area are:

- 1) an outage of DCTL Newark-Ravenswood & Tesla-Ravenswood 230 kV with limitation of thermal overloading of Ames-Ravenswood #1 115 kV line. And
- 2) an overlapping outage of Moraga-Sobrante & Moraga-Claremont #1 115 kV lines with limitation of thermal overloading of Moraga-Claremont #2 115 kV line.

The most critical contingency in North Coast/North Bay area is an outage of Vaca Dixon-Tulucay 230 kV line with Delta Energy Center power plant out of service. The area limitation is thermal overloading of Vaca Dixon-Lakeville 230 kV line.

Effectiveness factors:

See Appendix B – Table titled [Ames/Pittsburg/Oakland](#).

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7320 (T-133Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Contra Costa Sub-area

The most critical contingency is an outage of Kelso-Tesla 230 kV with Gateway out of service. The area limitation is thermal overloading of the Delta Switching Yard-Tesla 230 kV line. This limiting contingency establishes a LCR of 1145 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

For most helpful procurement information please read procedure 2210Z Effectiveness

Factors under 7320 (T-133Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Bay Area overall

The most critical need is the aggregate of sub-area requirements. This establishes a LCR of 4752 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this area.

The most critical single contingency is the loss of the Tesla-Metcalf 500 kV with Delta Energy Center out of service. The area limitation is reactive margin. This limiting contingency establishes a local capacity need of 3676 MW in 2023 .

Effectiveness factors:

For most helpful procurement information please read procedure 2210Z Effectiveness Factors under 7320 (T-133Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Changes compared to last year's results:

From 2022 the load forecast increased by 261 MW compared with the physically defined Bay Area. The LCR has decreased by 563 MW due to new transmission projects.

Bay Area Overall Requirements:

| 2023 | Wind (MW) | QF/Selfgen (MW) | Muni (MW) | Market (MW) | Battery (MW) | Max. Qualifying Capacity (MW) |
|----------------------|-----------|-----------------|-----------|-------------|--------------|-------------------------------|
| Available generation | 321 | 245 | 382 | 6102 | 4 | 7054 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|-------------------------------------|------------------------------------------|-----------------|----------------------|
| Category B (Single) ¹³ | 3676 | 0 | 3676 |
| Category C (Multiple) ¹⁴ | 4752 | 0 | 4752 |

¹³ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹⁴ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

6. Greater Fresno Area

Area Definition:

The transmission facilities coming into the Greater Fresno area are:

- 1) Gates-Mustang #1 230 kV
- 2) Gates-Mustang #2 230 kV
- 3) Gates #5 230/70 kV Transformer Bank
- 4) Mercy Spring 230 /70 Bank # 1
- 5) Los Banos #3 230/70 Transformer Bank
- 6) Los Banos #4 230/70 Transformer Bank
- 7) Warnerville-Wilson 230kV
- 8) Melones-North Merced 230 kV line
- 9) Panoche-Tranquility #1 230 kV
- 10) Panoche-Tranquility #2 230 kV
- 11) Panoche #1 230/115 kV Transformer Bank
- 12) Panoche #2 230/115 kV Transformer Bank
- 13) Corcoran-Smyrna 115kV
- 14) Coalinga #1-San Miguel 70 kV

The substations that delineate the Greater Fresno area are:

- 1) Gates is out Mustang is in
- 2) Gates is out Mustang is in
- 3) Gates 230 is out Gates 70 is in
- 4) Mercy Springs 230 is out Mercy Springs 70 is in
- 5) Los Banos 230 is out Los Banos 70 is in
- 6) Los Banos 230 is out Los Banos 70 is in
- 7) Warnerville is out Wilson is in
- 8) Melones is out North Merced is in
- 9) Panoche is out Tranquility #1 is in
- 10) Panoche is out Tranquility #2 is in
- 11) Panoche 230 is out Panoche 115 is in
- 12) Panoche 230 is out Panoche 115 is in
- 13) Corcoran is in Smyrna is out
- 14) Coalinga is in San Miguel is out

Load:

Total 2023 load within the defined area: 3276 MW with -114 MW of AAEE, 104 MW of losses and -35 MW of DG resulting in total load + losses of 3231 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Gates #12 500/230 Transformer Bank addition (Dec 2019)
2. Wilson 115 kV SVC(2020)
3. Northern Fresno 115 kV Reinforcement (Revised scope- 2020)
4. Wilson-Legrand 115 kV Reconductoring (2020)
5. Panoche-Oro Loma 115 kV Reconductoring (2020)
6. Oro Loma 70 kV Reinforcement (2020)
7. Reedley 70 kV Reinforcement Projects (2021)
8. Herndon-Bullard Reconductoring Projects (2021)

Critical Contingency Analysis Summary:

Hanford Sub-area

The most critical contingency for the Hanford sub-area is the loss of the Gates-Mustang #1 and #2 230 kV lines, which would thermally overload the McCall-Kingsburg #1 115 kV line . This limiting contingency establishes a local capacity need of 107 MW in 2023 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Coalinga Sub-area

The most critical contingency for the Coalinga sub-area is the loss of the Gates #5 230/70 kV transformer followed by the Panoche-Schindler #1 and #2 common tower

contingency, which could cause voltage instability in the pocket. This limiting contingency establishes a local capacity need of 16 MW in 2023 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Borden Sub-area

The most critical contingency for the Borden sub-area is the loss of the Borden #4 230/70 kV transformer followed by the Friant-Coppermine 70 kV line, which could cause overload on the Borden #1 230/70 kV transformer. This limiting contingency establishes a local capacity need of 8 MW in 2023 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Reedley Sub-area

The most critical contingency for the Reedley sub-area is the loss of the McCall-Reedley (McCall-Wahtoke) 115 kV line followed by the Sanger-Reedley 115 kV line, which could thermally overload the Kings River-Sanger-Reedley (Sanger-Rainbow Tap) 115 kV line. This limiting contingency establishes a local capacity need of 12 MW (including 1 MW of deficiency) in 2023 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

There is no single critical contingency in this sub-area.

Herndon Sub-area

The most critical contingency is the loss of Herndon-Woodward 115kV line and Herndon-Barton 115kV line. This contingency could thermally overload the Herndon-Manchester 115 kV line. This limiting contingency established an LCR of 821 MW in

2023 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

The single most critical contingency is the loss of Herndon-Barton 115 kV line with Balch 1 generating unit out of service. This contingency would thermally overload the Herndon-Manchester 115 kV line and establishes an LCR of 293 MW.

Effectiveness factors:

See Appendix B - Table titled [Herndon](#).

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7430 (T-129) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Overall (Wilson) Sub-area

The most critical contingency for the Fresno area is the loss of the Gates-Mustang 230 kV line #1 or #2 and Helms-Gregg 230 kV line, which could thermally overload the remaining Gates-Mustang 230 kV line. This limiting contingency establishes a local capacity need of 1688 MW in 2023 as the generation capacity necessary for reliable load serving capability within this area.

The most critical single contingency for the Fresno area is the loss of the Gates-Mustang 230kV line #1 or #2 and one Helms unit, which could thermally overload the remaining Gates-Mustang 230kV line. This limiting contingency establishes a local capacity need of 1688 MW.

Effectiveness factors:

For most helpful procurement information please read procedure 2210Z Effectiveness Factors under 7430 (T-129) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Changes compared to last year's results:

Overall the load forecast decreased by 121 MW. The LCR need has decreased by 172 MW 2022 need due to load decrease, and new transmission projects.

Fresno Area Overall Requirements:

| 2023 | QF/Selfgen (MW) | Muni (MW) | Market (MW) | Max. Qualifying Capacity (MW) |
|----------------------|--------------------|--------------|----------------|----------------------------------|
| Available generation | 28 | 312 | 3177 | 3517 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|-------------------------------------|---------------------------------------------|--------------------|-------------------------|
| Category B (Single) ¹⁵ | 1688 | 0 | 1688 |
| Category C (Multiple) ¹⁶ | 1688 | 0 | 1688 |

7. Kern Area

Area Definition:

The transmission facilities coming into the Kern PP sub-area are:

- 1) Midway-Kern PP #1 230 kV Line
- 2) Midway-Kern PP #2 230 kV Line
- 3) Midway-Kern PP #3 230 kV Line
- 4) Midway-Kern PP #4 230 kV Line
- 5) Famoso-Lerdo 115 kV Line (Normal Open)
- 6) Wasco-Famoso 70 kV Line (Normal Open)
- 7) Copus-Old River 70 kV Line (Normal Open)
- 8) Copus-Old River 70 kV Line (Normal Open)
- 9) Weedpatch CB 32 70 kV (Normal Open)
- 10) Wheeler Ridge-Lamont 115 kV Line (Normal Open)

The substations that delineate the Kern-PP sub-area are:

- 1) Midway 230 kV is out and Bakerfield 230 kV is in
- 2) Midway 230 kV is out Kern PP 230 kV is in
- 3) Midway 230 kV is out and Stockdale 230 kV is in
- 4) Midway 230 kV is out Kern PP 230 kV is in
- 5) Famoso 115 kV is out Cawelo 115 kV is in
- 6) Wasco 70 kV is out Mc Farland 70 kV is in
- 7) Copus 70 kV is out, South Kern Solar 70 kV is in

¹⁵ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹⁶ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

- 8) Lakeview 70 kV is out, San Emidio Junction 70 kV is in
- 9) Weedpath 70 kV is out, Wellfield 70 kV is in
- 10) Wheeler Ridge 115 kV is out, Adobe Solar 115 kV is in

Load:

2023 total busload within the defined area is 1183 MW with -44 MW of AAEE, 10 MW of losses and -9 MW DG resulting in a total (load plus losses) of 1140 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Kern PP 230 kV area reinforcement project
2. Midway-Kern PP 1, 3 & 4 230 kV line capacity increase project

Critical Contingency Analysis Summary

Westpark Sub-area

The most critical contingency is PSE-Bear and Kern-Westpark # 1 or # 2 resulting in thermal overload of the remaining Kern-Westpark # 1 or # 2. This limiting contingency establishes a LCR of 51 MW (including 6 MW of deficiency) in 2019 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

Kern Oil Sub-area

The most critical contingency is the Kern PP-Live Oak 115 kV Line and Kern PP-7th Standard 115 kV Line resulting in the thermal overload of the Kern PP-Magunden-Witco 115 kV Line (Kern PP-Kern Water section). This limiting contingency establishes a LCR of 131 MW (including 2 MW of deficiency) in 2019 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

The most critical single contingency is the loss of the Kern PP -7th Standard 115 kV line with Mount Poso unit out of service. The area limitation is thermal overloading of the Kern PP-Magunden-Witco 115 kV line (Kern PP-Kern Water section) and establishes a local capacity need of 107 MW in 2023.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7450 (New) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

South Kern PP Sub-area

South Kern PP Sub-area has been greatly reduced due to Kern PP 230 kV area reinforcement and the Midway-Kern 1, 3 & 4 230 kV line capacity increase transmission projects. For 2023 this sub-area need is lower than the Westpark and Kern Oil sub-areas combined.

Changes compared to last year's results:

Kern area load has gone up by 255 MW due to definition change, with no impact to local area designation for any resources. Comparing the same definition as last year, the Kern area load forecast has gone down by 9 MW. The LCR requirement has increased by 59 MW mainly due to the needs in the Westpark sub-area which has no requirement in the 2022 study.

Kern Area Overall Requirements:

| 2023 | QF/Selfgen (MW) | Market (MW) | Max. Qualifying Capacity (MW) |
|----------------------|-----------------|-------------|-------------------------------|
| Available generation | 13 | 462 | 475 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|-------------------------------------|------------------------------------------|-----------------|----------------------|
| Category B (Single) ¹⁷ | 152 | 6 | 158 |
| Category C (Multiple) ¹⁸ | 174 | 8 | 182 |

¹⁷ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

¹⁸ LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

8. LA Basin Area

Area Definition:

The transmission tie lines into the LA Basin Area are:

- 1) San Onofre - San Luis Rey #1, #2, and #3 230 kV Lines
- 2) San Onofre - Talega #2 230 kV Lines
- 3) San Onofre - Capistrano #1 230 kV Lines
- 4) Lugo - Mira Loma #2 & #3 500 kV Lines
- 5) Lugo - Rancho Vista #1 500 kV Line
- 6) Vincent – Mesa 500 kV Line
- 7) Sylmar - Eagle Rock 230 kV Line
- 8) Sylmar - Gould 230 kV Line
- 9) Vincent - Mesa #1 & #2 230 kV Lines
- 10) Vincent - Rio Hondo #1 & #2 230 kV Lines
- 11) Devers - Red Bluff 500 kV #1 and #2 Lines
- 12) Mirage – Coachela Valley # 1 230 kV Line
- 13) Mirage - Ramon # 1 230 kV Line
- 14) Mirage - Julian Hinds 230 kV Line

The substations that delineate the LA Basin Area are:

- 1) San Onofre is in San Luis Rey is out
- 2) San Onofre is in Talega is out
- 3) San Onofre is in Capistrano is out
- 4) Mira Loma is in Lugo is out
- 5) Rancho Vista is in Lugo is out
- 6) Eagle Rock is in Sylmar is out
- 7) Gould is in Sylmar is out
- 8) Mira Loma is in Vincent is out
- 9) Mesa is in Vincent is out
- 10) Rio Hondo is in Vincent is out
- 11) Devers is in Red Bluff is out
- 12) Mirage is in Coachela Valley is out
- 13) Mirage is in Ramon is out
- 14) Mirage is in Julian Hinds is out

Load:

The CEC-adopted demand forecast for 2023 from the 2018-2030 Mid Baseline, Low AAE and AAPV savings for 1-in-10 heat wave forecast is 20,076 MW¹⁹. A total of 20,072 MW²⁰ of managed 1-in-10 peak demand was modeled for the study.

List of physical units: See Appendix A.

Major new projects modeled:

1. Mesa Loop-In Project and Laguna Bell Corridor 230 kV line upgrades
2. Delaney – Colorado River 500 kV Line
3. Hassayampa – North Gila #2 500 kV Line (APS)
4. West of Devers 230 kV line upgrades
5. Full implementation of the CPUC-approved long-term procurement plan (LTPP) for 431 MW of preferred resources in the western LA Basin sub-area
6. Alamitos repowering (640 MW, Non-OTC)
7. Retirement of 2,010 MW of the existing Alamitos once-through-cool generation
8. Huntington Beach repowering (644 MW, Non-OTC)
Retirement of 452 MW of the existing Huntington Beach once-through-cool generation

Critical Contingency Analysis Summary

El Nido Sub-area:

The most critical contingency for the El Nido sub-area is the loss of the La Fresa – Hinson 230 kV line followed by the loss of the La Fresa – Redondo #1 and #2 230 kV lines, which could cause voltage collapse. This limiting contingency establishes an LCR of 53 MW (including 12.5 MW are existing 20-minute demand response and 23.7 MW of LTPP preferred resources) in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

¹⁹ <https://efiling.energy.ca.gov/GetDocument.aspx?tn=222579> (Form 1.5d)

²⁰ This load represents the geographic LA Basin load which includes Saugus Substation load. The geographic LA Basin load matches with the the CEC's forecast for the LA Basin.

Effectiveness factors:

All units have the same effectiveness factor.

Western LA Basin Sub-area:

The most limiting contingency is the loss of Mesa – Redondo 230 kV line, system re-adjusted, followed by the loss of Mesa – Lighthipe 230 kV line or vice versa, which could result in thermal overload of the Mesa – Laguna Bell #1 230 kV line. This limiting contingency establishes a local capacity need of 3,970 MW (including 162 MW are of existing 20-minute demand response and 432 MW of the LTPP preferred resources) in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

See Appendix B - Table titled [LA Basin](#).

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7630 (G-219Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

There are other combinations of contingencies in the area that could overload a significant number of 230 kV lines in this sub-area have less LCR need. As such, anyone of them (combination of contingencies) could become binding for any given set of procured resources. As a result, these effectiveness factors may not be the best indicator towards informed procurement.

West of Devers Sub-area:

There are no local capacity requirements due to implementation of the Mesa Loop-in as well as West of Devers reconductoring projects.

Valley-Devers Sub-area:

There are no local capacity requirements due to implementation of the Colorado River-Delaney 500 kV line project.

Valley Sub-area:

There are no local capacity requirements due to implementation of the Colorado River-Delaney 500 kV line project.

Eastern LA Basin Sub-area:

The most critical contingency is the loss of the Alberhill - Serrano 500 kV line, followed by an N-2 of Red Bluff-Devers #1 and #2 500 kV lines, which could result in voltage instability. This limiting contingency establishes a local capacity need of 2,702 MW (including 159 MW of existing 20-minute demand response) in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:



All units within this area have the same effectiveness factor.

Overall LA Basin Area and San Diego-Imperial Valley Area Combined:

The LCR needs of the LA Basin area and San Diego-Imperial Valley area have been considered through a coordinated study process to ensure that the resource needs for each LCR area not only satisfy its own area reliability need but also provide support to the other area if needed. With the retirement of the San Onofre Nuclear Generating Station, and the impending retirement of other once-through cooled generation in the LA Basin and San Diego areas, the two areas are electrically interdependent on each other. Resource needs in one area are dependent on the amount of resources that are dispatched for the adjacent area and vice versa. The SDG&E system, being the southernmost electrical area in the ISO's southern system and smaller of the overall LA Basin-San Diego-Imperial Valley area, is evaluated first for its LCR needs. The LCR needs for the LA Basin and its subareas are then evaluated after the initial determination of the LCR needs for the overall San Diego-Imperial Valley area. The LCR needs in the overall San Diego-Imperial Valley area are then re-checked to ensure that the initial determination is still adequate. This iterative process is needed due to the interaction of resources on the LCR needs in the LA Basin-San Diego-Imperial Valley area. With this process, the LCR needs for the respective areas are coordinated within

the overall LA Basin-San Diego-Imperial Valley area. *It is important to note that the San Diego subarea is a part or subset of the overall San Diego-Imperial Valley area.* The total LCR needs for the combined LA Basin-San Diego-Imperial Valley area are the sum of the LCR needs for the LA Basin and the San Diego-Imperial Valley area.

As part of the load assumptions for the 2023 LCR study, the ISO utilized the 1-in-2 hourly load forecast from the California Energy Commission (CEC) and adjusted to the 1-in-10 demand forecast for the peak day for 2023 timeframe utilizing the multiplier from the CEC to determine the percentage for scaling the loads for SDG&E and SCE for simultaneous peak at the time of SCE and SDG&E peak loads, respectively. Two study cases were developed: one with SCE peak load and corresponding SDG&E simultaneous load at SCE peak; the other had SDG&E peak load with corresponding SCE simultaneous load. This is to capture better load models between the two areas of SCE and SDG&E at each other's peak demand. In previous year's LCR study, the ISO modeled both the LA Basin and SDG&E at their peak demands simultaneously based on historical load data that showed loads in these two areas that peaked at the same time. The new approach is based on the forecast of hourly loads in the future from the CEC. The following two diagrams illustrate the hourly consumption loads and the managed loads for SCE and SDG&E on the CEC's forecast peak day for these two areas on August 31, 2023. The following table illustrates the estimated derates for either SCE or SDG&E loads at the time of SDG&E or SCE peak demand, respectively.

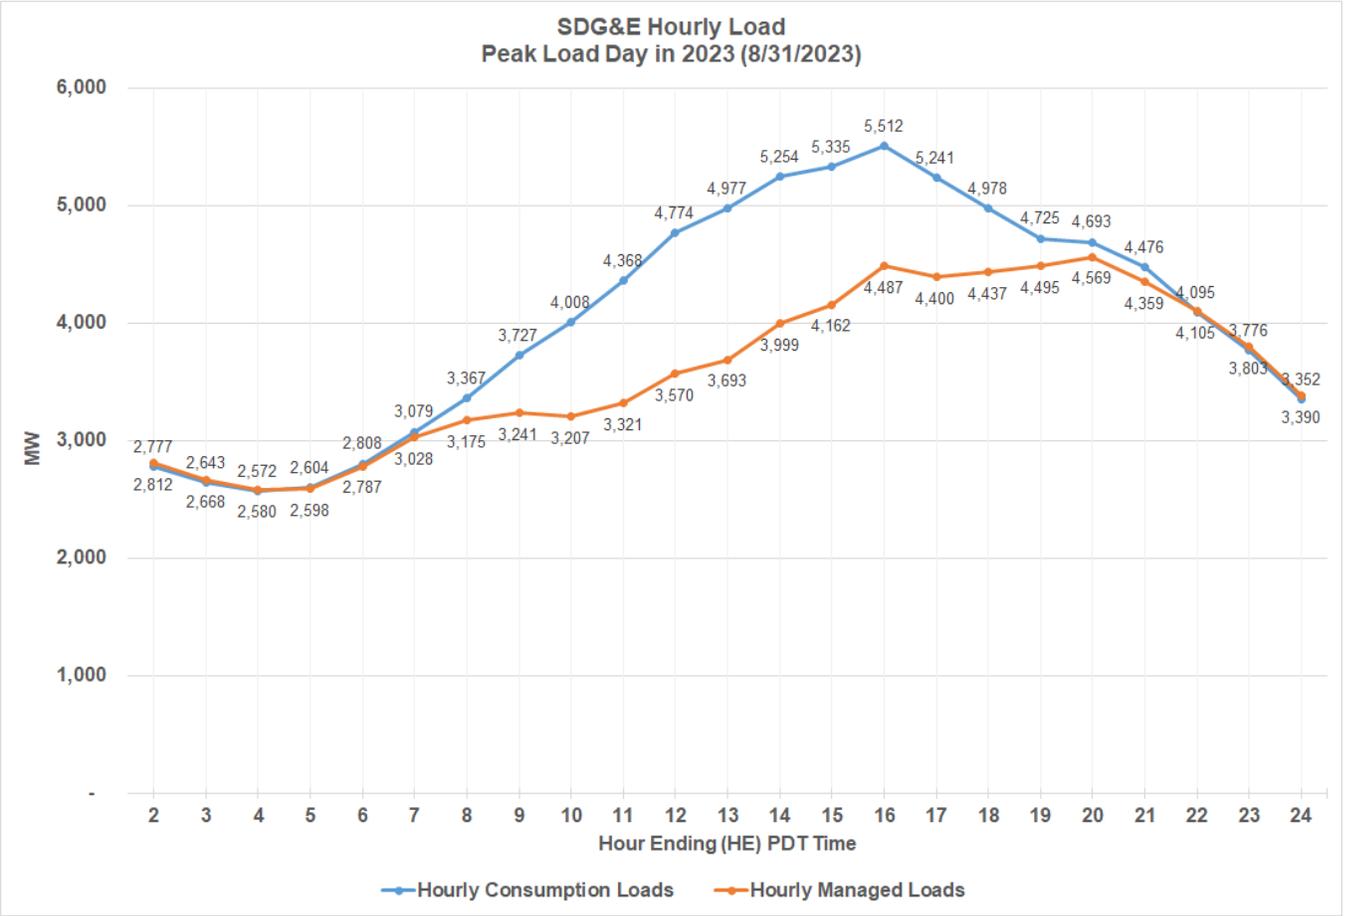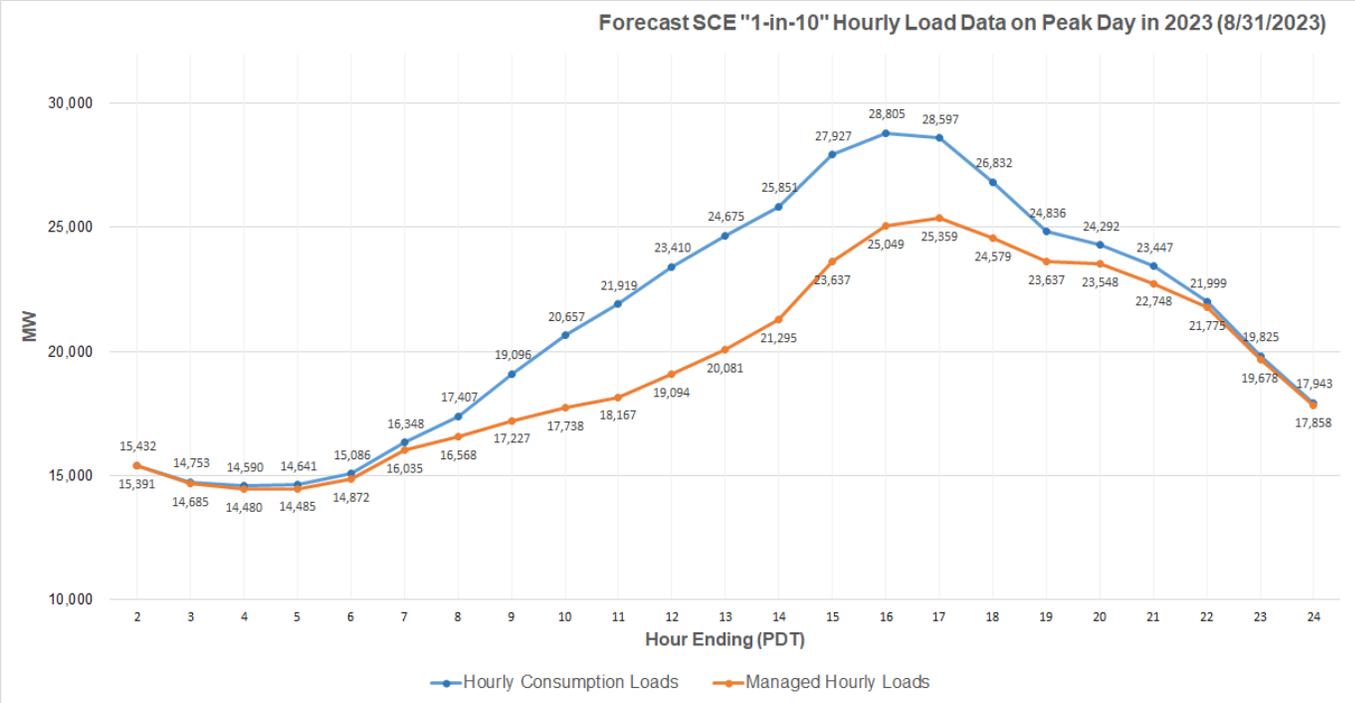

| Year | SCE peak demand | | | SDG&E @ SCE peak demand | | | SDG&E peak demand | | | SCE @ SDG&E peak demand | | |
|------|---------------------|-------------------------------------------|------------------------------------------|-------------------------|--------------------------------------|----------------------|---------------------|-------------------------------------------|------------------------------------------|-------------------------|--------------------------------------|----------------------|
| | Date/time (PDT)* | Hourly Managed Peak Demand (MW) from plot | LSE/BA Table peak demand forecast (MW)** | Date/time (PDT)* | Hourly Managed Demand (MW) from plot | % of own peak demand | Date/time (PDT)* | Hourly Managed Peak Demand (MW) from plot | LSE/BA Table peak demand forecast (MW)** | Date/time (PDT)* | Hourly Managed Demand from plot (MW) | % of own peak demand |
| 2023 | 8/31/2023 17:00 hr. | 25,359 | 25,368 | 8/31/2023 17:00 hr. | 4,400 | 96.30% | 8/31/2023 20:00 hr. | 4,569 | 4,554 | 8/31/2023 20:00 hr. | 23,548 | 92.86% |

Notes:

*All hour expressed in PDT hour ending (HE)

**Peak demand from the CEC posted 2017 CED Revised Forecast for LSE/BA Table for Mid Demand Level (1-in-10) with Low AAEE and AAPV

The following is the discussion of the LCR needs for each of these respective areas:

1. Overall San Diego-Imperial Valley Area:

The most critical contingency resulting in thermal loading concerns for the overall San Diego-Imperial Valley area is the G-1/N-1 (Category B) overlapping outage that involves the loss of the TDM combined cycled power plant (593 MW), system readjustment, followed by the loss of the Imperial Valley – North Gila 500 kV line or vice versa (Category C). This overlapping contingency could thermally overload the EI Centro 230/92 kV transformer, which is owned by the Imperial Irrigation District (IID). For the 2023 LCR study, the Imperial Valley – EI Centro (i.e., the “S” line) line upgrades are implemented with an estimated in-service date by the end of 2021. Furthermore the EI Centro 230/161 kV transformer would be the next limiting constraint if the EI Centro 230/92 kV constraint is removed. The aforementioned contingency establishes a total local capacity need of 4,132 MW in 2023 as the local resource capacity necessary for reliable load serving capability within the overall San Diego – Imperial Valley area.

2. Overall LA Basin Area:

The most critical contingency resulting in thermal loading concern for the overall LA Basin is the G-1/N-1 contingency of TDM power plant (593 MW), system readjustment, followed by the loss of the Imperial Valley – North Gila 500 kV line or vice versa. This overlapping contingency could thermally overload the IID’s El Centro 230/92 kV transformer. This establishes a total local capacity need of 6,793 MW (including 321 MW of existing 20-minute demand response as well as 432 MW of LTPP preferred resources) in the LA Basin area in 2023 as the minimum resource capacity necessary for reliable load serving capability within this area.

The overall local capacity need for the combined LA Basin-San Diego-Imperial Valley area is 10,925 MW in 2023 time frame as follows: 6,793 MW in the overall LA Basin and 4,132 MW in the overall San Diego-Imperial Valley area as the minimum capacity necessary for reliable load serving capability within these areas. The most limiting constraint is the thermal loading concern on the IID-owned El Centro 230/92 kV transformer under an overlapping G-1/N-1 (or vice versa) contingency, followed closely the limiting constraint on the Mesa – Laguna Bell 230 kV line under an overlapping N-1/N-1 contingency of the Mesa – Redondo 230kV line, system readjustment, then followed by the Mesa – Lighthipe 230kV line.

Effectiveness factors:

See Appendix B - Table titled [LA Basin](#).

For other helpful procurement information please read procedure 2210Z Effectiveness Factors under 7570 (T-144Z), 7580 (T-139Z), 7590 (T-137Z, 6750) and 7680 (T-130Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Changes compared to last year’s results:

Compared with 2022, the load forecast is higher by 1052 MW and the LCR need has increased by 771 MW, primarily due to higher demand forecast.

LA Basin Overall Requirements:

| 2023 | QF (MW) | Muni (MW) | Wind (MW) | Market (MW) | Preferred Res. (MW) | 20 Min. DR (MW) | Mothball (MW) | Max. Qualifying Capacity (MW) |
|----------------------|---------|-----------|-----------|-------------|---------------------|-----------------|---------------|-------------------------------|
| Available generation | 279 | 1,164 | 124 | 5,556 | 432 | 321 | 435 | 8,311 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|-------------------------------------|------------------------------------------|-----------------|----------------------|
| Category B (Single) ²¹ | 6,793 | 0 | 6,793 |
| Category C (Multiple) ²² | 6,793 | 0 | 6,793 |

9. Big Creek/Ventura Area

Area Definition:

The transmission tie lines into the Big Creek/Ventura Area are:

- 1) Antelope #1 500/230 kV Transformer
- 2) Antelope #2 500/230 kV Transformer
- 3) Sylmar - Pardee 230 kV #1 and #2 Lines
- 4) Vincent - Pardee 230 kV #2 Line
- 5) Vincent - Santa Clara 230 kV Line

The substations that delineate the Big Creek/Ventura Area are:

- 1) Antelope 500 kV is out Antelope 230 kV is in
- 2) Antelope 500 kV is out Antelope 230 kV is in
- 3) Sylmar is out Pardee is in
- 4) Vincent is out Pardee is in
- 5) Vincent is out Santa Clara is in

²¹ LCR requirement for a single contingency means that there wouldn't be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

²² LCR requirement for multiple contingencies means that not only there wouldn't be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

Load:

Total 2023 busload within the defined area²³ is 4708 MW including the impact of AAEE and AAPV based on the CEC managed forecast with 82 MW of losses and 379 MW of pumps resulting in a total managed load + losses + pumps of 5169 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Big Creek Corridor Rating Increase Project (ISD - 12/31/2018).
2. Pardee-Moorpark No. 4 230 kV Transmission Circuit (ISD – 12/31/2020)

Critical Contingency Analysis Summary:

Rector Sub-area:

LCR need is satisfied by the need in the larger Vestal sub-area.

Effectiveness factors:

See Appendix B - Table titled [Rector](#).

Vestal Sub-area:

The most critical contingencies for the Vestal sub-area are:

1. Loss of one of the Magunden-Vestal 230 kV lines with the Eastwood unit out of service, which would thermally overload the remaining Magunden-Vestal 230 kV line and
2. Loss of Magunden-Springville #1 230 kV line with Eastwood out of service which would thermally overload the Magunden-Springville #2 230 kV line.

These limiting contingencies establish a LCR of 621 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

²³ The Big Creek Ventura LCA includes the Saugus Substation.

Effectiveness factors:

For helpful procurement information please read procedure 2210Z Effectiveness Factors under 7500 posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Santa Clara Sub-area:

The most critical contingency is the loss of the Pardee - Santa Clara 230 kV line followed by the loss of Moorpark - Santa Clara 230 kV #1 and #2 lines, which would cause voltage collapse. This limiting contingency establishes a local capacity need of 295 MW (including 102 MW of deficiency) in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

The value of the local capacity need varies depending on the location and reactive power capability provided to the transmission system by the new resource or resources that will be procured to fill the need.

| Location of new resource(s) | Reactive power capability of new resource(s) | |
|-----------------------------|----------------------------------------------|--------------------|
| | 0.95 lead/lag power factor range | Unity power factor |
| Goleta 66 kV | 295 MW | 316 MW |
| Santa Clara 66 kV | 322 MW | 358 MW |

Moorpark Sub-area:

No requirement identified.

Big Creek/Ventura overall:

The most critical contingency is the loss of the Lugo - Victorville 500 kV line followed by loss of one of the Sylmar - Pardee 230 kV line, which would thermally overload the remaining Sylmar - Pardee 230 kV line. This limiting contingency establishes a local capacity need of 2,690 MW as the minimum capacity necessary for reliable load serving capability within this area.

The single most critical contingency is the loss of Sylmar - Pardee #1 (or # 2) line with Pastoria power plant (CCGT) out of service, which could thermally overload the remaining Sylmar - Pardee #2 or #1 230 kV line. This limiting contingency establishes a local capacity need of 2,212 MW.

Effectiveness factors:

For helpful procurement information please read procedure 2210Z Effectiveness Factors under 7680 (T-130Z), 7510 (T-163Z), 7550 (T-159Z) and 8610 (T-131Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

Changes compared to last year’s results:

Compared with 2022 the load forecast is up by 149 MW and the LCR need has increased by 195 MW due to load forecast increase as well as deficiency increase resulting from resource retirements.

Big Creek/Ventura Overall Requirements:

| 2023 | QF (MW) | Muni (MW) | Preferred Res. (MW) | Market (MW) | Max. Qualifying Capacity (MW) |
|----------------------|---------|-----------|---------------------|-------------|-------------------------------|
| Available generation | 52 | 372 | 108 | 2974 | 3506 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW Requirement |
|-------------------------------------|------------------------------------------|-----------------|----------------------|
| Category B (Single) ²⁴ | 2212 | 0 | 2212 |
| Category C (Multiple) ²⁵ | 2690 | 102 | 2792 |

²⁴ LCR requirement for a single contingency means that there wouldn’t be any criteria violations following the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

²⁵ LCR requirement for multiple contingencies means that not only there wouldn’t be any criteria violations following the loss of a single element, but also the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

10. San Diego-Imperial Valley Area

Area Definition:

The transmission tie lines forming a boundary around the Greater San Diego-Imperial Valley area include:

- 1) Imperial Valley – North Gila 500 kV Line
- 2) Otay Mesa – Tijuana 230 kV Line
- 3) San Onofre - San Luis Rey #1 230 kV Line
- 4) San Onofre - San Luis Rey #2 230 kV Line
- 5) San Onofre - San Luis Rey #3 230 kV Line
- 6) San Onofre – Talega 230 kV Line
- 7) San Onofre – Capistrano 230 kV Line
- 8) Imperial Valley – El Centro 230 kV Line
- 9) Imperial Valley – La Rosita 230 kV Line

The substations that delineate the Greater San Diego-Imperial Valley area are:

- 1) Imperial Valley is in North Gila is out
- 2) Otay Mesa is in Tijuana is out
- 3) San Onofre is out San Luis Rey is in
- 4) San Onofre is out San Luis Rey is in
- 5) San Onofre is out San Luis Rey is in
- 6) San Onofre is out Talega is in
- 7) San Onofre is out Capistrano is in
- 8) Imperial Valley is in El Centro is out
- 9) Imperial Valley is in La Rosita is out

Load:

The CEC-adopted demand forecast for 2023 from the 2018-2030 Mid Demand Baseline, Low AAEE and AAPV savings for 1-in-10 heat wave forecast is 4,554 MW.

The total managed peak demand including 115 MW transmission losses modeled in the study is 4,535 MW.

List of physical units: See Appendix A.

Major new projects modeled:

1. Ocean Ranch 69 kV substation
2. Mesa Height TL600 Loop-in
3. Re-conductor of Mission-Mesa Heights 69 kV

4. Re-conductor of Kearny-Mission 69 kV line
5. TL6906 Mesa Rim rearrangement
6. Upgrade Bernardo - Rancho Carmel 69 kV line
7. Re-conductor of Japanese Mesa–Basilone–Talega Tap 69 kV lines
8. 2nd Miguel–Bay Boulevard 230 kV line
9. Sycamore–Penasquitos 230 kV line
10. 2nd Mission 230/69 kV bank
11. Suncrest SVC project
12. By-passing 500 kV series capacitor banks on the Southwest Powerlink and Sunrise Powerlink lines
13. Encina generation retirement
14. Carlsbad Energy Center (5x100 MW)
15. Battery energy storage projects (total of 78 MW) at various locations: El Cajon (8 MW), Escondido (30 MW), Melrose (2x20 MW)
16. TL632 Granite loop-in and TL6914 reconfiguration
17. 2nd San Marcos–Escondido 69 kV line
18. Re-conductor of Stuart Tap–Las Pulgas 69 kV line (TL690E)
19. 2nd Poway–Pomerado 69 kV line
20. Artesian 230 kV expansion with 69 kV upgrade
21. South Orange County Reliability Enhancement
22. Imperial Valley bank #80 replacement

Critical Contingency Analysis Summary:

El Cajon Sub-area

The most critical contingency for the El Cajon sub-area is the loss of the Granite - Los Coches 69 kV lines #1 and #2, which could thermally overload the El Cajon-Los Coches 69 kV line (TL631). This limiting contingency establishes a LCR of 35 MW in 2023 as the minimum generation capacity necessary for reliable load serving capability within this sub-area after the TL632 Granite Loop-In and TL6914 reconfiguration project are completed.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Mission Sub-area

The LCR need for the Mission sub-area is eliminated with the completions of the T600 Clairemont – Kearny loop-in to Mesa Hights 69 kV and TL676 Mission – Mesa Heights 69 kV reconductor projects.

Esco Sub-area

The most critical contingency for the Esco sub-area is the loss of anyone of the two Sycamore-Pomerado 69 kV lines (TL6915 or TL6924) followed by the loss of Artisian 230/69 kV transformer bank, which could thermally overload the remaining Sycamore-Pomerado 69 kV line. This limiting contingency establishes a LCR of 20 MW in 2023 as the minimum generation capacity necessary for reliable load serving capability within this sub-area.

Pala Sub-area

The most critical contingency for the Pala sub-area is the loss of Pendleton – San Luis Rey 69kV line (TL6912) followed by the loss of Lilac - Pala 69kV line (TL6932), which could thermally overload the Monserate – Morro Hill Tap 69 kV line (TL694). This limiting contingency establishes a local capacity need of 10 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.

Border Sub-area

The most critical contingency for the Border sub-area is the loss of Bay Boulevard – Otay 69kV line #1 (TL645) followed by Bay Boulevard Otay – 69 kV line #2 (TL646), which could thermally overload the Imperial Beach – Bay Boulevard 69 kV line (TL647).

This limiting contingency establishes a local capacity need of 108 MW in 2023 as the minimum capacity necessary for reliable load serving capability within this sub-area.

Effectiveness factors:

All units within this sub-area have the same effectiveness factor.


Miramar Sub-area


With the completions of the Sycamore - Penasquitos 230 kV line and second Miguel – Bay Boulevard 230 kV line projects, this sub-area is eliminated.

Overall LA Basin Area and San Diego-Imperial Valley Area Combined:

The LCR needs of the LA Basin area and San Diego-Imperial Valley area have been considered through a coordinated study process to ensure that the resource needs for each LCR area not only satisfy its own area reliability need but also provide support to the other area if needed. With the retirement of the San Onofre Nuclear Generating Station, and the impending retirement of other once-through cooled generation in the LA Basin and San Diego areas, the two areas are electrically interdependent on each other. Resource needs in one area are dependent on the amount of resources that are dispatched for the adjacent area and vice versa. The SDG&E system, being the southernmost electrical area in the ISO's southern system and smaller of the overall LA Basin-San Diego-Imperial Valley area, is evaluated first for its LCR needs. The LCR needs for the LA Basin and its subareas are then evaluated after the initial determination of the LCR needs for the overall San Diego-Imperial Valley area. The LCR needs in the overall San Diego-Imperial Valley area are then re-checked to ensure that the initial determination is still adequate. This iterative process is needed due to the interaction of resources on the LCR needs in the LA Basin-San Diego-Imperial Valley area. With this process, the LCR needs for the respective areas are coordinated within the overall LA Basin-San Diego-Imperial Valley area. *It is important to note that the San Diego subarea is a part or subset of the overall San Diego-Imperial Valley area.* The total LCR needs for the combined LA Basin-San Diego-Imperial Valley area are the sum of the LCR needs for the LA Basin and the San Diego-Imperial Valley area.

As part of the load assumptions for the 2023 LCR study, the ISO utilized the 1-in-2 hourly load forecast from the California Energy Commission (CEC) and adjusted to the 1-in-10 demand forecast for the peak day for 2023 timeframe utilizing the multiplier from the CEC to determine the percentage for scaling the loads for SDG&E and SCE for simultaneous peak at the time of SCE and SDG&E peak loads, respectively. Two study cases were developed: one with SCE peak load and corresponding SDG&E simultaneous load at SCE peak; the other had SDG&E peak load with corresponding SCE simultaneous load. This is to capture better load models between the two areas of SCE and SDG&E at each other's peak demand. In previous year's LCR study, the ISO modeled both the LA Basin and SDG&E at their peak demands simultaneously based on historical load data that showed loads in these two areas that peaked at the same time. The new approach is based on the forecast of hourly loads in the future from the CEC. The following two diagrams illustrate the hourly consumption loads and the managed loads for SCE and SDG&E on the CEC's forecast peak day for these two areas on August 31, 2023. The following table illustrates the estimated derates for either SCE or SDG&E loads at the time of SDG&E or SCE peak demand, respectively.

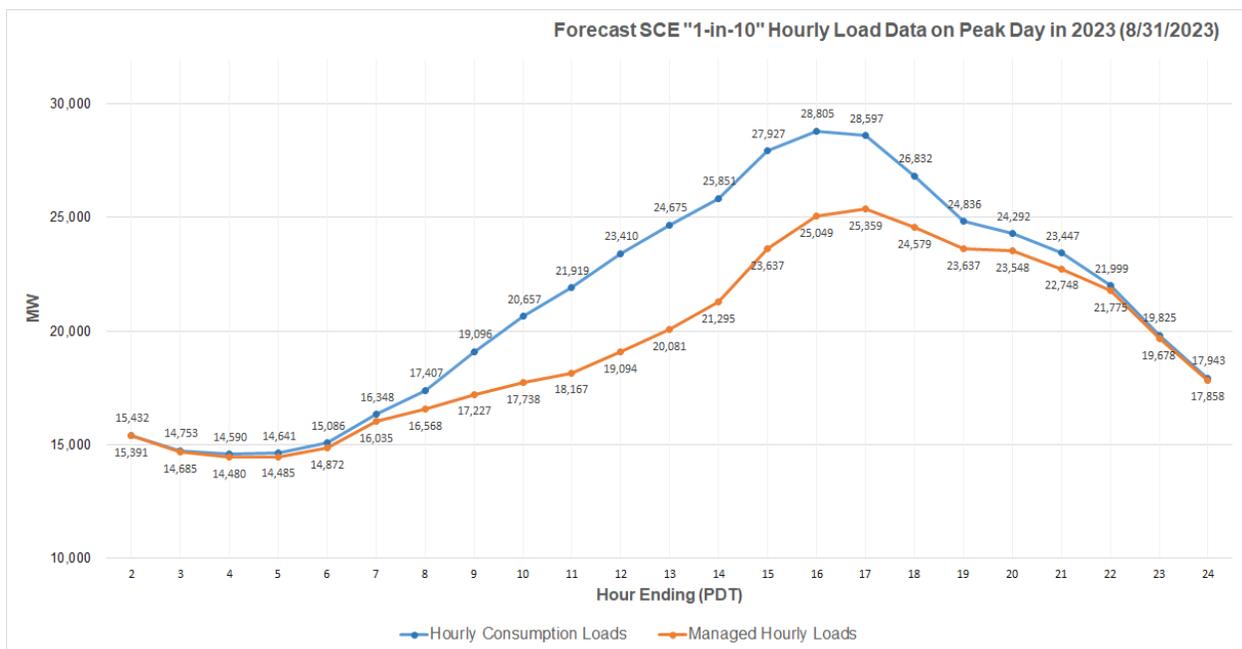

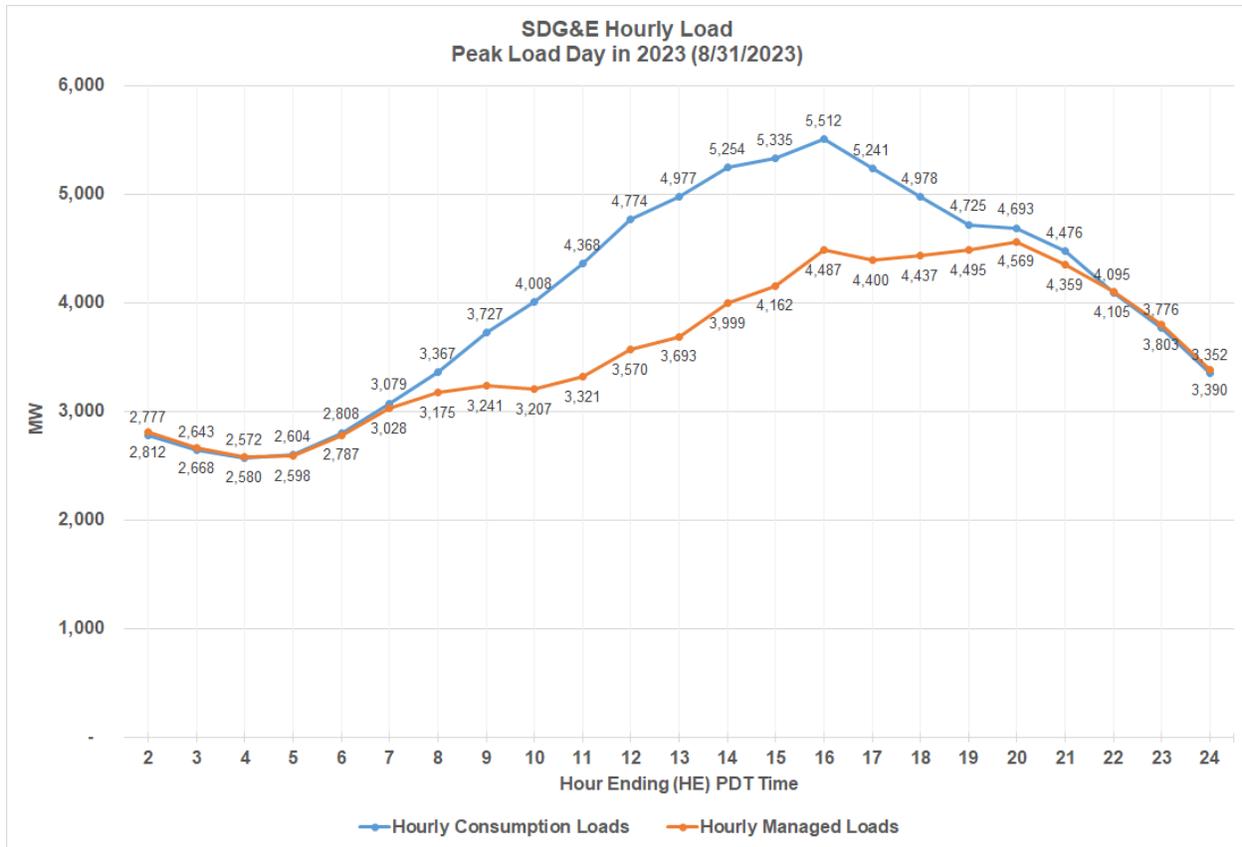

| Year | SCE peak demand | | | SDG&E @ SCE peak demand | | | SDG&E peak demand | | | SCE @ SDG&E peak demand | | |
|------|---------------------|-------------------------------------------|------------------------------------------|-------------------------|--------------------------------------|----------------------|---------------------|-------------------------------------------|------------------------------------------|-------------------------|--------------------------------------|----------------------|
| | Date/time (PDT)* | Hourly Managed Peak Demand (MW) from plot | LSE/BA Table peak demand forecast (MW)** | Date/time (PDT)* | Hourly Managed Demand (MW) from plot | % of own peak demand | Date/time (PDT)* | Hourly Managed Peak Demand (MW) from plot | LSE/BA Table peak demand forecast (MW)** | Date/time (PDT)* | Hourly Managed Demand from plot (MW) | % of own peak demand |
| 2023 | 8/31/2023 17:00 hr. | 25,359 | 25,368 | 8/31/2023 17:00 hr. | 4,400 | 96.30% | 8/31/2023 20:00 hr. | 4,569 | 4,554 | 8/31/2023 20:00 hr. | 23,548 | 92.86% |

Notes:

*All hour expressed in PDT hour ending (HE)

**Peak demand from the CEC posted 2017 CED Revised Forecast for LSE/BA Table for Mid Demand

Level (1-in-10) with Low AAEE and AAPV

The following is the discussion of the LCR needs for each of these respective areas:

1. Overall San Diego-Imperial Valley Area:

The most critical contingency resulting in thermal loading concerns for the overall San Diego-Imperial Valley area is the G-1/N-1 (Category B) overlapping outage that involves the loss of the TDM combined cycled power plant (593 MW), system readjustment, followed by the loss of the Imperial Valley – North Gila 500 kV line or vice versa (Category C). This overlapping contingency could thermally overload the Imperial Valley- El Centro 230/92 kV transformer²⁶. This contingency establishes a total local capacity need of 4,132 MW in 2023 as the resource capacity necessary for reliable load serving capability within the overall San Diego – Imperial Valley area. This amount of LCR need was achieved after utilization of 20-minute demand response and LTPP LCR preferred resources in the LA Basin.

The overall combined LA Basin-San Diego-Imperial Valley area has a total of 10,925 MW in 2023 time frame as follows: 6,793 MW for the overall LA Basin and 4,132 MW for the overall San Diego-Imperial Valley area as the minimum capacity necessary for reliable load serving capability within these areas. The most limiting constraint is the thermal loading concern on the IID-owned El Centro 230/92 kV transformer under an overlapping G-1/N-1 (or vice versa) contingency, followed closely the limiting constraint on the Mesa – Laguna Bell 230kV line under an overlapping N-1/N-1 contingency of the Mesa – Redondo 230kV line, system readjustment, then followed by the Mesa – Lighthipe 230kV line.

Effectiveness factors:

See Appendix B - Table titled [San Diego](#).

For other helpful procurement information please read procedure 2210Z Effectiveness

²⁶ The El Centro 230/92kV transformer is owned and operated by the Imperial Irrigation District (IID) that is in connected in series with the IID-owned “S” line which connects the IID electrical grid with the ISO BAA’s SDG&E-owned electrical grid.

Factors under 7820 (T-132Z) posted at: <http://www.caiso.com/Documents/2210Z.pdf>

2. San Diego Sub-area:

San Diego sub-area is part of the overall San Diego-Imperial Valley LCR area. The LCR need for the San Diego sub-area can either be caused by the larger need for the San Diego-Imperial Valley area (as discussed in item #1 above), or be caused by other outages that exclusively affect the San Diego sub-area only. The ultimate San Diego sub-area LCR need will be determined by the larger requirement of these analyses.

For the outages that exclusively affect the San Diego sub-area only, it is the overlapping N-1-1 of the ECO-Miguel 500 kV line, system readjustment, followed by the outage of the Sycamore-Suncrest 230 kV line. The limiting constraint is the thermal loading concern on the remaining Sycamore-Suncrest 230 kV line, causing an LCR need of 3,002 MW for the San Diego sub-area.

Net Qualifying Capacity at time of net peak demand

The expectation of the Resource Adequacy (RA) program is to provide resources “when needed and where needed” in order to ensure safe and reliable operation of the grid in real time. The current Qualifying Capacity (QC) rules of Local Regulatory Agencies (LRAs) – and correspondingly Net Qualifying Capacity rules of the ISO - have not fully adjusted to changes in real time conditions and more specifically the shift of load to later hours of the day (6, 7 or 8 p.m.). This misalignment between capacity determinations and peak demands on the transmission system may result in critical local resources not being available during the most stressed demand conditions (net peak). As the ISO is mandated to maintain local and system reliability at all hours of the day during the entire year, this misalignment increases the probability that other procurement, such as Capacity Procurement Mechanism (CPM) or Reliability Must Run (RMR), may be needed.

Changes compared to last year's results:

Compared with the 2022 LCR study results, the 2023 adjusted peak demand forecast is lower by 518 MW. The overall LCR need for the San Diego – Imperial Valley area has

decreased by 511 MW primarily due to lower managed peak demand forecast as well as implementation of the S-line upgrades between IID and SDG&E. The LCR need could have been lower if not for the decrease of net qualifying capacity for solar generation located in the most effective area.

San Diego-Imperial Valley Area Overall Requirements:

| 2023 | QF (MW) | Wind (MW) | Market (MW) | Battery (MW) | 20 minute DR (MW) | Max. Qualifying Capacity (MW) |
|----------------------|---------|-----------|-------------|--------------|-------------------|-------------------------------|
| Available generation | 106 | 213 | 4,104 | 78 | 19 | 4,520 |

| 2023 | Existing Generation Capacity Needed (MW) | Deficiency (MW) | Total MW LCR Need |
|-------------------------------------|------------------------------------------|-----------------|-------------------|
| Category B (Single) ²⁷ | 4,132 | 0 | 4,132 |
| Category C (Multiple) ²⁸ | 4,132 | 0 | 4,132 |

11. Valley Electric Area

Valley Electric Association LCR area has been eliminated on the basis of the following:

- No generation exists in this area
- No category B issues were observed in this area
- Category C and beyond –
 - No common-mode N-2 issues were observed
 - No issues were observed for category B outage followed by a common-mode N-2 outage
 - All the N-1-1 issues that were observed can either be mitigated by the existing UVLS or by an operating procedure

²⁷ A single contingency means that the system will be able to survive the loss of a single element, however the operators will not have any means (other than load drop) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

²⁸ Multiple contingencies means that the system will be able to survive the loss of a single element, and the operators will have enough generation (other operating procedures) in order to bring the system within a safe operating zone and get prepared for the next contingency as required by NERC transmission operations standards.

Appendix A - List of physical resources by PTO, local area and market ID

V. Appendix A – List of physical resources by PTO, local area and market ID

| PTO | MKT/SCHED RESOURCE ID | BUS # | BUS NAME | kV | NQC | UNIT ID | LCR AREA NAME | LCR SUB-AREA NAME | NQC Comments | CAISO Tag |
|------|-----------------------|-------|-----------|------|--------|---------|---------------|----------------------------------|--------------|------------|
| PG&E | ALMEGT_1_UNIT 1 | 38118 | ALMDACT1 | 13.8 | 23.40 | 1 | Bay Area | Oakland | | MUNI |
| PG&E | ALMEGT_1_UNIT 2 | 38119 | ALMDACT2 | 13.8 | 23.50 | 1 | Bay Area | Oakland | | MUNI |
| PG&E | BANKPP_2_NSPIN | 38820 | DELTA A | 13.2 | 11.55 | 1 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38820 | DELTA A | 13.2 | 11.55 | 2 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38820 | DELTA A | 13.2 | 11.55 | 3 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38815 | DELTA B | 13.2 | 11.55 | 4 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38815 | DELTA B | 13.2 | 11.55 | 5 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38770 | DELTA C | 13.2 | 11.55 | 6 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38770 | DELTA C | 13.2 | 11.55 | 7 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38765 | DELTA D | 13.2 | 11.55 | 8 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38765 | DELTA D | 13.2 | 11.55 | 9 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38760 | DELTA E | 13.2 | 11.55 | 10 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BANKPP_2_NSPIN | 38760 | DELTA E | 13.2 | 11.55 | 11 | Bay Area | Contra Costa | Pumps | MUNI |
| PG&E | BRDSLD_2_HIWIND | 32172 | HIGHWINDS | 34.5 | 42.93 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | BRDSLD_2_MTZUM2 | 32179 | MNTZUMA2 | 0.69 | 20.72 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | BRDSLD_2_MTZUMA | 32188 | HIGHWND3 | 0.69 | 9.75 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | BRDSLD_2_SHILO1 | 32176 | SHILOH | 34.5 | 39.75 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | BRDSLD_2_SHILO2 | 32177 | SHILOH 2 | 34.5 | 39.75 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | BRDSLD_2_SHLO3A | 32191 | SHILOH3 | 0.58 | 27.16 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | BRDSLD_2_SHLO3B | 32194 | SHILOH4 | 0.58 | 26.50 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | CALPIN_1_AGNEW | 35860 | OLS-AGNE | 9.11 | 28.00 | 1 | Bay Area | San Jose, South Bay-Moss Landing | Aug NQC | Market |
| PG&E | CAYTNO_2_VASCO | 30531 | 0162-WD | 230 | 4.30 | FW | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | CLRMTK_1_QF | | | | 0.00 | | Bay Area | Oakland | Not modeled | QF/Selfgen |
| PG&E | COCOPP_2_CTG1 | 33188 | MARSHCT1 | 16.4 | 195.90 | 1 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | COCOPP_2_CTG2 | 33188 | MARSHCT2 | 16.4 | 195.40 | 2 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | COCOPP_2_CTG3 | 33189 | MARSHCT3 | 16.4 | 194.80 | 3 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | COCOPP_2_CTG4 | 33189 | MARSHCT4 | 16.4 | 197.55 | 4 | Bay Area | Contra Costa | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|-------------|------|--------|---|----------|--------------------------------------|----------------------------|------------|
| PG&E | COCOSB_6_SOLAR | | | | 0.00 | | Bay Area | Contra Costa | Not modeled Energy Only | Market |
| PG&E | CROKET_7_UNIT | 32900 | CRCKTCOG | 18 | 231.08 | 1 | Bay Area | Pittsburg | Aug NQC | QF/Selfgen |
| PG&E | CSCCOG_1_UNIT 1 | 36859 | Laf300 | 12 | 3.00 | 1 | Bay Area | San Jose, South Bay- Moss Landing | | MUNI |
| PG&E | CSCCOG_1_UNIT 1 | 36859 | Laf300 | 12 | 3.00 | 2 | Bay Area | San Jose, South Bay- Moss Landing | | MUNI |
| PG&E | CSCGNR_1_UNIT 1 | 36858 | Gia100 | 13.8 | 24.00 | 1 | Bay Area | San Jose, South Bay- Moss Landing | | MUNI |
| PG&E | CSCGNR_1_UNIT 2 | 36895 | Gia200 | 13.8 | 24.00 | 2 | Bay Area | San Jose, South Bay- Moss Landing | | MUNI |
| PG&E | CUMBIA_1_SOLAR | 33102 | COLUMBIA | 0.38 | 7.79 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | DELTA_2_PL1X4 | 33108 | DEC CTG1 | 18 | 181.13 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | DELTA_2_PL1X4 | 33109 | DEC CTG2 | 18 | 181.13 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | DELTA_2_PL1X4 | 33110 | DEC CTG3 | 18 | 181.13 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | DELTA_2_PL1X4 | 33107 | DEC STG1 | 24 | 269.60 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | DIXNLD_1_LNDFL | | | | 1.30 | | Bay Area | | Not modeled Aug NQC | Market |
| PG&E | DUANE_1_PL1X3 | 36865 | DVRaST3 | 13.8 | 48.36 | 1 | Bay Area | San Jose, South Bay- Moss Landing | | MUNI |
| PG&E | DUANE_1_PL1X3 | 36863 | DVRaGT1 | 13.8 | 49.72 | 1 | Bay Area | San Jose, South Bay- Moss Landing | | MUNI |
| PG&E | DUANE_1_PL1X3 | 36864 | DVRbGT2 | 13.8 | 49.72 | 1 | Bay Area | San Jose, South Bay- Moss Landing | | MUNI |
| PG&E | GATWAY_2_PL1X3 | 33119 | GATEWAY2 | 18 | 177.51 | 1 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | GATWAY_2_PL1X3 | 33120 | GATEWAY3 | 18 | 177.51 | 1 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | GATWAY_2_PL1X3 | 33118 | GATEWAY1 | 18 | 187.47 | 1 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | GILROY_1_UNIT | 35850 | GLRY COG | 13.8 | 69.00 | 1 | Bay Area | Llagas, South Bay- Moss Landing | Aug NQC | Market |
| PG&E | GILROY_1_UNIT | 35850 | GLRY COG | 13.8 | 36.00 | 2 | Bay Area | Llagas, South Bay- Moss Landing | Aug NQC | Market |
| PG&E | GILRPP_1_PL1X2 | 35851 | GROYPKR1 | 13.8 | 47.70 | 1 | Bay Area | Llagas, South Bay- Moss Landing | Aug NQC | Market |
| PG&E | GILRPP_1_PL1X2 | 35852 | GROYPKR2 | 13.8 | 47.70 | 1 | Bay Area | Llagas, South Bay- Moss Landing | Aug NQC | Market |
| PG&E | GILRPP_1_PL3X4 | 35853 | GROYPKR3 | 13.8 | 46.20 | 1 | Bay Area | Llagas, South Bay- Moss Landing | Aug NQC | Market |
| PG&E | GRZZLY_1_BERKLY | 32741 | HILLSIDE_12 | 12.5 | 24.57 | 1 | Bay Area | None | Aug NQC | Net Seller |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|--------|---|----------|----------------------------------|------------------------|------------|
| PG&E | KELSO_2_UNITS | 33813 | MARIPCT1 | 13.8 | 49.51 | 1 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | KELSO_2_UNITS | 33815 | MARIPCT2 | 13.8 | 49.51 | 2 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | KELSO_2_UNITS | 33817 | MARIPCT3 | 13.8 | 49.51 | 3 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | KELSO_2_UNITS | 33819 | MARIPCT4 | 13.8 | 49.51 | 4 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | KIRKER_7_KELCYN | | | | 3.22 | | Bay Area | Pittsburg | Not modeled | Market |
| PG&E | LAWRNC_7_SUNYVL | | | | 0.18 | | Bay Area | None | Not modeled Aug NQC | Market |
| PG&E | LECEF_1_UNITS | 35854 | LECEFGT1 | 13.8 | 45.97 | 1 | Bay Area | San Jose, South Bay-Moss Landing | Aug NQC | Market |
| PG&E | LECEF_1_UNITS | 35855 | LECEFGT2 | 13.8 | 45.97 | 1 | Bay Area | San Jose, South Bay-Moss Landing | Aug NQC | Market |
| PG&E | LECEF_1_UNITS | 35856 | LECEFGT3 | 13.8 | 45.97 | 1 | Bay Area | San Jose, South Bay-Moss Landing | Aug NQC | Market |
| PG&E | LECEF_1_UNITS | 35857 | LECEFGT4 | 13.8 | 45.97 | 1 | Bay Area | San Jose, South Bay-Moss Landing | Aug NQC | Market |
| PG&E | LECEF_1_UNITS | 35858 | LECEFST1 | 13.8 | 110.33 | 1 | Bay Area | San Jose, South Bay-Moss Landing | | Market |
| PG&E | LMBEPK_2_UNITA1 | 32173 | LAMBGT1 | 13.8 | 48.00 | 1 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | LMBEPK_2_UNITA2 | 32174 | GOOSEHGT | 13.8 | 48.00 | 2 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | LMBEPK_2_UNITA3 | 32175 | CREEDGT1 | 13.8 | 48.00 | 3 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | LMEC_1_PL1X3 | 33112 | LMECCT1 | 18 | 160.07 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | LMEC_1_PL1X3 | 33111 | LMECCT2 | 18 | 160.07 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | LMEC_1_PL1X3 | 33113 | LMECST1 | 18 | 235.85 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | MARTIN_1_SUNSET | | | | 1.85 | | Bay Area | None | Not modeled Aug NQC | QF/Selfgen |
| PG&E | METCLF_1_QF | | | | 0.08 | | Bay Area | None | Not modeled Aug NQC | QF/Selfgen |
| PG&E | METEC_2_PL1X3 | 35881 | MEC CTG1 | 18 | 178.43 | 1 | Bay Area | South Bay-Moss Landing | Aug NQC | Market |
| PG&E | METEC_2_PL1X3 | 35882 | MEC CTG2 | 18 | 178.43 | 1 | Bay Area | South Bay-Moss Landing | Aug NQC | Market |
| PG&E | METEC_2_PL1X3 | 35883 | MEC STG1 | 18 | 213.13 | 1 | Bay Area | South Bay-Moss Landing | Aug NQC | Market |
| PG&E | MISSIX_1_QF | | | | 0.01 | | Bay Area | None | Not modeled Aug NQC | QF/Selfgen |
| PG&E | MLPTAS_7_QFUNTS | | | | 0.04 | | Bay Area | San Jose, South Bay-Moss Landing | Not modeled Aug NQC | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|--------|---|----------|------------------------|-------------------------|------------|
| PG&E | MOSSLD_1_QF | | | | 0.00 | | Bay Area | | Not modeled Aug NQC | Market |
| PG&E | MOSSLD_2_PSP1 | 36221 | DUKMOSS1 | 18 | 163.20 | 1 | Bay Area | South Bay-Moss Landing | 78% starting 2021 | Market |
| PG&E | MOSSLD_2_PSP1 | 36222 | DUKMOSS2 | 18 | 163.20 | 1 | Bay Area | South Bay-Moss Landing | 78% starting 2021 | Market |
| PG&E | MOSSLD_2_PSP1 | 36223 | DUKMOSS3 | 18 | 183.60 | 1 | Bay Area | South Bay-Moss Landing | 78% starting 2021 | Market |
| PG&E | MOSSLD_2_PSP2 | 36224 | DUKMOSS4 | 18 | 163.20 | 1 | Bay Area | South Bay-Moss Landing | 78% starting 2021 | Market |
| PG&E | MOSSLD_2_PSP2 | 36225 | DUKMOSS5 | 18 | 163.20 | 1 | Bay Area | South Bay-Moss Landing | 78% starting 2021 | Market |
| PG&E | MOSSLD_2_PSP2 | 36226 | DUKMOSS6 | 18 | 183.60 | 1 | Bay Area | South Bay-Moss Landing | 78% starting 2021 | Market |
| PG&E | NEWARK_1_QF | | | | 0.29 | | Bay Area | None | Not modeled Aug NQC | QF/Selfgen |
| PG&E | OAK C_1_EBMUD | | | | 1.62 | | Bay Area | Oakland | Not modeled Aug NQC | MUNI |
| PG&E | OAK C_7_UNIT 1 | 32901 | OAKLND 1 | 13.8 | 55.00 | 1 | Bay Area | Oakland | | Market |
| PG&E | OAK C_7_UNIT 2 | 32902 | OAKLND 2 | 13.8 | 55.00 | 1 | Bay Area | Oakland | | Market |
| PG&E | OAK C_7_UNIT 3 | 32903 | OAKLND 3 | 13.8 | 55.00 | 1 | Bay Area | Oakland | | Market |
| PG&E | OAK L_1_GTG1 | | | | 0.00 | | Bay Area | Oakland | Not modeled Energy Only | Market |
| PG&E | OXMTN_6_LNDFIL | 33469 | OX_MTN | 4.16 | 1.45 | 1 | Bay Area | Ames | | Market |
| PG&E | OXMTN_6_LNDFIL | 33469 | OX_MTN | 4.16 | 1.45 | 2 | Bay Area | Ames | | Market |
| PG&E | OXMTN_6_LNDFIL | 33469 | OX_MTN | 4.16 | 1.45 | 3 | Bay Area | Ames | | Market |
| PG&E | OXMTN_6_LNDFIL | 33469 | OX_MTN | 4.16 | 1.45 | 4 | Bay Area | Ames | | Market |
| PG&E | OXMTN_6_LNDFIL | 33469 | OX_MTN | 4.16 | 1.45 | 5 | Bay Area | Ames | | Market |
| PG&E | OXMTN_6_LNDFIL | 33469 | OX_MTN | 4.16 | 1.45 | 6 | Bay Area | Ames | | Market |
| PG&E | OXMTN_6_LNDFIL | 33469 | OX_MTN | 4.16 | 1.45 | 7 | Bay Area | Ames | | Market |
| PG&E | PALALT_7_COBUG | | | | 4.50 | | Bay Area | None | Not modeled | MUNI |
| PG&E | RICHMN_1_CHVSR2 | | | | 3.48 | | Bay Area | None | Not modeled Aug NQC | Market |
| PG&E | RICHMN_1_SOLAR | | | | 0.82 | | Bay Area | None | Not modeled Aug NQC | Market |
| PG&E | RICHMN_7_BAYENV | | | | 2.00 | | Bay Area | None | Not modeled Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|---------------------|-------|----------|------|--------|---|----------|----------------------------------|---------------------|------------|
| PG&E | RUSCTY_2_UNITS | 35304 | RUSELCT1 | 15 | 186.97 | 1 | Bay Area | Ames | No NQC - Pmax | Market |
| PG&E | RUSCTY_2_UNITS | 35305 | RUSELCT2 | 15 | 186.97 | 2 | Bay Area | Ames | No NQC - Pmax | Market |
| PG&E | RUSCTY_2_UNITS | 35306 | RUSELST1 | 15 | 246.06 | 3 | Bay Area | Ames | No NQC - Pmax | Market |
| PG&E | RVRVEW_1_UNITA1 | 33178 | RVEC_GEN | 13.8 | 48.70 | 1 | Bay Area | Contra Costa | Aug NQC | Market |
| PG&E | SRINTL_6_UNIT | 33468 | SRI INTL | 9.11 | 0.34 | 1 | Bay Area | None | Aug NQC | QF/Selfgen |
| PG&E | STAUFF_1_UNIT | 33139 | STAUFER | 9.11 | 0.02 | 1 | Bay Area | None | Aug NQC | QF/Selfgen |
| PG&E | STOILS_1_UNITS | 32921 | CHEVGEN1 | 13.8 | 1.22 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | STOILS_1_UNITS | 32922 | CHEVGEN2 | 13.8 | 1.22 | 1 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | STOILS_1_UNITS | 32923 | CHEVGEN3 | 13.8 | 0.57 | 3 | Bay Area | Pittsburg | Aug NQC | Market |
| PG&E | TIDWTR_2_UNITS | 33151 | FOSTER W | 12.5 | 3.57 | 1 | Bay Area | Pittsburg | Aug NQC | Net Seller |
| PG&E | TIDWTR_2_UNITS | 33151 | FOSTER W | 12.5 | 3.57 | 2 | Bay Area | Pittsburg | Aug NQC | Net Seller |
| PG&E | TIDWTR_2_UNITS | 33151 | FOSTER W | 12.5 | 2.71 | 3 | Bay Area | Pittsburg | Aug NQC | Net Seller |
| PG&E | UNCHEM_1_UNIT | 32920 | UNION CH | 9.11 | 11.07 | 1 | Bay Area | Pittsburg | Aug NQC | QF/Selfgen |
| PG&E | UNOCAL_1_UNITS | 32910 | UNOCAL | 12 | 0.25 | 1 | Bay Area | Pittsburg | Aug NQC | QF/Selfgen |
| PG&E | UNOCAL_1_UNITS | 32910 | UNOCAL | 12 | 0.25 | 2 | Bay Area | Pittsburg | Aug NQC | QF/Selfgen |
| PG&E | UNOCAL_1_UNITS | 32910 | UNOCAL | 12 | 0.25 | 3 | Bay Area | Pittsburg | Aug NQC | QF/Selfgen |
| PG&E | USWNRD_2_SMUD | 32169 | SOLANOWP | 21 | 27.08 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | USWNRD_2_SMUD2 | 32186 | SOLANO | 34.5 | 33.87 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | USWNRD_2_UNITS | 32168 | EXNCO | 9.11 | 15.79 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | USWPJR_2_UNITS | 39233 | GRNRDG | 0.69 | 20.72 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | WNDMAS_2_UNIT 1 | 33170 | WINDMSTR | 9.11 | 10.07 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | ZOND_6_UNIT | 35316 | ZOND SYS | 9.11 | 4.53 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | ZZ_IBMCTL_1_UNIT 1 | 35637 | IBM-CTLE | 115 | 0.00 | 1 | Bay Area | San Jose, South Bay-Moss Landing | No NQC - hist. data | Market |
| PG&E | ZZ_IMHOFF_1_UNIT 1 | 33136 | CCCSD | 12.5 | 0.00 | 1 | Bay Area | Pittsburg | No NQC - hist. data | QF/Selfgen |
| PG&E | ZZ_LFC 51_2_UNIT 1 | 35310 | PPASSWND | 21 | 0.00 | 1 | Bay Area | None | No NQC - est. data | Wind |
| PG&E | ZZ_MARKHM_1_CATL ST | 35863 | CATALYST | 9.11 | 0.00 | 1 | Bay Area | San Jose, South Bay-Moss Landing | | QF/Selfgen |
| PG&E | ZZ_NA | 35861 | SJ-SCL W | 4.3 | 0.00 | 1 | Bay Area | San Jose, South Bay-Moss Landing | No NQC - hist. data | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-------------------------|-------|----------|------|------|----|----------|----------------------------------|---------------------|------------|
| PG&E | ZZ_NA | 36209 | SLD ENRG | 12.5 | 0.00 | 1 | Bay Area | South Bay-Moss Landing | | QF/Selfgen |
| PG&E | ZZ_SEAWST_6_LAPOS | 35312 | FOREBAYW | 22 | 0.00 | 1 | Bay Area | Contra Costa | No NQC - est. data | Wind |
| PG&E | ZZ_SHELRF_1_UNITS | 33141 | SHELL 1 | 12.5 | 0.00 | 1 | Bay Area | Pittsburg | No NQC - hist. data | Net Seller |
| PG&E | ZZ_SHELRF_1_UNITS | 33142 | SHELL 2 | 12.5 | 0.00 | 1 | Bay Area | Pittsburg | No NQC - hist. data | Net Seller |
| PG&E | ZZ_SHELRF_1_UNITS | 33143 | SHELL 3 | 12.5 | 0.00 | 1 | Bay Area | Pittsburg | No NQC - hist. data | Net Seller |
| PG&E | ZZ_USWPFK_6_FRICK | 35320 | FRICKWND | 12 | 1.90 | 1 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | ZZ_USWPFK_6_FRICK | 35320 | FRICKWND | 12 | 0.00 | 2 | Bay Area | Contra Costa | Aug NQC | Wind |
| PG&E | ZZ_ZANKER_1_UNIT 1 | 35861 | SJ-SCL W | 4.3 | 0.00 | RN | Bay Area | San Jose, South Bay-Moss Landing | No NQC - hist. data | QF/Selfgen |
| PG&E | ZZZ_New Unit | 35623 | SWIFT | 21 | 4.00 | BT | Bay Area | | No NQC - Pmax | Battery |
| PG&E | ZZZ_New Unit | 30522 | 0354-WD | 21 | 1.83 | EW | Bay Area | Contra Costa | No NQC - Pmax | Market |
| PG&E | ZZZ_New Unit | 35307 | A100US-L | 12.6 | 0.00 | RN | Bay Area | | Energy Only | Market |
| PG&E | ZZZ_New Unit | 35859 | HGST-LV | 12.4 | 0.00 | RN | Bay Area | | Energy Only | Market |
| PG&E | ZZZ_New Unit | 35302 | NUMMI-LV | 12.6 | 0.00 | RN | Bay Area | | Energy Only | Market |
| PG&E | ZZZZZZ_COCOPP_7_UNIT 6 | 33116 | C.COS 6 | 18 | 0.00 | RT | Bay Area | Contra Costa | Retired | Market |
| PG&E | ZZZZZZ_COCOPP_7_UNIT 7 | 33117 | C.COS 7 | 18 | 0.00 | RT | Bay Area | Contra Costa | Retired | Market |
| PG&E | ZZZZZZ_CONTAN_1_UNIT | 36856 | CCA100 | 13.8 | 0.00 | 1 | Bay Area | San Jose, South Bay-Moss Landing | Retired | MUNI |
| PG&E | ZZZZZZ_FLOWD1_6_A LTPP1 | 35318 | FLOWDPTR | 9.11 | 0.00 | 1 | Bay Area | Contra Costa | Retired | Wind |
| PG&E | ZZZZZZ_MOSSLD_7_UNIT 6 | 36405 | MOSSLND6 | 22 | 0.00 | 1 | Bay Area | South Bay-Moss Landing | Retired | Market |
| PG&E | ZZZZZZ_MOSSLD_7_UNIT 7 | 36406 | MOSSLND7 | 22 | 0.00 | 1 | Bay Area | South Bay-Moss Landing | Retired | Market |
| PG&E | ZZZZZZ_PITTSP_7_UNIT 5 | 33105 | PTSB 5 | 18 | 0.00 | RT | Bay Area | Pittsburg | Retired | Market |
| PG&E | ZZZZZZ_PITTSP_7_UNIT 6 | 33106 | PTSB 6 | 18 | 0.00 | RT | Bay Area | Pittsburg | Retired | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|---------------------------|-------|----------|------|-------|----|----------|-----------------------------|----------------------------|------------|
| PG&E | ZZZZZ_PITTSP_7_U NIT 7 | 30000 | PTSB 7 | 20 | 0.00 | RT | Bay Area | Pittsburg | Retired | Market |
| PG&E | ZZZZZ_UNTDQF_7_U NITS | 33466 | UNTED CO | 9.11 | 0.00 | 1 | Bay Area | None | Retired | QF/Selfgen |
| PG&E | ADERA_1_SOLAR1 | 34319 | Q644 | 0.48 | 0.00 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | ADMEST_6_SOLAR | 34315 | ADAMS_E | 12.5 | 0.00 | 1 | Fresno | Wilson, Herndon | Energy Only | Market |
| PG&E | AGRICO_6_PL3N5 | 34608 | AGRICO | 13.8 | 22.69 | 3 | Fresno | Wilson, Herndon | | Market |
| PG&E | AGRICO_7_UNIT | 34608 | AGRICO | 13.8 | 7.47 | 2 | Fresno | Wilson, Herndon | | Market |
| PG&E | AGRICO_7_UNIT | 34608 | AGRICO | 13.8 | 43.13 | 4 | Fresno | Wilson, Herndon | | Market |
| PG&E | AVENAL_6_AVPARK | 34265 | AVENAL P | 12 | 0.00 | 1 | Fresno | Wilson, Coalinga | Energy Only | Market |
| PG&E | AVENAL_6_AVSLR1 | | | | 0.00 | | Fresno | Wilson, Coalinga | Not modeled Energy Only | Market |
| PG&E | AVENAL_6_AVSLR2 | | | | 0.00 | | Fresno | Wilson, Coalinga | Not modeled Energy Only | Market |
| PG&E | AVENAL_6_SANDDG | 34263 | SANDDRAG | 12 | 0.00 | 1 | Fresno | Wilson, Coalinga | Energy Only | Market |
| PG&E | AVENAL_6_SUNCTY | 34257 | SUNCTY D | 12 | 0.00 | 1 | Fresno | Wilson, Coalinga | Energy Only | Market |
| PG&E | BALCHS_7_UNIT 1 | 34624 | BALCH | 13.2 | 33.00 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | BALCHS_7_UNIT 2 | 34612 | BLCH | 13.8 | 52.50 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | BALCHS_7_UNIT 3 | 34614 | BLCH | 13.8 | 52.50 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | CANTUA_1_SOLAR | 34349 | CANTUA_D | 12.5 | 4.10 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | CANTUA_1_SOLAR | 34349 | CANTUA_D | 12.5 | 4.10 | 2 | Fresno | Wilson | Aug NQC | Market |
| PG&E | CAPMAD_1_UNIT 1 | 34179 | MADERA_G | 13.8 | 4.29 | 1 | Fresno | Wilson | | Market |
| PG&E | CHEVCO_6_UNIT 1 | 34652 | CHV.COAL | 9.11 | 1.70 | 1 | Fresno | Wilson, Coalinga | Aug NQC | QF/Selfgen |
| PG&E | CHEVCO_6_UNIT 2 | 34652 | CHV.COAL | 9.11 | 0.93 | 2 | Fresno | Wilson, Coalinga | Aug NQC | QF/Selfgen |
| PG&E | CHWCHL_1_BIOMAS | 34305 | CHWCHLA2 | 13.8 | 9.78 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | CHWCHL_1_UNIT | 34301 | CHOWCOGN | 13.8 | 48.00 | 1 | Fresno | Wilson, Herndon | | Market |
| PG&E | COLGA1_6_SHELLW | 34654 | COLNGAGN | 9.11 | 34.70 | 1 | Fresno | Wilson, Coalinga | Aug NQC | Net Seller |
| PG&E | CORCAN_1_SOLAR1 | | | | 8.20 | | Fresno | Wilson, Herndon, Hanford | Not Modeled Aug NQC | Market |
| PG&E | CORCAN_1_SOLAR2 | | | | 4.51 | | Fresno | Wilson, Herndon, Hanford | Not Modeled Aug NQC | Market |
| PG&E | CRESSY_1_PARKER | 34140 | CRESSEY | 115 | 0.73 | | Fresno | Wilson | Not modeled Aug NQC | MUNI |
| PG&E | CRNEVL_6_CRNVA | 34634 | CRANEVLY | 12 | 0.90 | 1 | Fresno | Wilson, Borden | Aug NQC | Market |
| PG&E | CRNEVL_6_SJQN 2 | 34631 | SJ2GEN | 9.11 | 3.20 | 1 | Fresno | Wilson, Borden | Aug NQC | Market |
| PG&E | CRNEVL_6_SJQN 3 | 34633 | SJ3GEN | 9.11 | 4.20 | 1 | Fresno | Wilson, Borden | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|--------|---|--------|-----------------------------|----------------------------|------------|
| PG&E | CURTIS_1_CANLCK | | | | 0.13 | | Fresno | Wilson | Not modeled Aug NQC | Market |
| PG&E | CURTIS_1_FARFLD | | | | 0.30 | | Fresno | Wilson | Not modeled Aug NQC | Market |
| PG&E | DINUBA_6_UNIT | 34648 | DINUBA E | 13.8 | 3.93 | 1 | Fresno | Wilson, Herndon, Reedley | | Market |
| PG&E | EEKTMN_6_SOLAR1 | 34627 | KETTLEMN | 0.34 | 0.00 | 1 | Fresno | Wilson | Energy Only | Market |
| PG&E | ELCAP_1_SOLAR | | | | 0.62 | | Fresno | Wilson | Not Modeled Aug NQC | Market |
| PG&E | ELNIDP_6_BIOMAS | 34330 | ELNIDO | 13.8 | 9.40 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | EXCHEC_7_UNIT 1 | 34306 | EXCHQUER | 13.8 | 90.72 | 1 | Fresno | Wilson | Aug NQC | MUNI |
| PG&E | EXCLSG_1_SOLAR | 34623 | Q678 | 0.5 | 24.60 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | FRESHW_1_SOLAR1 | 34669 | Q529A | 4.16 | 0.00 | 1 | Fresno | Wilson, Herndon | Energy Only | Market |
| PG&E | FRESHW_1_SOLAR1 | 34669 | Q529A | 0.48 | 0.00 | 2 | Fresno | Wilson, Herndon | Energy Only | Market |
| PG&E | FRIANT_6_UNITS | 34636 | FRIANTDM | 6.6 | 5.76 | 2 | Fresno | Wilson, Borden | Aug NQC | Net Seller |
| PG&E | FRIANT_6_UNITS | 34636 | FRIANTDM | 6.6 | 3.08 | 3 | Fresno | Wilson, Borden | Aug NQC | Net Seller |
| PG&E | FRIANT_6_UNITS | 34636 | FRIANTDM | 6.6 | 0.81 | 4 | Fresno | Wilson, Borden | Aug NQC | Net Seller |
| PG&E | GIFENS_6_BUGSL1 | | | | 8.20 | | Fresno | Wilson | Not modeled Aug NQC | Market |
| PG&E | GIFFEN_6_SOLAR | | | | 4.10 | | Fresno | Wilson | Not modeled Aug NQC | Market |
| PG&E | GUERNS_6_SOLAR | 34461 | GUERNSEY | 12.5 | 4.10 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | GUERNS_6_SOLAR | 34461 | GUERNSEY | 12.5 | 4.10 | 2 | Fresno | Wilson | Aug NQC | Market |
| PG&E | GWFPWR_1_UNITS | 34431 | GWF_HEP1 | 13.8 | 49.23 | 1 | Fresno | Wilson, Herndon, Hanford | | Market |
| PG&E | GWFPWR_1_UNITS | 34433 | GWF_HEP2 | 13.8 | 49.23 | 1 | Fresno | Wilson, Herndon, Hanford | | Market |
| PG&E | HAASPH_7_PL1X2 | 34610 | HAAS | 13.8 | 72.00 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | HAASPH_7_PL1X2 | 34610 | HAAS | 13.8 | 72.00 | 2 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | HELMPG_7_UNIT 1 | 34600 | HELMS | 18 | 407.00 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | HELMPG_7_UNIT 2 | 34602 | HELMS | 18 | 407.00 | 2 | Fresno | Wilson | Aug NQC | Market |
| PG&E | HELMPG_7_UNIT 3 | 34604 | HELMS | 18 | 404.00 | 3 | Fresno | Wilson | Aug NQC | Market |
| PG&E | HENRTA_6_SOLAR1 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | HENRTA_6_SOLAR2 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | HENRTA_6_UNITA1 | 34539 | GWF_GT1 | 13.8 | 49.98 | 1 | Fresno | Wilson | | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|-----------|------|--------|----|--------|-----------------------------|----------------------------|------------|
| PG&E | HENRTA_6_UNITA2 | 34541 | GWF_GT2 | 13.8 | 49.42 | 1 | Fresno | Wilson | | Market |
| PG&E | HENRTS_1_SOLAR | 34617 | Q581 | 0.38 | 41.00 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | HURON_6_SOLAR | 34557 | HURON_DI | 12.5 | 4.10 | 1 | Fresno | Wilson, Coalinga | Aug NQC | Market |
| PG&E | HURON_6_SOLAR | 34557 | HURON_DI | 12.5 | 4.10 | 2 | Fresno | Wilson, Coalinga | Aug NQC | Market |
| PG&E | INTTRB_6_UNIT | 34342 | INT.TURB | 9.11 | 5.63 | 1 | Fresno | Wilson | Aug NQC | QF/Selfgen |
| PG&E | JAYNE_6_WLSLR | 34639 | WESTLNDS | 0.48 | 0.00 | 1 | Fresno | Wilson, Coalinga | Energy Only | Market |
| PG&E | KANSAS_6_SOLAR | 34666 | KANSASS_S | 12.5 | 0.00 | F | Fresno | Wilson | Energy Only | Market |
| PG&E | KERKH1_7_UNIT 1 | 34344 | KERCK1-1 | 6.6 | 13.00 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | KERKH1_7_UNIT 3 | 34345 | KERCK1-3 | 6.6 | 12.80 | 3 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | KERKH2_7_UNIT 1 | 34308 | KERCKHOF | 13.8 | 153.90 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | KERMAN_6_SOLAR1 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | KERMAN_6_SOLAR2 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | KINGCO_1_KINGBR | 34642 | KINGSBUR | 9.11 | 34.50 | 1 | Fresno | Wilson, Herndon, Hanford | Aug NQC | Net Seller |
| PG&E | KINGRV_7_UNIT 1 | 34616 | KINGSRIV | 13.8 | 51.20 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | KNGBRG_1_KBSLR1 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | KNGBRG_1_KBSLR2 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | KNTSTH_6_SOLAR | 34694 | KENT_S | 0.8 | 0.00 | 1 | Fresno | Wilson | Energy Only | Market |
| PG&E | LEPRFD_1_KANSAS | 34680 | KANSAS | 12.5 | 8.20 | 1 | Fresno | Wilson, Hanford | Aug NQC | Market |
| PG&E | MALAGA_1_PL1X2 | 34671 | KRCDPCT1 | 13.8 | 48.00 | 1 | Fresno | Wilson, Herndon | | Market |
| PG&E | MALAGA_1_PL1X2 | 34672 | KRCDPCT2 | 13.8 | 48.00 | 1 | Fresno | Wilson, Herndon | | Market |
| PG&E | MCCALL_1_QF | 34219 | MCCALL 4 | 12.5 | 0.44 | QF | Fresno | Wilson, Herndon | Aug NQC | QF/Selfgen |
| PG&E | MCSWAN_6_UNITS | 34320 | MCSWAIN | 9.11 | 9.60 | 1 | Fresno | Wilson | Aug NQC | MUNI |
| PG&E | MENBIO_6_RENEW1 | 34339 | CALRENEW | 12.5 | 2.05 | 1 | Fresno | Wilson, Herndon | Aug NQC | Net Seller |
| PG&E | MENBIO_6_UNIT | 34334 | BIO PWR | 9.11 | 19.24 | 1 | Fresno | Wilson | Aug NQC | QF/Selfgen |
| PG&E | MERCED_1_SOLAR1 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | MERCED_1_SOLAR2 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | MERCFL_6_UNIT | 34322 | MERCEDFL | 9.11 | 3.36 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | MNDOTA_1_SOLAR1 | 34311 | NORTHSTAR | 0.2 | 24.60 | 1 | Fresno | Wilson | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|-------------|------|-------|----|--------|-----------------------------|----------------------------|--------|
| PG&E | MNDOTA_1_SOLAR2 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | MSTANG_2_SOLAR | 34683 | Q643W | 0.8 | 12.30 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | MSTANG_2_SOLAR3 | 34683 | Q643W | 0.8 | 16.40 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | MSTANG_2_SOLAR4 | 34683 | Q643W | 0.8 | 12.30 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | ONLLPP_6_UNITS | 34316 | ONEILPMP | 9.11 | 0.37 | 1 | Fresno | Wilson | Aug NQC | MUNI |
| PG&E | OROLOM_1_SOLAR1 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | OROLOM_1_SOLAR2 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | PAIGES_6_SOLAR | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | PINFLT_7_UNITS | 38720 | PINEFLAT | 13.8 | 70.00 | 1 | Fresno | Wilson, Herndon | Aug NQC | MUNI |
| PG&E | PINFLT_7_UNITS | 38720 | PINEFLAT | 13.8 | 70.00 | 2 | Fresno | Wilson, Herndon | Aug NQC | MUNI |
| PG&E | PINFLT_7_UNITS | 38720 | PINEFLAT | 13.8 | 70.00 | 3 | Fresno | Wilson, Herndon | Aug NQC | MUNI |
| PG&E | PNCHPP_1_PL1X2 | 34328 | STARGT1 | 13.8 | 59.96 | 1 | Fresno | Wilson | | Market |
| PG&E | PNCHPP_1_PL1X2 | 34329 | STARGT2 | 13.8 | 59.96 | 2 | Fresno | Wilson | | Market |
| PG&E | PNOCHE_1_PL1X2 | 34142 | WHD_PAN2 | 13.8 | 49.97 | 1 | Fresno | Wilson, Herndon | | Market |
| PG&E | PNOCHE_1_UNITA1 | 34186 | DG_PAN1 | 13.8 | 48.00 | 1 | Fresno | Wilson | | Market |
| PG&E | REEDLY_6_SOLAR | | | | 0.00 | | Fresno | Wilson, Herndon, Reedley | Not modeled Energy Only | Market |
| PG&E | S_RITA_6_SOLAR1 | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | SCHNDR_1_FIVPTS | 34353 | SCHINDLER_D | 12.5 | 4.10 | 1 | Fresno | Wilson, Coalinga | Aug NQC | Market |
| PG&E | SCHNDR_1_FIVPTS | 34353 | SCHINDLER_D | 12.5 | 2.05 | 2 | Fresno | Wilson, Coalinga | Aug NQC | Market |
| PG&E | SCHNDR_1_WSTSDE | 34353 | SCHINDLER_D | 12.5 | 4.10 | 3 | Fresno | Wilson, Coalinga | Aug NQC | Market |
| PG&E | SCHNDR_1_WSTSDE | 34353 | SCHINDLER_D | 12.5 | 2.05 | 4 | Fresno | Wilson, Coalinga | Aug NQC | Market |
| PG&E | SGREGY_6_SANGER | 34646 | SANGERCO | 13.8 | 38.77 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | SGREGY_6_SANGER | 34646 | SANGERCO | 13.8 | 9.31 | 2 | Fresno | Wilson | Aug NQC | Market |
| PG&E | STOREY_2_MDRCH2 | 34253 | BORDEN D | 12.5 | 0.21 | QF | Fresno | Wilson | Not modeled Aug NQC | Market |
| PG&E | STOREY_2_MDRCH3 | 34253 | BORDEN D | 12.5 | 0.18 | QF | Fresno | Wilson | Not modeled Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|------------------------|-------|--------------|------|-------|----|--------|-----------------------------|----------------------------|------------|
| PG&E | STOREY_2_MDRCH4 | 34253 | BORDEN D | 12.5 | 0.27 | QF | Fresno | Wilson | Not modeled Aug NQC | Market |
| PG&E | STOREY_7_MDRCHW | 34209 | STOREY D | 12.5 | 0.21 | 1 | Fresno | Wilson | Aug NQC | Net Seller |
| PG&E | STROUD_6_SOLAR | 34563 | STROUD_D | 12.5 | 4.10 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | STROUD_6_SOLAR | 34563 | STROUD_D | 12.5 | 4.10 | 2 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | TRNQL8_2_AZUSR1 | | | | 0.00 | | Fresno | Wilson | Not modeled Aug NQC | Market |
| PG&E | TRNQLT_2_SOLAR | 34340 | Q643X | 0.8 | 82.00 | 1 | Fresno | Wilson | Aug NQC | Market |
| PG&E | ULTPFR_1_UNIT 1 | 34640 | ULTR.PWR | 9.11 | 24.07 | 1 | Fresno | Wilson, Herndon | Aug NQC | Market |
| PG&E | VEGA_6_SOLAR1 | 34314 | VEGA | 34.5 | 0.00 | 1 | Fresno | Wilson | Energy Only | Market |
| PG&E | WAUKNA_1_SOLAR | 34696 | CORCORANPV_S | 21 | 8.20 | 1 | Fresno | Wilson, Herndon, Hanford | Aug NQC | Market |
| PG&E | WAUKNA_1_SOLAR2 | 34677 | Q558 | 21 | 8.10 | 1 | Fresno | Wilson, Herndon, Hanford | No NQC - Pmax | Market |
| PG&E | WFRESN_1_SOLAR | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | WHITNY_6_SOLAR | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | WISHON_6_UNITS | 34658 | WISHON | 2.3 | 4.51 | 1 | Fresno | Wilson, Borden | Aug NQC | Market |
| PG&E | WISHON_6_UNITS | 34658 | WISHON | 2.3 | 4.51 | 2 | Fresno | Wilson, Borden | Aug NQC | Market |
| PG&E | WISHON_6_UNITS | 34658 | WISHON | 2.3 | 4.51 | 3 | Fresno | Wilson, Borden | Aug NQC | Market |
| PG&E | WISHON_6_UNITS | 34658 | WISHON | 2.3 | 4.51 | 4 | Fresno | Wilson, Borden | Aug NQC | Market |
| PG&E | WISHON_6_UNITS | 34658 | WISHON | 2.3 | 0.36 | SJ | Fresno | Wilson, Borden | Aug NQC | Market |
| PG&E | WOODWR_1_HYDRO | | | | 0.00 | | Fresno | Wilson | Not modeled Energy Only | Market |
| PG&E | WRGHTP_7_AMENGY | 34207 | WRIGHT D | 12.5 | 0.03 | QF | Fresno | Wilson | Aug NQC | QF/Selfgen |
| PG&E | ZZ_BORDEN_2_QF | 34253 | BORDEN D | 12.5 | 1.30 | QF | Fresno | Wilson | No NQC - hist. data | Net Seller |
| PG&E | ZZ_BULLRD_7_SAGN ES | 34213 | BULLD 12 | 12.5 | 0.06 | 1 | Fresno | Wilson | Aug NQC | QF/Selfgen |
| PG&E | ZZ_GATES_6_PL1X2 | 34553 | WHD_GAT2 | 13.8 | 0.00 | 1 | Fresno | Wilson, Coalinga | | Market |
| PG&E | ZZ_JRWOOD_1_UNIT 1 | 34332 | JRWCOGEN | 9.11 | 0.00 | 1 | Fresno | Wilson | | QF/Selfgen |
| PG&E | ZZ_KERKH1_7_UNIT 2 | 34343 | KERCK1-2 | 6.6 | 8.50 | 2 | Fresno | Wilson, Herndon | No NQC - hist. data | Market |
| PG&E | ZZ_NA | 34485 | FRESNOWW | 12.5 | 0.00 | 1 | Fresno | Wilson | No NQC - hist. data | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|---------------|--------|-------------|------|-------|----|----------|--------------------------|---------------------|------------|
| PG&E | ZZ_NA | 34485 | FRESNOWW | 12.5 | 0.10 | 2 | Fresno | Wilson | No NQC - hist. data | QF/Selfgen |
| PG&E | ZZ_NA | 34485 | FRESNOWW | 12.5 | 0.00 | 3 | Fresno | Wilson | No NQC - hist. data | QF/Selfgen |
| PG&E | ZZZ_New Unit | 34653 | Q526 | 0.55 | 0.00 | 1 | Fresno | Wilson, Coalinga | Energy Only | Market |
| PG&E | ZZZ_New Unit | 34673 | Q532 | 0.55 | 0.00 | 1 | Fresno | Wilson, Coalinga | Energy Only | Market |
| PG&E | ZZZ_New Unit | 34467 | GIFFEN_DIST | 12.5 | 4.10 | 1 | Fresno | Wilson, Herndon | No NQC - est. data | Market |
| PG&E | ZZZ_New Unit | 34649 | Q965 | 0.36 | 5.53 | 1 | Fresno | Wilson, Herndon | No NQC - est. data | Market |
| PG&E | ZZZ_New Unit | 365514 | Q1032G1 | 0.55 | 7.87 | 1 | Fresno | Wilson | No NQC - est. data | Market |
| PG&E | ZZZ_New Unit | 34644 | Q679 | 0.55 | 8.20 | 1 | Fresno | Wilson | No NQC - est. data | Market |
| PG&E | ZZZ_New Unit | 365502 | Q632BC1 | 0.55 | 8.28 | 1 | Fresno | Wilson | No NQC - est. data | Market |
| PG&E | ZZZ_New Unit | 34313 | NORTHSTAR | 0.55 | 61.60 | 1 | Fresno | Wilson | No NQC - Pmax | Market |
| PG&E | ZZZ_New Unit | 365517 | Q1032G2 | 0.55 | 7.87 | 2 | Fresno | Wilson | No NQC - est. data | Market |
| PG&E | ZZZ_New Unit | 365520 | Q1032G3 | 0.55 | 67.49 | 3 | Fresno | Wilson | No NQC - est. data | Market |
| PG&E | ZZZ_New Unit | 34689 | ORO LOMA_3 | 12.5 | 20.00 | EW | Fresno | Wilson | No NQC - Pmax | Market |
| PG&E | ZZZ_New Unit | 34690 | CORCORAN | 12.5 | 8.20 | FW | Fresno | Wilson, Herndon, Hanford | No NQC - est. data | Market |
| PG&E | ZZZ_New Unit | 34692 | CORCORAN | 12.5 | 12.00 | FW | Fresno | Wilson, Herndon, Hanford | No NQC - Pmax | Market |
| PG&E | ZZZ_New Unit | 34651 | JACALITO-LV | 0.55 | 1.22 | RN | Fresno | Wilson | No NQC - Pmax | Market |
| PG&E | ZZZ_New Unit | 34603 | JGBSWLT | 12.5 | 0.00 | ST | Fresno | Wilson, Herndon | Energy Only | Market |
| PG&E | ZZZZ_New Unit | 34335 | Q723 | 0.32 | 20.50 | 1 | Fresno | Wilson, Borden | No NQC - est. data | Market |
| PG&E | ZZZZ_New Unit | 34688 | Q272 | 0.55 | 50.43 | 1 | Fresno | Wilson | No NQC - est. data | Market |
| PG&E | BRDGV_7_BAKER | | | | 0.88 | | Humboldt | None | Not modeled Aug NQC | Net Seller |
| PG&E | FAIRHV_6_UNIT | 31150 | FAIRHAVN | 13.8 | 13.58 | 1 | Humboldt | None | Aug NQC | Net Seller |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|----------------------------|-------|-----------|------|-------|----|----------|-------------------------|-------------------------|------------|
| PG&E | FTSWRD_6_TRFORK | | | | 0.10 | | Humboldt | None | Not modeled Aug NQC | Market |
| PG&E | FTSWRD_7_QFUNTS | | | | 0.00 | | Humboldt | None | Not modeled Aug NQC | QF/Selfgen |
| PG&E | GRSCRK_6_BGCKWW | | | | 0.00 | | Humboldt | None | Not modeled Energy Only | QF/Selfgen |
| PG&E | HUMBPP_1_UNITS3 | 31180 | HUMB_G1 | 13.8 | 16.30 | 1 | Humboldt | None | | Market |
| PG&E | HUMBPP_1_UNITS3 | 31180 | HUMB_G1 | 13.8 | 15.83 | 2 | Humboldt | None | | Market |
| PG&E | HUMBPP_1_UNITS3 | 31180 | HUMB_G1 | 13.8 | 16.67 | 3 | Humboldt | None | | Market |
| PG&E | HUMBPP_1_UNITS3 | 31180 | HUMB_G1 | 13.8 | 16.20 | 4 | Humboldt | None | | Market |
| PG&E | HUMBPP_6_UNITS | 31181 | HUMB_G2 | 13.8 | 16.14 | 5 | Humboldt | None | | Market |
| PG&E | HUMBPP_6_UNITS | 31181 | HUMB_G2 | 13.8 | 16.33 | 6 | Humboldt | None | | Market |
| PG&E | HUMBPP_6_UNITS | 31181 | HUMB_G2 | 13.8 | 16.24 | 7 | Humboldt | None | | Market |
| PG&E | HUMBPP_6_UNITS | 31182 | HUMB_G3 | 13.8 | 16.62 | 8 | Humboldt | None | | Market |
| PG&E | HUMBPP_6_UNITS | 31182 | HUMB_G3 | 13.8 | 16.33 | 9 | Humboldt | None | | Market |
| PG&E | HUMBPP_6_UNITS | 31182 | HUMB_G3 | 13.8 | 15.95 | 10 | Humboldt | None | | Market |
| PG&E | HUMBSB_1_QF | | | | 0.00 | | Humboldt | None | Not modeled Aug NQC | QF/Selfgen |
| PG&E | KEKAWK_6_UNIT | 31166 | KEKAWAK | 9.1 | 0.80 | 1 | Humboldt | None | Aug NQC | Net Seller |
| PG&E | LAPAC_6_UNIT | 31158 | LP SAMOA | 12.5 | 0.00 | 1 | Humboldt | None | | Market |
| PG&E | LOWGAP_1_SUPHR | | | | 0.00 | | Humboldt | None | Not modeled Aug NQC | Market |
| PG&E | PACLUM_6_UNIT | 31152 | PAC.LUMB | 13.8 | 9.31 | 1 | Humboldt | None | Aug NQC | Net Seller |
| PG&E | PACLUM_6_UNIT | 31152 | PAC.LUMB | 13.8 | 9.31 | 2 | Humboldt | None | Aug NQC | Net Seller |
| PG&E | PACLUM_6_UNIT | 31153 | PAC.LUMB | 2.4 | 5.59 | 3 | Humboldt | None | Aug NQC | Net Seller |
| PG&E | ZZZZZ_BLULKE_6_BLU UELK | 31156 | BLUELKPP | 12.5 | 0.00 | 1 | Humboldt | None | Retired | Market |
| PG&E | 7STDRD_1_SOLAR1 | 35065 | 7STNDRD_1 | 21 | 8.20 | FW | Kern | South Kern PP, Kern Oil | Aug NQC | Market |
| PG&E | ADOBEE_1_SOLAR | 35021 | Q622B | 34.5 | 8.20 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | BDGRCK_1_UNITS | 35029 | BADGERCK | 13.8 | 43.00 | 1 | Kern | South Kern PP | Aug NQC | Net Seller |
| PG&E | BEARMT_1_UNIT | 35066 | PSE-BEAR | 13.8 | 45.00 | 1 | Kern | South Kern PP, Westpark | Aug NQC | Net Seller |
| PG&E | BKRFLD_2_SOLAR1 | | | | 0.57 | | Kern | South Kern PP | Not modeled Aug NQC | Market |
| PG&E | DEXZEL_1_UNIT | 35024 | DEXEL + | 13.8 | 17.15 | 1 | Kern | South Kern PP, Kern Oil | Aug NQC | Net Seller |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|----------------------|--------|-----------|------|-------|----|------|-------------------------------|---------------------|------------|
| PG&E | DISCOV_1_CHEVRN | 35062 | DISCOVERY | 13.8 | 3.04 | 1 | Kern | South Kern PP, Kern Oil | Aug NQC | QF/Selfgen |
| PG&E | DOUBLC_1_UNITS | 35023 | DOUBLE C | 13.8 | 51.20 | 1 | Kern | South Kern PP | Aug NQC | Net Seller |
| PG&E | KERNFT_1_UNITS | 35026 | KERNFRNT | 9.11 | 51.30 | 1 | Kern | South Kern PP | Aug NQC | Net Seller |
| PG&E | KRNCNY_6_UNIT | 35018 | KERNCNYN | 11 | 3.42 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | LAMONT_1_SOLAR1 | 35019 | REGULUS | 0.4 | 24.60 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | LAMONT_1_SOLAR2 | 35092 | Q744G4 | 0.38 | 8.20 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | LAMONT_1_SOLAR3 | 35087 | Q744G3 | 0.4 | 6.15 | 3 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | LAMONT_1_SOLAR4 | 35059 | Q744G2 | 0.4 | 22.06 | 2 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | LAMONT_1_SOLAR5 | 35054 | Q744G1 | 0.4 | 6.83 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | LIVOAK_1_UNIT 1 | 35058 | PSE-LVOK | 9.1 | 42.70 | 1 | Kern | South Kern PP, Kern Oil | Aug NQC | Net Seller |
| PG&E | MAGUND_1_BKISR1 | | | | 0.00 | | Kern | South Kern PP, Kern Oil | Not modeled Aug NQC | Market |
| PG&E | MAGUND_1_BKSSR2 | | | | 2.15 | | Kern | South Kern PP, Kern Oil | Not modeled Aug NQC | Market |
| PG&E | MTNPOS_1_UNIT | 35036 | MT POSO | 13.8 | 46.64 | 1 | Kern | South Kern PP, Kern Oil | Aug NQC | Net Seller |
| PG&E | OLDRIV_6_BIOGAS | | | | 1.62 | | Kern | South Kern PP | Not modeled Aug NQC | Market |
| PG&E | OLDRV1_6_SOLAR | 35091 | OLD_RVR1 | 12.5 | 8.20 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | RIOBRV_6_UNIT 1 | 35020 | RIOBRAVO | 9.1 | 1.26 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | SIERRA_1_UNITS | 35027 | HISIERRA | 9.11 | 51.60 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | SKERN_6_SOLAR1 | 35089 | S_KERN | 0.48 | 8.20 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | SKERN_6_SOLAR2 | 365563 | Q885 | 0.36 | 4.10 | 1 | Kern | South Kern PP | Aug NQC | Market |
| PG&E | VEDDER_1_SEKERN | 35046 | SEKR | 9.11 | 9.46 | 1 | Kern | South Kern PP, Kern Oil | Aug NQC | QF/Selfgen |
| PG&E | ZZZZ_OILDAL_1_UNIT 1 | 35028 | OILDALE | 9.11 | 0.00 | RT | Kern | South Kern PP, Kern Oil | Retired | Net Seller |
| PG&E | ZZZZ_ULTOGL_1_PO SO | 35035 | ULTR PWR | 9.11 | 0.00 | 1 | Kern | South Kern PP, Kern Oil | Retired | QF/Selfgen |
| PG&E | ADLIN_1_UNITS | 31435 | GEO.ENGY | 9.1 | 8.00 | 1 | NCNB | Eagle Rock, Fulton, Lakeville | | Market |
| PG&E | ADLIN_1_UNITS | 31435 | GEO.ENGY | 9.1 | 8.00 | 2 | NCNB | Eagle Rock, Fulton, Lakeville | | Market |
| PG&E | CLOVDL_1_SOLAR | | | | 0.00 | | NCNB | Eagle Rock, Fulton, Lakeville | Not modeled Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|-------|---|------|-------------------------------|--------------------------|------------|
| PG&E | CSTOGA_6_LNDFIL | | | | 0.00 | | NCNB | Fulton, Lakeville | Not modeled Energy Only | Market |
| PG&E | FULTON_1_QF | | | | 0.01 | | NCNB | Fulton, Lakeville | Not modeled Aug NQC | QF/Selfgen |
| PG&E | GEYS11_7_UNIT11 | 31412 | GEYSER11 | 13.8 | 68.00 | 1 | NCNB | Eagle Rock, Fulton, Lakeville | | Market |
| PG&E | GEYS12_7_UNIT12 | 31414 | GEYSER12 | 13.8 | 50.00 | 1 | NCNB | Fulton, Lakeville | | Market |
| PG&E | GEYS13_7_UNIT13 | 31416 | GEYSER13 | 13.8 | 56.00 | 1 | NCNB | Lakeville | | Market |
| PG&E | GEYS14_7_UNIT14 | 31418 | GEYSER14 | 13.8 | 50.00 | 1 | NCNB | Fulton, Lakeville | | Market |
| PG&E | GEYS16_7_UNIT16 | 31420 | GEYSER16 | 13.8 | 49.00 | 1 | NCNB | Fulton, Lakeville | | Market |
| PG&E | GEYS17_7_UNIT17 | 31422 | GEYSER17 | 13.8 | 56.00 | 1 | NCNB | Fulton, Lakeville | | Market |
| PG&E | GEYS18_7_UNIT18 | 31424 | GEYSER18 | 13.8 | 45.00 | 1 | NCNB | Lakeville | | Market |
| PG&E | GEYS20_7_UNIT20 | 31426 | GEYSER20 | 13.8 | 40.00 | 1 | NCNB | Lakeville | | Market |
| PG&E | GYS5X6_7_UNITS | 31406 | GEYSR5-6 | 13.8 | 42.50 | 1 | NCNB | Eagle Rock, Fulton, Lakeville | | Market |
| PG&E | GYS5X6_7_UNITS | 31406 | GEYSR5-6 | 13.8 | 42.50 | 2 | NCNB | Eagle Rock, Fulton, Lakeville | | Market |
| PG&E | GYS7X8_7_UNITS | 31408 | GEYSER78 | 13.8 | 38.00 | 1 | NCNB | Eagle Rock, Fulton, Lakeville | | Market |
| PG&E | GYS7X8_7_UNITS | 31408 | GEYSER78 | 13.8 | 38.00 | 2 | NCNB | Eagle Rock, Fulton, Lakeville | | Market |
| PG&E | GYSRVL_7_WSPRNG | | | | 1.34 | | NCNB | Fulton, Lakeville | Not modeled Aug NQC | QF/Selfgen |
| PG&E | HILAND_7_YOLOWD | | | | 0.00 | | NCNB | Eagle Rock, Fulton, Lakeville | Not Modeled. Energy Only | Market |
| PG&E | IGNACO_1_QF | | | | 0.13 | | NCNB | Lakeville | Not modeled Aug NQC | QF/Selfgen |
| PG&E | INDVLY_1_UNITS | 31436 | INDIAN V | 9.1 | 1.11 | 1 | NCNB | Eagle Rock, Fulton, Lakeville | Aug NQC | Net Seller |
| PG&E | MONTPH_7_UNITS | 32700 | MONTICLO | 9.1 | 3.03 | 1 | NCNB | Fulton, Lakeville | Aug NQC | Market |
| PG&E | MONTPH_7_UNITS | 32700 | MONTICLO | 9.1 | 3.03 | 2 | NCNB | Fulton, Lakeville | Aug NQC | Market |
| PG&E | MONTPH_7_UNITS | 32700 | MONTICLO | 9.1 | 0.91 | 3 | NCNB | Fulton, Lakeville | Aug NQC | Market |
| PG&E | NCPA_7_GP1UN1 | 38106 | NCPA1GY1 | 13.8 | 31.00 | 1 | NCNB | Lakeville | Aug NQC | MUNI |
| PG&E | NCPA_7_GP1UN2 | 38108 | NCPA1GY2 | 13.8 | 28.00 | 1 | NCNB | Lakeville | Aug NQC | MUNI |
| PG&E | NCPA_7_GP2UN3 | 38110 | NCPA2GY1 | 13.8 | 0.00 | 1 | NCNB | Fulton, Lakeville | Aug NQC | MUNI |
| PG&E | NCPA_7_GP2UN4 | 38112 | NCPA2GY2 | 13.8 | 52.73 | 1 | NCNB | Fulton, Lakeville | Aug NQC | MUNI |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|------------------------|--------|----------|------|--------|---|--------|--------------------------------------------------------------------------|-------------------------|------------|
| PG&E | POTTER_6_UNITS | 31433 | POTTRVLY | 2.4 | 0.97 | 1 | NCNB | Eagle Rock, Fulton, Lakeville | Aug NQC | Market |
| PG&E | POTTER_6_UNITS | 31433 | POTTRVLY | 2.4 | 0.44 | 3 | NCNB | Eagle Rock, Fulton, Lakeville | Aug NQC | Market |
| PG&E | POTTER_6_UNITS | 31433 | POTTRVLY | 2.4 | 0.44 | 4 | NCNB | Eagle Rock, Fulton, Lakeville | Aug NQC | Market |
| PG&E | POTTER_7_VECINO | | | | 0.00 | | NCNB | Eagle Rock, Fulton, Lakeville | Not modeled Aug NQC | QF/Selfgen |
| PG&E | SANTFG_7_UNITS | 31400 | SANTA FE | 13.8 | 31.50 | 1 | NCNB | Lakeville | | Market |
| PG&E | SANTFG_7_UNITS | 31400 | SANTA FE | 13.8 | 31.50 | 2 | NCNB | Lakeville | | Market |
| PG&E | SMUDGO_7_UNIT 1 | 31430 | SMUDGE01 | 13.8 | 47.00 | 1 | NCNB | Lakeville | | Market |
| PG&E | SNMALF_6_UNITS | 31446 | SONMA LF | 9.1 | 3.92 | 1 | NCNB | Fulton, Lakeville | Aug NQC | QF/Selfgen |
| PG&E | UKIAH_7_LAKEMN | 38020 | CITY UKH | 115 | 0.49 | 1 | NCNB | Eagle Rock, Fulton, Lakeville | Aug NQC | MUNI |
| PG&E | UKIAH_7_LAKEMN | 38020 | CITY UKH | 115 | 1.21 | 2 | NCNB | Eagle Rock, Fulton, Lakeville | Aug NQC | MUNI |
| PG&E | WDFRDF_2_UNITS | 31404 | WEST FOR | 13.8 | 12.50 | 1 | NCNB | Fulton, Lakeville | | Market |
| PG&E | WDFRDF_2_UNITS | 31404 | WEST FOR | 13.8 | 12.50 | 2 | NCNB | Fulton, Lakeville | | Market |
| PG&E | ZZZ_New Unit | 365542 | Q1221 | 13.8 | 35.00 | 1 | NCNB | Eagle Rock, Fulton, Lakeville | No NQC - Pmax | Market |
| PG&E | ZZZZ_BEARN_2_UNITS | 31402 | BEAR CAN | 13.8 | 0.00 | 1 | NCNB | Fulton, Lakeville | Retired | Market |
| PG&E | ZZZZ_BEARN_2_UNITS | 31402 | BEAR CAN | 13.8 | 0.00 | 2 | NCNB | Fulton, Lakeville | Retired | Market |
| PG&E | ZZZZZ_GEYS17_2_B OTRCK | 31421 | BOTTLERK | 13.8 | 0.00 | 1 | NCNB | Fulton, Lakeville | Retired | Market |
| PG&E | ALLGNY_6_HYDRO1 | | | | 0.08 | | Sierra | South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | APLHIL_1_SLABCK | | | | 0.00 | 1 | Sierra | Placerville, South of Rio Oso, South of Palermo, South of Table Mountain | Not modeled Energy Only | Market |
| PG&E | BANGOR_6_HYDRO | | | | 0.32 | | Sierra | South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | BELDEN_7_UNIT 1 | 31784 | BELDEN | 13.8 | 119.00 | 1 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|--------|---|--------|-------------------------------------------------------------------------------------------|---------------------|------------|
| PG&E | BIOMAS_1_UNIT 1 | 32156 | WOODLAND | 9.11 | 24.94 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Net Seller |
| PG&E | BNNIEN_7_ALTAPH | 32376 | BONNIE N | 60 | 0.56 | | Sierra | Weimer, Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | BOGUE_1_UNITA1 | 32451 | FREC | 13.8 | 47.60 | 1 | Sierra | Bogue, Drum-Rio Oso, South of Table Mountain | Aug NQC | Market |
| PG&E | BOWMN_6_HYDRO | 32480 | BOWMAN | 9.11 | 1.57 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | BUCKCK_2_HYDRO | | | | 0.29 | | Sierra | South of Palermo, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | BUCKCK_7_OAKFLT | | | | 1.30 | | Sierra | South of Palermo, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | BUCKCK_7_PL1X2 | 31820 | BCKS CRK | 11 | 30.63 | 1 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | BUCKCK_7_PL1X2 | 31820 | BCKS CRK | 11 | 26.62 | 2 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | CAMPFW_7_FARWST | 32470 | CMP.FARW | 9.11 | 2.90 | 1 | Sierra | South of Table Mountain | Aug NQC | MUNI |
| PG&E | CHICPK_7_UNIT 1 | 32462 | CHI.PARK | 11.5 | 42.00 | 1 | Sierra | Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | COLGAT_7_UNIT 1 | 32450 | COLGATE1 | 13.8 | 161.65 | 1 | Sierra | South of Table Mountain | Aug NQC | MUNI |
| PG&E | COLGAT_7_UNIT 2 | 32452 | COLGATE2 | 13.8 | 161.68 | 1 | Sierra | South of Table Mountain | Aug NQC | MUNI |
| PG&E | CRESTA_7_PL1X2 | 31812 | CRESTA | 11.5 | 34.66 | 1 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | CRESTA_7_PL1X2 | 31812 | CRESTA | 11.5 | 35.34 | 2 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|-------|---|--------|-----------------------------------------------------------------------------------|---------------------|--------|
| PG&E | DAVIS_1_SOLAR1 | | | | 0.41 | | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | DAVIS_1_SOLAR2 | | | | 0.41 | | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | DAVIS_7_MNMETH | | | | 1.80 | | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | DEADCK_1_UNIT | 31862 | DEADWOOD | 9.11 | 0.00 | 1 | Sierra | Drum-Rio Oso, South of Table Mountain | Aug NQC | MUNI |
| PG&E | DEERCR_6_UNIT 1 | 32474 | DEER CRK | 9.11 | 7.00 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | DRUM_7_PL1X2 | 32504 | DRUM 1-2 | 6.6 | 13.00 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | DRUM_7_PL1X2 | 32504 | DRUM 1-2 | 6.6 | 13.00 | 2 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | DRUM_7_PL3X4 | 32506 | DRUM 3-4 | 6.6 | 13.26 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | DRUM_7_PL3X4 | 32506 | DRUM 3-4 | 6.6 | 15.64 | 2 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | DRUM_7_UNIT 5 | 32454 | DRUM 5 | 13.8 | 50.00 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | DUTCH1_7_UNIT 1 | 32464 | DTCHFLT1 | 11 | 22.00 | 1 | Sierra | Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | DUTCH2_7_UNIT 1 | 32502 | DTCHFLT2 | 6.9 | 26.00 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | ELDORO_7_UNIT 1 | 32513 | ELDRADO1 | 21.6 | 11.00 | 1 | Sierra | Placerville, South of Rio Oso, South of Palermo, South of Table Mountain | | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|-------|---|--------|-----------------------------------------------------------------------------------|-------------|------------|
| PG&E | ELDORO_7_UNIT 2 | 32514 | ELDRADO2 | 21.6 | 11.00 | 1 | Sierra | Placerville, South of Rio Oso, South of Palermo, South of Table Mountain | | Market |
| PG&E | FMEADO_6_HELLHL | 32486 | HELLHOLE | 9.11 | 0.32 | 1 | Sierra | South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | FMEADO_7_UNIT | 32508 | FRNCH MD | 4.2 | 16.00 | 1 | Sierra | South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | FORBST_7_UNIT 1 | 31814 | FORBSTWN | 11.5 | 37.50 | 1 | Sierra | Drum-Rio Oso, South of Table Mountain | Aug NQC | MUNI |
| PG&E | GOLDHL_1_QF | | | | 0.33 | | Sierra | Placerville, South of Rio Oso, South of Palermo, South of Table Mountain | Not modeled | QF/Selfgen |
| PG&E | GRIDLY_6_SOLAR | 38054 | GRIDLEY | 60 | 0.00 | 1 | Sierra | Pease, South of Table Mountain | Energy Only | Market |
| PG&E | GRNLF1_1_UNITS | 32490 | GRNLEAF1 | 13.8 | 33.36 | 1 | Sierra | Bogue, Drum-Rio Oso, South of Table Mountain | Aug NQC | Market |
| PG&E | GRNLF1_1_UNITS | 32491 | GRNLEAF1 | 13.8 | 15.84 | 2 | Sierra | Bogue, Drum-Rio Oso, South of Table Mountain | Aug NQC | Market |
| PG&E | GRNLF2_1_UNIT | 32492 | GRNLEAF2 | 13.8 | 36.45 | 1 | Sierra | Pease, Drum-Rio Oso, South of Table Mountain | Aug NQC | QF/Selfgen |
| PG&E | HALSEY_6_UNIT | 32478 | HALSEY F | 9.11 | 13.50 | 1 | Sierra | Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | HAYPRS_6_QFUNTS | 32488 | HAYPRES+ | 9.11 | 0.00 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | QF/Selfgen |
| PG&E | HAYPRS_6_QFUNTS | 32488 | HAYPRES+ | 9.11 | 0.00 | 2 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|------------------|-------|-----------|------|--------|---|--------|-----------------------------------------------------------------------------------|-------------------------|------------|
| PG&E | HIGGNS_1_COMBIE | | | | 0.00 | | Sierra | Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Not modeled Energy Only | Market |
| PG&E | HIGGNS_7_QFUNTS | | | | 0.23 | | Sierra | Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Not modeled Aug NQC | QF/Selfgen |
| PG&E | KANAKA_1_UNIT | | | | 0.00 | | Sierra | Drum-Rio Oso, South of Table Mountain | Not modeled Aug NQC | MUNI |
| PG&E | KELYRG_6_UNIT | 31834 | KELLYRDG | 9.11 | 11.00 | 1 | Sierra | Drum-Rio Oso, South of Table Mountain | Aug NQC | MUNI |
| PG&E | LIVEOK_6_SOLAR | | | | 0.51 | | Sierra | Pease, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | LODIEC_2_PL1X2 | 38124 | LODI ST1 | 18 | 95.82 | 1 | Sierra | South of Rio Oso, South of Palermo, South of Table Mountain | | MUNI |
| PG&E | LODIEC_2_PL1X2 | 38123 | LODI CT1 | 18 | 184.18 | 1 | Sierra | South of Rio Oso, South of Palermo, South of Table Mountain | | MUNI |
| PG&E | MDFKRL_2_PROJECT | 32456 | MIDLFORK | 13.8 | 63.94 | 1 | Sierra | South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | MDFKRL_2_PROJECT | 32458 | RALSTON | 13.8 | 82.13 | 1 | Sierra | South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | MDFKRL_2_PROJECT | 32456 | MIDLFORK | 13.8 | 63.94 | 2 | Sierra | South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | NAROW1_2_UNIT | 32466 | NARROWS1 | 9.1 | 12.00 | 1 | Sierra | South of Table Mountain | Aug NQC | Market |
| PG&E | NAROW2_2_UNIT | 32468 | NARROWS2 | 9.1 | 28.51 | 1 | Sierra | South of Table Mountain | Aug NQC | MUNI |
| PG&E | NWCSTL_7_UNIT 1 | 32460 | NEWCASTLE | 13.2 | 12.00 | 1 | Sierra | Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|-------|---|--------|---------------------------------------------------------------------------|---------------------|------------|
| PG&E | OROVIL_6_UNIT | 31888 | OROVILLE | 9.11 | 7.50 | 1 | Sierra | Drum-Rio Oso, South of Table Mountain | Aug NQC | Market |
| PG&E | OXBOW_6_DRUM | 32484 | OXBOW F | 9.11 | 6.00 | 1 | Sierra | Weimer, Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | PLACVL_1_CHILIB | 32510 | CHILIBAR | 4.2 | 0.00 | 1 | Sierra | Placerville, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | PLACVL_1_RCKCRE | | | | 2.18 | | Sierra | Placerville, South of Rio Oso, South of Palermo, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | PLSNTG_7_LNCLND | 32408 | PLSNT GR | 60 | 3.26 | | Sierra | Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | POEPH_7_UNIT 1 | 31790 | POE 1 | 13.8 | 60.00 | 1 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | POEPH_7_UNIT 2 | 31792 | POE 2 | 13.8 | 60.00 | 1 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | RCKCRK_7_UNIT 1 | 31786 | ROCK CK1 | 13.8 | 57.00 | 1 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | RCKCRK_7_UNIT 2 | 31788 | ROCK CK2 | 13.8 | 56.90 | 1 | Sierra | South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | RIOOSO_1_QF | | | | 0.93 | | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Not modeled Aug NQC | QF/Selfgen |
| PG&E | ROLLIN_6_UNIT | 32476 | ROLLINSF | 9.11 | 13.50 | 1 | Sierra | Weimer, Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | MUNI |
| PG&E | SLYCRK_1_UNIT 1 | 31832 | SLY.CR. | 9.11 | 13.00 | 1 | Sierra | Drum-Rio Oso, South of Table Mountain | Aug NQC | Market |
| PG&E | SPAULD_6_UNIT 3 | 32472 | SPAULDG | 9.11 | 6.50 | 3 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-----------------|-------|----------|------|-------|---|--------|-----------------------------------------------------------------------------------|---------------------|------------|
| PG&E | SPAULD_6_UNIT12 | 32472 | SPAULDG | 9.11 | 7.00 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | SPAULD_6_UNIT12 | 32472 | SPAULDG | 9.11 | 4.40 | 2 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | SPI LI_2_UNIT 1 | 32498 | SPILINCF | 12.5 | 12.99 | 1 | Sierra | Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Net Seller |
| PG&E | STIGCT_2_LODI | 38114 | Stig CC | 13.8 | 49.50 | 1 | Sierra | South of Rio Oso, South of Palermo, South of Table Mountain | | MUNI |
| PG&E | ULTRCK_2_UNIT | 32500 | ULTR RCK | 9.11 | 22.83 | 1 | Sierra | Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | WDLEAF_7_UNIT 1 | 31794 | WOODLEAF | 13.8 | 60.00 | 1 | Sierra | Drum-Rio Oso, South of Table Mountain | Aug NQC | MUNI |
| PG&E | WHEATL_6_LNDFIL | 32350 | WHEATLND | 60 | 3.20 | | Sierra | South of Table Mountain | Not modeled Aug NQC | Market |
| PG&E | WISE_1_UNIT 1 | 32512 | WISE | 12 | 14.50 | 1 | Sierra | Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | WISE_1_UNIT 2 | 32512 | WISE | 12 | 3.20 | 1 | Sierra | Placer, Drum-Rio Oso, South of Rio Oso, South of Palermo, South of Table Mountain | Aug NQC | Market |
| PG&E | YUBACT_1_SUNSWT | 32494 | YUBA CTY | 9.11 | 49.97 | 1 | Sierra | Pease, Drum-Rio Oso, South of Table Mountain | Aug NQC | Net Seller |
| PG&E | YUBACT_6_UNITA1 | 32496 | YCEC | 13.8 | 47.60 | 1 | Sierra | Pease, Drum-Rio Oso, South of Table Mountain | | Market |
| PG&E | ZZ_NA | 32162 | RIV.DLTA | 9.11 | 0.00 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | No NQC - hist. data | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|----------------------|--------|--------------|------|--------|----|----------|---------------------------------------------------------|-------------------------|------------|
| PG&E | ZZ_UCDAVS_1_UNIT | 32166 | UC DAVIS | 9.11 | 0.00 | RN | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | No NQC - hist. data | QF/Selfgen |
| PG&E | ZZZ_New Unit | 365510 | Q653F | 0.48 | 4.92 | 1 | Sierra | Drum-Rio Oso, South of Palermo, South of Table Mountain | No NQC - est. data | Market |
| PG&E | ZZZZZ_PACORO_6_U NIT | 31890 | PO POWER | 9.11 | 0.00 | 1 | Sierra | Drum-Rio Oso, South of Table Mountain | Retired | QF/Selfgen |
| PG&E | ZZZZZ_PACORO_6_U NIT | 31890 | PO POWER | 9.11 | 0.00 | 2 | Sierra | Drum-Rio Oso, South of Table Mountain | Retired | QF/Selfgen |
| PG&E | BEARDS_7_UNIT 1 | 34074 | BEARDSLY | 6.9 | 8.36 | 1 | Stockton | Tesla-Bellota, Stanislaus | Aug NQC | MUNI |
| PG&E | CAMCHE_1_PL1X3 | 33850 | CAMANCHE | 4.2 | 0.20 | 1 | Stockton | Tesla-Bellota | Aug NQC | MUNI |
| PG&E | CAMCHE_1_PL1X3 | 33850 | CAMANCHE | 4.2 | 0.20 | 2 | Stockton | Tesla-Bellota | Aug NQC | MUNI |
| PG&E | CAMCHE_1_PL1X3 | 33850 | CAMANCHE | 4.2 | 0.20 | 3 | Stockton | Tesla-Bellota | Aug NQC | MUNI |
| PG&E | COGNAT_1_UNIT | 33818 | STCKNBIOMASS | 13.8 | 42.33 | 1 | Stockton | Weber | Aug NQC | Net Seller |
| PG&E | CRWCKS_1_SOLAR1 | 34051 | Q539 | 34.5 | 0.00 | 1 | Stockton | Tesla-Bellota | Energy Only | Market |
| PG&E | DONNLS_7_UNIT | 34058 | DONNELLS | 13.8 | 72.00 | 1 | Stockton | Tesla-Bellota, Stanislaus | Aug NQC | MUNI |
| PG&E | FROGTN_1_UTICAA | | | | 0.49 | | Stockton | Tesla-Bellota, Stanislaus | Not Modeled Aug NQC | Market |
| PG&E | FROGTN_7_UTICA | | | | 0.00 | | Stockton | Tesla-Bellota, Stanislaus | Not modeled Energy Only | Market |
| PG&E | LOCKFD_1_BEARCK | | | | 0.62 | | Stockton | Tesla-Bellota | Not modeled Energy Only | Market |
| PG&E | LOCKFD_1_KSOLAR | | | | 0.41 | | Stockton | Tesla-Bellota | Not modeled Energy Only | Market |
| PG&E | LODI25_2_UNIT 1 | 38120 | LODI25CT | 9.11 | 23.80 | 1 | Stockton | Lockeford | | MUNI |
| PG&E | MANTEC_1_ML1SR1 | | | | 0.00 | | Stockton | Tesla-Bellota | Not modeled Energy Only | Market |
| PG&E | PEORIA_1_SOLAR | | | | 0.62 | | Stockton | Tesla-Bellota, Stanislaus | Not modeled Aug NQC | Market |
| PG&E | PHOENX_1_UNIT | | | | 0.90 | | Stockton | Tesla-Bellota, Stanislaus | Not modeled Aug NQC | Market |
| PG&E | SCHLTE_1_PL1X3 | 33805 | GWFTRCY1 | 13.8 | 88.55 | 1 | Stockton | Tesla-Bellota | | Market |
| PG&E | SCHLTE_1_PL1X3 | 33807 | GWFTRCY2 | 13.8 | 88.55 | 1 | Stockton | Tesla-Bellota | | Market |
| PG&E | SCHLTE_1_PL1X3 | 33811 | GWFTRCY3 | 13.8 | 142.70 | 1 | Stockton | Tesla-Bellota | | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|------|-------------------------|-------|-----------|------|-------|----|------------|---------------------------|---------------------|------------|
| PG&E | SMPRI1_1_SMPSON | 33810 | SP CMPNY | 13.8 | 46.05 | 1 | Stockton | Tesla-Bellota | Aug NQC | Market |
| PG&E | SNDBAR_7_UNIT 1 | 34060 | SANDBAR | 13.8 | 7.06 | 1 | Stockton | Tesla-Bellota, Stanislaus | Aug NQC | MUNI |
| PG&E | SPIFBD_1_PL1X2 | 34055 | SPISONORA | 13.8 | 2.32 | 1 | Stockton | Tesla-Bellota, Stanislaus | Aug NQC | Market |
| PG&E | SPRGAP_1_UNIT 1 | 34078 | SPRNG GP | 6 | 7.00 | 1 | Stockton | Tesla-Bellota, Stanislaus | Aug NQC | Market |
| PG&E | STANIS_7_UNIT 1 | 34062 | STANISLS | 13.8 | 91.00 | 1 | Stockton | Tesla-Bellota, Stanislaus | Aug NQC | Market |
| PG&E | STNRES_1_UNIT | 34056 | STNSLSRP | 13.8 | 19.27 | 1 | Stockton | Tesla-Bellota | Aug NQC | Net Seller |
| PG&E | THMENG_1_UNIT 1 | 33806 | TH.E.DV. | 13.8 | 4.89 | 1 | Stockton | Tesla-Bellota | Aug NQC | Net Seller |
| PG&E | TULLCK_7_UNITS | 34076 | TULLOCH | 6.9 | 4.79 | 1 | Stockton | Tesla-Bellota | Aug NQC | MUNI |
| PG&E | TULLCK_7_UNITS | 34076 | TULLOCH | 6.9 | 5.39 | 2 | Stockton | Tesla-Bellota | Aug NQC | MUNI |
| PG&E | TULLCK_7_UNITS | 34076 | TULLOCH | 6.9 | 3.54 | 3 | Stockton | Tesla-Bellota | Aug NQC | MUNI |
| PG&E | ULTPCH_1_UNIT 1 | 34050 | CH.STN. | 13.8 | 16.19 | 1 | Stockton | Tesla-Bellota, Stanislaus | Aug NQC | QF/Selfgen |
| PG&E | VLYHOM_7_SSJID | | | | 0.57 | | Stockton | Tesla-Bellota, Stanislaus | Not modeled Aug NQC | MUNI |
| PG&E | WEBER_6_FORWRD | | | | 4.20 | | Stockton | Weber | Not modeled Aug NQC | Market |
| PG&E | ZZ_NA | 33830 | GEN.MILL | 9.11 | 0.00 | 1 | Stockton | Lockeford | No NQC - hist. data | QF/Selfgen |
| PG&E | ZZ_NA | 33687 | STKTN WW | 60 | 1.50 | 1 | Stockton | Weber | No NQC - hist. data | QF/Selfgen |
| PG&E | ZZ_NA | 33821 | PAC_ETH | 12.5 | 0.00 | RN | Stockton | Weber | No NQC - hist. data | QF/Selfgen |
| PG&E | ZZZZZ_STOKCG_1_UNIT 1 | 33814 | INGREDION | 12.5 | 0.00 | RN | Stockton | Tesla-Bellota | Retired | QF/Selfgen |
| PG&E | ZZZZZZZ_SANJOA_1_UNIT 1 | 33808 | SJ COGEN | 13.8 | 0.00 | 1 | Stockton | Tesla-Bellota | Retired | QF/Selfgen |
| SCE | ACACIA_6_SOLAR | 29878 | ACACIA_G | 0.48 | 8.20 | EQ | BC/Ventura | Big Creek | Energy Only | Market |
| SCE | ALAMO_6_UNIT | 25653 | ALAMO SC | 13.8 | 15.07 | 1 | BC/Ventura | Big Creek | Aug NQC | MUNI |
| SCE | BIGCRK_2_EXESWD | 24323 | PORTAL | 4.8 | 9.45 | 1 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24306 | B CRK1-1 | 7.2 | 19.58 | 1 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24311 | B CRK3-1 | 13.8 | 34.44 | 1 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|----------|------|-------|----|------------|---------------------------|-------------------------|--------|
| SCE | BIGCRK_2_EXESWD | 24308 | B CRK2-1 | 13.8 | 49.99 | 1 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24317 | MAMOTH1G | 13.8 | 92.02 | 1 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24306 | B CRK1-1 | 7.2 | 21.26 | 2 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24311 | B CRK3-1 | 13.8 | 33.46 | 2 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24308 | B CRK2-1 | 13.8 | 51.18 | 2 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24318 | MAMOTH2G | 13.8 | 92.02 | 2 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24309 | B CRK2-2 | 7.2 | 18.40 | 3 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24307 | B CRK1-2 | 13.8 | 21.26 | 3 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24312 | B CRK3-2 | 13.8 | 34.44 | 3 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24309 | B CRK2-2 | 7.2 | 19.39 | 4 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24307 | B CRK1-2 | 13.8 | 30.71 | 4 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24312 | B CRK3-2 | 13.8 | 35.43 | 4 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24310 | B CRK2-3 | 7.2 | 16.73 | 5 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24313 | B CRK3-3 | 13.8 | 35.92 | 5 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24310 | B CRK2-3 | 7.2 | 18.21 | 6 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24314 | B CRK 4 | 11.5 | 49.60 | 41 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24314 | B CRK 4 | 11.5 | 49.80 | 42 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24315 | B CRK 8 | 13.8 | 24.01 | 81 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_2_EXESWD | 24315 | B CRK 8 | 13.8 | 43.30 | 82 | BC/Ventura | Big Creek, Rector, Vestal | Aug NQC | Market |
| SCE | BIGCRK_7_DAM7 | | | | 0.00 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Energy Only | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|-------------|------|--------|----|------------|---------------------------|-------------------------|--------|
| SCE | BIGCRK_7_MAMRES | | | | 0.00 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Energy Only | Market |
| SCE | BIGSKY_2_BSKSR6 | 29742 | BSKY G BC | 0.42 | 8.20 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_BSKSR7 | 29703 | BSKY G WABS | 0.42 | 8.20 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_BSKSR8 | 29724 | BSKY G ABSR | 0.38 | 8.20 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_SOLAR1 | 29727 | BSKY G SMR | 0.42 | 8.20 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_SOLAR2 | 29701 | BSKY_G_ESC | 0.42 | 34.02 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_SOLAR3 | 29745 | BSKY_G_BD | 0.42 | 8.20 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_SOLAR4 | 29736 | BSKY_G_BA | 0.42 | 17.07 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_SOLAR5 | 29739 | BSKY_G_BB | 0.42 | 2.05 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_SOLAR6 | 29730 | BSKY_G_SOLV | 0.42 | 34.85 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | BIGSKY_2_SOLAR7 | 29733 | BSKY_G_ADSR | 0.42 | 20.50 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | CEDUCR_2_SOLAR1 | 25049 | DUCOR1 | 0.39 | 0.00 | EQ | BC/Ventura | Big Creek, Vestal | Energy Only | Market |
| SCE | CEDUCR_2_SOLAR2 | 25052 | DUCOR2 | 0.39 | 0.00 | EQ | BC/Ventura | Big Creek, Vestal | Energy Only | Market |
| SCE | CEDUCR_2_SOLAR3 | 25055 | DUCOR3 | 0.39 | 0.00 | EQ | BC/Ventura | Big Creek, Vestal | Energy Only | Market |
| SCE | CEDUCR_2_SOLAR4 | 25058 | DUCOR4 | 0.39 | 0.00 | EQ | BC/Ventura | Big Creek, Vestal | Energy Only | Market |
| SCE | DELSUR_6_CREST | | | | 0.00 | | BC/Ventura | Big Creek | Energy Only | Market |
| SCE | DELSUR_6_DRYFRB | | | | 2.05 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |
| SCE | DELSUR_6_SOLAR1 | | | | 2.67 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |
| SCE | EASTWD_7_UNIT | 24319 | EASTWOOD | 13.8 | 199.00 | 1 | BC/Ventura | Big Creek, Rector, Vestal | | Market |
| SCE | EDMONS_2_NSPIN | 25605 | EDMON1AP | 14.4 | 16.86 | 1 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25606 | EDMON2AP | 14.4 | 16.86 | 2 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25607 | EDMON3AP | 14.4 | 16.86 | 3 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25607 | EDMON3AP | 14.4 | 16.86 | 4 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25608 | EDMON4AP | 14.4 | 16.86 | 5 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25608 | EDMON4AP | 14.4 | 16.86 | 6 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25609 | EDMON5AP | 14.4 | 16.86 | 7 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25609 | EDMON5AP | 14.4 | 16.86 | 8 | BC/Ventura | Big Creek | Pumps | MUNI |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|-----------|------|--------|----|------------|-------------------------------|-----------------------------------------------------------------|------------|
| SCE | EDMONS_2_NSPIN | 25610 | EDMON6AP | 14.4 | 16.86 | 9 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25610 | EDMON6AP | 14.4 | 16.86 | 10 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25611 | EDMON7AP | 14.4 | 16.85 | 11 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25611 | EDMON7AP | 14.4 | 16.85 | 12 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25612 | EDMON8AP | 14.4 | 16.85 | 13 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | EDMONS_2_NSPIN | 25612 | EDMON8AP | 14.4 | 16.85 | 14 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | GLDFGR_6_SOLAR1 | 25079 | PRIDE B G | 0.64 | 8.20 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | GLDFGR_6_SOLAR2 | 25169 | PRIDE C G | 0.64 | 4.67 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | GLOW_6_SOLAR | 29896 | APPINV | 0.42 | 0.00 | EQ | BC/Ventura | Big Creek | Energy Only | Market |
| SCE | GOLETA_2_QF | 24057 | GOLETA | 66 | 0.05 | | BC/Ventura | Ventura, S.Clara, Moorpark | Not modeled Aug NQC | QF/Selfgen |
| SCE | GOLETA_6_ELLWOD | 29004 | ELLWOOD | 13.8 | 0.00 | 1 | BC/Ventura | Ventura, S.Clara, Moorpark | Retirement requested effective date January 1, 2019 | Market |
| SCE | GOLETA_6_EXGEN | 24362 | EXGEN2 | 13.8 | 4.10 | G1 | BC/Ventura | Ventura, S.Clara, Moorpark | Aug NQC - Currently out of service | QF/Selfgen |
| SCE | GOLETA_6_EXGEN | 24326 | EXGEN1 | 13.8 | 2.83 | S1 | BC/Ventura | Ventura, S.Clara, Moorpark | Aug NQC - Currently out of service | QF/Selfgen |
| SCE | GOLETA_6_GAVOTA | 24057 | GOLETA | 66 | 0.26 | | BC/Ventura | Ventura, S.Clara, Moorpark | Not modeled Aug NQC | Market |
| SCE | GOLETA_6_TAJIGS | 24057 | GOLETA | 66 | 2.84 | | BC/Ventura | Ventura, S.Clara, Moorpark | Not modeled Aug NQC | Market |
| SCE | LEBECS_2_UNITS | 29051 | PSTRIAG1 | 18 | 165.58 | G1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | LEBECS_2_UNITS | 29052 | PSTRIAG2 | 18 | 165.58 | G2 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | LEBECS_2_UNITS | 29054 | PSTRIAG3 | 18 | 165.58 | G3 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | LEBECS_2_UNITS | 29053 | PSTRIAS1 | 18 | 170.45 | S1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | LEBECS_2_UNITS | 29055 | PSTRIAS2 | 18 | 82.79 | S2 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | LITLRK_6_SEPV01 | | | | 0.00 | | BC/Ventura | Big Creek | Not modeled Energy Only | Market |
| SCE | LITLRK_6_SOLAR1 | | | | 2.05 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |
| SCE | LITLRK_6_SOLAR2 | | | | 0.82 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|-----------|------|-------|----|------------|-------------------------------|-----------------------------------------------------------------|------------|
| SCE | LITLRK_6_SOLAR4 | | | | 1.23 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |
| SCE | LNCSTR_6_CREST | | | | 0.00 | | BC/Ventura | Big Creek | Not modeled Energy Only | Market |
| SCE | MNDALY_6_MCGRTH | 29306 | MCGPKGEN | 13.8 | 47.20 | 1 | BC/Ventura | Ventura, S.Clara, Moorpark | | Market |
| SCE | MOORPK_2_CALABS | 25081 | WDT251 | 13.8 | 5.40 | EQ | BC/Ventura | Ventura, Moorpark | Aug NQC | Market |
| SCE | MOORPK_6_QF | 29952 | CAMGEN | 13.8 | 26.42 | D1 | BC/Ventura | Ventura, S.Clara, Moorpark | Aug NQC | Market |
| SCE | MOORPK_7_UNITA1 | 24098 | MOORPARK | 66 | 2.12 | | BC/Ventura | Ventura, Moorpark | Not modeled Aug NQC | Market |
| SCE | NEENCH_6_SOLAR | 29900 | ALPINE_G | 0.48 | 27.06 | EQ | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | OASIS_6_CREST | | | | 0.00 | | BC/Ventura | Big Creek | Not modeled Energy Only | Market |
| SCE | OASIS_6_SOLAR1 | 25095 | SOLARISG2 | 0.2 | 0.00 | EQ | BC/Ventura | Big Creek | Not modeled Energy Only | Market |
| SCE | OASIS_6_SOLAR2 | 25075 | SOLARISG | 0.2 | 8.20 | EQ | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | OASIS_6_SOLAR3 | | | | 0.00 | | BC/Ventura | Big Creek | Not modeled Energy Only | Market |
| SCE | OMAR_2_UNIT 1 | 24102 | OMAR 1G | 13.8 | 72.80 | 1 | BC/Ventura | Big Creek | | Net Seller |
| SCE | OMAR_2_UNIT 2 | 24103 | OMAR 2G | 13.8 | 74.00 | 2 | BC/Ventura | Big Creek | | Net Seller |
| SCE | OMAR_2_UNIT 3 | 24104 | OMAR 3G | 13.8 | 75.90 | 3 | BC/Ventura | Big Creek | | Net Seller |
| SCE | OMAR_2_UNIT 4 | 24105 | OMAR 4G | 13.8 | 81.44 | 4 | BC/Ventura | Big Creek | | Net Seller |
| SCE | ORMOND_7_UNIT 1 | 24107 | ORMOND1G | 26 | 0.00 | 1 | BC/Ventura | Ventura, Moorpark | Retirement requested effective date October 1, 2018 | Market |
| SCE | ORMOND_7_UNIT 2 | 24108 | ORMOND2G | 26 | 0.00 | 2 | BC/Ventura | Ventura, Moorpark | Retirement requested effective date October 1, 2018 | Market |
| SCE | OSO_6_NSPIN | 25614 | OSO A P | 13.2 | 2.25 | 1 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | OSO_6_NSPIN | 25614 | OSO A P | 13.2 | 2.25 | 2 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | OSO_6_NSPIN | 25614 | OSO A P | 13.2 | 2.25 | 3 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | OSO_6_NSPIN | 25614 | OSO A P | 13.2 | 2.25 | 4 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | OSO_6_NSPIN | 25615 | OSO B P | 13.2 | 2.25 | 5 | BC/Ventura | Big Creek | Pumps | MUNI |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|--------------|------|-------|----|------------|------------------------------|----------------------------|------------|
| SCE | OSO_6_NSPIN | 25615 | OSO B P | 13.2 | 2.25 | 6 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | OSO_6_NSPIN | 25615 | OSO B P | 13.2 | 2.25 | 7 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | OSO_6_NSPIN | 25615 | OSO B P | 13.2 | 2.25 | 8 | BC/Ventura | Big Creek | Pumps | MUNI |
| SCE | PANDOL_6_UNIT | 24113 | PANDOL | 13.8 | 23.32 | 1 | BC/Ventura | Big Creek, Vestal | Aug NQC | Market |
| SCE | PANDOL_6_UNIT | 24113 | PANDOL | 13.8 | 23.32 | 2 | BC/Ventura | Big Creek, Vestal | Aug NQC | Market |
| SCE | PLAINV_6_BSOLAR | 29917 | SSOLAR)GRWKS | 0.8 | 0.00 | 1 | BC/Ventura | Big Creek | Energy Only | Market |
| SCE | PLAINV_6_DSOLAR | 29914 | WADR_PV | 0.42 | 4.10 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | PLAINV_6_NLRSR1 | 29921 | NLR_INVTR | 0.42 | 0.00 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | PLAINV_6_SOLAR3 | 25089 | CNTRL ANT G | 0.42 | 0.00 | 1 | BC/Ventura | Big Creek | Energy Only | Market |
| SCE | PLAINV_6_SOLARC | 25086 | SIRA SOLAR G | 0.8 | 0.00 | 1 | BC/Ventura | Big Creek | Energy Only | Market |
| SCE | PMDLET_6_SOLAR1 | | | | 4.10 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |
| SCE | RECTOR_2_CREST | 24212 | RECTOR | 66 | 0.00 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Aug NQC | Market |
| SCE | RECTOR_2_KAWEAH | 24212 | RECTOR | 66 | 0.03 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Aug NQC | Market |
| SCE | RECTOR_2_KAWH 1 | 24212 | RECTOR | 66 | 0.19 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Aug NQC | Market |
| SCE | RECTOR_2_QF | 24212 | RECTOR | 66 | 0.07 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Aug NQC | QF/Selfgen |
| SCE | RECTOR_7_TULARE | 24212 | RECTOR | 66 | 0.00 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled | Market |
| SCE | REDMAN_2_SOLAR | | | | 1.54 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |
| SCE | ROSMND_6_SOLAR | | | | 1.23 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |
| SCE | RSMSLR_6_SOLAR1 | 29984 | DAWNGEN | 0.8 | 8.20 | EQ | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | RSMSLR_6_SOLAR2 | 29888 | TWILGHTG | 0.8 | 8.20 | EQ | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | SAUGUS_2_TOLAND | 24135 | SAUGUS | 66 | 0.00 | | BC/Ventura | Big Creek | Not modeled Energy Only | Market |
| SCE | SAUGUS_6_MWDFTH | 24135 | SAUGUS | 66 | 7.40 | | BC/Ventura | Big Creek | Not modeled Aug NQC | MUNI |
| SCE | SAUGUS_6_PTCHGN | 24118 | PITCHGEN | 13.8 | 19.91 | D1 | BC/Ventura | Big Creek | Aug NQC | MUNI |
| SCE | SAUGUS_6_QF | 24135 | SAUGUS | 66 | 0.62 | | BC/Ventura | Big Creek | Not modeled Aug NQC | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|----------|------|-------|----|------------|----------------------------|-------------------------|------------|
| SCE | SAUGUS_7_CHIQCN | 24135 | SAUGUS | 66 | 5.61 | | BC/Ventura | Big Creek | Not modeled Aug NQC | Market |
| SCE | SAUGUS_7_LOPEZ | 24135 | SAUGUS | 66 | 5.34 | | BC/Ventura | Big Creek | Not modeled Aug NQC | QF/Selfgen |
| SCE | SHUTLE_6_CREST | | | | 0.00 | | BC/Ventura | Big Creek | Not modeled Energy Only | Market |
| SCE | SNCLRA_2_HOWLNG | 25080 | GFID8045 | 13.8 | 7.63 | EQ | BC/Ventura | Ventura, S.Clara, Moorpark | Aug NQC | Market |
| SCE | SNCLRA_2_SPRHYD | | | | 0.38 | | BC/Ventura | Ventura, S.Clara, Moorpark | Not modeled Aug NQC | Market |
| SCE | SNCLRA_2_UNIT1 | 24159 | WILLAMET | 3.8 | 19.03 | D1 | BC/Ventura | Ventura, S.Clara, Moorpark | Aug NQC | Market |
| SCE | SNCLRA_6_OXGEN | 24110 | OXGEN | 13.8 | 34.10 | D1 | BC/Ventura | Ventura, S.Clara, Moorpark | Aug NQC | QF/Selfgen |
| SCE | SNCLRA_6_PROCGN | 24119 | PROCGEN | 13.8 | 45.74 | D1 | BC/Ventura | Ventura, S.Clara, Moorpark | Aug NQC | Market |
| SCE | SNCLRA_6_QF | | | | 0.00 | | BC/Ventura | Ventura, S.Clara, Moorpark | Not modeled Aug NQC | QF/Selfgen |
| SCE | SPRGVL_2_CREST | 24215 | SPRINGVL | 66 | 0.00 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Energy Only | Market |
| SCE | SPRGVL_2_QF | 24215 | SPRINGVL | 66 | 0.12 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Aug NQC | QF/Selfgen |
| SCE | SPRGVL_2_TULE | 24215 | SPRINGVL | 66 | 0.00 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Aug NQC | Market |
| SCE | SPRGVL_2_TULESC | 24215 | SPRINGVL | 66 | 0.03 | | BC/Ventura | Big Creek, Rector, Vestal | Not modeled Aug NQC | Market |
| SCE | SUNSHN_2_LNDFL | 29954 | WDT273 | 13.7 | 3.33 | 1 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | SUNSHN_2_LNDFL | 29954 | WDT273 | 13.7 | 3.33 | 2 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | SUNSHN_2_LNDFL | 29954 | WDT273 | 13.7 | 3.33 | 3 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | SUNSHN_2_LNDFL | 29954 | WDT273 | 13.7 | 3.33 | 4 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | SUNSHN_2_LNDFL | 29954 | WDT273 | 13.7 | 3.33 | 5 | BC/Ventura | Big Creek | Aug NQC | Market |
| SCE | SYCAMR_2_UNIT 1 | 24143 | SYCCYN1G | 13.8 | 85.00 | 1 | BC/Ventura | Big Creek | Aug NQC | Net Seller |
| SCE | SYCAMR_2_UNIT 2 | 24144 | SYCCYN2G | 13.8 | 85.00 | 2 | BC/Ventura | Big Creek | Aug NQC | Net Seller |
| SCE | SYCAMR_2_UNIT 3 | 24145 | SYCCYN3G | 13.8 | 85.00 | 3 | BC/Ventura | Big Creek | Aug NQC | Net Seller |
| SCE | SYCAMR_2_UNIT 4 | 24146 | SYCCYN4G | 13.8 | 85.00 | 4 | BC/Ventura | Big Creek | Aug NQC | Net Seller |
| SCE | TENGEN_2_PL1X2 | 24148 | TENNGEN1 | 13.8 | 18.57 | D1 | BC/Ventura | Big Creek | Aug NQC | Net Seller |
| SCE | TENGEN_2_PL1X2 | 24149 | TENNGEN2 | 13.8 | 18.57 | D2 | BC/Ventura | Big Creek | Aug NQC | Net Seller |
| SCE | VESTAL_2_KERN | 24372 | KR 3-1 | 11 | 0.24 | 1 | BC/Ventura | Big Creek, Vestal | Aug NQC | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|---------------------------|-------|------------|------|-------|---|------------|-------------------------------|----------------------------|------------|
| SCE | VESTAL_2_KERN | 24373 | KR 3-2 | 11 | 0.23 | 2 | BC/Ventura | Big Creek, Vestal | Aug NQC | QF/Selfgen |
| SCE | VESTAL_2_RTS042 | | | | 0.00 | | BC/Ventura | Big Creek, Vestal | Not modeled Energy Only | Market |
| SCE | VESTAL_2_SOLAR1 | 25066 | TULRESLR | 0.39 | 8.20 | 1 | BC/Ventura | Big Creek, Vestal | Aug NQC | Market |
| SCE | VESTAL_2_SOLAR2 | 25067 | TULRESLR | 0.39 | 1.78 | 1 | BC/Ventura | Big Creek, Vestal | Aug NQC | Market |
| SCE | VESTAL_2_SOLAR2 | 25068 | TULRESLR | 0.36 | 3.96 | 1 | BC/Ventura | Big Creek, Vestal | Aug NQC | Market |
| SCE | VESTAL_2_UNIT1 | | | | 4.39 | | BC/Ventura | Big Creek, Vestal | Not modeled Aug NQC | Market |
| SCE | VESTAL_2_WELLHD | 24116 | WELLGEN | 13.8 | 49.00 | 1 | BC/Ventura | Big Creek, Vestal | | Market |
| SCE | VESTAL_6_QF | 29008 | LAKEGEN | 13.8 | 1.04 | 1 | BC/Ventura | Big Creek, Vestal | Aug NQC | QF/Selfgen |
| SCE | WARNE_2_UNIT | 25651 | WARNE1 | 13.8 | 38.00 | 1 | BC/Ventura | Big Creek | Aug NQC | MUNI |
| SCE | WARNE_2_UNIT | 25652 | WARNE2 | 13.8 | 38.00 | 2 | BC/Ventura | Big Creek | Aug NQC | MUNI |
| SCE | ZZ_NA | 24370 | KAWGEN | 13.8 | 0.00 | 1 | BC/Ventura | Big Creek, Rector, Vestal | No NQC - hist. data | Market |
| SCE | ZZ_NA | 24422 | PALMDALE | 66 | 0.00 | 1 | BC/Ventura | Big Creek | No NQC - hist. data | Market |
| SCE | ZZ_NA | 24340 | CHARMIN | 13.8 | 2.80 | 1 | BC/Ventura | Ventura, S.Clara, Moorpark | No NQC - hist. data | QF/Selfgen |
| SCE | ZZ_VESTAL_6_ULTRG N | 24150 | ULTRAGEN | 13.8 | 0.00 | 1 | BC/Ventura | Big Creek, Vestal | Aug NQC | QF/Selfgen |
| SCE | ZZZ_New Unit | 25171 | PRIDE A G | 0.64 | 4.10 | 1 | BC/Ventura | Big Creek | No NQC - est. data | Market |
| SCE | ZZZ_New Unit | 25170 | PRIDE A G2 | 0.64 | 4.10 | 1 | BC/Ventura | Big Creek | No NQC - est. data | Market |
| SCE | ZZZZZ_APPGEN_6_U NIT 1 | 24009 | APPGEN1G | 13.8 | 0.00 | 1 | BC/Ventura | Big Creek | Retired | Market |
| SCE | ZZZZZ_APPGEN_6_U NIT 1 | 24010 | APPGEN2G | 13.8 | 0.00 | 2 | BC/Ventura | Big Creek | Retired | Market |
| SCE | ZZZZZ_APPGEN_6_U NIT 1 | 24361 | APPGEN3G | 13.8 | 0.00 | 3 | BC/Ventura | Big Creek | Retired | Market |
| SCE | ZZZZZ_MNDALY_7_U NIT 1 | 24089 | MANDLY1G | 13.8 | 0.00 | 1 | BC/Ventura | Ventura, S.Clara, Moorpark | Retired | Market |
| SCE | ZZZZZ_MNDALY_7_U NIT 2 | 24090 | MANDLY2G | 13.8 | 0.00 | 2 | BC/Ventura | Ventura, S.Clara, Moorpark | Retired | Market |
| SCE | ZZZZZ_MNDALY_7_U NIT 3 | 24222 | MANDLY3G | 16 | 0.00 | 3 | BC/Ventura | Ventura, S.Clara, Moorpark | Retired | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|--------------------------|-------|------------|------|-------|----|------------|-------------------------------|-----------------------------------|------------|
| SCE | ZZZZ_SNCLRA_6_WI LLMT | 24159 | WILLAMET | 13.8 | 0.00 | D1 | BC/Ventura | Ventura, S.Clara, Moorpark | Replaced by SNCLRA_2_ UNIT1 | QF/Selfgen |
| SCE | ALAMIT_7_UNIT 1 | 24001 | ALAMT1 G | 18 | 0.00 | 1 | LA Basin | Western | Retired by 2021 | Market |
| SCE | ALAMIT_7_UNIT 2 | 24002 | ALAMT2 G | 18 | 0.00 | 2 | LA Basin | Western | Retired by 2021 | Market |
| SCE | ALAMIT_7_UNIT 3 | 24003 | ALAMT3 G | 18 | 0.00 | 3 | LA Basin | Western | Retired by 2021 | Market |
| SCE | ALAMIT_7_UNIT 4 | 24004 | ALAMT4 G | 18 | 0.00 | 4 | LA Basin | Western | Retired by 2021 | Market |
| SCE | ALAMIT_7_UNIT 5 | 24005 | ALAMT5 G | 20 | 0.00 | 5 | LA Basin | Western | Retired by 2021 | Market |
| SCE | ALAMIT_7_UNIT 6 | 24161 | ALAMT6 G | 20 | 0.00 | 6 | LA Basin | Western | Retired by 2021 | Market |
| SCE | ALTWD_1_QF | 25635 | ALTWIND | 115 | 6.23 | Q1 | LA Basin | Eastern, Valley- Devers | Aug NQC | QF/Selfgen |
| SCE | ALTWD_1_QF | 25635 | ALTWIND | 115 | 6.23 | Q2 | LA Basin | Eastern, Valley- Devers | Aug NQC | QF/Selfgen |
| SCE | ANAHM_2_CANYN1 | 25211 | CanyonGT 1 | 13.8 | 49.40 | 1 | LA Basin | Western | | MUNI |
| SCE | ANAHM_2_CANYN2 | 25212 | CanyonGT 2 | 13.8 | 48.00 | 2 | LA Basin | Western | | MUNI |
| SCE | ANAHM_2_CANYN3 | 25213 | CanyonGT 3 | 13.8 | 48.00 | 3 | LA Basin | Western | | MUNI |
| SCE | ANAHM_2_CANYN4 | 25214 | CanyonGT 4 | 13.8 | 49.40 | 4 | LA Basin | Western | | MUNI |
| SCE | ANAHM_7_CT | 25208 | DowlingCTG | 13.8 | 40.64 | 1 | LA Basin | Western | Aug NQC | MUNI |
| SCE | ARCOGN_2_UNITS | 24011 | ARCO 1G | 13.8 | 57.40 | 1 | LA Basin | Western | Aug NQC | Net Seller |
| SCE | ARCOGN_2_UNITS | 24012 | ARCO 2G | 13.8 | 57.40 | 2 | LA Basin | Western | Aug NQC | Net Seller |
| SCE | ARCOGN_2_UNITS | 24013 | ARCO 3G | 13.8 | 57.40 | 3 | LA Basin | Western | Aug NQC | Net Seller |
| SCE | ARCOGN_2_UNITS | 24014 | ARCO 4G | 13.8 | 57.40 | 4 | LA Basin | Western | Aug NQC | Net Seller |
| SCE | ARCOGN_2_UNITS | 24163 | ARCO 5G | 13.8 | 28.70 | 5 | LA Basin | Western | Aug NQC | Net Seller |
| SCE | ARCOGN_2_UNITS | 24164 | ARCO 6G | 13.8 | 28.70 | 6 | LA Basin | Western | Aug NQC | Net Seller |
| SCE | BARRE_2_QF | 24016 | BARRE | 230 | 0.00 | | LA Basin | Western | Not modeled | QF/Selfgen |
| SCE | BARRE_6_PEAKER | 29309 | BARPKGEN | 13.8 | 47.00 | 1 | LA Basin | Western | | Market |
| SCE | BLAST_1_WIND | 24839 | BLAST | 115 | 12.99 | 1 | LA Basin | Eastern, Valley- Devers | Aug NQC | Wind |
| SCE | BUCKWD_1_NPALM1 | 25634 | BUCKWIND | 115 | 0.98 | | LA Basin | Eastern, Valley- Devers | Not modeled Aug NQC | Wind |
| SCE | BUCKWD_1_QF | 25634 | BUCKWIND | 115 | 4.37 | QF | LA Basin | Eastern, Valley- Devers | Aug NQC | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|----------|------|-------|----|----------|------------------------|-------------------------|------------|
| SCE | BUCKWD_7_WINTCV | 25634 | BUCKWIND | 115 | 0.35 | W5 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | CABZON_1_WINDA1 | 29290 | CABAZON | 33 | 10.87 | 1 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | CAPWD_1_QF | 25633 | CAPWIND | 115 | 5.18 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | QF/Selfgen |
| SCE | CENTER_2_QF | 29953 | SIGGEN | 13.8 | 18.20 | D1 | LA Basin | Western | Aug NQC | QF/Selfgen |
| SCE | CENTER_2_RHONDO | 24203 | CENTER S | 66 | 1.91 | | LA Basin | Western | Not modeled | QF/Selfgen |
| SCE | CENTER_2_SOLAR1 | | | | 0.00 | | LA Basin | Western | Not modeled Energy Only | Market |
| SCE | CENTER_6_PEAKER | 29308 | CTRPKGEN | 13.8 | 47.00 | 1 | LA Basin | Western | | Market |
| SCE | CENTRY_6_PL1X4 | 25302 | CLTNCTRY | 13.8 | 36.00 | 1 | LA Basin | Eastern, Eastern Metro | Aug NQC | MUNI |
| SCE | CHEVMN_2_UNITS | 24022 | CHEVGEN1 | 13.8 | 5.50 | 1 | LA Basin | Western, El Nido | Aug NQC | Net Seller |
| SCE | CHEVMN_2_UNITS | 24023 | CHEVGEN2 | 13.8 | 5.50 | 2 | LA Basin | Western, El Nido | Aug NQC | Net Seller |
| SCE | CHINO_2_APEBT1 | | | | 20.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | CHINO_2_JURUPA | | | | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | CHINO_2_QF | | | | 0.47 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | CHINO_2_SASOLR | | | | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | CHINO_2_SOLAR | | | | 0.41 | | LA Basin | Eastern, Eastern Metro | Not modeled | Market |
| SCE | CHINO_2_SOLAR2 | | | | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | CHINO_6_CIMGEN | 24026 | CIMGEN | 13.8 | 25.96 | D1 | LA Basin | Eastern, Eastern Metro | Aug NQC | QF/Selfgen |
| SCE | CHINO_6_SMPPAP | 24140 | SIMPSON | 13.8 | 22.78 | D1 | LA Basin | Eastern, Eastern Metro | Aug NQC | QF/Selfgen |
| SCE | CHINO_7_MILIKN | 24024 | CHINO | 66 | 1.19 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | COLTON_6_AGUAM1 | 25303 | CLTNAGUA | 13.8 | 43.00 | 1 | LA Basin | Eastern, Eastern Metro | Aug NQC | MUNI |
| SCE | CORONS_2_SOLAR | | | | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | CORONS_6_CLRWTR | 29338 | CLRWTRCT | 13.8 | 20.72 | G1 | LA Basin | Eastern, Eastern Metro | | MUNI |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|----------|------|-------|----|----------|------------------------|-------------------------|------------|
| SCE | CORONS_6_CLRWTR | 29340 | CLRWTRST | 13.8 | 7.28 | S1 | LA Basin | Eastern, Eastern Metro | | MUNI |
| SCE | DELAMO_2_SOLAR1 | | | | 0.62 | | LA Basin | Western | Not modeled Aug NQC | Market |
| SCE | DELAMO_2_SOLAR2 | | | | 0.72 | | LA Basin | Western | Not modeled Aug NQC | Market |
| SCE | DELAMO_2_SOLAR3 | | | | 0.51 | | LA Basin | Western | Not modeled Aug NQC | Market |
| SCE | DELAMO_2_SOLAR4 | | | | 0.53 | | LA Basin | Western | Not modeled Aug NQC | Market |
| SCE | DELAMO_2_SOLAR5 | | | | 0.41 | | LA Basin | Western | Not modeled Aug NQC | Market |
| SCE | DELAMO_2_SOLAR6 | | | | 0.82 | | LA Basin | Western | Not modeled Aug NQC | Market |
| SCE | DELAMO_2_SOLRC1 | | | | 0.00 | | LA Basin | Western | Not modeled Energy Only | Market |
| SCE | DELAMO_2_SOLRD | | | | 0.00 | | LA Basin | Western | Not modeled Energy Only | Market |
| SCE | DEVERS_1_QF | 25632 | TERAWND | 115 | 8.63 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | QF/Selfgen |
| SCE | DEVERS_1_QF | 25639 | SEAWIND | 115 | 10.35 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | QF/Selfgen |
| SCE | DEVERS_1_SEPV05 | | | | 0.00 | | LA Basin | Eastern, Valley-Devers | Not modeled Energy Only | Market |
| SCE | DEVERS_1_SOLAR | | | | 0.00 | | LA Basin | Eastern, Valley-Devers | Not modeled Energy Only | Market |
| SCE | DEVERS_1_SOLAR1 | | | | 0.00 | | LA Basin | Eastern, Valley-Devers | Not modeled Energy Only | Market |
| SCE | DEVERS_1_SOLAR2 | | | | 0.00 | | LA Basin | Eastern, Valley-Devers | Not modeled Energy Only | Market |
| SCE | DEVERS_2_DHSPG2 | | | | 0.00 | | LA Basin | Eastern, Valley-Devers | Not modeled Energy Only | Market |
| SCE | DMDVLY_1_UNITS | 25425 | ESRP P2 | 6.9 | 0.00 | 8 | LA Basin | Eastern, Eastern Metro | Aug NQC | QF/Selfgen |
| SCE | DREWS_6_PL1X4 | 25301 | CLTNDREW | 13.8 | 36.00 | 1 | LA Basin | Eastern, Eastern Metro | Aug NQC | MUNI |
| SCE | DVLCYN_1_UNITS | 25648 | DVLCYN1G | 13.8 | 50.35 | 1 | LA Basin | Eastern, Eastern Metro | Aug NQC | MUNI |
| SCE | DVLCYN_1_UNITS | 25649 | DVLCYN2G | 13.8 | 50.35 | 2 | LA Basin | Eastern, Eastern Metro | Aug NQC | MUNI |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|----------|------|--------|---|----------|------------------------|-------------------------|------------|
| SCE | DVLCYN_1_UNITS | 25603 | DVLCYN3G | 13.8 | 67.13 | 3 | LA Basin | Eastern, Eastern Metro | Aug NQC | MUNI |
| SCE | DVLCYN_1_UNITS | 25604 | DVLCYN4G | 13.8 | 67.13 | 4 | LA Basin | Eastern, Eastern Metro | Aug NQC | MUNI |
| SCE | ELLIS_2_QF | 24325 | ORCOGEN | 13.8 | 0.03 | 1 | LA Basin | Western | Aug NQC | QF/Selfgen |
| SCE | ELSEGN_2_UN1011 | 29904 | ELSEG5GT | 16.5 | 131.50 | 5 | LA Basin | Western, El Nido | Aug NQC | Market |
| SCE | ELSEGN_2_UN1011 | 29903 | ELSEG6ST | 13.8 | 131.50 | 6 | LA Basin | Western, El Nido | Aug NQC | Market |
| SCE | ELSEGN_2_UN2021 | 29902 | ELSEG7GT | 16.5 | 131.84 | 7 | LA Basin | Western, El Nido | Aug NQC | Market |
| SCE | ELSEGN_2_UN2021 | 29901 | ELSEG8ST | 13.8 | 131.84 | 8 | LA Basin | Western, El Nido | Aug NQC | Market |
| SCE | ETIWND_2_CHMPNE | | | | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | ETIWND_2_FONTNA | 24055 | ETIWANDA | 66 | 0.11 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | ETIWND_2_RTS010 | 24055 | ETIWANDA | 66 | 0.62 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | ETIWND_2_RTS015 | 24055 | ETIWANDA | 66 | 1.23 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | ETIWND_2_RTS017 | 24055 | ETIWANDA | 66 | 1.44 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | ETIWND_2_RTS018 | 24055 | ETIWANDA | 66 | 0.62 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | ETIWND_2_RTS023 | 24055 | ETIWANDA | 66 | 1.03 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | ETIWND_2_RTS026 | 24055 | ETIWANDA | 66 | 2.46 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | ETIWND_2_RTS027 | 24055 | ETIWANDA | 66 | 0.82 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | ETIWND_2_SOLAR1 | | | | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | ETIWND_2_SOLAR2 | | | | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | ETIWND_2_SOLAR5 | | | | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | ETIWND_2_UNIT1 | 24071 | INLAND | 13.8 | 23.36 | 1 | LA Basin | Eastern, Eastern Metro | Aug NQC | QF/Selfgen |
| SCE | ETIWND_6_GRPLND | 29305 | ETWPKGEN | 13.8 | 46.00 | 1 | LA Basin | Eastern, Eastern Metro | | Market |
| SCE | ETIWND_6_MWDETI | 25422 | ETI MWDG | 13.8 | 2.80 | 1 | LA Basin | Eastern, Eastern Metro | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|------------------|-------|-------------|------|-------|----|----------|------------------------|--------------------------------------------------|------------|
| SCE | ETIWND_7_MIDVLY | 24055 | ETIWANDA | 66 | 1.67 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | ETIWND_7_UNIT 3 | 24052 | MTNVIST3 | 18 | 0.00 | 3 | LA Basin | Eastern, Eastern Metro | Retirement requested effective date June 1, 2018 | Market |
| SCE | ETIWND_7_UNIT 4 | 24053 | MTNVIST4 | 18 | 0.00 | 4 | LA Basin | Eastern, Eastern Metro | Retirement requested effective date June 1, 2018 | Market |
| SCE | GARNET_1_SOLAR | 24815 | GARNET | 115 | 0.00 | | LA Basin | Eastern, Valley-Devers | Not modeled Energy Only | Market |
| SCE | GARNET_1_SOLAR2 | 24815 | GARNET | 115 | 1.64 | | LA Basin | Eastern, Valley-Devers | Not modeled Aug NQC | Market |
| SCE | GARNET_1_UNITS | 24815 | GARNET | 115 | 2.06 | G1 | LA Basin | Eastern, Valley-Devers | Aug NQC | Market |
| SCE | GARNET_1_UNITS | 24815 | GARNET | 115 | 0.71 | G2 | LA Basin | Eastern, Valley-Devers | Aug NQC | Market |
| SCE | GARNET_1_UNITS | 24815 | GARNET | 115 | 1.61 | G3 | LA Basin | Eastern, Valley-Devers | Aug NQC | Market |
| SCE | GARNET_1_WIND | 24815 | GARNET | 115 | 1.72 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | GARNET_1_WINDS | 24815 | GARNET | 115 | 5.96 | W2 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | GARNET_1_WT3WIND | 24815 | GARNET | 115 | 0.00 | W3 | LA Basin | Eastern, Valley-Devers | Aug NQC | Market |
| SCE | GARNET_2_HYDRO | 24815 | GARNET | 115 | 0.54 | | LA Basin | Eastern, Valley-Devers | Not modeled Aug NQC | Market |
| SCE | GARNET_2_WIND1 | 24815 | GARNET | 115 | 2.97 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | GARNET_2_WIND2 | 24815 | GARNET | 115 | 3.10 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | GARNET_2_WIND3 | 24815 | GARNET | 115 | 3.34 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | GARNET_2_WIND4 | 24815 | GARNET | 115 | 2.60 | QF | LA Basin | Eastern, Valley-Devers | Not modeled Aug NQC | Wind |
| SCE | GARNET_2_WIND5 | 24815 | GARNET | 115 | 0.80 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | GLNARM_2_UNIT 5 | 29013 | GLENARM5_CT | 13.8 | 50.00 | CT | LA Basin | Western | | MUNI |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|-------------|------|--------|----|----------|--------------------------------|---------------------|------------|
| SCE | GLNARM_2_UNIT 5 | 29014 | GLENARM5_ST | 13.8 | 15.00 | ST | LA Basin | Western | | MUNI |
| SCE | GLNARM_7_UNIT 1 | 29005 | PASADNA1 | 13.8 | 22.07 | 1 | LA Basin | Western | | MUNI |
| SCE | GLNARM_7_UNIT 2 | 29006 | PASADNA2 | 13.8 | 22.30 | 1 | LA Basin | Western | | MUNI |
| SCE | GLNARM_7_UNIT 3 | 25042 | PASADNA3 | 13.8 | 44.83 | 1 | LA Basin | Western | | MUNI |
| SCE | GLNARM_7_UNIT 4 | 25043 | PASADNA4 | 13.8 | 42.42 | 1 | LA Basin | Western | | MUNI |
| SCE | HARBGN_7_UNITS | 24062 | HARBOR G | 13.8 | 76.27 | 1 | LA Basin | Western | Mothballed | Market |
| SCE | HARBGN_7_UNITS | 24062 | HARBOR G | 13.8 | 11.86 | HP | LA Basin | Western | Mothballed | Market |
| SCE | HARBGN_7_UNITS | 25510 | HARBORG4 | 4.16 | 11.86 | LP | LA Basin | Western | Mothballed | Market |
| SCE | HINSON_6_CARBG | 24020 | CARBGEN1 | 13.8 | 14.83 | 1 | LA Basin | Western | Aug NQC | Market |
| SCE | HINSON_6_CARBG | 24328 | CARBGEN2 | 13.8 | 14.83 | 1 | LA Basin | Western | Aug NQC | Market |
| SCE | HINSON_6_LBECH1 | 24170 | LBEACH12 | 13.8 | 65.00 | 1 | LA Basin | Western | | Market |
| SCE | HINSON_6_LBECH2 | 24170 | LBEACH12 | 13.8 | 65.00 | 2 | LA Basin | Western | | Market |
| SCE | HINSON_6_LBECH3 | 24171 | LBEACH34 | 13.8 | 65.00 | 3 | LA Basin | Western | | Market |
| SCE | HINSON_6_LBECH4 | 24171 | LBEACH34 | 13.8 | 65.00 | 4 | LA Basin | Western | | Market |
| SCE | HINSON_6_SERRGN | 24139 | SERRFGEN | 13.8 | 28.90 | D1 | LA Basin | Western | Aug NQC | QF/Selfgen |
| SCE | HNTGBH_7_UNIT 1 | 24066 | HUNT1 G | 13.8 | 0.00 | 1 | LA Basin | Western | Retired by 2021 | Market |
| SCE | HNTGBH_7_UNIT 2 | 24067 | HUNT2 G | 13.8 | 0.00 | 2 | LA Basin | Western | Retired by 2021 | Market |
| SCE | INDIGO_1_UNIT 1 | 29190 | WINTECX2 | 13.8 | 42.00 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | INDIGO_1_UNIT 2 | 29191 | WINTECX1 | 13.8 | 42.00 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | INDIGO_1_UNIT 3 | 29180 | WINTEC8 | 13.8 | 42.00 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | INLDEM_5_UNIT 1 | 29041 | IIEC-G1 | 19.5 | 335.00 | 1 | LA Basin | Eastern, Valley, Valley-Devers | Aug NQC | Market |
| SCE | INLDEM_5_UNIT 2 | 29042 | IIEC-G2 | 19.5 | 335.00 | 1 | LA Basin | Eastern, Valley, Valley-Devers | Mothballed | Market |
| SCE | LACIEN_2_VENICE | 24337 | VENICE | 13.8 | 0.00 | 1 | LA Basin | Western, El Nido | Aug NQC | MUNI |
| SCE | LAGBEL_2_STG1 | | | | 9.60 | | LA Basin | | Not modeled Aug NQC | Market |
| SCE | LAGBEL_6_QF | 29951 | REFUSE | 13.8 | 0.29 | D1 | LA Basin | Western | Aug NQC | QF/Selfgen |
| SCE | LGHTHP_6_ICEGEN | 24070 | ICEGEN | 13.8 | 48.00 | 1 | LA Basin | Western | Aug NQC | QF/Selfgen |
| SCE | MESAS_2_QF | 24209 | MESA CAL | 66 | 0.00 | | LA Basin | Western | Not modeled Aug NQC | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|----------|------|-------|----|----------|------------------------|---------------------|------------|
| SCE | MIRLOM_2_CORONA | | | | 2.23 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | MIRLOM_2_LNDFL | | | | 1.23 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | MIRLOM_2_MLBBTA | | | | 10.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | MIRLOM_2_MLBBTB | | | | 10.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | MIRLOM_2_ONTARO | | | | 2.26 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | MIRLOM_2_RTS032 | | | | 0.62 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | MIRLOM_2_RTS033 | | | | 0.41 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | MIRLOM_2_TEMESC | | | | 1.65 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | MIRLOM_6_DELGEN | 29339 | DELGEN | 13.8 | 25.93 | 1 | LA Basin | Eastern, Eastern Metro | Aug NQC | QF/Selfgen |
| SCE | MIRLOM_6_PEAKER | 29307 | MRLPKGEN | 13.8 | 46.00 | 1 | LA Basin | Eastern, Eastern Metro | | Market |
| SCE | MIRLOM_7_MWDLKM | 24210 | MIRALOMA | 66 | 4.80 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | MUNI |
| SCE | MOJAVE_1_SIPHON | 25657 | MJVSPHN1 | 13.8 | 4.79 | 1 | LA Basin | Eastern, Eastern Metro | Aug NQC | Market |
| SCE | MOJAVE_1_SIPHON | 25658 | MJVSPHN1 | 13.8 | 4.79 | 2 | LA Basin | Eastern, Eastern Metro | Aug NQC | Market |
| SCE | MOJAVE_1_SIPHON | 25659 | MJVSPHN1 | 13.8 | 4.79 | 3 | LA Basin | Eastern, Eastern Metro | Aug NQC | Market |
| SCE | MTWIND_1_UNIT 1 | 29060 | MOUNTWND | 115 | 11.77 | S1 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | MTWIND_1_UNIT 2 | 29060 | MOUNTWND | 115 | 5.88 | S2 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | MTWIND_1_UNIT 3 | 29060 | MOUNTWND | 115 | 5.95 | S3 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | OLINDA_2_COYCRK | 24211 | OLINDA | 66 | 3.13 | | LA Basin | Western | Not modeled | QF/Selfgen |
| SCE | OLINDA_2_LNDFL2 | 29011 | BREAPWR2 | 13.8 | 3.86 | C1 | LA Basin | Western | Aug NQC | Market |
| SCE | OLINDA_2_LNDFL2 | 29011 | BREAPWR2 | 13.8 | 3.86 | C2 | LA Basin | Western | Aug NQC | Market |
| SCE | OLINDA_2_LNDFL2 | 29011 | BREAPWR2 | 13.8 | 3.86 | C3 | LA Basin | Western | Aug NQC | Market |
| SCE | OLINDA_2_LNDFL2 | 29011 | BREAPWR2 | 13.8 | 3.86 | C4 | LA Basin | Western | Aug NQC | Market |
| SCE | OLINDA_2_LNDFL2 | 29011 | BREAPWR2 | 13.8 | 6.91 | S1 | LA Basin | Western | Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|------------------|-------|----------|------|-------|----|----------|------------------------|-------------------------|------------|
| SCE | OLINDA_2_QF | 24211 | OLINDA | 66 | 0.01 | | LA Basin | Western | Not modeled Aug NQC | QF/Selfgen |
| SCE | OLINDA_7_LNDFIL | 24211 | OLINDA | 66 | 0.00 | | LA Basin | Western | Not modeled Aug NQC | QF/Selfgen |
| SCE | PADUA_2_ONTARO | 24111 | PADUA | 66 | 0.12 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | PADUA_2_SOLAR1 | 24111 | PADUA | 66 | 0.00 | | LA Basin | Eastern, Eastern Metro | Not modeled Energy Only | Market |
| SCE | PADUA_6_MWDSDM | 24111 | PADUA | 66 | 5.51 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | MUNI |
| SCE | PADUA_6_QF | 24111 | PADUA | 66 | 0.38 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | PADUA_7_SDIMAS | 24111 | PADUA | 66 | 1.05 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | PANSEA_1_PANARO | 25640 | PANAERO | 115 | 7.95 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | PWEST_1_UNIT | 24815 | GARNET | 115 | 0.56 | PC | LA Basin | Western | Aug NQC | Market |
| SCE | REDOND_7_UNIT 5 | 24121 | REDON5 G | 18 | 0.00 | 5 | LA Basin | Western | Retired by 2021 | Market |
| SCE | REDOND_7_UNIT 6 | 24122 | REDON6 G | 18 | 0.00 | 6 | LA Basin | Western | Retired by 2021 | Market |
| SCE | REDOND_7_UNIT 7 | 24123 | REDON7 G | 20 | 0.00 | 7 | LA Basin | Western | Retired by 2021 | Market |
| SCE | REDOND_7_UNIT 8 | 24124 | REDON8 G | 20 | 0.00 | 8 | LA Basin | Western | Retired by 2021 | Market |
| SCE | RENWD_1_QF | 25636 | RENWIND | 115 | 1.33 | Q1 | LA Basin | Eastern, Valley-Devers | Aug NQC | QF/Selfgen |
| SCE | RENWD_1_QF | 25636 | RENWIND | 115 | 1.32 | Q2 | LA Basin | Eastern, Valley-Devers | Aug NQC | QF/Selfgen |
| SCE | RHONDO_2_QF | 24213 | RIOHONDO | 66 | 0.21 | | LA Basin | Western | Not modeled Aug NQC | QF/Selfgen |
| SCE | RHONDO_6_PUENTE | 24213 | RIOHONDO | 66 | 0.00 | | LA Basin | Western | Not modeled Aug NQC | Net Seller |
| SCE | RVSIIDE_2_RERCU3 | 24299 | RERC2G3 | 13.8 | 48.50 | 1 | LA Basin | Eastern, Eastern Metro | | MUNI |
| SCE | RVSIIDE_2_RERCU4 | 24300 | RERC2G4 | 13.8 | 48.50 | 1 | LA Basin | Eastern, Eastern Metro | | MUNI |
| SCE | RVSIIDE_6_RERCU1 | 24242 | RERC1G | 13.8 | 48.35 | 1 | LA Basin | Eastern, Eastern Metro | | MUNI |
| SCE | RVSIIDE_6_RERCU2 | 24243 | RERC2G | 13.8 | 48.50 | 1 | LA Basin | Eastern, Eastern Metro | | MUNI |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|------------------|-------|----------|------|--------|----|----------|----------------------------------------|---------------------|------------|
| SCE | RVSIIDE_6_SOLAR1 | 24244 | SPRINGEN | 13.8 | 3.08 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | RVSIIDE_6_SPRING | 24244 | SPRINGEN | 13.8 | 36.00 | 1 | LA Basin | Eastern, Eastern Metro | | Market |
| SCE | SANITR_6_UNITS | 24324 | SANIGEN | 13.8 | 2.92 | D1 | LA Basin | Eastern, Eastern Metro | Aug NQC | QF/Selfgen |
| SCE | SANTGO_2_LNDFL1 | | | | 15.88 | | LA Basin | | Not modeled Aug NQC | Market |
| SCE | SANTGO_2_MABBT1 | | | | 2.00 | | LA Basin | | Not modeled Aug NQC | Market |
| SCE | SANWD_1_QF | 25646 | SANWIND | 115 | 4.11 | Q1 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | SANWD_1_QF | 25646 | SANWIND | 115 | 4.11 | Q2 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | SBERDO_2_PSP3 | 24921 | MNTV-CT1 | 18 | 140.56 | 1 | LA Basin | Eastern, West of Devers, Eastern Metro | | Market |
| SCE | SBERDO_2_PSP3 | 24922 | MNTV-CT2 | 18 | 140.56 | 1 | LA Basin | Eastern, West of Devers, Eastern Metro | | Market |
| SCE | SBERDO_2_PSP3 | 24923 | MNTV-ST1 | 18 | 243.89 | 1 | LA Basin | Eastern, West of Devers, Eastern Metro | | Market |
| SCE | SBERDO_2_PSP4 | 24924 | MNTV-CT3 | 18 | 140.56 | 1 | LA Basin | Eastern, West of Devers, Eastern Metro | | Market |
| SCE | SBERDO_2_PSP4 | 24925 | MNTV-CT4 | 18 | 140.56 | 1 | LA Basin | Eastern, West of Devers, Eastern Metro | | Market |
| SCE | SBERDO_2_PSP4 | 24926 | MNTV-ST2 | 18 | 243.89 | 1 | LA Basin | Eastern, West of Devers, Eastern Metro | | Market |
| SCE | SBERDO_2_QF | 24214 | SANBRDNO | 66 | 0.28 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | SBERDO_2_REDLND | 24214 | SANBRDNO | 66 | 0.82 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | SBERDO_2_RTS005 | 24214 | SANBRDNO | 66 | 1.03 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | SBERDO_2_RTS007 | 24214 | SANBRDNO | 66 | 1.03 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | SBERDO_2_RTS011 | 24214 | SANBRDNO | 66 | 1.44 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | SBERDO_2_RTS013 | 24214 | SANBRDNO | 66 | 1.44 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | SBERDO_2_RTS016 | 24214 | SANBRDNO | 66 | 0.62 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|-----------------|-------|-------------|------|-------|----|----------|----------------------------------------|-------------------------|------------|
| SCE | SBERDO_2_RTS048 | 24214 | SANBRDNO | 66 | 0.00 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Energy Only | Market |
| SCE | SBERDO_2_SNTANA | 24214 | SANBRDNO | 66 | 0.00 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | SBERDO_6_MILLCK | 24214 | SANBRDNO | 66 | 0.64 | | LA Basin | Eastern, West of Devers, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | SENTNL_2_CTG1 | 29101 | SENTINEL_G1 | 13.8 | 92.09 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | SENTNL_2_CTG2 | 29102 | SENTINEL_G2 | 13.8 | 92.40 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | SENTNL_2_CTG3 | 29103 | SENTINEL_G3 | 13.8 | 92.36 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | SENTNL_2_CTG4 | 29104 | SENTINEL_G4 | 13.8 | 91.98 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | SENTNL_2_CTG5 | 29105 | SENTINEL_G5 | 13.8 | 91.83 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | SENTNL_2_CTG6 | 29106 | SENTINEL_G6 | 13.8 | 92.16 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | SENTNL_2_CTG7 | 29107 | SENTINEL_G7 | 13.8 | 91.84 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | SENTNL_2_CTG8 | 29108 | SENTINEL_G8 | 13.8 | 91.56 | 1 | LA Basin | Eastern, Valley-Devers | | Market |
| SCE | TIFFNY_1_DILLON | 29021 | WINTEC6 | 115 | 11.93 | 1 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | TRNSWD_1_QF | 25637 | TRANWIND | 115 | 10.33 | QF | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | VALLEY_5_PERRIS | 24160 | VALLEYSC | 115 | 7.94 | | LA Basin | Eastern, Valley, Valley-Devers | Not modeled Aug NQC | QF/Selfgen |
| SCE | VALLEY_5_REDMTN | 24160 | VALLEYSC | 115 | 2.20 | | LA Basin | Eastern, Valley, Valley-Devers | Not modeled Aug NQC | QF/Selfgen |
| SCE | VALLEY_5_RTS044 | 24160 | VALLEYSC | 115 | 3.28 | | LA Basin | Eastern, Valley, Valley-Devers | Not modeled Aug NQC | Market |
| SCE | VALLEY_5_SOLAR1 | 24160 | VALLEYSC | 115 | 0.00 | | LA Basin | Eastern, Valley, Valley-Devers | Not modeled Energy Only | Market |
| SCE | VALLEY_5_SOLAR2 | 25082 | WDT786 | 34.5 | 8.20 | EQ | LA Basin | Eastern, Valley, Valley-Devers | Aug NQC | Market |
| SCE | VALLEY_7_BADLND | 24160 | VALLEYSC | 115 | 0.58 | | LA Basin | Eastern, Valley, Valley-Devers | Not modeled Aug NQC | Market |
| SCE | VALLEY_7_UNITA1 | 24160 | VALLEYSC | 115 | 2.56 | | LA Basin | Eastern, Valley, Valley-Devers | Not modeled Aug NQC | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-----|--------------------|-------|----------|------|-------|----|----------|------------------------|-------------------------|------------|
| SCE | VENWD_1_WIND1 | 25645 | VENWIND | 115 | 2.50 | Q1 | LA Basin | Eastern, Valley-Devers | Aug NQC | QF/Selfgen |
| SCE | VENWD_1_WIND2 | 25645 | VENWIND | 115 | 4.25 | Q2 | LA Basin | Eastern, Valley-Devers | Aug NQC | QF/Selfgen |
| SCE | VENWD_1_WIND3 | 25645 | VENWIND | 115 | 5.05 | EU | LA Basin | Eastern, Valley-Devers | Aug NQC | QF/Selfgen |
| SCE | VERNON_6_GONZL1 | 24342 | FEDGEN | 13.8 | 5.75 | 1 | LA Basin | Western | | MUNI |
| SCE | VERNON_6_GONZL2 | 24342 | FEDGEN | 13.8 | 5.75 | 1 | LA Basin | Western | | MUNI |
| SCE | VERNON_6_MALBRG | 24239 | MALBRG1G | 13.8 | 42.37 | C1 | LA Basin | Western | | MUNI |
| SCE | VERNON_6_MALBRG | 24240 | MALBRG2G | 13.8 | 42.37 | C2 | LA Basin | Western | | MUNI |
| SCE | VERNON_6_MALBRG | 24241 | MALBRG3G | 13.8 | 49.26 | S3 | LA Basin | Western | | MUNI |
| SCE | VILLPK_2_VALLYV | 24216 | VILLA PK | 66 | 4.10 | | LA Basin | Western | Not modeled Aug NQC | QF/Selfgen |
| SCE | VILLPK_6_MWDYOR | 24216 | VILLA PK | 66 | 4.20 | | LA Basin | Western | Not modeled Aug NQC | MUNI |
| SCE | VISTA_2_RIALTO | 24901 | VSTA | 230 | 0.41 | | LA Basin | Eastern, Eastern Metro | Energy Only | Market |
| SCE | VISTA_2_RTS028 | 24901 | VSTA | 230 | 1.44 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | Market |
| SCE | VISTA_6_QF | 24902 | VSTA | 66 | 0.06 | | LA Basin | Eastern, Eastern Metro | Not modeled Aug NQC | QF/Selfgen |
| SCE | WALCRK_2_CTG1 | 29201 | WALCRKG1 | 13.8 | 96.00 | 1 | LA Basin | Western | | Market |
| SCE | WALCRK_2_CTG2 | 29202 | WALCRKG2 | 13.8 | 96.00 | 1 | LA Basin | Western | | Market |
| SCE | WALCRK_2_CTG3 | 29203 | WALCRKG3 | 13.8 | 96.00 | 1 | LA Basin | Western | | Market |
| SCE | WALCRK_2_CTG4 | 29204 | WALCRKG4 | 13.8 | 96.00 | 1 | LA Basin | Western | | Market |
| SCE | WALCRK_2_CTG5 | 29205 | WALCRKG5 | 13.8 | 96.65 | 1 | LA Basin | Western | | Market |
| SCE | WALNUT_2_SOLAR | | | | 0.00 | | LA Basin | Western | Not modeled Energy Only | Market |
| SCE | WALNUT_6_HILLGEN | 24063 | HILLGEN | 13.8 | 39.51 | D1 | LA Basin | Western | Aug NQC | Net Seller |
| SCE | WALNUT_7_WCOVCT | 24157 | WALNUT | 66 | 3.45 | | LA Basin | Western | Not modeled Aug NQC | Market |
| SCE | WALNUT_7_WCOVST | 24157 | WALNUT | 66 | 5.51 | | LA Basin | Western | Not modeled Aug NQC | Market |
| SCE | WHTWTR_1_WINDA1 | 29061 | WHITEWTR | 33 | 16.30 | 1 | LA Basin | Eastern, Valley-Devers | Aug NQC | Wind |
| SCE | ZZ_ARCOGN_2_UNIT S | 24018 | BRIGEN | 13.8 | 0.00 | 1 | LA Basin | Western | No NQC - hist. data | Net Seller |
| SCE | ZZ_HINSON_6_QF | 24064 | HINSON | 66 | 0.00 | 1 | LA Basin | Western | No NQC - hist. data | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-------|-------------------------|-------|----------|------|--------|----|----------|------------------------|---------------------|------------|
| SCE | ZZ_LAFRES_6_QF | 24332 | PALOGEN | 13.8 | 0.00 | D1 | LA Basin | Western, El Nido | No NQC - hist. data | QF/Selfgen |
| SCE | ZZ_MOBGEN_6_UNIT 1 | 24094 | MOBGEN | 13.8 | 0.00 | 1 | LA Basin | Western, El Nido | No NQC - hist. data | QF/Selfgen |
| SCE | ZZ_NA | 29260 | ALTAMSA4 | 115 | 0.00 | 1 | LA Basin | Eastern, Valley-Devers | No NQC - hist. data | Wind |
| SCE | ZZ_NA | 24329 | MOBGEN2 | 13.8 | 0.00 | 1 | LA Basin | Western, El Nido | No NQC - hist. data | QF/Selfgen |
| SCE | ZZ_NA | 24330 | OUTFALL1 | 13.8 | 0.00 | 1 | LA Basin | Western, El Nido | No NQC - hist. data | QF/Selfgen |
| SCE | ZZ_NA | 24331 | OUTFALL2 | 13.8 | 0.00 | 1 | LA Basin | Western, El Nido | No NQC - hist. data | QF/Selfgen |
| SCE | ZZ_NA | 24327 | THUMSGEN | 13.8 | 0.00 | 1 | LA Basin | Western | No NQC - hist. data | QF/Selfgen |
| SCE | ZZ_SANTGO_6_COYO TE | 24341 | COYGEN | 13.8 | 0.00 | 1 | LA Basin | Western | No NQC - hist. data | QF/Selfgen |
| SCE | ZZZZ_New | 90000 | ALMT-GT1 | 18 | 200.00 | X1 | LA Basin | Western | No NQC - Pmax | Market |
| SCE | ZZZZ_New | 90003 | HUNT-GT1 | 18 | 202.00 | X1 | LA Basin | Western | No NQC - Pmax | Market |
| SCE | ZZZZ_New | 90001 | ALMT-GT2 | 18 | 200.00 | X2 | LA Basin | Western | No NQC - Pmax | Market |
| SCE | ZZZZ_New | 90004 | HUNT-GT2 | 18 | 202.00 | X2 | LA Basin | Western | No NQC - Pmax | Market |
| SCE | ZZZZ_New | 90002 | ALMT-ST1 | 18 | 240.00 | X3 | LA Basin | Western | No NQC - Pmax | Market |
| SCE | ZZZZ_New | 90005 | HUNT-ST1 | 18 | 240.00 | X3 | LA Basin | Western | No NQC - Pmax | Market |
| SCE | ZZZZZ_BRDWAY_7_U NIT 3 | 29007 | BRODWYSC | 13.8 | 0.00 | | LA Basin | Western | Retired | MUNI |
| SCE | ZZZZZZ_ELSEGN_7_U NIT 4 | 24048 | ELSEG4 G | 18 | 0.00 | 4 | LA Basin | Western, El Nido | Retired | Market |
| SDG&E | BORDER_6_UNITA1 | 22149 | CALPK_BD | 13.8 | 48.00 | 1 | SD-IV | San Diego, Border | | Market |
| SDG&E | BREGGO_6_DEGRSL | | | | 2.58 | | SD-IV | San Diego | Not modeled Aug NQC | Market |
| SDG&E | BREGGO_6_SOLAR | 22082 | BR GEN1 | 0.21 | 10.66 | 1 | SD-IV | San Diego | Aug NQC | Market |
| SDG&E | CBRILLO_6_PLSTP1 | 22092 | CABRILLO | 69 | 2.72 | 1 | SD-IV | San Diego | Aug NQC | Market |
| SDG&E | CCRITA_7_RPPCHF | 22124 | CHCARITA | 138 | 2.00 | 1 | SD-IV | San Diego | Aug NQC | Market |
| SDG&E | CHILLS_1_SYCENG | 22120 | CARLTNHS | 138 | 0.67 | 1 | SD-IV | San Diego | Aug NQC | QF/Selfgen |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-------|-----------------|-------|------------|------|-------|----|-------|---------------------|------------------------|------------|
| SDG&E | CHILLS_7_UNITA1 | 22120 | CARLTNHS | 138 | 1.52 | 2 | SD-IV | San Diego | Aug NQC | QF/Selfgen |
| SDG&E | CNTNLA_2_SOLAR1 | 23463 | DW GEN3&4 | 0.33 | 51.25 | 1 | SD-IV | None | Aug NQC | Market |
| SDG&E | CNTNLA_2_SOLAR2 | 23463 | DW GEN3&4 | 0.33 | 0.00 | 2 | SD-IV | None | Energy Only | Market |
| SDG&E | CPSTNO_7_PRMADS | 22112 | CAPSTRNO | 138 | 5.65 | 1 | SD-IV | San Diego | Aug NQC | Market |
| SDG&E | CPVERD_2_SOLAR | 23309 | IV GEN3 G1 | 0.31 | 31.66 | G1 | SD-IV | None | Aug NQC | Market |
| SDG&E | CPVERD_2_SOLAR | 23301 | IV GEN3 G2 | 0.31 | 25.33 | G2 | SD-IV | None | Aug NQC | Market |
| SDG&E | CRELMN_6_RAMON1 | | | | 0.82 | | SD-IV | San Diego | Not modeled Aug NQC | Market |
| SDG&E | CRELMN_6_RAMON2 | | | | 2.05 | | SD-IV | San Diego | Not modeled Aug NQC | Market |
| SDG&E | CRSTWD_6_KUMYAY | 22915 | KUMEYAAY | 0.69 | 13.25 | 1 | SD-IV | San Diego | Aug NQC | Wind |
| SDG&E | CSLR4S_2_SOLAR | 23298 | DW GEN1 G1 | 0.32 | 26.65 | G1 | SD-IV | None | Aug NQC | Market |
| SDG&E | CSLR4S_2_SOLAR | 23299 | DW GEN1 G2 | 0.32 | 26.65 | G2 | SD-IV | None | Aug NQC | Market |
| SDG&E | DIVSON_6_NSQF | 22172 | DIVISION | 69 | 44.23 | 1 | SD-IV | San Diego | Aug NQC | QF/Selfgen |
| SDG&E | ELCAJN_6_EB1BT1 | | | | 7.50 | | SD-IV | San Diego, El Cajon | Not modeled. | Battery |
| SDG&E | ELCAJN_6_LM6K | 23320 | EC GEN2 | 13.8 | 48.10 | 1 | SD-IV | San Diego, El Cajon | | Market |
| SDG&E | ELCAJN_6_UNITA1 | 22150 | EC GEN1 | 13.8 | 45.42 | 1 | SD-IV | San Diego, El Cajon | | Market |
| SDG&E | ENERSJ_2_WIND | | | | 41.10 | | SD-IV | None | Not modeled Aug NQC | Wind |
| SDG&E | ESCND0_6_EB1BT1 | | | | 10.00 | 1 | SD-IV | San Diego, Esco | Not modeled. | Battery |
| SDG&E | ESCND0_6_EB2BT2 | | | | 10.00 | 1 | SD-IV | San Diego, Esco | Not modeled. | Battery |
| SDG&E | ESCND0_6_EB3BT3 | | | | 10.00 | 1 | SD-IV | San Diego, Esco | Not modeled. | Battery |
| SDG&E | ESCND0_6_PL1X2 | 22257 | ESGEN | 13.8 | 48.71 | 1 | SD-IV | San Diego, Esco | | Market |
| SDG&E | ESCND0_6_UNITB1 | 22153 | CALPK_ES | 13.8 | 48.00 | 1 | SD-IV | San Diego, Esco | | Market |
| SDG&E | ESCO_6_GLMQF | 22332 | GOALLINE | 69 | 36.41 | 1 | SD-IV | San Diego, Esco | Aug NQC | Net Seller |
| SDG&E | IVSLRP_2_SOLAR1 | 23440 | DW GEN2 G1 | 0.36 | 82.00 | 1 | SD-IV | None | Aug NQC | Market |
| SDG&E | IVWEST_2_SOLAR1 | 23155 | DU GEN1 G1 | 0.2 | 33.27 | G1 | SD-IV | None | Aug NQC | Market |
| SDG&E | IVWEST_2_SOLAR1 | 23156 | DU GEN1 G2 | 0.2 | 28.23 | G2 | SD-IV | None | Aug NQC | Market |
| SDG&E | JACMSR_1_JACSR1 | | | | 8.20 | | SD-IV | None | Not modeled Aug NQC | Market |
| SDG&E | LAKHDG_6_UNIT 1 | 22625 | LKHODG1 | 13.8 | 20.00 | 1 | SD-IV | San Diego | | Market |
| SDG&E | LAKHDG_6_UNIT 2 | 22626 | LKHODG2 | 13.8 | 20.00 | 2 | SD-IV | San Diego | | Market |
| SDG&E | LARKSP_6_UNIT 1 | 22074 | LRKSPBD1 | 13.8 | 46.00 | 1 | SD-IV | San Diego, Border | | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-------|-----------------|-------|------------|------|--------|----|-------|--------------------|-----------------------------------------------------------------------------------|------------|
| SDG&E | LARKSP_6_UNIT 2 | 22075 | LRKSPBD2 | 13.8 | 46.00 | 1 | SD-IV | San Diego, Border | | Market |
| SDG&E | LAROA1_2_UNITA1 | 20187 | LRP-U1 | 16 | 0.00 | 1 | SD-IV | None | Connect to CENACE/CF E grid for the summer – not available for ISO BAA RA purpose | Market |
| SDG&E | LAROA2_2_UNITA1 | 22996 | INTBST | 18 | 145.19 | 1 | SD-IV | None | | Market |
| SDG&E | LAROA2_2_UNITA1 | 22997 | INTBCT | 16 | 176.81 | 1 | SD-IV | None | | Market |
| SDG&E | LILIAC_6_SOLAR | | | | 1.23 | | SD-IV | San Diego | Not modeled. | Market |
| SDG&E | MRGT_6_MEF2 | 22487 | MEF_MR2 | 13.8 | 47.90 | 1 | SD-IV | San Diego, Miramar | | Market |
| SDG&E | MRGT_6_MMAREF | 22486 | MEF_MR1 | 13.8 | 48.00 | 1 | SD-IV | San Diego, Miramar | | Market |
| SDG&E | MSHGTS_6_MMARLF | 22448 | MESAHGTS | 69 | 4.42 | 1 | SD-IV | San Diego, Mission | Aug NQC | Market |
| SDG&E | MSSION_2_QF | 22496 | MISSION | 69 | 0.65 | 1 | SD-IV | San Diego | Aug NQC | Market |
| SDG&E | MURRAY_6_UNIT | | | | 0.00 | | SD-IV | San Diego | Not modeled Energy Only | Market |
| SDG&E | NIMTG_6_NIQF | 22576 | NOISLMTR | 69 | 36.15 | 1 | SD-IV | San Diego | Aug NQC | QF/Selfgen |
| SDG&E | OCTILO_5_WIND | 23314 | OCO GEN G1 | 0.69 | 35.12 | G1 | SD-IV | None | Aug NQC | Wind |
| SDG&E | OCTILO_5_WIND | 23318 | OCO GEN G2 | 0.69 | 35.12 | G2 | SD-IV | None | Aug NQC | Wind |
| SDG&E | OGROVE_6_PL1X2 | 22628 | PA GEN1 | 13.8 | 48.00 | 1 | SD-IV | San Diego, Pala | | Market |
| SDG&E | OGROVE_6_PL1X2 | 22629 | PA GEN2 | 13.8 | 48.00 | 1 | SD-IV | San Diego, Pala | | Market |
| SDG&E | OTAY_6_LNDFL5 | 22604 | OTAY | 69 | 0.00 | | SD-IV | San Diego, Border | Not modeled Energy Only | Market |
| SDG&E | OTAY_6_LNDFL6 | 22604 | OTAY | 69 | 0.00 | | SD-IV | San Diego, Border | Not modeled Energy Only | Market |
| SDG&E | OTAY_6_PL1X2 | 22617 | OYGEN | 13.8 | 35.50 | 1 | SD-IV | San Diego, Border | | Market |
| SDG&E | OTAY_6_UNITB1 | 22604 | OTAY | 69 | 2.16 | 1 | SD-IV | San Diego, Border | Aug NQC | Market |
| SDG&E | OTAY_7_UNITC1 | 22604 | OTAY | 69 | 1.78 | 3 | SD-IV | San Diego, Border | Aug NQC | QF/Selfgen |
| SDG&E | OTMESA_2_PL1X3 | 22605 | OTAYMGT1 | 18 | 165.16 | 1 | SD-IV | San Diego | | Market |
| SDG&E | OTMESA_2_PL1X3 | 22606 | OTAYMGT2 | 18 | 166.17 | 1 | SD-IV | San Diego | | Market |
| SDG&E | OTMESA_2_PL1X3 | 22607 | OTAYMST1 | 16 | 272.27 | 1 | SD-IV | San Diego | | Market |
| SDG&E | PALOMR_2_PL1X3 | 22262 | PEN_CT1 | 18 | 170.18 | 1 | SD-IV | San Diego | | Market |
| SDG&E | PALOMR_2_PL1X3 | 22263 | PEN_CT2 | 18 | 170.18 | 1 | SD-IV | San Diego | | Market |
| SDG&E | PALOMR_2_PL1X3 | 22265 | PEN_ST | 18 | 225.24 | 1 | SD-IV | San Diego | | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-------|-----------------|-------|--------------|------|--------|---|-------|-----------------|---------------------|------------|
| SDG&E | PIOPIC_2_CTG1 | 23162 | PIO PICO CT1 | 13.8 | 106.00 | 1 | SD-IV | San Diego | No NQC - Pmax | Market |
| SDG&E | PIOPIC_2_CTG2 | 23163 | PIO PICO CT2 | 13.8 | 106.00 | 1 | SD-IV | San Diego | No NQC - Pmax | Market |
| SDG&E | PIOPIC_2_CTG3 | 23164 | PIO PICO CT3 | 13.8 | 106.00 | 1 | SD-IV | San Diego | No NQC - Pmax | Market |
| SDG&E | PTLOMA_6_NTCCGN | 22660 | POINTLMA | 69 | 2.12 | 2 | SD-IV | San Diego | Aug NQC | QF/Selfgen |
| SDG&E | PTLOMA_6_NTCQF | 22660 | POINTLMA | 69 | 19.76 | 1 | SD-IV | San Diego | Aug NQC | QF/Selfgen |
| SDG&E | SAMPSN_6_KELCO1 | 22704 | SAMPSON | 12.5 | 3.27 | 1 | SD-IV | San Diego | Aug NQC | Net Seller |
| SDG&E | SMRCOS_6_LNDFIL | 22724 | SANMRCOS | 69 | 1.50 | 1 | SD-IV | San Diego | Aug NQC | Market |
| SDG&E | TERMEX_2_PL1X3 | 22982 | TDM CTG2 | 18 | 156.44 | 1 | SD-IV | None | | Market |
| SDG&E | TERMEX_2_PL1X3 | 22983 | TDM CTG3 | 18 | 156.44 | 1 | SD-IV | None | | Market |
| SDG&E | TERMEX_2_PL1X3 | 22981 | TDM STG | 21 | 280.13 | 1 | SD-IV | None | | Market |
| SDG&E | VLCNTR_6_VCCLR | | | | 0.96 | | SD-IV | San Diego, Pala | Not modeled Aug NQC | Market |
| SDG&E | VLCNTR_6_VCCLR1 | | | | 1.03 | | SD-IV | San Diego, Pala | Not modeled Aug NQC | Market |
| SDG&E | VLCNTR_6_VCCLR2 | | | | 2.05 | | SD-IV | San Diego, Pala | Not modeled Aug NQC | Market |
| SDG&E | ZZ_NA | 22916 | PFC-AVC | 0.6 | 0.00 | 1 | SD-IV | San Diego | No NQC - hist. data | QF/Selfgen |
| SDG&E | ZZZ_New Unit | 23352 | ECO GEN2 | 0.55 | 5.30 | 1 | SD-IV | None | No NQC - est. data | Market |
| SDG&E | ZZZ_New Unit | 23541 | Q1061_BESS | 0.48 | 20.00 | 1 | SD-IV | San Diego, Esco | No NQC - est. data | Battery |
| SDG&E | ZZZ_New Unit | 23287 | Q429_G1 | 0.31 | 41.00 | 1 | SD-IV | None | No NQC - est. data | Market |
| SDG&E | ZZZ_New Unit | 23441 | DW GEN2 G2 | 0.42 | 61.60 | 1 | SD-IV | None | Aug NQC | Market |
| SDG&E | ZZZ_New unit | 22783 | EA5 REPOWER1 | 13.8 | 100.00 | 1 | SD-IV | San Diego | No NQC - Pmax | Market |
| SDG&E | ZZZ_New unit | 22784 | EA5 REPOWER2 | 13.8 | 100.00 | 1 | SD-IV | San Diego | No NQC - Pmax | Market |
| SDG&E | ZZZ_New unit | 22788 | EA5 REPOWER3 | 13.8 | 100.00 | 1 | SD-IV | San Diego | No NQC - Pmax | Market |
| SDG&E | ZZZ_New unit | 22786 | EA5 REPOWER4 | 13.8 | 100.00 | 1 | SD-IV | San Diego | No NQC - Pmax | Market |
| SDG&E | ZZZ_New unit | 22787 | EA5 REPOWER5 | 13.8 | 100.00 | 1 | SD-IV | San Diego | No NQC - Pmax | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-------|---------------------|-------|--------------|------|-------|----|-------|---------------------|--------------------|---------|
| SDG&E | ZZZ_New Unit | 23216 | Q1294_BESS | 0.48 | 20.00 | C9 | SD-IV | San Diego, Esco | No NQC - est. data | Battery |
| SDG&E | ZZZ_New Unit | 22942 | BUE GEN 1_G1 | 0.69 | 11.60 | G1 | SD-IV | None | No NQC - est. data | Wind |
| SDG&E | ZZZ_New Unit | 23100 | ECO GEN1 G1 | 0.69 | 27.38 | G1 | SD-IV | None | No NQC - est. data | Wind |
| SDG&E | ZZZ_New Unit | 22945 | BUE GEN 1_G2 | 0.69 | 11.60 | G2 | SD-IV | None | No NQC - est. data | Wind |
| SDG&E | ZZZ_New Unit | 22947 | BUE GEN 1_G3 | 0.69 | 11.60 | G3 | SD-IV | None | No NQC - est. data | Wind |
| SDG&E | ZZZZ_New Unit | 23443 | DW GEN2 G3B | 0.6 | 43.09 | 1 | SD-IV | None | Aug NQC | Market |
| SDG&E | ZZZZ_New Unit | 23442 | DW GEN2 G3A | 0.6 | 60.35 | 1 | SD-IV | None | Aug NQC | Market |
| SDG&E | ZZZZ_New Unit | 23131 | Q183_G1 | 0.69 | 0.00 | G1 | SD-IV | None | Energy Only | Market |
| SDG&E | ZZZZ_New Unit | 23134 | Q183_G2 | 0.69 | 0.00 | G2 | SD-IV | None | Energy Only | Market |
| SDG&E | ZZZZ_New Unit | 22949 | BUE GEN 1_G4 | 0.69 | 26.00 | G3 | SD-IV | None | No NQC - est. data | Wind |
| SDG&E | ZZZZZ_ELCAJN_7_GT 1 | 22212 | ELCAJNGT | 12.5 | 0.00 | 1 | SD-IV | San Diego, El Cajon | Retired | Market |
| SDG&E | ZZZZZ_ENCINA_7_EA 1 | 22233 | ENCINA 1 | 14.4 | 0.00 | 1 | SD-IV | San Diego, Encina | Retired | Market |
| SDG&E | ZZZZZ_ENCINA_7_EA 2 | 22234 | ENCINA 2 | 14.4 | 0.00 | 1 | SD-IV | San Diego, Encina | Retired by 2019 | Market |
| SDG&E | ZZZZZ_ENCINA_7_EA 3 | 22236 | ENCINA 3 | 14.4 | 0.00 | 1 | SD-IV | San Diego, Encina | Retired by 2019 | Market |
| SDG&E | ZZZZZ_ENCINA_7_EA 4 | 22240 | ENCINA 4 | 22 | 0.00 | 1 | SD-IV | San Diego, Encina | Retired by 2019 | Market |
| SDG&E | ZZZZZ_ENCINA_7_EA 5 | 22244 | ENCINA 5 | 24 | 0.00 | 1 | SD-IV | San Diego, Encina | Retired by 2019 | Market |
| SDG&E | ZZZZZ_ENCINA_7_GT 1 | 22248 | ENCINAGT | 12.5 | 0.00 | 1 | SD-IV | San Diego, Encina | Retired by 2019 | Market |
| SDG&E | ZZZZZ_KEARNY_7_KY 2 | 22373 | KEARN2AB | 12.5 | 0.00 | 1 | SD-IV | San Diego, Mission | Retired | Market |
| SDG&E | ZZZZZ_KEARNY_7_KY 2 | 22374 | KEARN2CD | 12.5 | 0.00 | 1 | SD-IV | San Diego, Mission | Retired | Market |
| SDG&E | ZZZZZ_KEARNY_7_KY 2 | 22373 | KEARN2AB | 12.5 | 0.00 | 2 | SD-IV | San Diego, Mission | Retired | Market |
| SDG&E | ZZZZZ_KEARNY_7_KY 2 | 22374 | KEARN2CD | 12.5 | 0.00 | 2 | SD-IV | San Diego, Mission | Retired | Market |

Appendix A - List of physical resources by PTO, local area and market ID

| | | | | | | | | | | |
|-------|------------------------|-------|----------|------|------|---|-------|--------------------|---------|--------|
| SDG&E | ZZZZZ_KEARNY_7_KY 3 | 22375 | KEARN3AB | 12.5 | 0.00 | 1 | SD-IV | San Diego, Mission | Retired | Market |
| SDG&E | ZZZZZ_KEARNY_7_KY 3 | 22376 | KEARN3CD | 12.5 | 0.00 | 1 | SD-IV | San Diego, Mission | Retired | Market |
| SDG&E | ZZZZZ_KEARNY_7_KY 3 | 22375 | KEARN3AB | 12.5 | 0.00 | 2 | SD-IV | San Diego, Mission | Retired | Market |
| SDG&E | ZZZZZ_KEARNY_7_KY 3 | 22376 | KEARN3CD | 12.5 | 0.00 | 2 | SD-IV | San Diego, Mission | Retired | Market |
| SDG&E | ZZZZZ_MRGT_7_UNIT S | 22488 | MIRAMRGT | 12.5 | 0.00 | 1 | SD-IV | San Diego, Miramar | Retired | Market |
| SDG&E | ZZZZZ_MRGT_7_UNIT S | 22488 | MIRAMRGT | 12.5 | 0.00 | 2 | SD-IV | San Diego, Miramar | Retired | Market |

○

VI. Appendix B – Effectiveness factors for procurement guidance

Table - Eagle Rock.

Effectiveness factors to the Eagle Rock-Cortina 115 kV line:

| Gen Bus | Gen Name | Gen ID | Eff Fctr (%) |
|----------------|-----------------|---------------|---------------------|
| 31406 | GEYSR5-6 | 1 | 36 |
| 31406 | GEYSR5-6 | 2 | 36 |
| 31408 | GEYSER78 | 1 | 36 |
| 31408 | GEYSER78 | 2 | 36 |
| 31412 | GEYSER11 | 1 | 37 |
| 31435 | GEO.ENGY | 1 | 35 |
| 31435 | GEO.ENGY | 2 | 35 |
| 31433 | POTTRVLY | 1 | 34 |
| 31433 | POTTRVLY | 3 | 34 |
| 31433 | POTTRVLY | 4 | 34 |
| 38020 | CITY UKH | 1 | 32 |
| 38020 | CITY UKH | 2 | 32 |

Table - Fulton

Effectiveness factors to the Lakeville-Petaluma-Cotati 60 kV line:

| Gen Bus | Gen Name | Gen ID | Eff Fctr (%) |
|----------------|-----------------|---------------|---------------------|
| 31466 | SONMA LF | 1 | 52 |
| 31422 | GEYSER17 | 1 | 12 |
| 31404 | WEST FOR | 1 | 12 |
| 31404 | WEST FOR | 2 | 12 |
| 31414 | GEYSER12 | 1 | 12 |
| 31418 | GEYSER14 | 1 | 12 |
| 31420 | GEYSER16 | 1 | 12 |
| 31402 | BEAR CAN | 1 | 12 |
| 31402 | BEAR CAN | 2 | 12 |
| 38110 | NCPA2GY1 | 1 | 12 |
| 38112 | NCPA2GY2 | 1 | 12 |
| 32700 | MONTICLO | 1 | 10 |
| 32700 | MONTICLO | 2 | 10 |
| 32700 | MONTICLO | 3 | 10 |
| 31435 | GEO.ENGY | 1 | 6 |
| 31435 | GEO.ENGY | 2 | 6 |
| 31408 | GEYSER78 | 1 | 6 |
| 31408 | GEYSER78 | 2 | 6 |
| 31412 | GEYSER11 | 1 | 6 |
| 31406 | GEYSR5-6 | 1 | 6 |
| 31406 | GEYSR5-6 | 2 | 6 |

Appendix B - Effectiveness factors for procurement guidance

Table - Lakeville

Effectiveness factors to the Vaca Dixon-Lakeville 230 kV line:

| Gen Bus | Gen Name | Gen ID | Eff Fctr (%) |
|----------------|-----------------|---------------|---------------------|
| 31400 | SANTA FE | 2 | 38 |
| 31430 | SMUDGE01 | 1 | 38 |
| 31400 | SANTA FE | 1 | 38 |
| 31416 | GEYSER13 | 1 | 38 |
| 31424 | GEYSER18 | 1 | 38 |
| 31426 | GEYSER20 | 1 | 38 |
| 38106 | NCPA1GY1 | 1 | 38 |
| 38108 | NCPA1GY2 | 1 | 38 |
| 31421 | BOTTLERK | 1 | 36 |
| 31404 | WEST FOR | 2 | 36 |
| 31402 | BEAR CAN | 1 | 36 |
| 31402 | BEAR CAN | 2 | 36 |
| 31404 | WEST FOR | 1 | 36 |
| 31414 | GEYSER12 | 1 | 36 |
| 31418 | GEYSER14 | 1 | 36 |
| 31420 | GEYSER16 | 1 | 36 |
| 31422 | GEYSER17 | 1 | 36 |
| 38110 | NCPA2GY1 | 1 | 36 |
| 38112 | NCPA2GY2 | 1 | 36 |
| 31446 | SONMA LF | 1 | 36 |
| 32700 | MONTICLO | 1 | 31 |
| 32700 | MONTICLO | 2 | 31 |
| 32700 | MONTICLO | 3 | 31 |
| 31406 | GEYSR5-6 | 1 | 18 |
| 31406 | GEYSR5-6 | 2 | 18 |
| 31405 | RPSP1014 | 1 | 18 |
| 31408 | GEYSER78 | 1 | 18 |
| 31408 | GEYSER78 | 2 | 18 |
| 31412 | GEYSER11 | 1 | 18 |
| 31435 | GEO.ENGY | 1 | 18 |
| 31435 | GEO.ENGY | 2 | 18 |
| 31433 | POTTRVLY | 1 | 15 |
| 31433 | POTTRVLY | 2 | 15 |
| 31433 | POTTRVLY | 3 | 15 |
| 38020 | CITY UKH | 1 | 15 |
| 38020 | CITY UKH | 2 | 15 |

Table – Rio Oso

Effectiveness factors to the Rio Oso-Atlantic 230 kV line:

| Gen Bus | Gen Name | Gen ID | Eff Fctr. (%) |
|----------------|-----------------|---------------|----------------------|
| 32498 | SPILINCF | 1 | 49 |

Appendix B - Effectiveness factors for procurement guidance

| | | | |
|-------|----------|---|----|
| 32500 | ULTR RCK | 1 | 49 |
| 32456 | MIDLFORK | 1 | 33 |
| 32456 | MIDLFORK | 2 | 33 |
| 32458 | RALSTON | 1 | 33 |
| 32513 | ELDRADO1 | 1 | 32 |
| 32514 | ELDRADO2 | 1 | 32 |
| 32510 | CHILIBAR | 1 | 32 |
| 32486 | HELLHOLE | 1 | 31 |
| 32508 | FRNCH MD | 1 | 30 |
| 32460 | NEWCSTLE | 1 | 26 |
| 32478 | HALSEY F | 1 | 24 |
| 32512 | WISE | 1 | 24 |
| 38114 | Stig CC | 1 | 14 |
| 38123 | Q267CT | 1 | 14 |
| 38124 | Q267ST | 1 | 14 |
| 32462 | CHI.PARK | 1 | 8 |
| 32464 | DTCHFLT1 | 1 | 4 |

Table – South of Table Mountain

Effectiveness factors to the Caribou-Palermo 115 kV line:

| Gen Bus | Gen Name | Gen ID | Eff Fctr. (%) |
|---------|----------|--------|---------------|
| 31814 | FORBSTWN | 1 | 7 |
| 31794 | WOODLEAF | 1 | 7 |
| 31832 | SLY.CR. | 1 | 7 |
| 31862 | DEADWOOD | 1 | 7 |
| 31890 | PO POWER | 1 | 6 |
| 31890 | PO POWER | 2 | 6 |
| 31888 | OROVLE | 1 | 6 |
| 31834 | KELLYRDG | 1 | 6 |
| 32450 | COLGATE1 | 1 | 4 |
| 32466 | NARROWS1 | 1 | 4 |
| 32468 | NARROWS2 | 1 | 4 |
| 32452 | COLGATE2 | 1 | 4 |
| 32470 | CMP.FARW | 1 | 4 |
| 32451 | FREC | 1 | 4 |
| 32490 | GRNLEAF1 | 1 | 4 |
| 32490 | GRNLEAF1 | 2 | 4 |
| 32496 | YCEC | 1 | 4 |
| 32494 | YUBA CTY | 1 | 4 |
| 32492 | GRNLEAF2 | 1 | 4 |
| 32498 | SPILINCF | 1 | 2 |
| 31788 | ROCK CK2 | 1 | 2 |
| 31812 | CRESTA | 1 | 2 |
| 31812 | CRESTA | 2 | 2 |
| 31820 | BCKS CRK | 1 | 2 |
| 31820 | BCKS CRK | 2 | 2 |

Appendix B - Effectiveness factors for procurement guidance

| | | | |
|-------|-----------|---|---|
| 31786 | ROCK CK1 | 1 | 2 |
| 31790 | POE 1 | 1 | 2 |
| 31792 | POE 2 | 1 | 2 |
| 31784 | BELDEN | 1 | 2 |
| 32500 | ULTR RCK | 1 | 2 |
| 32156 | WOODLAND | 1 | 2 |
| 32510 | CHILIBAR | 1 | 2 |
| 32513 | ELDRADO1 | 1 | 2 |
| 32514 | ELDRADO2 | 1 | 2 |
| 32478 | HALSEY F | 1 | 2 |
| 32460 | NEWCASTLE | 1 | 1 |
| 32458 | RALSTON | 1 | 1 |
| 32512 | WISE | 1 | 1 |
| 32456 | MIDLFORK | 1 | 1 |
| 32456 | MIDLFORK | 2 | 1 |
| 32486 | HELLHOLE | 1 | 1 |
| 32508 | FRNCH MD | 1 | 1 |
| 32162 | RIV.DLTA | 1 | 1 |
| 32502 | DTCHFLT2 | 1 | 1 |
| 32462 | CHI.PARK | 1 | 1 |
| 32464 | DTCHFLT1 | 1 | 1 |
| 32454 | DRUM 5 | 1 | 1 |
| 32476 | ROLLINSF | 1 | 1 |
| 32484 | OXBOW F | 1 | 1 |
| 32474 | DEER CRK | 1 | 1 |
| 32504 | DRUM 1-2 | 1 | 1 |
| 32504 | DRUM 1-2 | 2 | 1 |
| 32506 | DRUM 3-4 | 1 | 1 |
| 32506 | DRUM 3-4 | 2 | 1 |
| 32166 | UC DAVIS | 1 | 1 |
| 32472 | SPAULDG | 1 | 1 |
| 32472 | SPAULDG | 2 | 1 |
| 32472 | SPAULDG | 3 | 1 |
| 32480 | BOWMAN | 1 | 1 |
| 32488 | HAYPRES+ | 1 | 1 |
| 32488 | HAYPRES+ | 2 | 1 |
| 38124 | LODI ST1 | 1 | 1 |
| 38123 | LODI CT1 | 1 | 1 |
| 38114 | STIG CC | 1 | 1 |

Table – San Jose

Effectiveness factors to the Newark-NRS 115 kV line.

| Bus# | Bus Name | ID | Eff Factor % |
|-------|----------|----|--------------|
| 36895 | Gia200 | 1 | 25 |
| 36858 | Gia100 | 1 | 25 |

Appendix B - Effectiveness factors for procurement guidance

| | | | |
|-------|----------|---|----|
| 36859 | Laf300 | 2 | 23 |
| 36859 | Laf300 | 1 | 23 |
| 36863 | DVRaGT1 | 1 | 23 |
| 36864 | DVRbGt2 | 1 | 23 |
| 36865 | DVRaST3 | 1 | 23 |
| 35854 | LECEFGT1 | 1 | 19 |
| 35855 | LECEFGT2 | 1 | 19 |
| 35856 | LECEFGT3 | 1 | 19 |
| 35857 | LECEFGT4 | 1 | 19 |
| 35858 | LECEFST1 | 1 | 19 |
| 35860 | OLS-AGNE | 1 | 19 |
| 35863 | CATALYST | 1 | 12 |

Table – South Bay-Moss Landing

Effectiveness factors to the Moss Landing-Las Aguillas 230 kV line.

| Bus# | Bus Name | ID | Eff | Factor | % |
|-------|----------|----|-----|--------|---|
| 36209 | SLD ENRG | 1 | 20 | | |
| 36221 | DUKMOSS1 | 1 | 20 | | |
| 36222 | DUKMOSS2 | 1 | 20 | | |
| 36223 | DUKMOSS3 | 1 | 20 | | |
| 36224 | DUKMOSS4 | 1 | 20 | | |
| 36225 | DUKMOSS5 | 1 | 20 | | |
| 36226 | DUKMOSS6 | 1 | 20 | | |
| 36405 | MOSSLND6 | 1 | 17 | | |
| 36406 | MOSSLND7 | 1 | 17 | | |
| 35881 | MEC CTG1 | 1 | 13 | | |
| 35882 | MEC CTG2 | 1 | 13 | | |
| 35883 | MEC STG1 | 1 | 13 | | |
| 35850 | GLRY COG | 1 | 12 | | |
| 35850 | GLRY COG | 2 | 12 | | |
| 35851 | GROYPKR1 | 1 | 12 | | |
| 35852 | GROYPKR2 | 1 | 12 | | |
| 35853 | GROYPKR3 | 1 | 12 | | |
| 35623 | SWIFT | BT | 10 | | |
| 35863 | CATALYST | 1 | 10 | | |
| 36863 | DVRaGT1 | 1 | 8 | | |
| 36864 | DVRbGt2 | 1 | 8 | | |
| 36865 | DVRaST3 | 1 | 8 | | |
| 36859 | Laf300 | 2 | 8 | | |
| 36859 | Laf300 | 1 | 8 | | |
| 36858 | Gia100 | 1 | 7 | | |
| 36895 | Gia200 | 1 | 7 | | |
| 35854 | LECEFGT1 | 1 | 7 | | |
| 35855 | LECEFGT2 | 1 | 7 | | |
| 35856 | LECEFGT3 | 1 | 7 | | |
| 35857 | LECEFGT4 | 1 | 7 | | |

Appendix B - Effectiveness factors for procurement guidance

35858 LECEFST1 1 7
 35860 OLS-AGNE 1 7

Table – Ames/Pittsburg/Oakland

1) Effectiveness factors to the Ames-Ravenswood #1 115 kV line.

| Bus# | Bus Name | ID | Eff | Factor | % |
|-------|-------------|----|-----|--------|---|
| 35304 | RUSELCT1 | 1 | 10 | | |
| 35305 | RUSELCT2 | 2 | 10 | | |
| 35306 | RUSELST1 | 3 | 10 | | |
| 33469 | OX_MTN | 1 | 10 | | |
| 33469 | OX_MTN | 2 | 10 | | |
| 33469 | OX_MTN | 3 | 10 | | |
| 33469 | OX_MTN | 4 | 10 | | |
| 33469 | OX_MTN | 5 | 10 | | |
| 33469 | OX_MTN | 6 | 10 | | |
| 33469 | OX_MTN | 7 | 10 | | |
| 33107 | DEC STG1 | 1 | 3 | | |
| 33108 | DEC CTG1 | 1 | 3 | | |
| 33109 | DEC CTG2 | 1 | 3 | | |
| 33110 | DEC CTG3 | 1 | 3 | | |
| 33102 | COLUMBIA | 1 | 3 | | |
| 33111 | LMECCT2 | 1 | 3 | | |
| 33112 | LMECCT1 | 1 | 3 | | |
| 33113 | LMECST1 | 1 | 3 | | |
| 33151 | FOSTER W | 1 | 2 | | |
| 33151 | FOSTER W | 2 | 2 | | |
| 33151 | FOSTER W | 3 | 2 | | |
| 33136 | CCCS | 1 | 2 | | |
| 33141 | SHELL 1 | 1 | 2 | | |
| 33142 | SHELL 2 | 1 | 2 | | |
| 33143 | SHELL 3 | 1 | 2 | | |
| 32900 | CRCKTCOG | 1 | 2 | | |
| 32910 | UNOCAL | 1 | 2 | | |
| 32910 | UNOCAL | 2 | 2 | | |
| 32910 | UNOCAL | 3 | 2 | | |
| 32920 | UNION CH | 1 | 2 | | |
| 32921 | ChevGen1 | 1 | 2 | | |
| 32922 | ChevGen2 | 1 | 2 | | |
| 32923 | ChevGen3 | 3 | 2 | | |
| 32741 | HILLSIDE_12 | 1 | 2 | | |
| 32901 | OAKLND 1 | 1 | 1 | | |
| 32902 | OAKLND 2 | 2 | 1 | | |
| 32903 | OAKLND 3 | 3 | 1 | | |
| 38118 | ALMDACT1 | 1 | 1 | | |
| 38119 | ALMDACT2 | 1 | 1 | | |

Appendix B - Effectiveness factors for procurement guidance

2) Effectiveness factors to the Moraga-Claremont #2 115 kV line.

| Bus# | Bus Name | ID | Eff Factor % |
|-------|-------------|----|--------------|
| 32741 | HILLSIDE_12 | 1 | 15 |
| 32921 | ChevGen1 | 1 | 15 |
| 32922 | ChevGen2 | 1 | 15 |
| 32923 | ChevGen3 | 3 | 15 |
| 32920 | UNION CH | 1 | 14 |
| 32910 | UNOCAL | 1 | 13 |
| 32910 | UNOCAL | 2 | 13 |
| 32910 | UNOCAL | 3 | 13 |
| 32901 | OAKLND 1 | 1 | 10 |
| 32902 | OAKLND 2 | 2 | 10 |
| 32903 | OAKLND 3 | 3 | 10 |
| 38118 | ALMDACT1 | 1 | 10 |
| 38119 | ALMDACT2 | 1 | 10 |
| 33141 | SHELL 1 | 1 | 9 |
| 33142 | SHELL 2 | 1 | 9 |
| 33143 | SHELL 3 | 1 | 9 |
| 33136 | CCCS | 1 | 8 |
| 32900 | CRCKTCOG | 1 | 7 |
| 33151 | FOSTER W | 1 | 6 |
| 33151 | FOSTER W | 2 | 6 |
| 33151 | FOSTER W | 3 | 6 |
| 33102 | COLUMBIA | 1 | 3 |
| 33111 | LMECCT2 | 1 | 3 |
| 33112 | LMECCT1 | 1 | 3 |
| 33113 | LMECST1 | 1 | 3 |
| 33107 | DEC STG1 | 1 | 3 |
| 33108 | DEC CTG1 | 1 | 3 |
| 33109 | DEC CTG2 | 1 | 3 |
| 33110 | DEC CTG3 | 1 | 3 |

Table – Herndon

Effectiveness factors to the Herndon-Manchester 115 kV line.

| Bus# | Bus Name | ID | Eff Factor % |
|-------|----------|----|--------------|
| 34624 | BALCH 1 | 1 | 21.838 |
| 34616 | KINGSRIV | 1 | 20.665 |
| 34648 | DINUBA E | 1 | 19.515 |
| 34671 | KRCDPCT1 | 1 | 19.43 |
| 34672 | KRCDPCT2 | 1 | 19.43 |
| 34308 | KERCKHOF | 1 | 17.441 |
| 34343 | KERCK1-2 | 2 | 17.441 |
| 34344 | KERCK1-1 | 1 | 17.441 |

Appendix B - Effectiveness factors for procurement guidance

| | | | | |
|-------|--------------|----|---|--------|
| 34345 | KERCK1-3 | | 3 | 17.441 |
| 34603 | JGBSWLT | ST | | 14.719 |
| 34677 | Q558 | | 1 | 14.719 |
| 34690 | CORCORAN_3 | FW | | 14.719 |
| 34692 | CORCORAN_4 | FW | | 14.719 |
| 34696 | CORCORANPV_S | | 1 | 14.719 |
| 34699 | Q529 | | 1 | 14.719 |
| 34610 | HAAS | | 1 | 13.43 |
| 34610 | HAAS | | 2 | 13.43 |
| 34612 | BLCH 2-2 | | 1 | 13.43 |
| 34614 | BLCH 2-3 | | 1 | 13.43 |
| 34431 | GWF_HEP1 | | 1 | 8.487 |
| 34433 | GWF_HEP2 | | 1 | 8.487 |
| 34617 | Q581 | | 1 | 4.723 |
| 34649 | Q965 | | 1 | 4.723 |
| 34680 | KANSAS | | 1 | 4.723 |
| 34467 | GIFFEN_DIST | | 1 | 3.701 |
| 34563 | STROUD_DIST | | 2 | 3.701 |
| 34563 | STROUD_DIST | | 1 | 3.701 |
| 34608 | AGRICO | | 2 | 3.701 |
| 34608 | AGRICO | | 3 | 3.701 |
| 34608 | AGRICO | | 4 | 3.701 |
| 34644 | Q679 | | 1 | 3.701 |
| 36550 | Q632BC1 | | 1 | 3.701 |

Table – LA Basin

Effectiveness factors to the Mesa – Laguna Bell #1 230 kV line:

Resource Locations **Effectiveness Factor (%)**

| | | |
|----------|----------|--------|
| REFUSE | 13.8 #D1 | -34.52 |
| MALBRG1G | 13.8 #C1 | -34.42 |
| ELSEG6ST | 13.8 #6 | -26.66 |
| ELSEG5GT | 16.5 #5 | -26.64 |
| VENICE | 13.8 #1 | -26.22 |
| MOBGEN1 | 13.8 #1 | -26.18 |
| PALOGEN | 13.8 #D1 | -26.18 |
| ARCO 1G | 13.8 #1 | -23.13 |
| HARBOR G | 13.8 #1 | -23.03 |
| THUMSGEN | 13.8 #1 | -23.03 |
| CARBGEN1 | 13.8 #1 | -23.02 |
| SERRFGEN | 13.8 #D1 | -23.02 |
| ICEGEN | 13.8 #D1 | -22.33 |
| ALMITOSW | 66.0 #I3 | -18.01 |
| ALAMTX1 | 18.0 #X1 | -17.93 |

Appendix B - Effectiveness factors for procurement guidance

| | | |
|------------|----------|--------|
| CTRPKGEN | 13.8 #1 | -17.51 |
| SIGGEN | 13.8 #D1 | -17.51 |
| BARRE | 66.0 #m3 | -12.76 |
| BARPKGEN | 13.8 #1 | -12.71 |
| RIOHONDO | 66.0 #18 | -12.50 |
| WALNUT | 66.0 #13 | -12.29 |
| OLINDA | 66.0 #1 | -12.07 |
| EME WCG1 | 13.8 #1 | -12.00 |
| BREAPWR2 | 13.8 #C4 | -11.98 |
| ELLIS | 66.0 #17 | -11.98 |
| JOHANNA | 66.0 #15 | -11.42 |
| SANTIAGO | 66.0 #18 | -10.63 |
| DowlingCTG | 13.8 #1 | -9.62 |
| CanyonGT 1 | 13.8 #1 | -9.58 |
| VILLA PK | 66.0 #12 | -9.29 |

Table – Rector

Effectiveness factors to the Rector-Vestal 230 kV line:

| Gen Bus | Gen Name | Gen ID | MW Eff Fctr (%) |
|---------|----------|--------|-----------------|
| 24370 | KAWGEN | 1 | 51 |
| 24306 | B CRK1-1 | 1 | 45 |
| 24306 | B CRK1-1 | 2 | 45 |
| 24307 | B CRK1-2 | 3 | 45 |
| 24307 | B CRK1-2 | 4 | 45 |
| 24319 | EASTWOOD | 1 | 45 |
| 24323 | PORTAL | 1 | 45 |
| 24308 | B CRK2-1 | 1 | 45 |
| 24308 | B CRK2-1 | 2 | 45 |
| 24309 | B CRK2-2 | 3 | 45 |
| 24309 | B CRK2-2 | 4 | 45 |
| 24310 | B CRK2-3 | 5 | 45 |
| 24310 | B CRK2-3 | 6 | 45 |
| 24315 | B CRK 8 | 81 | 45 |
| 24315 | B CRK 8 | 82 | 45 |
| 24311 | B CRK3-1 | 1 | 45 |
| 24311 | B CRK3-1 | 2 | 45 |
| 24312 | B CRK3-2 | 3 | 45 |
| 24312 | B CRK3-2 | 4 | 45 |
| 24313 | B CRK3-3 | 5 | 45 |
| 24317 | MAMOTH1G | 1 | 45 |
| 24318 | MAMOTH2G | 2 | 45 |
| 24314 | B CRK 4 | 41 | 43 |

Appendix B - Effectiveness factors for procurement guidance

24314 B CRK 4 42 43

Table – San Diego

Effectiveness factors to the Imperial Valley – El Centro 230 kV line (i.e., the “S” line):

| GENERATOR | MW Eff Factor (%) |
|--------------------|--------------------------|
| INTBCT 16.0 #1 | 25.42 |
| INTBST 18.0 #1 | 25.42 |
| DW GEN2 G1 0.4 #1 | 25.18 |
| DW GEN1 G1 0.3 #G1 | 25.15 |
| DU GEN1 G2 0.2 #G2 | 25.14 |
| DW GEN1 G2 0.3 #G2 | 25.14 |
| DU GEN1 G1 0.2 #G1 | 25.08 |
| DW GEN3&4 0.3 #1 | 25.08 |
| OCO GEN G1 0.7 #G1 | 22.71 |
| OCO GEN G2 0.7 #G2 | 22.71 |
| ECO GEN1 G 0.7 #G1 | 21.85 |
| Q644G 0.3 #1 | 21.11 |
| OTAYMGT1 18.0 #1 | 17.82 |
| OTAYMGT2 18.0 #1 | 17.82 |
| OTAYMST1 16.0 #1 | 17.82 |
| PIO PICO 1 13.8 #1 | 17.52 |
| PIO PICO 1 13.8 #1 | 17.52 |
| PIO PICO 1 13.8 #1 | 17.52 |
| KUMEYAAY 0.7 #1 | 17.05 |
| EC GEN2 13.8 #1 | 16.91 |
| EC GEN1 13.8 #1 | 16.89 |
| OY GEN 13.8 #1 | 16.82 |
| OTAY 69.0 #1 | 16.81 |
| OTAY 69.0 #3 | 16.81 |
| DIVISION 69.0 #1 | 16.78 |
| NOISLMTR 69.0 #1 | 16.75 |
| SAMPSON 12.5 #1 | 16.69 |
| CABRILLO 69.0 #1 | 16.62 |
| LRKSPBD1 13.8 #1 | 16.56 |
| LRKSPBD2 13.8 #1 | 16.56 |
| POINTLMA 69.0 #2 | 16.56 |
| CALPK_BD 13.8 #1 | 16.55 |

Appendix B - Effectiveness factors for procurement guidance

| | | |
|----------|----------|-------|
| MESAHGTS | 69.0 #1 | 16.48 |
| CARLTNHS | 138.0 #1 | 16.46 |
| CARLTNHS | 138.0 #2 | 16.46 |
| MISSION | 69.0 #1 | 16.39 |
| EASTGATE | 69.0 #1 | 16.25 |
| MEF MR1 | 13.8 #1 | 16.23 |
| CHCARITA | 138.0 #1 | 16.21 |
| MEF MR2 | 13.8 #1 | 16.08 |
| LkHodG1 | 13.8 #1 | 15.60 |
| LkHodG2 | 13.8 #1 | 15.60 |
| GOALLINE | 69.0 #1 | 15.23 |
| PEN_CT1 | 18.0 #1 | 14.98 |
| CALPK_ES | 13.8 #1 | 14.97 |
| ENCINA 2 | 14.4 #1 | 14.96 |
| ES GEN | 13.8 #1 | 14.96 |
| PEN_CT2 | 18.0 #1 | 14.93 |
| PEN_ST | 18.0 #1 | 14.92 |
| SANMRCOS | 69.0 #1 | 14.84 |
| PA GEN1 | 13.8 #1 | 14.40 |
| PA GEN2 | 13.8 #1 | 14.40 |
| BR GEN1 | 0.2 #1 | 13.67 |
| CAPSTRNO | 138.0 #1 | 11.88 |

Resources connected to Imperial Valley substation or nearby SDG&E-owned substations in the area are most effective in mitigating the S-Line overload concern.