

January 18, 2019

The Honorable Kimberly D. Bose
Secretary
Federal Energy Regulatory Commission
888 First Street, NE
Washington, DC 20426

**Re: California Independent System Operator Corporation
Docket: ER15-2565-_____
Energy Imbalance Market Special Report – Transition Period –
August 2018 for Idaho Power Company**

Dear Secretary Bose:

The Department of Market Monitoring (DMM) hereby submits its Energy Imbalance Market (EIM) special report on the transition period of Idaho Power Company (IPCO) during its first six months of participation in the EIM for August 2018. IPCO entered the EIM on April 4, 2018.

Please contact the undersigned directly with any questions or concerns regarding the foregoing.

Respectfully submitted,

By: /s/ Eric Hildebrandt

Eric Hildebrandt
Director of Market Monitoring
California Independent System
Operator Corporation
250 Outcropping Way
Folsom, CA 95630
Tel: (916) 608-7123
Fax: (916) 608-7222
ehildebrandt@caiso.com

California ISO

Report on energy imbalance market issues and performance: Idaho Power for August 2018

January 16, 2019

Prepared by: Department of Market Monitoring

Executive summary

Pursuant to the Commission's October 29, 2015 Order on the ISO's energy imbalance market (EIM), the ISO filed a report on October 11, 2018 covering the period from August 1 through August 31, 2018 (August report) for the Idaho Power area in the energy imbalance market.¹ This report provides a review by the Department of Market Monitoring (DMM) of energy imbalance market performance in the Idaho Power area during the period covered in the ISO's August report. Key findings in this report include the following:

- Prices in the Idaho Power area often tracked similarly to prices in PacifiCorp East on average and remained lower on average than system prices. Price separation between these two areas and the ISO was most pronounced during peak load hours when high system prices caused transfers from these areas to reach their upper scheduling limits. Prices averaged about \$45/MWh in the 15-minute market and \$39/MWh in the 5-minute market.
- Idaho Power did not fail either the upward or downward sufficiency test during the month of August.
- During August, the frequency of valid under supply infeasibilities was very low, occurring during only one interval in the 15-minute market and three intervals in the 5-minute market. Valid over-supply infeasibilities did not occur in the 15-minute or 5-minute markets for Idaho Power during August. On average for the month, transition period pricing decreased average 15-minute and 5-minute market prices by less than \$1/MWh.
- DMM reviewed the results and conclusions in the ISO's August report and found that the results are consistent with those reported in this document.

Section 1 of this report provides a description of prices and power balance constraint relaxations, section 2 discusses the load bias limiter, and section 3 discusses the flexible ramping sufficiency test.

¹ The ISO's August 2018 Report was filed at FERC and posted on the ISO website on October 11, 2018, <http://www.caiso.com/Documents/Oct11-2018-EIMTransitionPeriodReport-IPCO-Aug2018-ER15-2565.pdf>

1 Energy imbalance market prices

Figure 1.1 and Figure 1.2 show hourly average 15-minute and 5-minute prices during August for Idaho Power, PacifiCorp East, and Pacific Gas and Electric (PG&E), as well as the bilateral prices DMM used as an additional benchmark for energy imbalance market prices.

The bilateral price benchmark for Idaho Power is composed of energy prices at the Mid-Columbia hub published by ICE. These are representative of prices used for settling imbalance energy in the Idaho Power area prior to energy imbalance market implementation.

Prices in the Idaho Power area often tracked similarly to prices in PacifiCorp East on average and remained lower on average than system prices. Price separation between these two areas and the ISO was most pronounced during peak load hours when high system prices caused transfers from these areas to reach their upper scheduling limits. Further, average prices in the ISO were high during the month of August, driven in part by high gas prices, seasonally high load, and reduced renewable generation. In the Idaho Power area during the month, prices averaged about \$45/MWh in the 15-minute market and \$39/MWh in the 5-minute market.

Figure 1.1 Average hourly 15-minute price (August 2018)

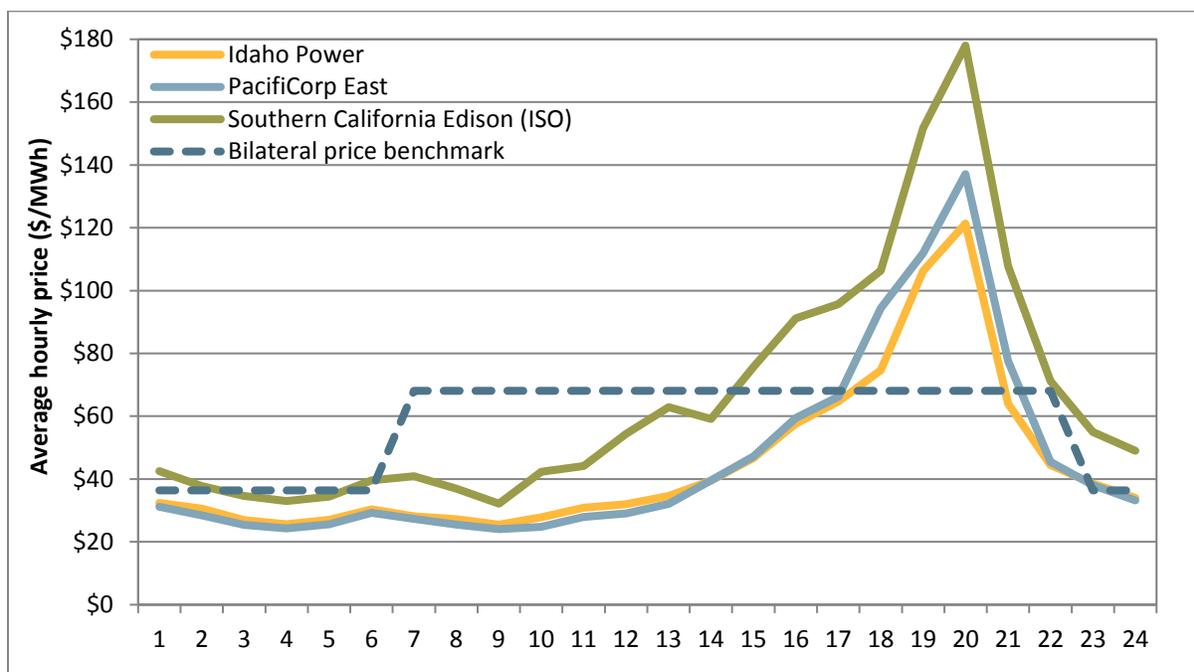
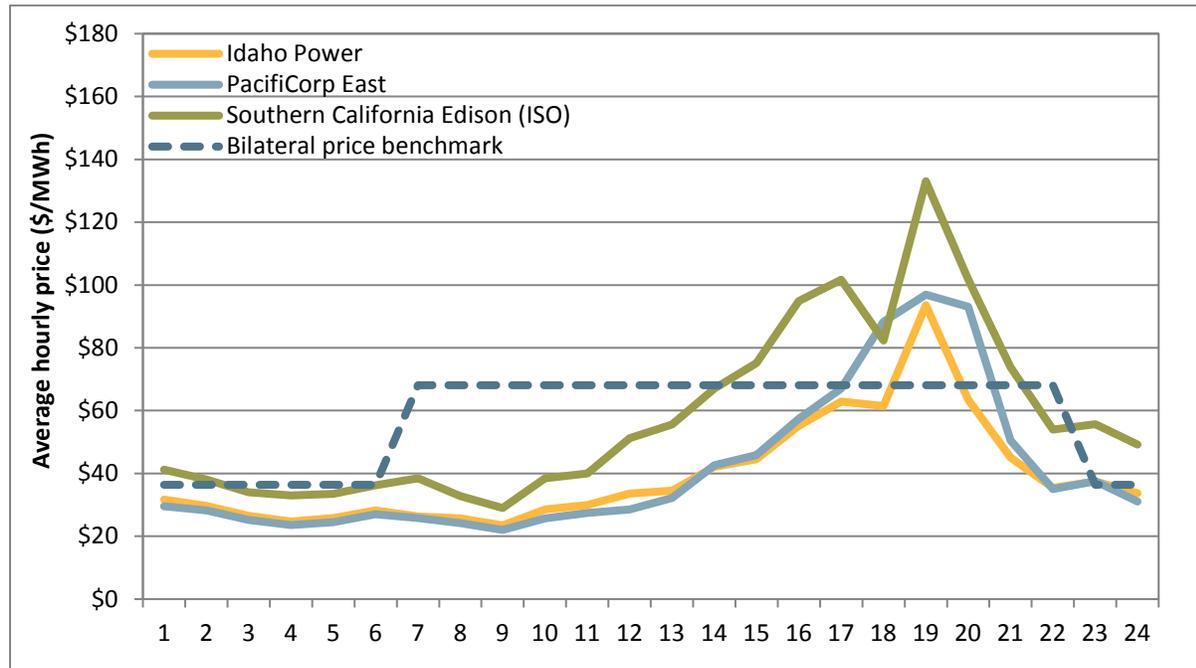


Figure 1.2 Average hourly 5-minute price (August 2018)

All power balance constraint relaxations that occurred in August were subject to the six-month transition period pricing that expires in October 2018. The transition period pricing mechanism sets prices at the highest cost supply bid dispatched to meet demand rather than at the \$1,000/MWh penalty parameter while relaxing the constraint for shortages, or the -\$155/MWh penalty parameter while relaxing the constraint for excess energy.² Power balance constraint relaxations can be grouped in the following categories:

- **Valid under-supply infeasibility** (power balance constraint shortage). These occurred when the power balance constraint was relaxed because load exceeded available generation. The ISO validated that ISO software was working appropriately during these instances.
- **Valid over-supply infeasibility** (power balance constraint excess). These occurred when the power balance constraint was relaxed because generation exceeded load. The ISO validated that ISO software was working appropriately during these instances.
- **Load bias limiter would have resolved infeasibility.** These occurred when a load adjustment entered by operators exceeded the amount of the power balance constraint relaxation and in the same direction. During the transition period, the load bias limiter did not change price outcomes because transition period pricing was applied during these intervals instead. However, in these

² When transition period pricing provisions are triggered by relaxation of the power balance constraint, any shadow price associated with the flexible ramping product is set to \$0/MWh to allow the market software to use the last economic bid dispatched.


cases, the load bias limiter would have reduced the operator adjustment in the pricing run to resolve the infeasibility had transition period pricing not been in effect.

- Correctable infeasibility.** These occurred when the ISO software relaxed the power balance constraint because of either a software error or data error. These required a price correction or would have triggered a price correction if transition period pricing were not active.³

Figure 1.3 and Figure 1.4 show the monthly frequency of under-supply and over-supply infeasibilities, respectively, in the 5-minute market and 15-minute market. As shown in Figure 1.3, the frequency of valid under supply infeasibilities was very low throughout August, occurring during only one interval in the 15-minute market and three intervals in the 5-minute market.

As shown in Figure 1.4, valid over-supply infeasibilities did not occur in the 15-minute or 5-minute markets for Idaho Power during August.

Figure 1.3 Frequency of under-supply power balance infeasibilities by month Idaho Power

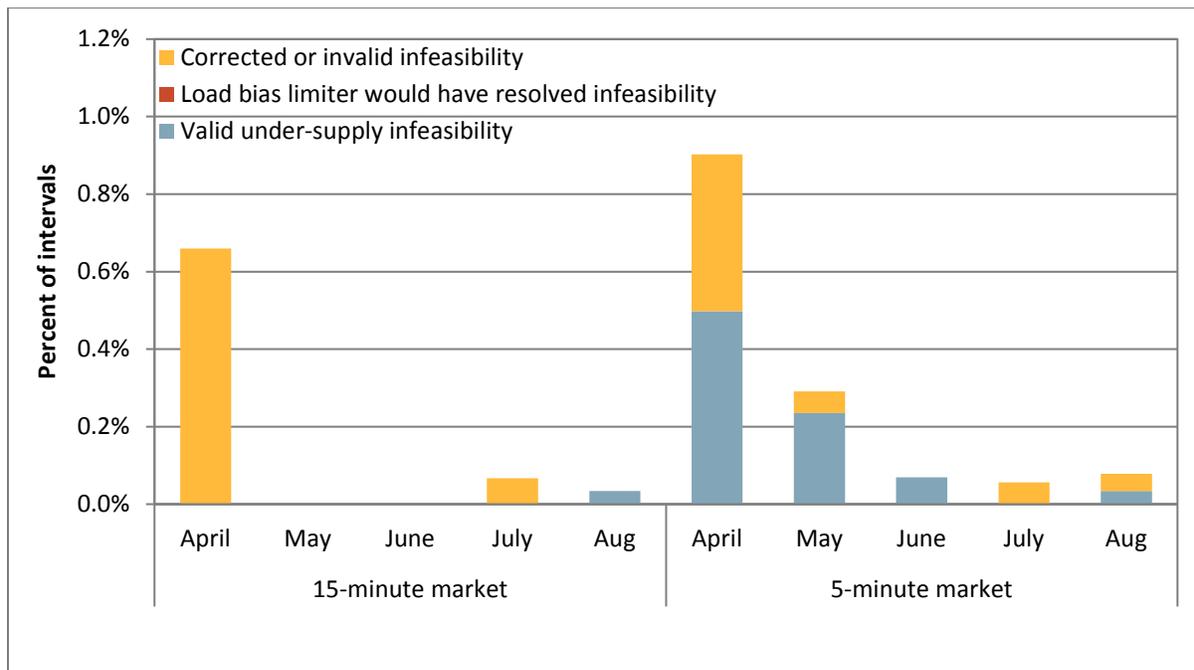

³ Section 35 of the ISO tariff provides the ISO authority to correct prices if it detects an invalid market solution or issues due to a data input failure, occurrence of hardware or software failure, or a result that is inconsistent with the ISO tariff. During erroneous intervals, the ISO determined that prices resulting under transition period pricing were equivalent to prices that would result from a price correction, so no further price adjustment was appropriate. http://www.caiso.com/Documents/Section35_MarketValidationAndPriceCorrection_May1_2014.pdf.

**Figure 1.4 Frequency of over-supply power balance infeasibilities by month
Idaho Power**

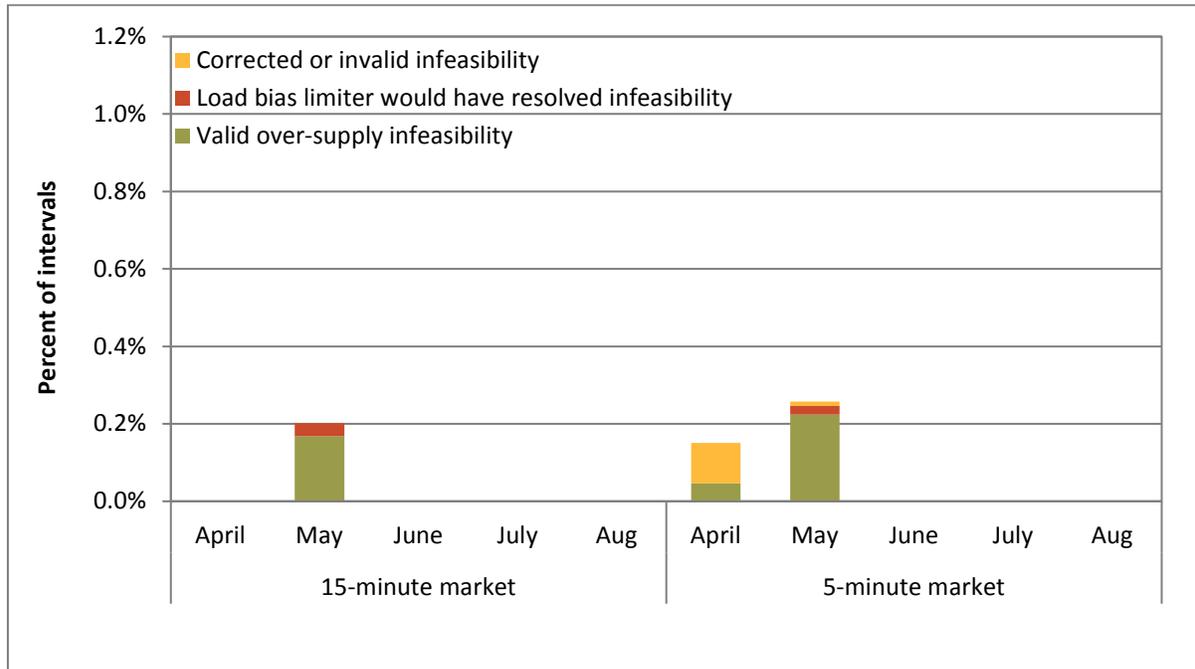


Figure 1.5 and Figure 1.6 show the average monthly prices in the 15-minute market and 5-minute market *with* and *without* the special transition period pricing provisions applied to mitigate prices in the Idaho Power area during August.⁴ These figures also include the average bilateral price benchmark for comparison to Idaho Power prices, depicted by the dashed blue line. Because there was only one valid power balance constraint in the 15-minute market and only three valid power balance constraints in the 5-minute market, prices with and without transition period pricing were mostly converged. On average for the month, transition period pricing decreased average 15-minute and 5-minute market prices by less than \$1/MWh.

⁴ A detailed description of the methodology used to calculate these counterfactual prices that would result without transition period pricing was provided on p. 7 of the January 2017 report for Arizona Public Service from DMM: http://www.caiso.com/Documents/May1_2017_Department_MarketMonitoring_EIMTransitionPeriodReport_ArizonaPublicService_Jan2017_ER15-2565.pdf

Figure 1.5 Average prices by month – Idaho Power (15-minute market)


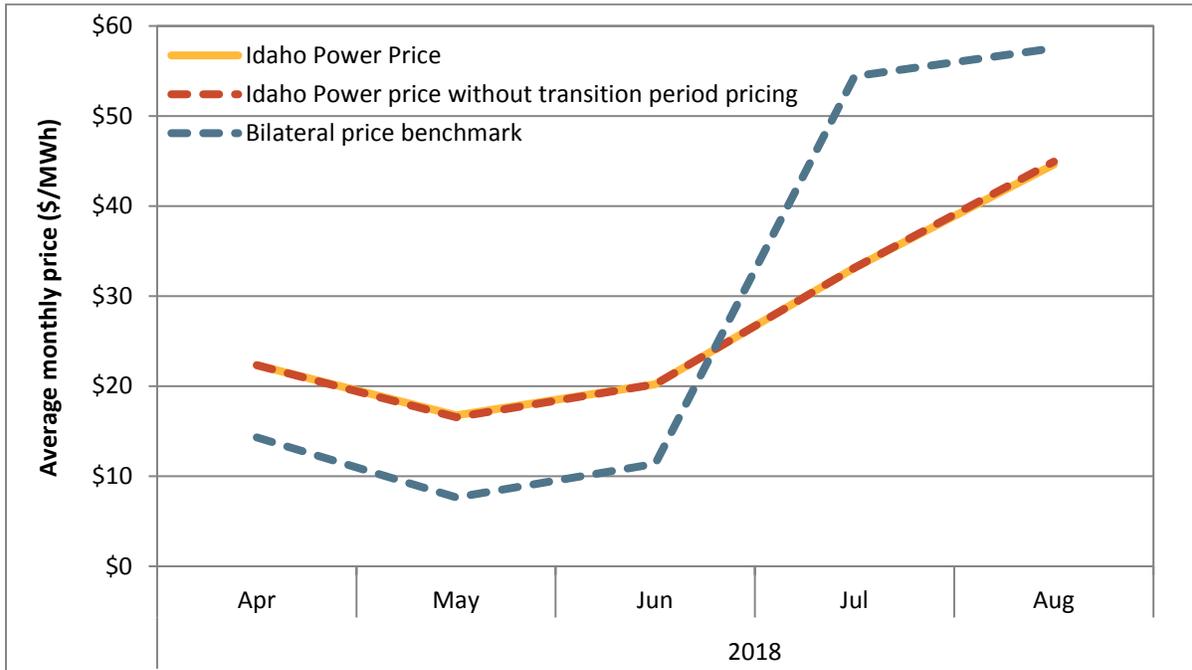


Figure 1.6 Average prices by month – Idaho Power (5-minute market)

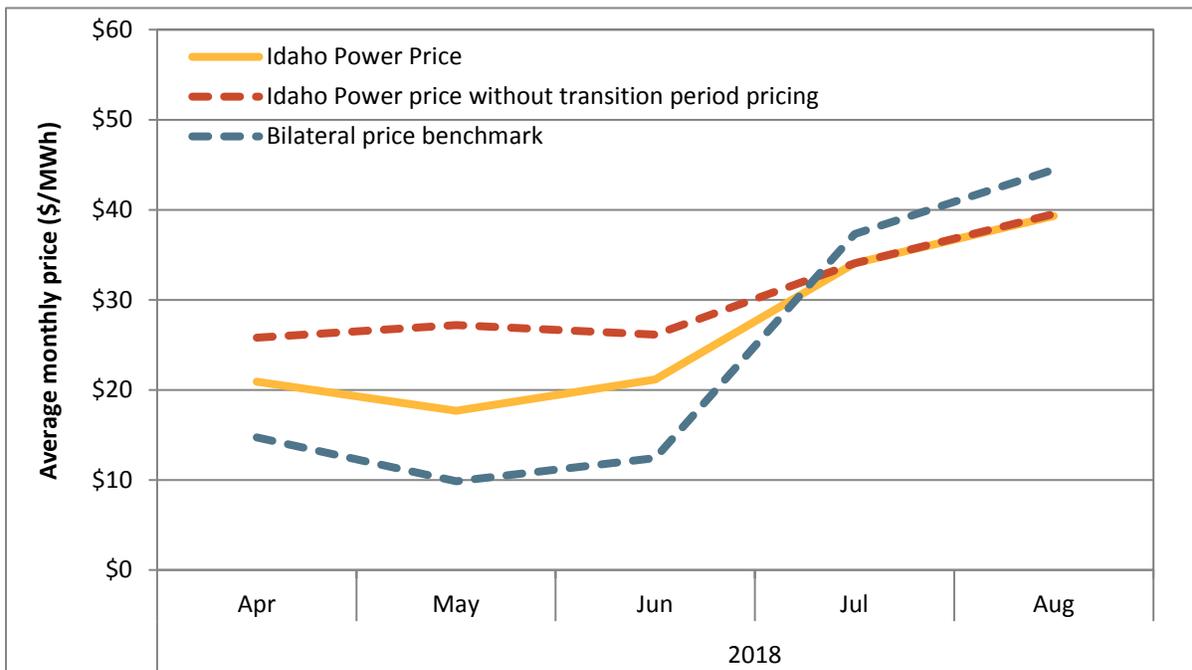

2 Load bias limiter

When the load bias limiter is triggered it has the same effect as the transition period pricing feature and causes prices to be set by the last economic bid dispatched rather than the \$1,000/MWh penalty price for under-supply power balance relaxations or the -\$155/MWh penalty price for over-supply power balance relaxations. A more detailed description of the load bias limiter is included in DMM’s April 2015 report.⁵

Table 2.1 shows average 15-minute and 5-minute market prices with transition period pricing as well as counterfactual estimates for prices without transition period pricing and without either transition period pricing or the load bias limiter. For each of the valid power balance constraint shortages in the month of August, the load bias limiter would have not triggered during any of these shortage infeasibilities. As a result, the load bias limiter would have had no impact on prices had transition period pricing not been in effect.

Table 2.1 Impact of load bias limiter on Idaho Power prices (August 2018)

	Average proxy price	Price with transition period pricing	Estimated price without transition period pricing	Estimated price without transition period pricing or load bias limiter	Potential impact of load bias limiter	
					Dollars	Percent
<i>Idaho Power</i>						
15-minute market (FMM)	\$57.53	\$44.62	\$44.94	\$44.94	\$0.00	0.0%
5-minute market (RTD)	\$57.53	\$39.31	\$39.53	\$39.53	\$0.00	0.0%

⁵ Report on Energy Imbalance Market Issues and Performance, Department of Market Monitoring, April 2, 2015, pp.34-35. http://www.caiso.com/Documents/Apr2_2015_DMM_AssessmentPerformance_EIM-Feb13-Mar16_2015_ER15-402.pdf.

3 Flexible ramping sufficiency test

The flexible ramping sufficiency test ensures that each balancing area has enough ramping resources over each hour to meet expected upward and downward ramping needs. The test is designed to ensure that each energy imbalance market area has sufficient ramping capacity to meet real-time market requirements without relying on transfers from other balancing areas.

When the energy imbalance market was initially implemented there was an upward ramping sufficiency test. In November 2016, the ISO implemented an additional downward ramping sufficiency test in the market with the introduction of the flexible ramping product, which replaced the flexible ramping constraint. If an area fails the upward sufficiency test, energy imbalance market imports cannot be increased.⁶ Similarly, if an area fails the downward sufficiency test, exports cannot be increased. In addition to the sufficiency test, each area is also subject to a capacity test. If an area fails the capacity test, then the flexible ramping sufficiency test automatically fails as a result.⁷


Limiting transfers can impact the frequency of power balance constraint relaxations and, thus, price separation across balancing areas. Constraining transfer capability may also impact the efficiency of the energy imbalance market by limiting transfers into and out of a balancing area that could potentially provide benefits to other balancing areas.

Figure 3.1 shows the frequency that Idaho Power failed the sufficiency test in the upward or downward direction. During the month of August, Idaho Power did not fail the upward or downward sufficiency test. As shown in Figure 3.1, Idaho Power has continued to fail the upward sufficiency test less frequently by month since April.

⁶ *Business Practice Manual for the Energy Imbalance Market*, August 30, 2016, p. 45-52:
https://bpmcm.caiso.com/BPM%20Document%20Library/Energy%20Imbalance%20Market/BPM_for_Energy%20Imbalance%20Market_V6_clean.docx.

⁷ *Business Practice Manual for the Energy Imbalance Market*, August 30, 2016, p. 45.

Figure 3.1 Idaho Power flexible ramping sufficiency test results

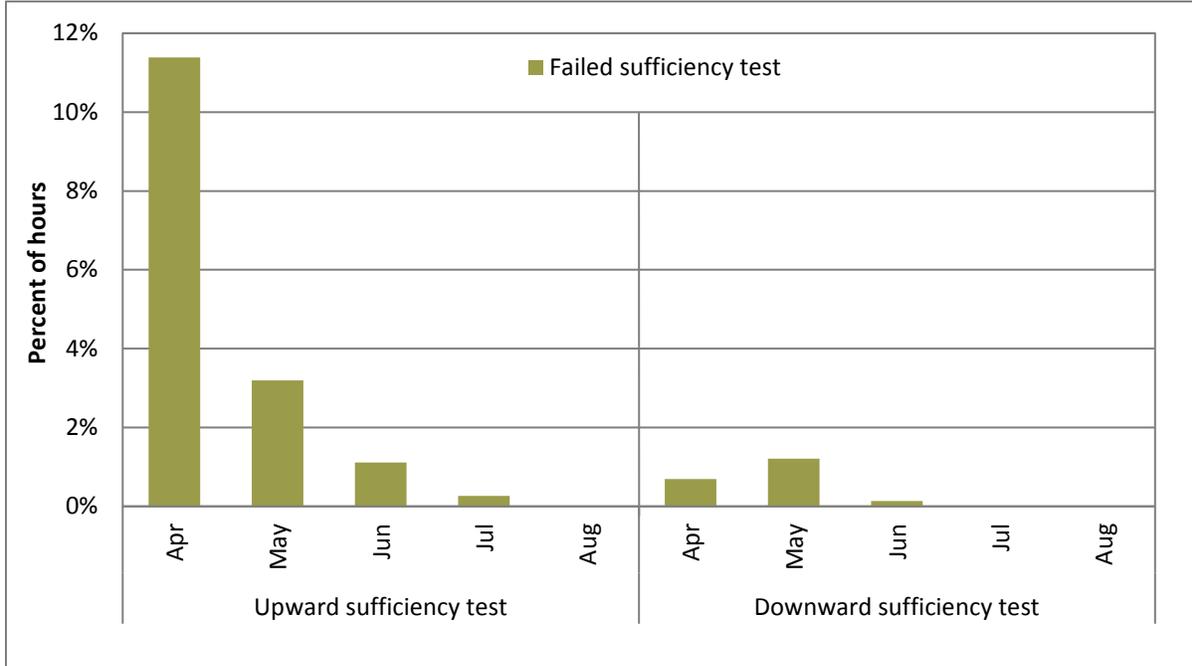

CERTIFICATE OF SERVICE

I certify that I have served the foregoing document upon the parties listed on the official service list in the captioned proceedings, in accordance with the requirements of Rule 2010 of the Commission's Rules of Practice and Procedure (18 C.F.R. § 385.2010).

Dated at Folsom, California, on this 18th day of January, 2019.

1st Grace Clark
Grace Clark