



California ISO

Western Energy Imbalance Market
Resource Sufficiency Evaluation
Metrics Report covering October 2023

November 21, 2023

Prepared by: Department of Market Monitoring

California Independent System Operator

1 Report overview

As part of the Western Energy Imbalance Market (WEIM) resource sufficiency evaluation enhancements stakeholder initiative, DMM is providing additional information and analysis about resource sufficiency evaluation performance, accuracy, and impacts in regular monthly reports.¹ This report provides metrics and analysis covering October 2023.

Report highlights

Resource sufficiency evaluation failures

- **The frequency of capacity or flexibility test failures was low across the WEIM during October.** Public Service Company of New Mexico (PNM) failed the upward flexibility test in around 1.9 percent of intervals. Puget Sound Energy failed the upward flexibility test in around 1.3 percent of intervals. For all other balancing areas, failures for each test type occurred in less than 1 percent of intervals.

Phase 2 resource sufficiency evaluation enhancements

This report includes analysis of phase 2 (track 1) of the resource sufficiency evaluation enhancements implemented on July 1, 2023.

- **Adjustment for real-time low-priority and economic exports in the ISO area resource sufficiency evaluation.** These exports are no longer strictly counted as part of the ISO area demand obligation. The enhancement had no impact on preventing any test failures in October.
- **Implementation of Assistance Energy Transfers (AET).** This option gives balancing areas access to excess WEIM supply that may not have been available otherwise following a resource sufficiency evaluation failure, but are subject to an ex-post surcharge for this energy. Four balancing areas were opted into Assistance Energy Transfers for some period of time during October (Avangrid, NV Energy, NorthWestern Energy, and the ISO area). Avangrid and NorthWestern Energy failed the resource sufficiency evaluation during periods when they had opted in to the program.

Mosaic quantile regression approach for calculating uncertainty

This report includes an overview and analysis on the mosaic quantile regression method implemented on February 1 for calculating net load uncertainty in the flexible ramping test. Key findings of this analysis include the following:

- **Overall, the uncertainty values from the mosaic quantile regression approach were lower on average across all balancing areas compared to those calculated with the prior histogram approach.** However, results of the mosaic quantile regression approach vary more widely, with extremely high or low values in many hours. This variability — combined with the complexity of the mosaic quantile regression approach — can make it more difficult for WEIM balancing areas to plan for and meet flexibility test requirements without significant excess. DMM has published a more detailed review of the mosaic quantile regression approach.² DMM finds that the regression model has limited predictive capability for forecasting net load uncertainty.

¹ California ISO, *EIM Resource Sufficiency Evaluation Enhancements Straw Proposal*, August 16, 2021: <http://www.caiso.com/InitiativeDocuments/StrawProposal-ResourceSufficiencyEvaluationEnhancements.pdf>

² Department of Market Monitoring, *Review of mosaic quantile regression for estimating net load uncertainty*, November 20, 2023: <http://www.caiso.com/Documents/Review-of-the-Mosaic-Quantile-Regression-Nov-20-2023.pdf>

DMM has prepared a more detailed report on the mosaic quantile regression approach that is currently under review by various subject matter experts.

- Current forecast information is ultimately combined with the regression results to calculate uncertainty. In some instances, the balancing areas included in the pass-group for performing the uncertainty regressions is inconsistent from the balancing areas included in the pass-group used to determine the current forecast information. This discrepancy can create significant swings in the calculated flexible ramping product uncertainty target for the group of balancing areas that pass the resource sufficiency evaluation. DMM has requested that the ISO consider options to resolve inconsistencies in the composition of balancing areas in the pass-group.

CAISO non-participating pump load

This report also examines the magnitude of non-participating pump loads in the ISO balancing area that are not included in the ISO area resource sufficiency evaluation.

- Non-participating pump load is included in the ISO area real-time market requirement but is not included in the resource sufficiency evaluation. This can contribute to conditions in which the ISO passes the resource sufficiency evaluation while an Energy Emergency Alert is issued (such as during July). Real-time low priority or economic export schedules and rapidly declining conditions can also contribute to this outcome.

DMM recommends that the ISO and stakeholders consider whether non-participating pump load should be included in the resource sufficiency evaluation. This would better align the conditions in the real-time market with the conditions considered in the resource sufficiency evaluation.

Organization of report

- Section 2 provides an overview of the flexible ramp sufficiency and bid-range capacity tests.
- Section 3 provides an overview of the changes implemented as part of phase 2 (track 1) of resource sufficiency evaluation enhancements. This includes analysis on the following topics:
 - Adjustment for lower priority exports in the ISO area resource sufficiency evaluation.
 - Implementation of Assistance Energy Transfers.
- Section 4 summarizes the frequency and size of resource sufficiency evaluation failures.
- Section 5 provides an overview and analysis on the quantile regression method for calculating uncertainty in the resource sufficiency evaluation. This method was implemented on February 1.
- Section 6 provides an overview of demand differences that can exist between the real-time market and resource sufficiency evaluation. CAISO non-participating pump load is included in the real-time market but not in the resource sufficiency evaluation.
- Section 7 summarizes WEIM import limits and transfers following a resource sufficiency evaluation failure.

DMM continues to welcome feedback on existing or additional metrics and analysis that WEIM entities and other stakeholders would find most helpful. Comments and questions may be submitted to DMM via email at DMM@caiso.com.

2 Overview of the flexible ramp sufficiency and capacity tests

As part of the Western Energy Imbalance Market (WEIM) design, each balancing area (including the California ISO) is subject to a resource sufficiency evaluation. The evaluation is performed prior to each hour to ensure that generation in each area is sufficient without relying on transfers from other balancing areas. The evaluation is made up of four tests: the power flow feasibility test, the balancing test, the bid range capacity test, and the flexible ramp sufficiency test.

The market software automatically limits transfers into a balancing area from other WEIM areas if a balancing area fails either of the following two tests:

- **The bid range capacity test (capacity test)** requires that each area provides incremental bid-in capacity to meet the imbalance between load, inertia, and generation base schedules.
- **The flexible ramp sufficiency test (flexibility test)** requires that each balancing area has enough ramping flexibility over an hour to meet the forecasted change in demand as well as uncertainty.

If an area fails either the flexible ramp sufficiency test or bid range capacity test in the *upward* direction, WEIM transfers into that area cannot be *increased*.³ Similarly, if an area fails either test in the *downward* direction, transfers out of that area cannot be *increased*.

Bid range capacity test

The *bid range capacity test* requires that each area provide incremental (or decremental) bid-in capacity to meet the imbalance between load, inertia, and generation base schedules. Equation 2.1 shows the different components and mathematical formulation of the bid range capacity test. As shown in Equation 2.1, the requirement for the bid range capacity test is calculated as the *load forecast* plus *export base schedules* minus *import and generation base schedules*. Inertia uncertainty was removed on June 1, 2022.

Equation 2.1 Bid range capacity test requirement

$$\begin{array}{c}
 \text{Requirement} = \text{Load} + \text{Export}_{\text{base}} - \text{Import}_{\text{base}} - \text{Generation}_{\text{base}} \\
 \underbrace{\hspace{1.5cm}} \quad \underbrace{\hspace{4.5cm}} \\
 \text{Load forecast} \qquad \qquad \text{Intertie and generation} \\
 \qquad \qquad \qquad \qquad \qquad \text{base schedules}
 \end{array}$$

If the requirement is positive, then the area must show sufficient incremental bid range capacity to meet the requirement, and if the requirement is negative, then sufficient decremental bid range capacity must be shown.

The bid range capacity used to meet the requirement is calculated relative to the base schedules. For the California ISO balancing area, the “base” schedules used in the requirement are the advisory schedules from the last binding 15-minute market run. For all other WEIM areas, the export, import, and generation schedules used in the requirement are the base schedules submitted as part of the hourly

³ If an area fails either test in the upward direction, net WEIM imports during the interval cannot exceed the greater of either the base transfer or optimal transfer from the last 15-minute market interval.

resource plan. Since the bid range capacity is calculated relative to the base schedules, the upward capacity test can generally be expressed as shown in Equation 2.2.⁴

Equation 2.2 Bid range capacity test reformulation

$$\underbrace{Generation_{maximum} + Net\ Import_{maximum}}_{\text{Upward capacity}} \geq \underbrace{Load}_{\text{Load forecast (requirement)}}$$

Incremental bid-in generation capacity is calculated as the range between the generation base schedule and the economic maximum, accounting for upward ancillary services and any de-rates (outages). Other resource constraints including start-times and ramp rates are not considered in the capacity test; 15-minute dispatchable imports and exports are included as bid range capacity.

Flexible ramp sufficiency test

The *flexible ramp sufficiency test* requires that each balancing area has enough ramping resources to meet expected upward and downward ramping needs in the real-time market without relying on transfers from other balancing areas. Each area must show sufficient ramping capability from the start of the hour to each of the four 15-minute intervals within the hour.

Equation 2.3 shows the different components and formulation of the flexible ramp sufficiency test requirement. The requirement for the flexible ramp sufficiency test is calculated as the *forecasted change in load* plus the *uncertainty component* minus two components: (1) the *diversity benefit* and (2) *flexible ramping credits*. Any undersupply infeasibility in the last 15-minute market interval is also accounted for in the flexibility test requirement since June 1, 2022.

Equation 2.3 Flexible ramp sufficiency test requirement

$$\begin{aligned} \text{Up Requirement} &= \Delta\text{Load} + \text{Up uncertainty} - \min \left[\begin{array}{l} \text{Net import capability,} \\ \text{Diversity benefit + Up credit} \end{array} \right] + \text{Undersupply infeasibility} \\ \text{Down Requirement} &= -\Delta\text{Load} + \text{Down uncertainty} - \min \left[\begin{array}{l} \text{Net export capability,} \\ \text{Diversity benefit + Down credit} \end{array} \right] - \text{Undersupply infeasibility} \end{aligned}$$

Change in load forecast
Net load uncertainty
Discounts: diversity benefit and credit reduction capped by transfer capability
Undersupply infeasibility in last 15-minute market interval, excluding imbalance conformance

The diversity benefit reflects that system-level flexible ramping needs are typically smaller than the sum of the needs of individual balancing areas because of reduced uncertainty across a larger footprint. As a result, balancing areas receive a prorated diversity benefit discount based on this proportion.

⁴ DMM has identified cases when the existing incremental approach for the capacity test relative to base schedules does not equal maximum capacity expected under a total approach. The incremental bid-range capacity can be positive only. If maximum capacity at the time of the test run is below base schedules, this difference will not be accounted for in the test. For more information, see DMM's *Comments on EIM Resource Sufficiency Evaluation Enhancements Issue Paper*, September 8, 2021: <https://stakeholdercenter.caiso.com/Common/DownloadFile/25df1561-236b-4a47-9b1c-717b4a9cf9f0>

The flexible ramping credits reflect the ability to reduce exports from a balancing area to increase upward ramping capability or to reduce imports to increase downward ramping capability.

As shown in Equation 2.3, the reduction in the flexibility test requirement because of any diversity benefit or flexible ramping credit is capped by the area's net import capability for the upward direction, or net export capability for the downward direction.

Last, as part of phase 1 of *resource sufficiency evaluation enhancements*, the flexibility test requirement now includes any undersupply infeasibility (power balance constraint relaxation) from the 15-minute market solution immediately prior to the resource sufficiency evaluation hour. This amount excludes any operator imbalance conformance.

Since February 1, 2023, the uncertainty component used in the flexible ramp sufficiency test is calculated using a regression method which considers forecasted net load currently on the system.⁵ The measured uncertainty reflects extreme historical net load errors (95 percent confidence interval) adjusted to reflect forecasted conditions. The net load error observations used to calculate uncertainty in the resource sufficiency evaluation are measured from the difference between (1) binding 5-minute market net load forecasts and (2) the corresponding advisory 15-minute market net load forecast.

⁵ California ISO, *Flexible Ramping Product Refinements Final Proposal*, August 31, 2020:
<http://www.caiso.com/InitiativeDocuments/FinalProposal-FlexibleRampingProductRefinements.pdf>

3 Resource sufficiency evaluation enhancements phase 2

Phase 2 (track 1) of the resource sufficiency evaluation enhancements was implemented on July 1, 2023. This included the following enhancements:

- **Adjustment for real-time low-priority and economic exports in the ISO area resource sufficiency evaluation.** These exports are no longer strictly counted as part of the ISO area demand obligation.
- **Implementation of Assistance Energy Transfers (AET).** This new option gives balancing areas access to excess WEIM supply that may not have been available otherwise following a resource sufficiency evaluation failure. Balancing areas can opt into AET to prevent their WEIM transfers from being limited during a test failure but will be subject to an ex-post surcharge.

More detailed information on each of these enhancements is discussed in the following sections.

Adjustment for lower priority exports in the ISO area resource sufficiency evaluation

Export schedules in the market can be based on economic bids or be self-scheduled (price-taking). The market defines different levels of prioritization for self-scheduled exports. The highest priority is given to Existing Transmission Contract (ETC) and Transmission Ownership Right (TOR) export schedules. Next, exports that are supported by non-resource adequacy capacity are given high-priority. Low-priority exports are those which are not supported by non-resource adequacy capacity. Within this category, export schedules that clear the residual unit commitment process can be self-scheduled in the real-time market with day-ahead priority (DA-LPT). Real-time low-priority price-taking (RT-LPT) exports are instead self-scheduled directly in real-time.

RT-LPT and economic exports that clear the hour-ahead scheduling process (HASP) are effectively no longer counted against the ISO area obligation in the resource sufficiency evaluation. During phase 1 of the initiative, analysis by the ISO showed the potential for advisory WEIM imports to support additional exports in HASP.⁶ These hourly exports would then be counted against the ISO area in the resource sufficiency evaluation but may not have existed without WEIM imports to balance these. Further, it was identified that these real-time low-priority and economic exports could be curtailed by ISO operators during tight system conditions subject to operator judgement and consistent with good utility practices.⁷ As a result, these export schedules were adjusted in the ISO area capacity and flexibility tests on July 1, 2023. In effect, only higher-priority exports as well as exports that were scheduled through the ISO residual unit commitment process are counted in the ISO area demand obligation.⁸

During October, the enhancement had no impact on the ISO area passing or failing the resource sufficiency evaluation. The ISO area would have still passed the capacity and flexibility test during all intervals in October had real-time low priority and economic exports been strictly counted against the demand obligation.

⁶ California ISO, *Interaction of Hourly Intertie Schedules and WEIM Transfers*, April 26, 2022: <http://www.caiso.com/InitiativeDocuments/AnalysisReport-InteractionofHourlyIntertieSchedulesandTransfers-WEIMResourceSufficiencyEvaluationEnhancements.pdf>

⁷ California ISO, *WEIM RSE Enhancements Phase 2 Second Revised Final Proposal*, December 6, 2022: <http://www.caiso.com/InitiativeDocuments/SecondRevisedFinalProposal-WEIMResourceSufficiencyEvaluationEnhancementsPhase2.pdf>

⁸ Including Existing Transmission Contract (ETC) and Transmission Ownership Right (TOR) export schedules.

Adjustment for lower priority exports in the *capacity test*

The upward capacity test requires that each balancing area show incremental available capacity to meet the imbalance between load, inertia, and generation “base” schedules. For the ISO balancing area, the “base” schedules used in the requirement are the advisory schedules from the last binding 15-minute market run, which includes all exports that cleared the hour-ahead scheduling process. Prior to the enhancements in July, all export schedules were included in the ISO area obligation (or test requirement) as extra demand while only *15-minute dispatchable* export schedules were counted as incremental available capacity since these could be dispatched down.

Following the enhancements, all export schedules are still included in the ISO area demand obligation, but both real-time low-priority and economic export schedules are now counted as incremental available capacity on the other side of the equation. This effectively removes these exports from the capacity test as the additional exports in the test requirement are cancelled out by additional available capacity.⁹ For example, assume that there is a real-time low priority export schedule of 75 MW in HASP. The 75 MW would still be counted as part of the obligation in the capacity test requirement, but this would be offset by 75 MW of upward available capacity counted towards meeting the requirement.

Adjustment for lower priority exports in the *flexibility test*

The flexibility test requires that each balancing area show sufficient flexibility over the evaluation hour to meet the forecasted change in demand as well as net load uncertainty. Flexible ramping capacity counted towards the requirement includes both economic energy bids which can be dispatched, as well as changes in fixed energy schedules from the binding interval immediately prior to the evaluation hour to each of the four intervals within the evaluation hour.

Prior to the enhancements, any change to an *hourly* inertia schedule from the previous hour to the evaluation hour was accounted for in the total flexible ramping capacity. So, an increase to an hourly export schedule (or decrease to an hourly import schedule) from the previous hour to the next would be counted as negative upward ramping capacity.¹⁰ *15-minute-dispatchable* exports were instead counted as upward ramping capacity based on the schedule in the market interval immediately prior to the evaluation hour. This reflects that these export schedules can be decrementally dispatched down to zero.

Following the enhancements, all real-time low-priority (RT-LPT) and economic export schedules are now counted as upward flexible capacity based on its schedule in the market interval immediately prior to the evaluation hour. For example, assume that in HASP there is RT-LPT export schedule of 50 MW in the previous hour and 75 MW during the evaluation hour. Prior to the enhancements, this change would have been counted as 25 MW of negative upward ramping capacity because of the fixed increase in demand. Following the enhancements, this would be counted as 50 MW of positive upward ramping capacity. All export schedules of higher priority than RT-LPT and economic are still counted in the flexibility test based on the change in the hourly schedule.

⁹ DMM has identified cases in which the upward available capacity counted for a low-priority or economic export exceeds the contribution of the export to the capacity test requirement. This can occur in the first 15-minute interval of the evaluation hour when the export schedule is increasing based on the difference between the more granular ramp-constrained dispatch and the hourly block schedule. A fix is underway.

¹⁰ Alternatively, a decrease to an hourly export schedule (or increase to an hourly import schedule) from the previous hour to the next would be counted as positive upward ramping capacity.

Assistance Energy Transfers

Assistance Energy Transfers (AET) gives balancing areas access to excess WEIM supply that may not have been available otherwise following an upward resource sufficiency evaluation failure. Without AET, a balancing area failing either the upward flexibility or upward capacity test would have net WEIM imports limited to the greater of either the base transfer or the optimal transfer from the last 15-minute market interval. Balancing areas can voluntarily opt in to the AET program to prevent their WEIM transfers from being limited during an upward resource sufficiency evaluation failure, but will be subject to an ex-post surcharge. Balancing areas must opt in or opt out of the program in advance of the trade date.¹¹

The Assistance Energy Transfer surcharge is applied during any interval in which an opt-in balancing area fails the upward flexibility or capacity test. The surcharge is calculated as the *applicable real-time assistance energy transfer* times the real-time bid cap.¹² The applicable AET quantity is based on the lesser of either (1) the tagged dynamic WEIM transfers or (2) the amount by which the balancing area failed the resource sufficiency evaluation. If the tagged dynamic WEIM transfers are less than the amount by which the balancing area failed the resource sufficiency evaluation, then the applicable AET quantity is also reduced by a credit. The credit is either upward available balancing capacity for WEIM entities or cleared regulation up for the the ISO balancing area.


Four balancing areas were opted into Assistance Energy Transfers during October (Avangrid, NV Energy, NorthWestern Energy, and the ISO area).¹³ The horizontal lines in Figure 3.1 show the days in which a balancing area opted in to the program during October. The vertical bars show the number of 5-minute market intervals in which a balancing area failed the resource sufficiency evaluation after opting in to AET. These are the intervals in which the WEIM import limit following a resource sufficiency evaluation failure were removed — giving the WEIM entity access to WEIM supply that may not have been available otherwise. During the month, there were very few intervals in which a balancing area both opted into AET and failed the resource sufficiency evaluation.

¹¹ Assistance Energy Transfer designation requests are submitted to Master File as *opt-in* or *opt-out* and include both a start and end date. The standard timeline to implement an opt-in or opt-out request is at least five business days in advance of the start date. An *emergency* opt-in request is also available, should reliability necessitate this, for two business days in advance of the start date. For more information, see: <https://bpmcm.caiso.com/Pages/ViewPRR.aspx?PRRID=1525&IsDlg=0>

¹² The soft bid cap is \$1,000/MWh and can increase to the hard bid cap of \$2,000/MWh under certain conditions.

¹³ The ISO balancing area can opt-in to Assistance Energy Transfers (AET) based on upcoming system conditions and operator experience. For more information, see the Business Practice Manual for the Western Energy Imbalance Market, section 11.3.2: <https://bpmcm.caiso.com/Pages/BPMDetails.aspx?BPM=Energy%20Imbalance%20Market>. The ISO area did not fail the resource sufficiency evaluation during an AET opt-in period.

Figure 3.1 5-minute market failure intervals under Assistance Energy Transfer opt-in (October 2023)

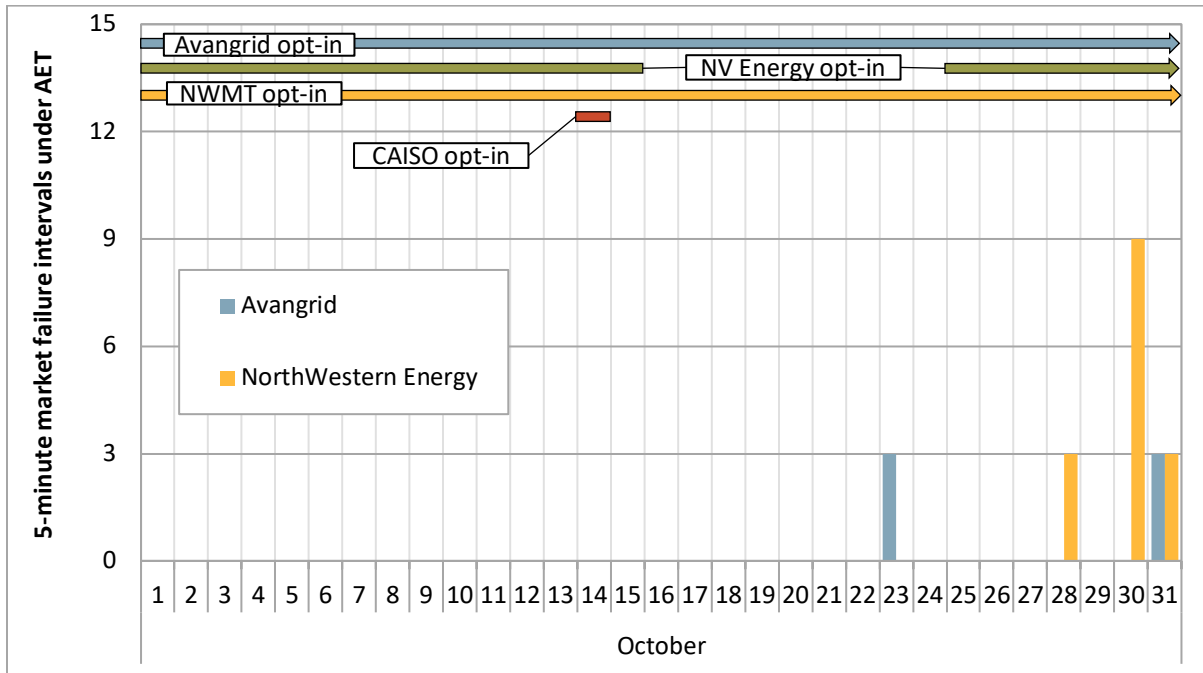

Opting in to the Assistance Energy Transfer program does not guarantee that the balancing area will achieve additional WEIM supply following a resource sufficiency evaluation failure (compared to opting out of the program). It only removes the import limit that would have been in place following a test failure, allowing the market to freely and optimally schedule WEIM transfers based on supply and demand conditions in the system. If the import limit following a test failure was set high such that it is not restricting the optimal solution, then opting in or opting out of the program will have no effect on WEIM import supply in that interval. In this scenario, the balancing area will still be subject to an ex-post surcharge. This is shown in Figure 3.2.

The example in Figure 3.2 highlights the impact of assistance energy transfer opt-in, when the import limit following a resource sufficiency evaluation failure is high (and not restrictive) or low (and restrictive). In this example, the optimal WEIM import in the 5-minute market without any limit is 100 MW and the balancing area failed the resource sufficiency evaluation by 150 MW. The example also assumes that there is no available balancing capacity or regulation credit such that the applicable assistance energy transfer quantity equals the 5-minute market transfer.

The example highlights two conditions — in which the WEIM import limit following the resource sufficiency evaluation failure is high at 200 MW or low at 25 MW. In the cases when the WEIM import limit is *high* (and not restrictive on the solution), opting in to the program has no effect on achieving additional energy, but would result in an ex-post surcharge. Alternatively, in the cases when the WEIM import limit is *low* (and restricting transfers), opting in to the program will achieve additional energy (75 MW in this example). In both cases, opting in to receiving assistance energy transfers results in the same surcharge.

Figure 3.2 Example — impact of assistance energy transfer opt-in when WEIM import limits are high or low


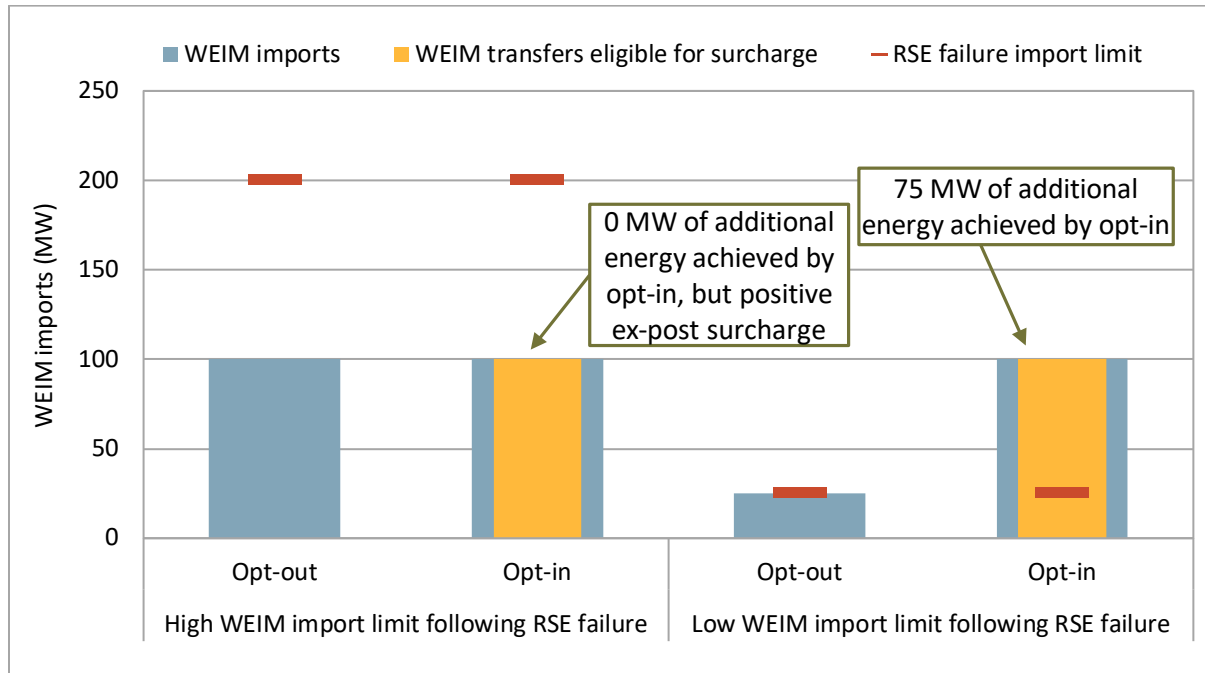


Figure 3.3 summarizes import limits following a resource sufficiency evaluation failure for both balancing areas that opted out or opted in to the Assistance Energy Transfer program.¹⁴

- The black horizontal line (right axis) shows the number of 5-minute market intervals with either a capacity or flexibility test failure.
- The blue bars (left axis) show the percent of 5-minute market failure intervals in which the resulting transfers after failing the resource sufficiency evaluation were *below* the import limit that was imposed (or would have been imposed for opt-in balancing areas). During these intervals, the optimal WEIM transfer was below the import limit such that an opt-in designation would have no effect on achieving additional energy.
- In all other failure intervals (red bars), the resulting transfers were either constrained to the limit imposed after failing the test or would have been constrained by the limit without an opt-in designation. During these intervals, additional WEIM transfers into the balancing area could have occurred through participation in the assistance energy transfer program.

¹⁴ Balancing areas that did not fail either the capacity or the flexibility tests during this period are not included in the figure.

Figure 3.3. Percent of upward 5-minute failure intervals in which WEIM imports were constrained or would have been constrained by test failure limits (October 2023)

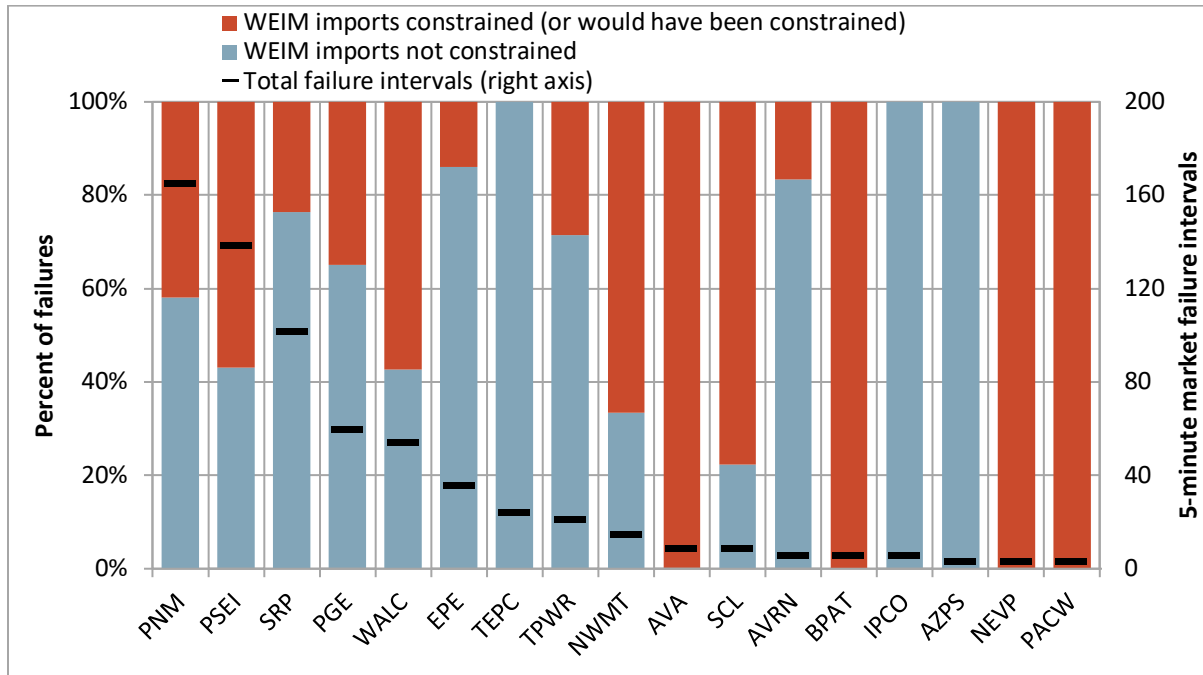

4 Frequency of resource sufficiency evaluation failures

This section summarizes the frequency and shortfall amount for bid-range capacity test and flexible ramping sufficiency test failures.¹⁵ If a balancing area fails either (or both) of these tests, then transfers between that and the rest of the WEIM areas are limited.

Figure 4.1 through Figure 4.4 show the percent of 15-minute intervals in which each WEIM area failed the upward capacity or the flexibility tests as well as the average shortfall of those test failures.¹⁶ Figure 4.5 through Figure 4.8 provide the same information for the downward direction. The dash indicates that the area did not fail the test during the month.

In October:

- Public Service Company of New Mexico (PNM) failed the upward flexibility test in around 1.9 percent of intervals.
- Puget Sound Energy failed the upward flexibility test in around 1.3 percent of intervals.
- All other balancing areas failed for each test type in less than 1 percent of intervals.

Net load uncertainty — which is added to the flexibility test requirement — was adjusted on February 1, 2023 as part of flexible ramping enhancements. The uncertainty was adjusted to incorporate current load, solar, and wind forecast information using a technique called *mosaic quantile regression*. This regression combines both histogram and quantile regression models to estimate the lower and upper extremes of uncertainty that might materialize. For more information on this regression, see Section 5. The capacity test currently does not include any net load uncertainty adder in the requirement.

Figure 4.9 shows the change in the percent of intervals with an upward test failure from October 2022 to October 2023. Figure 4.10 shows the same information for downward test failures.

Figure 4.11 summarizes the overlap between failure of the upward capacity and the flexibility tests during the month. The black horizontal line (right axis) shows the number of 15-minute intervals with either a capacity or a flexibility test failure for each WEIM area. The areas are shown in descending number of failure intervals. The bars (left axis) show the percent of the failure intervals that meet the condition. Figure 4.12 shows the same information for the downward direction. Areas that did not fail either the capacity or the flexibility tests during this period were omitted from the figure. Across both directions, the flexibility test was more often the source of the resource sufficiency evaluation failure.

¹⁵ Results in this section exclude known invalid test failures. These can occur because of a market disruption, software defect, or other errors.

¹⁶ Results in these figures reflect the final resource sufficiency evaluation (40 minutes prior to the evaluation hour).

Figure 4.1 Frequency of upward capacity test failures (percent of 15-minute intervals)

Arizona Publ. Serv.	—	—	—	—	0.1	0.4	0.5	0.7	0.2	0.0	0.1	—	—	—	0.0
Avangrid									0.0	—	—	—	—	0.8	—
Avista	0.0	—	—	—	0.1	—	—	—	0.1	0.0	—	—	—	—	0.0
BANC	0.0	0.3	—	—	—	—	—	—	—	—	—	—	—	—	—
BPA	0.0	0.5	—	—	0.4	—	—	—	0.2	—	0.3	0.4	—	0.1	—
California ISO	—	0.1	—	—	—	—	—	—	—	—	—	—	—	—	—
El Paso Electric									0.0	0.1	0.3	0.8	0.0	0.1	0.1
Idaho Power	0.2	0.2	—	—	—	—	—	—	0.0	0.1	—	—	—	—	—
LADWP	—	—	—	—	—	0.1	—	—	—	—	—	0.1	0.0	—	—
NorthWestern En.	0.1	0.1	—	0.2	0.1	0.3	0.1	—	—	—	—	0.3	—	—	—
NV Energy	—	—	—	—	—	—	—	—	—	0.0	—	0.0	0.0	—	0.0
PacifiCorp East	—	0.1	—	—	0.3	—	—	—	—	—	—	0.0	—	—	—
PacifiCorp West	0.2	0.0	—	0.0	0.0	0.1	0.1	—	—	—	—	—	0.1	—	—
Portland Gen. Elec.	0.1	—	—	0.3	—	—	0.0	0.0	0.1	0.4	0.1	0.0	—	0.0	0.0
Powerex	0.2	—	—	0.0	—	—	—	—	—	0.1	—	—	—	0.1	0.0
PSC of New Mexico	—	—	—	—	—	—	—	0.7	0.3	0.2	0.0	—	0.0	0.1	0.1
Puget Sound En.	—	0.2	0.1	0.0	—	—	0.0	0.2	—	0.1	0.5	1.5	0.5	0.2	0.7
Salt River Proj.	0.4	0.4	0.2	0.0	0.0	1.0	0.4	1.1	0.9	0.2	0.0	2.8	1.2	0.0	0.8
Seattle City Light	0.1	0.2	0.0	0.0	0.2	0.0	0.1	—	—	—	—	0.1	0.9	—	0.1
Tacoma Power	0.2	0.0	—	—	—	0.0	0.1	0.1	—	0.1	—	—	0.1	—	0.1
Tucson Elec. Pow.	0.1	—	—	—	—	0.1	0.0	—	—	—	—	0.3	—	—	0.2
Turlock Irrig. Dist.	—	—	—	—	0.2	—	—	—	0.0	—	—	0.1	—	—	—
WAPA DSW									2.3	0.8	0.7	1.1	0.6	0.1	0.3
	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct
	2022					2023									

Figure 4.2 Average shortfall of upward capacity test failures (MW)

Arizona Publ. Serv.	—	—	—	—	32	316	41	817	637	35	192	—	—	—	58
Avangrid									1	—	—	—	—	190	—
Avista	5	—	—	—	9	—	—	—	20	1	—	—	—	—	2
BANC	37	264	—	—	—	—	—	—	—	—	—	—	—	—	—
BPA	8	336	—	—	68	—	—	—	55	—	238	118	—	73	—
California ISO	—	141	—	—	—	—	—	—	—	—	—	—	—	—	—
El Paso Electric									6	8	88	20	8	6	18
Idaho Power	60	37	—	—	—	—	—	—	23	12	—	—	—	—	—
LADWP	—	—	—	—	—	49	—	—	—	—	—	10	18	—	—
NorthWestern En.	86	64	—	91	40	56	68	—	—	—	—	70	—	—	—
NV Energy	—	—	—	—	—	—	—	—	—	53	—	3	41	—	12
PacifiCorp East	—	124	—	—	293	—	—	—	—	—	—	116	—	—	—
PacifiCorp West	36	4	—	17	16	9	84	—	—	—	—	—	26	—	—
Portland Gen. Elec.	1	—	—	25	—	—	38	13	1	19	12	24	—	0	17
Powerex	142	—	—	50	—	—	—	—	—	131	—	—	—	154	2
PSC of New Mexico	—	—	—	—	—	—	—	52	24	106	5	—	25	4	48
Puget Sound En.	—	13	24	5	—	—	15	22	—	26	45	29	28	48	48
Salt River Proj.	214	132	30	17	26	44	44	54	30	38	1	65	56	80	56
Seattle City Light	9	7	5	2	16	2	16	—	—	—	—	2	6	—	5
Tacoma Power	6	0	—	—	—	0	5	0	—	2	—	—	7	—	5
Tucson Elec. Pow.	20	—	—	—	—	65	1	—	—	—	—	54	—	—	12
Turlock Irrig. Dist.	—	—	—	—	1	—	—	—	2	—	—	8	—	—	—
WAPA DSW									133	74	5	18	4	13	7
	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct
	2022					2023									

Figure 4.3 Frequency of upward flexibility test failures (percent of 15-minute intervals)

Arizona Publ. Serv.	0.1	—	—	0.1	0.4	0.9	1.8	2.5	1.1	0.2	0.1	—	0.0	—	—
Avangrid									1.0	0.7	0.1	0.2	0.0	0.9	0.1
Avista	0.1	—	0.1	—	0.1	—	0.0	0.0	0.2	0.2	0.0	—	—	—	0.1
BANC	—	0.3	—	—	—	—	—	—	—	0.1	—	—	—	—	—
BPA	1.0	1.1	0.2	0.1	0.4	—	0.1	0.6	0.2	1.2	0.3	1.3	0.2	0.2	0.1
California ISO	0.1	0.5	0.0	—	—	—	—	—	—	—	—	—	—	—	—
El Paso Electric									0.8	0.7	0.3	2.1	0.5	0.6	0.4
Idaho Power	0.2	0.5	—	0.1	—	0.0	0.1	0.3	0.3	0.5	0.1	—	—	—	0.1
LADWP	—	0.1	0.1	—	—	—	0.3	—	0.1	0.0	0.1	0.0	0.2	0.0	—
NorthWestern En.	1.0	0.2	—	0.5	0.8	0.3	0.1	0.2	0.8	0.3	0.2	1.0	0.4	0.2	0.2
NV Energy	0.1	0.1	0.1	0.2	0.0	0.1	0.3	0.0	0.1	0.1	0.0	0.1	0.2	0.1	—
PacifiCorp East	0.1	—	0.1	—	0.0	0.1	—	0.0	0.1	—	0.0	0.2	—	—	—
PacifiCorp West	0.1	0.1	—	0.1	—	0.1	0.1	—	0.1	0.6	0.0	0.2	—	—	0.0
Portland Gen. Elec.	0.1	0.1	0.2	1.0	0.1	0.0	0.1	0.0	0.1	1.5	0.7	0.1	—	—	0.6
Powerex	0.3	0.1	—	—	—	—	0.2	—	—	—	—	—	—	—	—
PSC of New Mexico	—	0.0	0.2	0.1	0.8	0.2	—	1.2	5.1	0.9	0.6	0.7	0.5	0.3	1.9
Puget Sound En.	0.2	0.3	—	0.0	—	—	0.1	0.8	0.2	1.0	0.6	2.6	1.3	0.2	1.3
Salt River Proj.	1.1	0.6	0.6	0.5	0.8	3.5	1.2	1.7	2.0	0.6	0.2	3.7	1.1	0.3	0.6
Seattle City Light	0.0	0.2	—	0.1	0.0	—	0.1	—	—	—	—	—	0.5	0.0	0.0
Tacoma Power	0.1	0.1	—	0.2	—	0.2	0.1	0.2	—	0.1	—	—	—	—	0.2
Tucson Elec. Pow.	—	0.4	0.0	—	0.2	0.3	0.3	0.3	0.1	0.1	—	0.2	0.3	—	0.1
Turlock Irrig. Dist.	—	0.1	—	—	1.2	—	—	—	0.0	—	—	0.1	—	—	—
WAPA DSW									2.7	0.7	0.8	0.3	0.6	0.2	0.3
	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct
	2022					2023									

Figure 4.4 Average shortfall of upward flexibility test failures (MW)

Arizona Publ. Serv.	28	—	—	15	65	154	77	288	119	36	76	—	88	—	—
Avangrid									79	13	9	20	26	138	60
Avista	30	—	5	—	11	—	13	12	35	14	4	—	—	—	21
BANC	—	237	—	—	—	—	—	—	—	64	—	—	—	—	—
BPA	56	232	43	42	114	—	36	62	99	82	164	114	44	41	5
California ISO	684	671	53	—	—	—	—	—	—	—	—	—	—	—	—
El Paso Electric									24	15	123	19	34	9	17
Idaho Power	34	45	—	14	—	5	51	28	42	24	46	—	—	—	10
LADWP	—	36	9	—	—	—	45	—	21	30	56	51	102	14	—
NorthWestern En.	22	83	—	45	30	44	16	40	14	33	11	32	20	6	11
NV Energy	80	88	41	91	69	60	69	29	164	59	24	52	207	12	—
PacifiCorp East	43	—	16	—	13	53	—	101	47	—	18	36	—	—	—
PacifiCorp West	31	28	—	62	—	14	79	—	30	146	2	35	—	—	22
Portland Gen. Elec.	25	16	19	46	12	39	16	9	61	49	37	27	—	—	25
Powerex	318	101	—	—	—	—	86	—	—	—	—	—	—	—	—
PSC of New Mexico	—	22	38	39	36	19	—	45	47	26	21	35	56	20	56
Puget Sound En.	17	21	—	29	—	—	45	46	29	59	48	55	43	18	86
Salt River Proj.	156	72	61	38	67	47	39	48	54	72	53	77	50	90	43
Seattle City Light	2	8	—	4	6	—	23	—	—	—	—	—	16	29	6
Tacoma Power	5	3	—	16	—	6	3	6	—	21	—	—	—	—	9
Tucson Elec. Pow.	—	44	5	—	97	67	28	31	36	30	—	35	21	—	13
Turlock Irrig. Dist.	—	3	—	—	6	—	—	—	1	—	—	12	—	—	—
WAPA DSW									71	122	21	9	21	14	16
	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct
	2022					2023									

Figure 4.5 Frequency of downward capacity test failures (percent of 15-minute intervals)

Arizona Publ. Serv.	—	—	—	—	0.1	—	—	—	0.6	—	—	—	—	—	—
Avangrid	—														
Avista	—	—	0.0	—	—	—	—	—	0.0	—	—	—	—	—	—
BANC	—														
BPA	—	0.1	—	—	—	—	0.1	—	0.2	0.1	—	—	—	—	—
California ISO	—														
El Paso Electric	—								0.2	0.1	0.3	0.2	0.1	0.2	—
Idaho Power	—														
LADWP	—	—	—	—	—	0.1	—	—	—	—	0.0	—	—	—	—
NorthWestern En.	—														
NV Energy	—	—	—	—	—	—	—	—	0.1	0.1	0.6	0.1	—	—	—
PacifiCorp East	—														
PacifiCorp West	—														
Portland Gen. Elec.	—														
Powerex	0.0	—	—	0.0	—	—	—	—	—	—	—	—	0.0	—	—
PSC of New Mexico	—	—	—	—	—	—	—	0.1	0.3	—	—	—	—	—	0.1
Puget Sound En.	—														
Salt River Proj.	0.2	1.1	0.2	0.3	—	0.4	1.5	0.2	0.3	0.6	0.4	0.7	—	0.1	0.1
Seattle City Light	—	0.2	—	—	—	—	0.1	—	—	—	—	—	—	0.3	0.1
Tacoma Power	0.3	—	0.1	—	0.2	—	0.2	0.1	—	—	—	—	0.0	—	0.0
Tucson Elec. Pow.	—														
Turlock Irrig. Dist.	—														
WAPA DSW	—								0.2	—	0.8	0.1	0.4	0.5	0.2
	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct
	2022					2023									

Figure 4.6 Average shortfall of downward capacity test failures (MW)

Arizona Publ. Serv.	—	—	—	—	146	—	—	—	210	—	—	—	—	—	—
Avangrid	—														
Avista	—	—	14	—	—	—	—	—	2	—	—	—	—	—	—
BANC	—														
BPA	—	31	—	—	—	—	—	435	—	12	99	—	—	—	—
California ISO	—														
El Paso Electric	—								91	8	11	15	2	18	—
Idaho Power	—														
LADWP	—	—	—	—	—	16	—	—	—	—	19	—	—	—	—
NorthWestern En.	—														
NV Energy	—	—	—	—	—	—	—	—	14	42	124	51	—	—	—
PacifiCorp East	—														
PacifiCorp West	—														
Portland Gen. Elec.	—														
Powerex	13	—	—	12	—	—	—	—	—	—	—	—	15	—	—
PSC of New Mexico	—	—	—	—	—	—	—	9	233	—	—	—	—	—	72
Puget Sound En.	—														
Salt River Proj.	72	27	11	14	—	15	15	6	79	27	35	39	—	13	46
Seattle City Light	—	6	—	—	—	—	7	—	—	—	—	—	—	12	15
Tacoma Power	8	—	33	—	2	—	4	7	—	—	—	—	1	—	4
Tucson Elec. Pow.	—														
Turlock Irrig. Dist.	—														
WAPA DSW	—								9	—	12	13	11	7	6
	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct
	2022					2023									

Figure 4.7 Frequency of downward flexibility test failures (percent of 15-minute intervals)

Arizona Publ. Serv.	—	0.1	0.2	0.2	0.1	0.9	0.5	2.1	0.7	1.2	0.1	—	—	—	—	
Avangrid									0.1	—	—	—	—	0.1	—	
Avista	—	0.1	0.2	—	0.0	—	—	0.1	0.1	0.1	—	—	—	—	—	
BANC																
BPA	0.0	0.3	—	0.2	0.2	—	0.0	0.1	0.6	5.5	0.0	0.4	—	0.0	0.2	
California ISO																
El Paso Electric									0.2	0.9	1.9	0.5	—	0.3	—	
Idaho Power	0.0	—	—	—	—	—	—	0.9	0.2	—	—	—	—	0.0	—	
LADWP																
NorthWestern En.	—	—	—	0.0	0.1	—	0.0	—	—	0.2	0.2	—	0.1	0.0	—	
NV Energy	0.2	0.5	0.5	0.6	0.1	0.1	0.1	0.1	0.0	0.1	0.4	0.1	0.1	0.0	0.1	
PacifiCorp East																
PacifiCorp West	—	—	0.1	—	0.0	—	—	—	0.0	0.2	0.0	—	—	1.1	—	
Portland Gen. Elec.																
Powerex	0.1	0.1	0.1	—	—	0.1	0.1	—	0.2	—	—	0.0	—	0.2	0.1	
PSC of New Mexico	0.0	0.2	0.2	0.1	—	0.0	—	0.4	1.6	2.1	—	0.1	0.4	1.1	0.4	
Puget Sound En.																
Salt River Proj.	0.2	1.0	0.2	0.9	0.3	1.4	3.3	1.0	0.3	0.1	0.1	0.1	—	—	—	
Seattle City Light	0.8	0.3	—	0.2	0.6	0.1	0.2	0.0	0.3	0.0	0.3	0.4	1.1	0.2	—	
Tacoma Power	0.2	—	—	—	0.1	—	0.2	0.1	—	—	—	0.0	—	0.1	—	
Tucson Elec. Pow.																
Turlock Irrig. Dist.	0.1	—	—	0.1	—	0.1	0.1	0.1	0.1	0.4	—	—	—	—	—	
WAPA DSW									2.7	0.5	0.7	0.1	0.2	0.6	0.8	
	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	
	2022					2023										

Figure 4.8 Average shortfall of downward flexibility test failures (MW)

Arizona Publ. Serv.	—	81	20	28	31	46	45	49	33	64	14	—	—	—	—	
Avangrid									13	—	—	—	—	11	—	
Avista	—	11	20	—	26	—	—	16	12	29	—	—	—	—	—	
BANC																
BPA	4	149	—	77	191	—	72	78	102	741	27	62	—	13	192	
California ISO																
El Paso Electric									8	15	30	36	—	21	—	
Idaho Power	13	—	—	—	—	—	—	31	11	—	—	—	—	17	—	
LADWP																
NorthWestern En.	—	—	—	2	16	—	17	—	—	39	16	—	15	2	—	
NV Energy	59	58	43	28	62	83	104	90	22	13	96	120	10	75	59	
PacifiCorp East																
PacifiCorp West	—	—	12	—	22	—	—	—	6	44	7	—	—	51	—	
Portland Gen. Elec.																
Powerex	87	62	86	—	—	23	30	—	48	—	—	85	—	67	421	
PSC of New Mexico	9	40	16	15	—	16	—	115	112	75	—	15	123	72	36	
Puget Sound En.																
Salt River Proj.	155	42	42	113	38	52	54	84	45	49	23	172	—	—	—	
Seattle City Light	21	10	—	24	39	10	28	6	6	30	15	7	10	21	—	
Tacoma Power	4	—	—	—	8	—	3	4	—	—	—	2	—	5	—	
Tucson Elec. Pow.																
Turlock Irrig. Dist.	2	—	—	5	—	6	6	14	8	4	—	—	—	—	—	
WAPA DSW									55	8	16	12	14	11	14	
	Aug	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	
	2022					2023										

**Figure 4.9 Change in percent of intervals with an upward resource sufficiency evaluation failure
(October 2022 to October 2023)**

WEIM entity	Flexibility test			Capacity test		
	Oct. 2022	Oct. 2023	Difference	Oct. 2022	Oct. 2023	Difference
Arizona Publ. Serv.	0%	0%	0%	0%	0.0%	0.0%
Avangrid		0.1%			0%	
Avista	0.1%	0.1%	0%	0%	0.0%	0.0%
BANC	0%	0%	0%	0%	0%	0%
BPA	0.2%	0.1%	-0.1%	0%	0%	0%
California ISO	0.0%	0%	0.0%	0%	0%	0%
El Paso Electric		0.4%			0.1%	
Idaho Power	0%	0.1%	0.1%	0%	0%	0%
LADWP	0.1%	0%	-0.1%	0%	0%	0%
NorthWestern En.	0%	0.2%	0.2%	0%	0%	0%
NV Energy	0.1%	0%	-0.1%	0%	0.0%	0.0%
PacifiCorp East	0.1%	0%	-0.1%	0%	0%	0%
PacifiCorp West	0%	0.0%	0.0%	0%	0%	0%
Portland Gen. Elec.	0.2%	0.6%	0.4%	0%	0.0%	0.0%
Powerex	0%	0%	0%	0%	0.0%	0.0%
PSC of New Mexico	0.2%	1.9%	1.6%	0%	0.1%	0.1%
Puget Sound En.	0%	1.3%	1.3%	0.1%	0.7%	0.6%
Salt River Proj.	0.6%	0.6%	-0.1%	0.2%	0.8%	0.7%
Seattle City Light	0%	0.0%	0.0%	0.0%	0.1%	0.1%
Tacoma Power	0%	0.2%	0.2%	0%	0.1%	0.1%
Tucson Elec. Pow.	0.0%	0.1%	0.1%	0%	0.2%	0.2%
Turlock Irrig. Dist.	0%	0%	0%	0%	0%	0%
WAPA DSW		0.3%			0.3%	

Figure 4.10 Change in percent of intervals with a downward resource sufficiency evaluation failure (October 2022 to October 2023)

WEIM entity	Flexibility test			Capacity test		
	Oct. 2022	Oct. 2023	Difference	Oct. 2022	Oct. 2023	Difference
Arizona Publ. Serv.	0.2%	0%	-0.2%	0%	0%	0%
Avangrid		0%			0%	
Avista	0.2%	0%	-0.2%	0.0%	0%	0.0%
BANC	0%	0%	0%	0%	0%	0%
BPA	0%	0.2%	0.2%	0%	0%	0%
California ISO	0%	0%	0%	0%	0%	0%
El Paso Electric		0%			0%	
Idaho Power	0%	0%	0%	0%	0%	0%
LADWP	0%	0%	0%	0%	0%	0%
NorthWestern En.	0%	0%	0%	0%	0%	0%
NV Energy	0.5%	0.1%	-0.4%	0%	0%	0%
PacifiCorp East	0%	0.1%	0.1%	0%	0%	0%
PacifiCorp West	0.1%	0%	-0.1%	0%	0%	0%
Portland Gen. Elec.	0%	0%	0%	0%	0%	0%
Powerex	0.1%	0.1%	0.0%	0%	0%	0%
PSC of New Mexico	0.2%	0.4%	0.2%	0%	0%	0%
Puget Sound En.	0.1%	0%	-0.1%	0%	0%	0%
Salt River Proj.	0.2%	0%	-0.2%	0.2%	0.1%	-0.1%
Seattle City Light	0%	0%	0%	0%	0%	0%
Tacoma Power	0%	0%	0%	0.1%	0%	-0.1%
Tucson Elec. Pow.	0%	0%	0%	0%	0%	0%
Turlock Irrig. Dist.	0%	0%	0%	0%	0%	0%
WAPA DSW		0.8%			0.2%	

Figure 4.11 Upward capacity/flexibility test failure intervals by concurrence (October 2023)


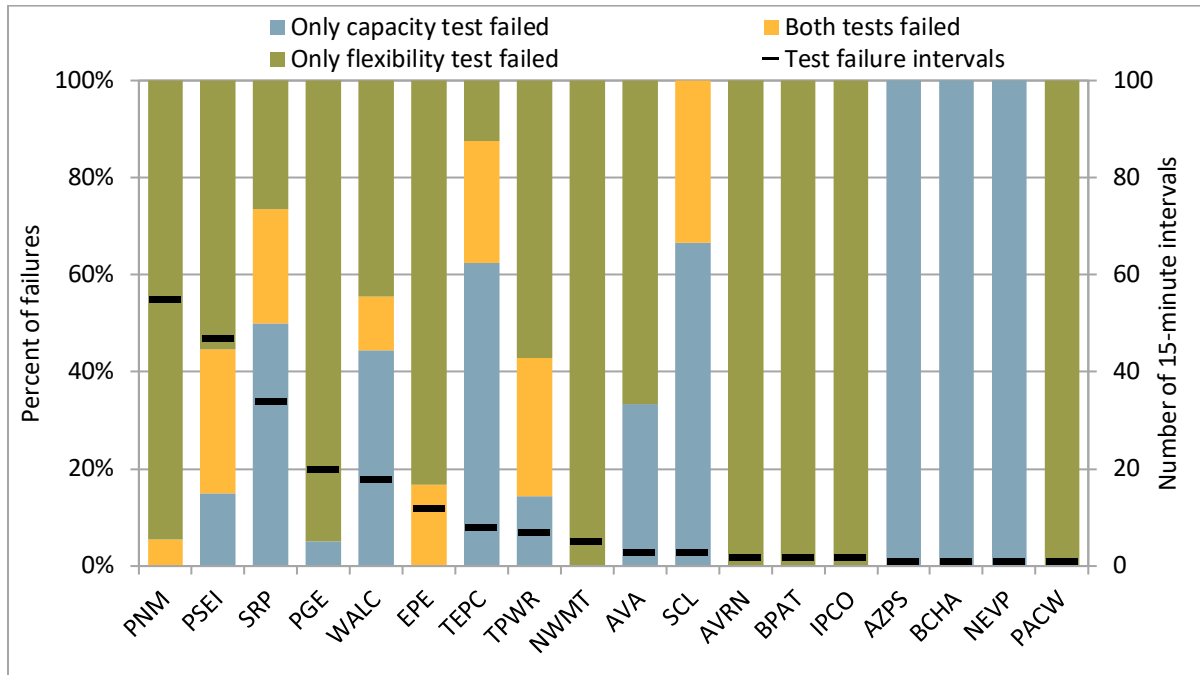


Figure 4.12 Downward capacity/flexibility test failure intervals by concurrence (October 2023)

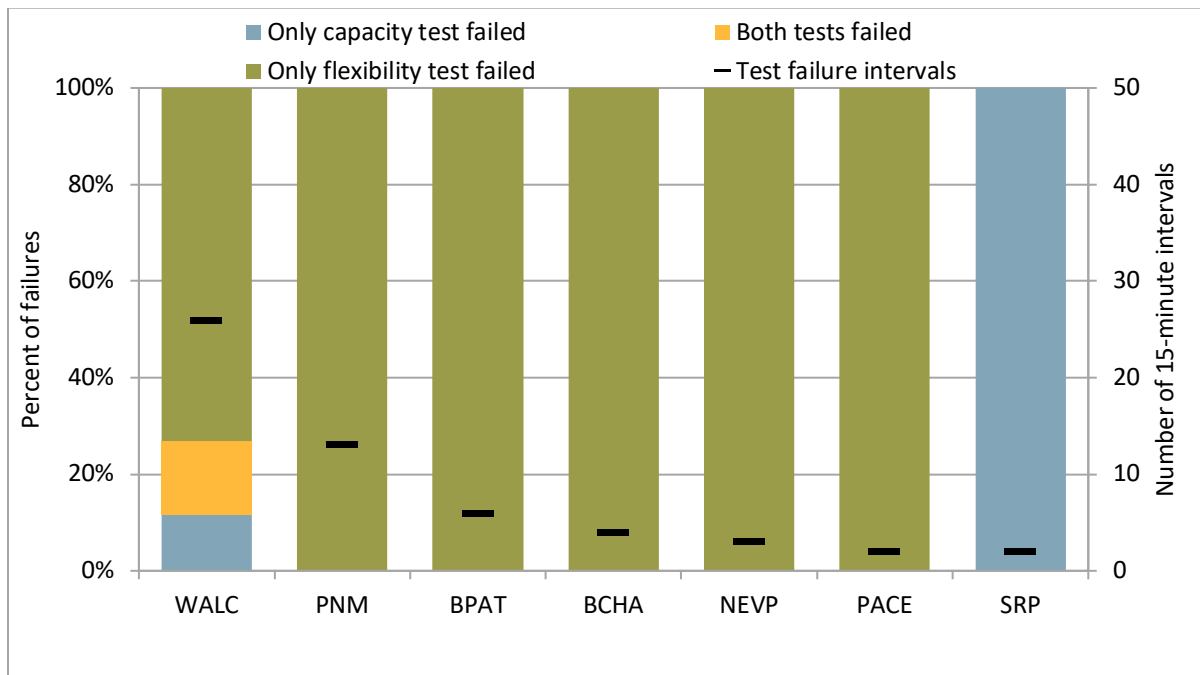

Impact of earlier runs of the resource sufficiency evaluation on market results

There are three runs of the resource sufficiency evaluation, at 75 minutes (first run), 55 minutes (second run), and 40 minutes (final run) prior to each evaluation hour. The first and second runs are sometimes considered the *advisory runs* with the results of the final evaluation at 40 minutes prior considered the *binding run*. The previous section summarized the frequency of resource sufficiency evaluation failures in the final run. However, the results in the earlier runs of the resource sufficiency evaluation can also impact binding market results in several key ways. These are discussed below.

Nodal flexible ramping capacity procurement in the first 15-minute interval of each hour

Flexible ramping product nodal procurement in the first 15-minute market interval of each hour is dependent on the second run of the resource sufficiency evaluation at 55 minutes prior to the evaluation hour.

The results of the resource sufficiency evaluation are used as an input for the flexible ramping product. As part of the enhancements implemented on February 1, the real-time market will enforce an area-specific uncertainty target for balancing areas that fail the resource sufficiency evaluation. This target can only be met by flexible capacity within that area. In contrast, flexible capacity for the group of balancing areas that pass the resource sufficiency evaluation are pooled together to meet the uncertainty target for the rest of the system.

Deliverable flexible capacity awards are produced through two deployment scenarios that adjust the expected net load forecast in the *following* interval by the lower and upper ends of uncertainty that might materialize. This ensures that upward and downward flexible capacity awards do not violate transmission or transfer constraints. A consequence of this is that binding flex ramp awards in the first 15-minute market interval of each hour are now dependent on the second run of the resource sufficiency evaluation at 55 minutes prior to the evaluation hour — based on the latest information available at the time of this market run.

Figure 4.13 and Figure 4.14 summarize the first interval of each evaluation hour during the month with a failure in the second (T-55) or final (T-40) resource sufficiency evaluation.¹⁷ This reflects failure of *either* the flexibility or capacity test in the second or final run. The red and yellow bars show intervals with a failure in the second evaluation (T-55) and whether the balancing area ultimately failed or passed in that interval based on the final evaluation results at 40 minutes prior to the hour. The dashed blue region instead shows cases in the first interval of the hour when the balancing area passed the second evaluation (T-55) but failed the final evaluation (T-40). In these intervals, the balancing area would have been included in the pass-group for the purpose of procuring flexible ramping capacity. The pass-group uncertainty requirement includes any diversity benefit of reduced uncertainty over a larger footprint.

¹⁷ Areas that did not fail in the first interval of a resource sufficiency evaluation at T-55 or T-40 during this period were omitted from these figures.

Figure 4.13 Upward resource sufficiency evaluation failures in first 15-minute interval of hour (October 2023)


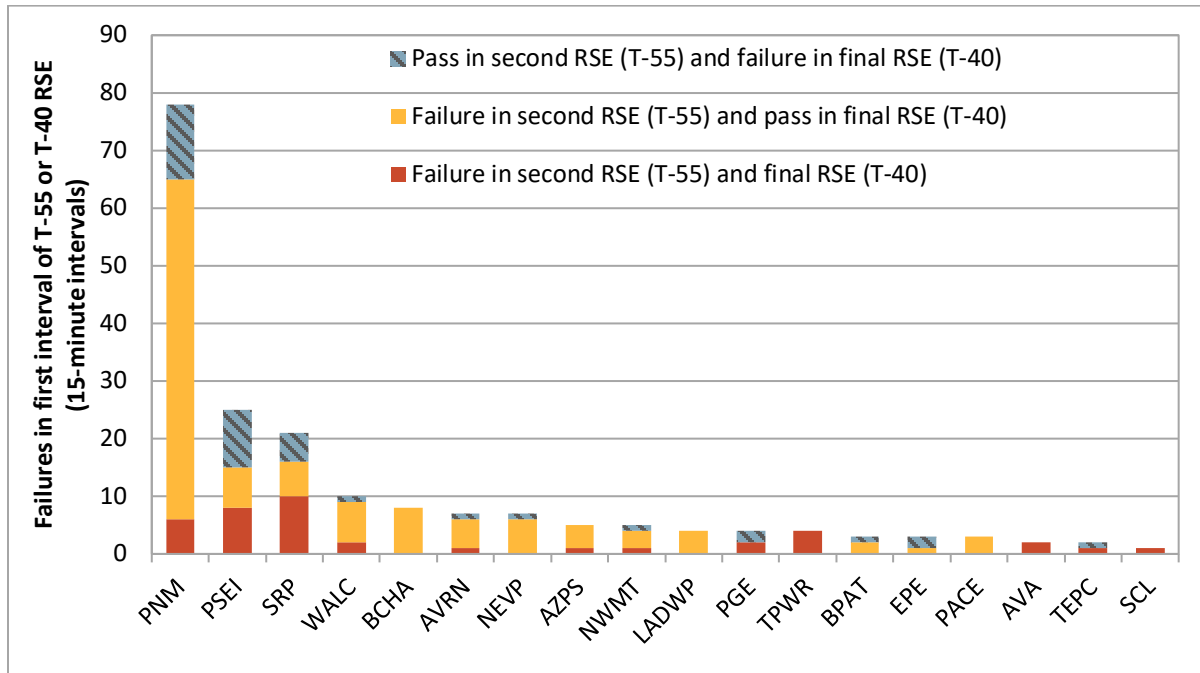


Figure 4.14 Downward resource sufficiency evaluation failures in first 15-minute interval of hour (October 2023)

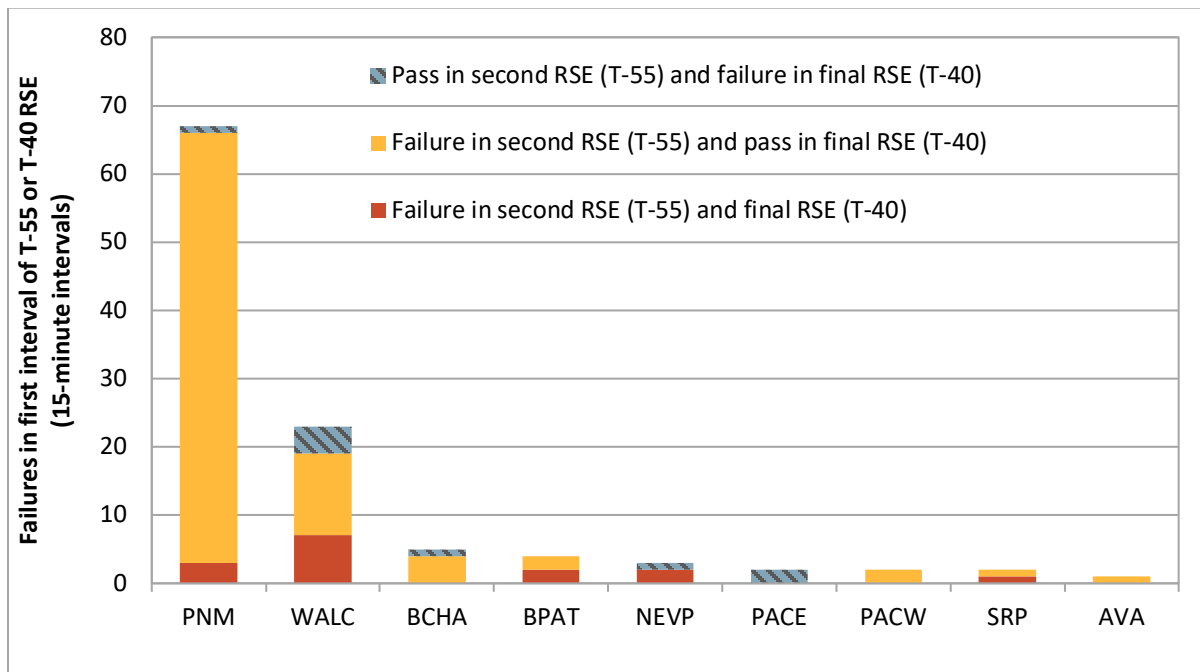

Calculating uncertainty for balancing areas passing the resource sufficiency evaluation

Uncertainty estimates created for the group of balancing areas that pass the resource sufficiency evaluation in the *first and second* interval of each hour are based on earlier test results.

As part of the enhancements implemented on February 1, uncertainty is now calculated based on regression results that use historical data to predict uncertainty relative to load, solar, and wind forecasts.¹⁸ Once all of the regressions are complete, the regression outputs can be combined with current forecast information to calculate uncertainty for each interval.

For a single balancing area that failed the resource sufficiency evaluation, these regressions can be performed in advance and local uncertainty targets can be readily determined based on current forecast information. However, for instead the group of balancing areas that pass the resource sufficiency evaluation (known as the pass-group), the regression procedure needs to first determine which balancing areas make up this group so that it can perform the regression using historical data accordingly for that group.

To perform the regressions to estimate the pass-group uncertainty, the composition of balancing areas in this group is based on earlier test results for the first and second 15-minute market interval of each hour. In the first interval, the results from the earliest resource sufficiency evaluation (T-75) is used to define the pass-group. In the second interval, the results from the second resource sufficiency evaluation (T-55) is used to define the pass-group. This is based on the latest information available at the time of this process.

However, the current weather information that is ultimately combined with the regression results to calculate uncertainty are instead consistent with the group of balancing areas in the pass-group for flexible ramping capacity procurement. This is based on the second run of the resource sufficiency evaluation (T-55) for interval 1 and the final resource sufficiency evaluation (T-40) for intervals 2 to through 4. Table 4.1 summarizes this inconsistency by showing which resource sufficiency evaluation run is used for each interval and process.

Table 4.1 Source of pass-group for calculating uncertainty and procuring flexible ramping capacity

15-minute market interval	Current weather information for calculating uncertainty and flex ramp procurement	Regression inputs and outputs
1	Second run (T-55)	First run (T-75)
2	Final run (T-40)	Second run (T-55)
3	Final run (T-40)	Final run (T-40)
4	Final run (T-40)	Final run (T-40)


Using an inconsistent composition of balancing areas in the pass-group between the forecast and regression information can create significant swings in the calculated uncertainty for this group. For example, if you have a model to predict uncertainty based on forecast information of all but one balancing area passing the test (based on earlier test results), but then combine this with current forecast information of all balancing areas (based on later test results), then the calculated uncertainty can be disconnected from forecasted conditions in the system. DMM has requested that the ISO consider options to resolve inconsistencies in the composition of balancing areas in the pass-group.

¹⁸ The calculation of uncertainty is described in more depth in the following section.

During about 16 percent of intervals during the month, the composition of balancing areas in the pass-group between the current forecast information and regression information were inconsistent for either upward or downward uncertainty. Figure 4.15 summarizes the impact of this inconsistency on pass-group uncertainty requirements in cases when the composition of balancing areas differed between the two sets of data. Figure 4.15 shows the percent of intervals in which the market uncertainty requirements (with inconsistent balancing areas in the pass-group) were higher or lower than counterfactual uncertainty requirements with a consistent composition of balancing areas in the pass-group.¹⁹ These results are shown separately for the following categories to highlight the impact of this inconsistency on uncertainty requirements.

- **Decreased requirements** indicate that market uncertainty requirements for the pass-group were lower as a result of inconsistent balancing areas in the pass-group.
- **Increased requirements** indicate that market uncertainty requirements for the pass-group were higher as a result of inconsistent balancing areas in the pass-group.
- **No impact** indicates that uncertainty requirements were capped by thresholds in a way that resulted in the same uncertainty requirements.
- **Unknown impact** indicates that there was an inconsistent composition of balancing areas in the pass-group but data was not available to calculate the impact.

Figure 4.15 Impact of pass-group inconsistency on uncertainty requirements (October 2023)

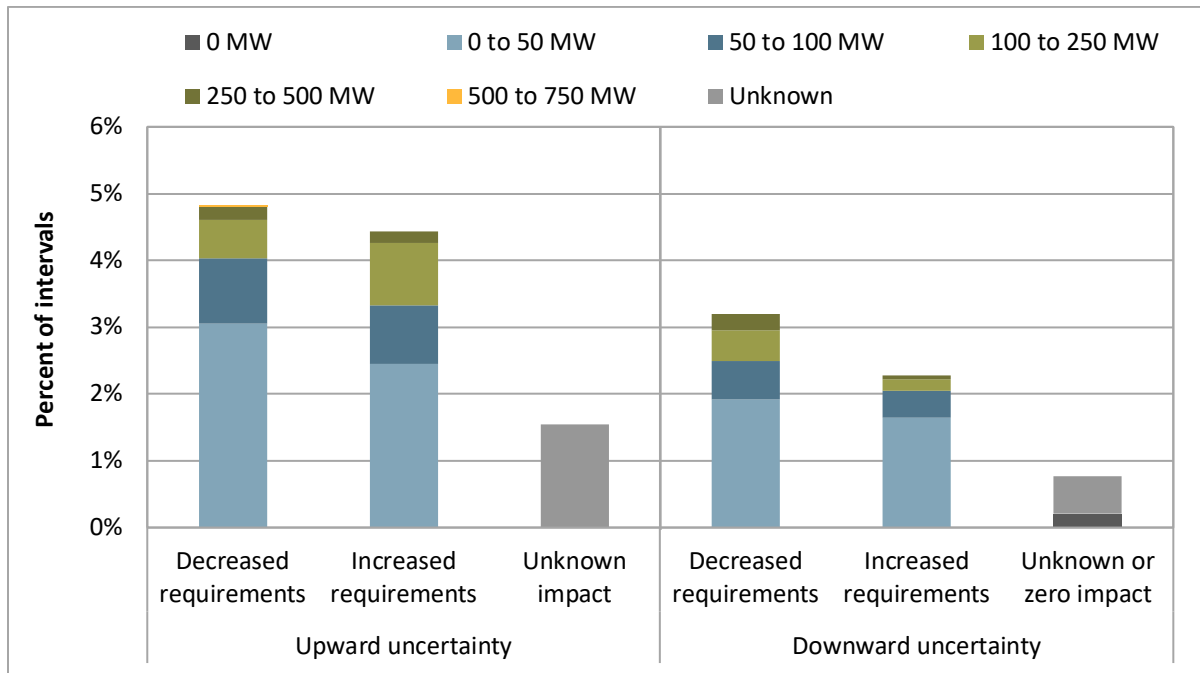

¹⁹ This analysis accounts for any thresholds that capped or would have capped calculated uncertainty requirements.

Additional impacts of earlier resource sufficiency evaluation failures on market results

Each real-time market run will use the latest resource sufficiency evaluation results available to optimize resources and energy transfers in the WEIM accordingly. This includes future advisory intervals that can be impacted by earlier runs of the resource sufficiency evaluation. In particular, the hour-ahead market includes resources and transfers in the WEIM footprint with transfer limits potentially impacted from test failures from the first run of the resource sufficiency evaluation at 75 minutes prior to the evaluation hour.

5 Net load uncertainty in the resource sufficiency evaluation

Net load uncertainty is included in the requirement of the flexible ramp sufficiency test (flexibility test) to capture additional flexibility needs that may be required in the evaluation hour due to variation in either load, solar, or wind forecasts. This calculation was adjusted on February 1 using a method called *mosaic quantile regression*. This section summarizes how uncertainty is currently calculated, the results of the uncertainty calculation, and how it compares with actual error between forecasts used in the tests and in the real-time market.

Calculating net load uncertainty in the resource sufficiency evaluation

Histogram method

Uncertainty used in the resource sufficiency evaluation was previously calculated by selecting the 2.5th and 97.5th percentile of observations from a distribution of historical net load forecast errors. This is known as the *histogram method*. The historical error observations in the distribution were the difference between binding 5-minute market net load forecasts and corresponding advisory 15-minute market net load forecasts.²⁰ Prior to February 1, 2023, the weekday distributions used data for the same hour from the previous 40 weekdays while weekend distributions instead used same-hour observations from the previous 20 weekend days. The histogram approach did not factor in any current load, solar, or wind forecast information. Under this approach, uncertainty could have been set by historical outlier observations uncorrelated with current market conditions such as an extreme historical observation in which wind forecasts were significant while wind forecasts in the evaluation hour were minimal.

Mosaic quantile regression method

The calculation for net load uncertainty was adjusted on February 1, 2023 as part of flexible ramping enhancements. The uncertainty was adjusted to incorporate current load, solar, and wind forecast information using a method called *mosaic quantile regression*.

Regression is a statistical method used to study the relationship between two or more variables, such as the relationship between the load or renewable forecasts (independent variables) and uncertainty (dependent variable). Ordinary Least Squares is widely used to estimate the *mean* relationship between these variables (i.e. the average value of the dependent variable as a function of the independent variable). In contrast, quantile regression is a variation of regression that is useful when interested in the relationship between the independent variable(s) and different *percentiles* of the dependent variable. For example, the relationship between the load or renewable forecasts and the 97.5th percentile of uncertainty.

The chosen regression method is a two-step procedure to forecast the lower and upper extremes of net load uncertainty that might materialize. The initial quantile regressions determine the relationship between the forecasts (load, solar, and wind) and the extremes of each type of uncertainty (load, solar, and wind). In a simple linear regression, the relationship between the dependent variable Y and the independent variable X takes the basic form of $Y = bX$ where the outcome of the regression, b , explains how much Y changes for every one unit increase in X (e.g. If b is two, then y is predicted to be twice X). For calculating uncertainty as a function of the forecast, the quantile regressions are instead defined in the quadratic form ($Y = aX^2 + bX + c$). The initial regressions are shown below in

²⁰ In comparing the 15-minute observation to the three corresponding 5-minute observations, the minimum and maximum net load errors were used as a separate observation in the distribution.

Equation 5.1 for upward net load uncertainty.²¹

Equation 5.1 Initial quantile regressions for upward net load uncertainty

$$\begin{aligned}
 \text{Load uncertainty}^{max} &= a_l^{97.5}(\text{load})^2 + b_l^{97.5}(\text{load}) + c_l^{97.5} + \varepsilon & (\tau = 0.975) \\
 \text{Solar uncertainty}^{min} &= a_s^{2.5}(\text{solar})^2 + b_s^{2.5}(\text{solar}) + c_s^{2.5} + \varepsilon & (\tau = 0.025) \\
 \text{Wind uncertainty}^{min} &= a_w^{2.5}(\text{wind})^2 + b_w^{2.5}(\text{wind}) + c_w^{2.5} + \varepsilon & (\tau = 0.025)
 \end{aligned}$$

Dependent variable: load, solar, and wind uncertainty — minimum or maximum difference between binding 5-minute market forecasts and advisory 15-minute market forecasts in each 15-minute market interval

Independent variable: advisory 15-minute market forecasts for load, solar, and wind in each interval

Error term (ε): variation in dependent variable that is not explained by independent variable

Quantile parameter (τ): determines the level of the quantile regression being estimated (high: 97.5th percentile, low: 2.5th percentile)

The uncertainty regressions use a distribution of historical forecast observations from the previous 180 days — separate for each balancing area, hour, and day-type (weekday or weekend/holiday). For the resource sufficiency evaluation, uncertainty in the distributions is the difference between binding 5-minute market forecasts and corresponding advisory 15-minute market forecasts.²² The outcome of these regressions are the coefficients a , b , and c , that define the relationships between the forecasts and the extreme end of uncertainty that might materialize.²³ These coefficients can then be combined with the historical 15-minute forecast data to create a distribution of predicted values for load, solar, and wind uncertainty which is needed for the second step of the calculation. This is shown below in Equation 5.2 for upward net load uncertainty.

Equation 5.2 Predicted values for upward net load uncertainty

$$\begin{aligned}
 \hat{L}_Q^{97.5} &= a_l^{97.5}(\text{load})^2 + b_l^{97.5}(\text{load}) + c_l^{97.5} \\
 \hat{S}_Q^{2.5} &= a_s^{2.5}(\text{solar})^2 + b_s^{2.5}(\text{solar}) + c_s^{2.5} \\
 \hat{W}_Q^{2.5} &= a_w^{2.5}(\text{wind})^2 + b_w^{2.5}(\text{wind}) + c_w^{2.5}
 \end{aligned}$$

Predicted values: predicted 97.5th percentile of load uncertainty and 2.5th percentile of solar and wind uncertainty based on regression coefficients and historical distribution

Regression coefficients: parameters “a”, “b”, and “c” that define the relationship between the forecasts and the extreme end of uncertainty that might materialize

²¹ Equations 1 to 5 are for calculating *upward* net load uncertainty. *Downward* net load uncertainty is instead based on the lower end of load uncertainty, and upper end of solar and wind uncertainty that might materialize.

²² In comparing the 15-minute observation to the three corresponding 5-minute observations, the maximum load errors and minimum wind and solar errors are used to calculate upward net load uncertainty. Or, minimum load errors, and maximum wind and solar errors for downward net load uncertainty.

²³ The coefficient c is also known as the intercept. It shows the value of the dependent variable when all independent variables are equal to zero.

The *mosaic* element of the regression combines the predicted forecasts above with the histogram method. For the histogram estimates, the 180-day distributions are again used to calculate the lower and upper ends of uncertainty, based on the 2.5th and 97.5th percentiles in the distribution. The combination of the predicted values and the histogram extremes in the mosaic variable are intended to capture the incremental weather effect of using predicted information relative to the histogram approach. Here, the calculation modifies the histogram net load by adding the predicted values and subtracting the histogram outcomes for each uncertainty type individually.²⁴ This is shown below in Equation 5.3 for upward net load uncertainty:

Equation 5.3 Mosaic variable for upward net load uncertainty

$$\text{mosaic}^{97.5} = \underbrace{NL_H^{97.5}}_{\substack{\text{Upward mosaic variable:} \\ \text{intermediate variable for} \\ \text{final regression}}} + \underbrace{\left(\underbrace{\left(\hat{L}_Q^{97.5} - L_H^{97.5} \right)}_{\substack{\text{97.5}^{\text{th}} \text{ percentile} \\ \text{of net load} \\ \text{uncertainty} \\ \text{from histogram}}} - \underbrace{\left(\hat{S}_Q^{2.5} - S_H^{2.5} \right)}_{\substack{\text{Predicted values: predicted} \\ \text{load, solar, and wind} \\ \text{uncertainty from initial} \\ \text{quantile regressions (using} \\ \text{historical distribution)}}} - \underbrace{\left(\hat{W}_Q^{2.5} - W_H^{2.5} \right)}_{\substack{\text{Load, solar, and wind} \\ \text{uncertainty from} \\ \text{histograms}}} \right)$$

Once the mosaic variable is calculated for each interval in the distribution, the software runs a final regression to predict net load uncertainty. Again, the quantile regression method looks for the extreme values of the data (at the 2.5th and 97.5th percentiles) such that the output reflects the upper and lower boundaries of the future uncertainty. Therefore, the predicted values obtained from the quantile regression models are expected to estimate the range in which net load uncertainty is likely to materialize. The final regression is shown in Equation 5.4 below:

Equation 5.4 Mosaic regression for upward net load uncertainty

$$\underbrace{\text{Net load uncertainty}^{max}}_{\substack{\text{Dependent variable: net load} \\ \text{uncertainty — maximum} \\ \text{difference between binding} \\ \text{5-minute market forecasts and} \\ \text{advisory 15-minute market} \\ \text{forecasts in each 15-minute} \\ \text{market interval}}} = a_m^{97.5} (\text{mosaic}^{97.5})^2 + b_m^{97.5} (\text{mosaic}^{97.5}) + c_m^{97.5} + \underbrace{\varepsilon}_{\substack{\text{Error term } (\varepsilon): \text{ variation} \\ \text{in dependent variable} \\ \text{that is not explained by} \\ \text{independent variable}}} \quad \underbrace{(\tau = 0.975)}_{\substack{\text{Quantile parameter } (\tau): \\ \text{determines the level of} \\ \text{the quantile regression} \\ \text{being estimated (high:} \\ \text{97.5}^{\text{th}} \text{ percentile)}}}$$

Once all of the regressions are complete, the regression output coefficients can be combined with current forecast information to calculate uncertainty for each interval. For the flexibility test, this forecast information is the same load, solar, and wind forecasts which are considered in the resource sufficiency evaluation for calculating ramping capacity and test requirements. The latest forecasts at the

²⁴ The mosaic variable can be thought of as the modified net load.

time of the second pass of the resource sufficiency evaluation at 55 minutes prior to the evaluation hour are held constant for the final test at 40 minutes prior to the hour. The final equations for combining the current forecast information with the regression coefficients and histogram extremes to calculate upward uncertainty for each interval are shown in Equation 5.5 below.

Equation 5.5 Calculation of upward uncertainty from current forecast information

$$\begin{aligned}\hat{L}_{current}^{97.5} &= a_l^{97.5}(load_{current})^2 + b_l^{97.5}(load_{current}) + c_l^{97.5} \\ \hat{S}_{current}^{2.5} &= a_s^{2.5}(solar_{current})^2 + b_s^{2.5}(solar_{current}) + c_s^{2.5} \\ \hat{W}_{current}^{2.5} &= a_w^{2.5}(wind_{current})^2 + b_w^{2.5}(wind_{current}) + c_w^{2.5} \\ mosaic_{current}^{97.5} &= NL_H^{97.5} + \left((\hat{L}_{current}^{97.5} - L_H^{97.5}) - (\hat{S}_{current}^{2.5} - S_H^{2.5}) - (\hat{W}_{current}^{2.5} - W_H^{2.5}) \right) \\ Net\ load\ uncertainty_{current}^{97.5} &= a_m^{97.5}(mosaic_{current}^{97.5})^2 + b_m^{97.5}(mosaic_{current}^{97.5}) + c_m^{97.5}\end{aligned}$$

The performance of the mosaic quantile regression method depends on whether there is a meaningful relationship between net load uncertainty, and the mosaic variables created from historical and predicted values. DMM has published a more detailed review of the mosaic quantile regression approach.²⁵ DMM finds that the regression model has limited predictive capability for forecasting net load uncertainty.

Thresholds for capping uncertainty

Uncertainty calculated from the quantile regressions are capped by the lesser of two thresholds. The thresholds are designed to help prevent extreme outlier results from impacting the final uncertainty. The *histogram* threshold is pulled for each hour from the 1st and 99th percentile of net load error observations from the previous 180 days.²⁶ The seasonal threshold is updated each quarter and is calculated based on the 1st and 99th percentile using observations over the previous 90 days. Here, each hour is calculated separately, and the greatest upward and downward uncertainty across all hours sets the seasonal threshold for each hour of the same direction.

Figure 5.1 shows the percent of test intervals in which the upward or downward uncertainty calculated by the quantile regression was capped by either the seasonal or histogram threshold during the month. A threshold is also in place that sets the *floor* for uncertainty at 0.1 MW in both directions. The upward and downward uncertainty is therefore set near zero when the uncertainty calculated from the quantile regression would be negative. Figure 5.2 shows the percent of test intervals in which the quantile regression uncertainty was set near zero by this threshold during the month.

²⁵ Department of Market Monitoring, *Review of mosaic quantile regression for estimating net load uncertainty*, November 20, 2023: <http://www.caiso.com/Documents/Review-of-the-Mosaic-Quantile-Regression-Nov-20-2023.pdf>

²⁶ The histogram threshold is updated every day. The distributions are separate for each hour and day type (weekday or weekend/holiday).

Figure 5.1 Quantile regression uncertainty capped by mosaic or histogram thresholds (October 2023)


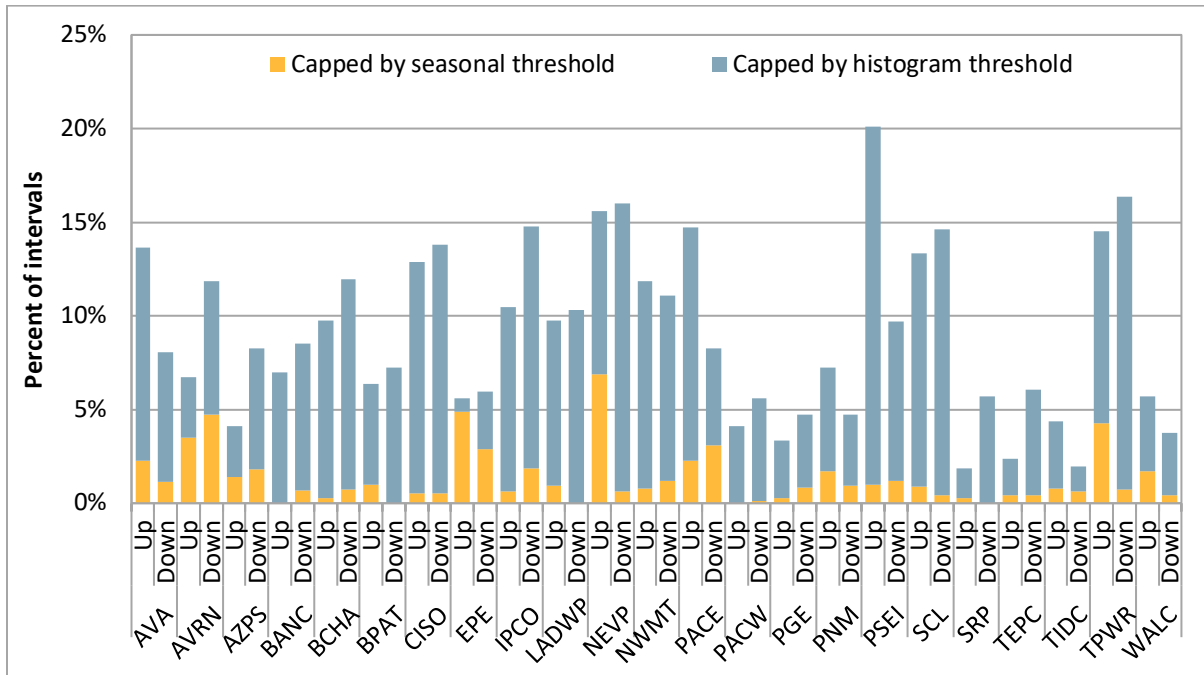


Figure 5.2 Quantile regression uncertainty set near zero by mosaic threshold (October 2023)

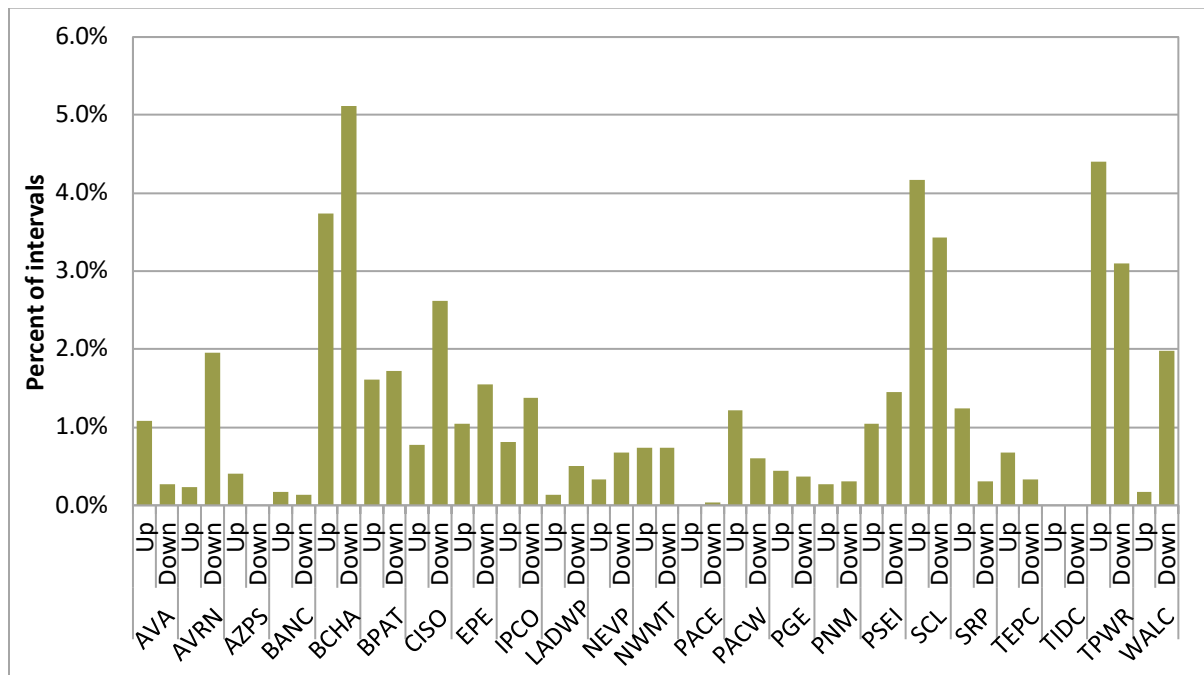

Using uncertainty from the flexible ramping product in the resource sufficiency evaluation

The calculation of uncertainty in the flexibility test continues to be measured similarly to the 15-minute market flexible ramping product — based on the difference between binding 5-minute market forecasts and corresponding advisory 15-minute market forecasts. The quantile regression uses the historical sample of 5-minute and 15-minute market observations to create hourly coefficients that define the relationship between the forecasts and uncertainty. The resource sufficiency evaluation and flexible ramping product uncertainty calculations for a single balancing area use the same hourly coefficients, but are combined with the current forecast information for each time horizon.²⁷

The calculated uncertainty is based on the 2.5th and 97.5th percentile for downward and upward uncertainty, respectively. The 95 percent confidence interval for the uncertainty requirement in the flexible ramping product was designed to capture the upper end of uncertainty needs, such that it could be optimally relaxed based on the trade-off between the cost of procuring additional flexible ramping capacity and the expected cost of a power balance constraint relaxation. In the resource sufficiency evaluation, this trade-off is not considered, and the upper end of uncertainty is instead required in full to pass both tests. DMM has asked the ISO and stakeholders to consider whether the 95 percent confidence interval, or another, is most appropriate for the tests.²⁸

Further, the resource sufficiency evaluation occurs in a different timeframe than the 15-minute market. Figure 5.3 illustrates the current uncertainty calculation — based on net load error between an advisory 15-minute market interval and corresponding binding 5-minute market intervals — as well as how it compares with the timeframe of the resource sufficiency evaluation. The current uncertainty calculation captures 45 to 55 minutes of potential uncertainty from the 15-minute market run to three corresponding 5-minute market runs. In contrast, when comparing the variable energy resource (VER) and load forecast values used in each interval of the resource sufficiency evaluation to corresponding 5-minute intervals, there exists a larger gap for uncertainty to materialize.²⁹


In comparing the first 15-minute test interval to corresponding 5-minute market intervals, the timeframe and potential for net load uncertainty is similar to the timeframe of the 15-minute market flexible ramping product uncertainty calculation. In the later test intervals, the gap between the predicted forecasts at the time of the resource sufficiency evaluation and the real-time forecasts widens, reaching above 100 minutes.

²⁷ A balancing-area-specific flexible ramping product uncertainty requirement will be enforced for any balancing area that failed the resource sufficiency evaluation.

²⁸ Department of Market Monitoring, *Comments on EIM Resource Sufficiency Evaluation Enhancements Issue Paper*, September 8, 2021: <http://www.cao.com/Documents/DMM-Comments-on-EIM-Resource-Sufficiency-Evaluation-Enhancements-Issue-Paper-Sep-8-2021.pdf>

²⁹ The figure shows the resource sufficiency evaluation run time at 55 minutes prior to the hour. While the financially binding test is run at 40 minutes prior to the hour, the VER and load forecasts used in the final test are pulled from the advisory test performed at T-55.

Figure 5.3 Comparison of current uncertainty calculation to the timeframe of the RSE

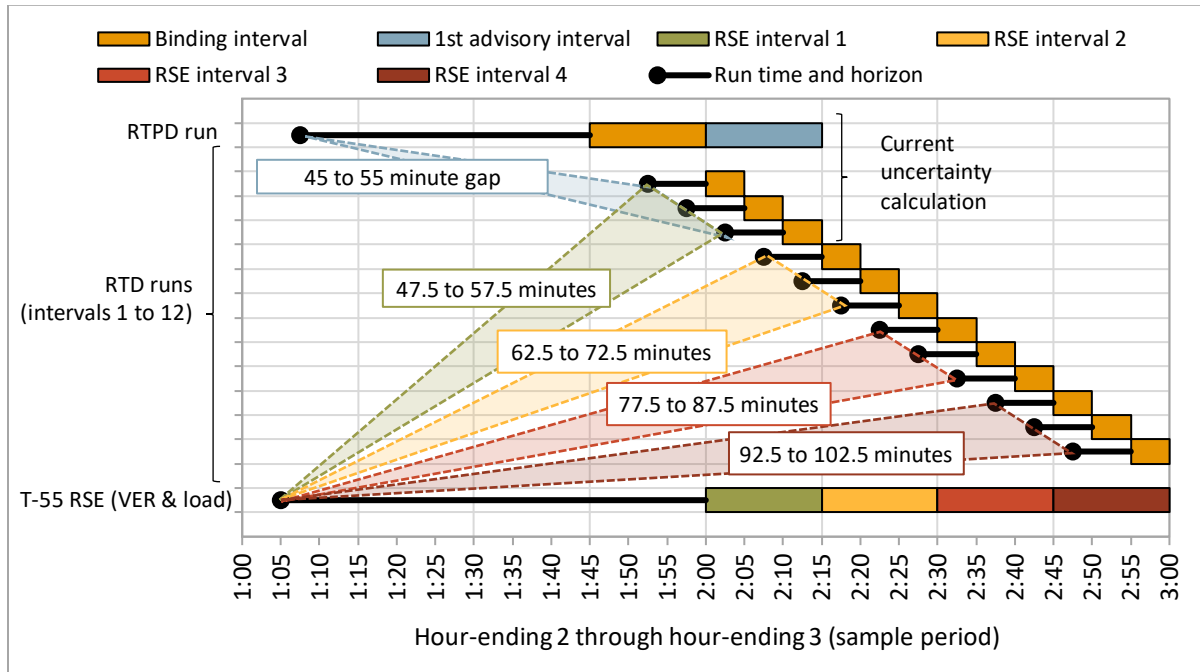

Results of quantile regression uncertainty in the resource sufficiency evaluation

Figure 5.4 summarizes the histogram uncertainty (pulled from the 2.5th and 97.5th percentile of observations in the hour from the previous 180 days) and the final uncertainty from the mosaic quantile regression during the month for the ISO area. The green and blue lines show the *average* upward and downward uncertainty from each method while the areas around the lines show the minimum and maximum amount over the month (range of uncertainty in each interval). The dashed red and yellow lines in Figure 5.4 show the average histogram and seasonal thresholds, respectively, during the month. Figures covering the same information for all WEIM entities are provided further below.

Overall, the uncertainty outcomes from the mosaic quantile regression approach were often comparable to those calculated with the prior histogram approach. The mosaic quantile regression approach tends to be somewhat lower on average across most hours and balancing areas. However, results of the mosaic quantile regression approach vary more widely.

Figure 5.4 California ISO resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

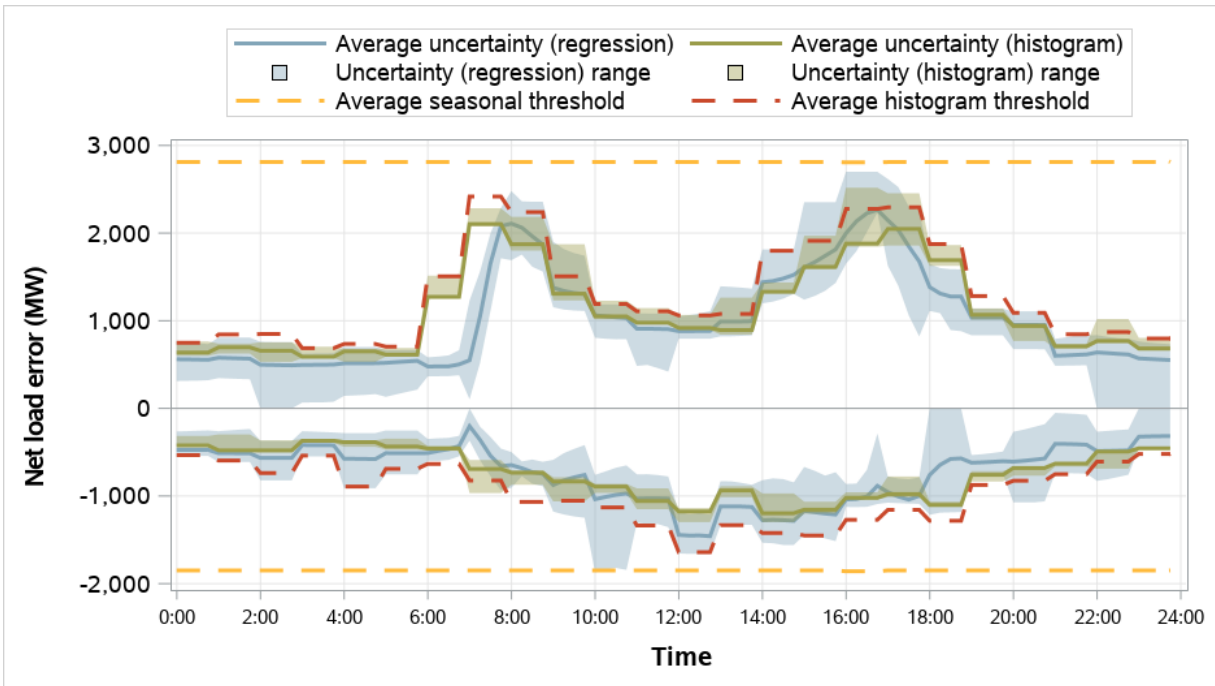


Figure 5.5 Arizona Public Service resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

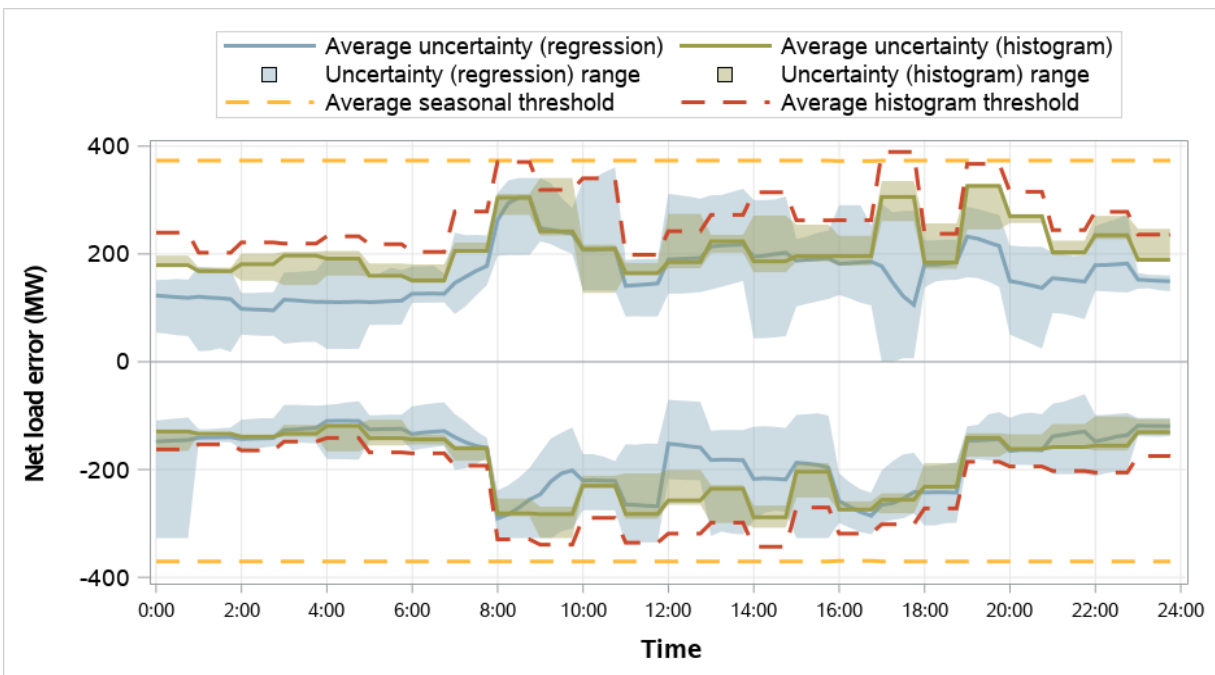


Figure 5.6 Avangrid resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

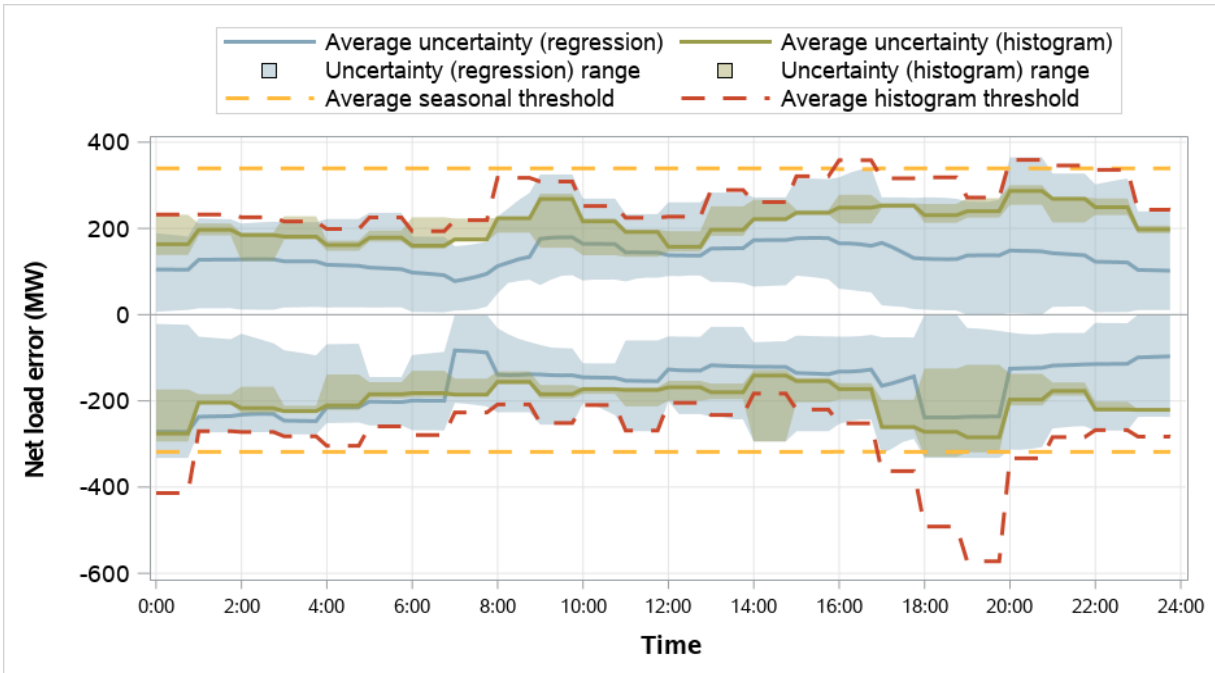


Figure 5.7 Avista resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

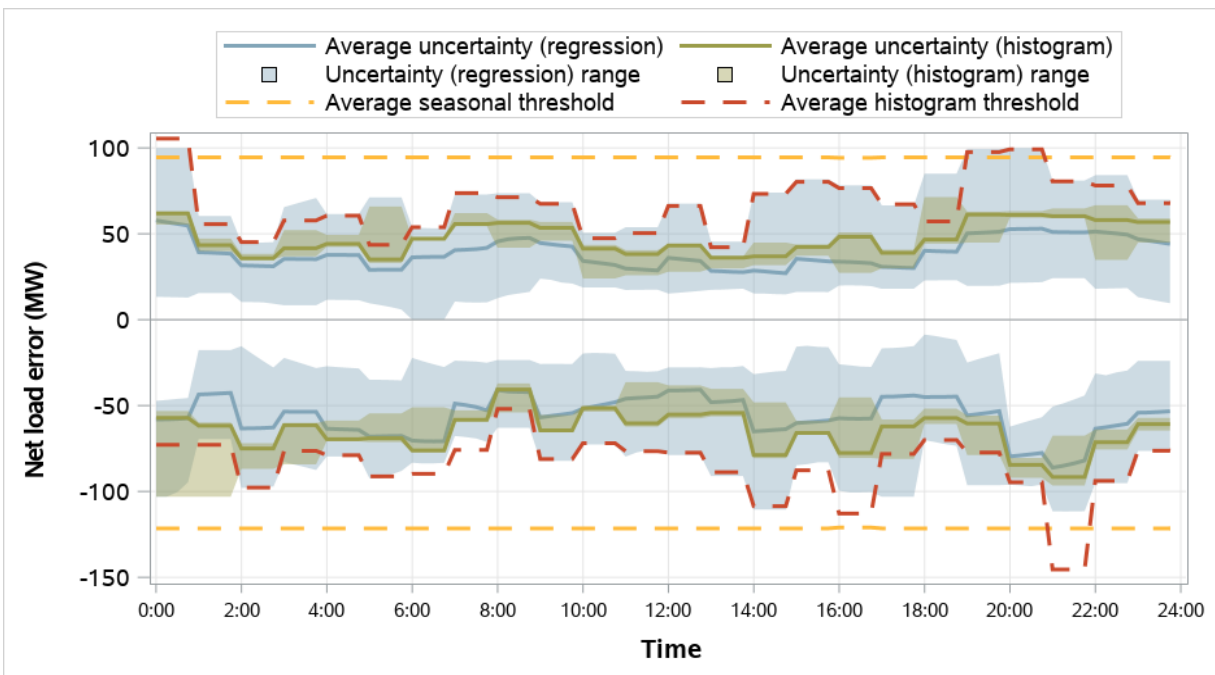


Figure 5.8 BANC resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

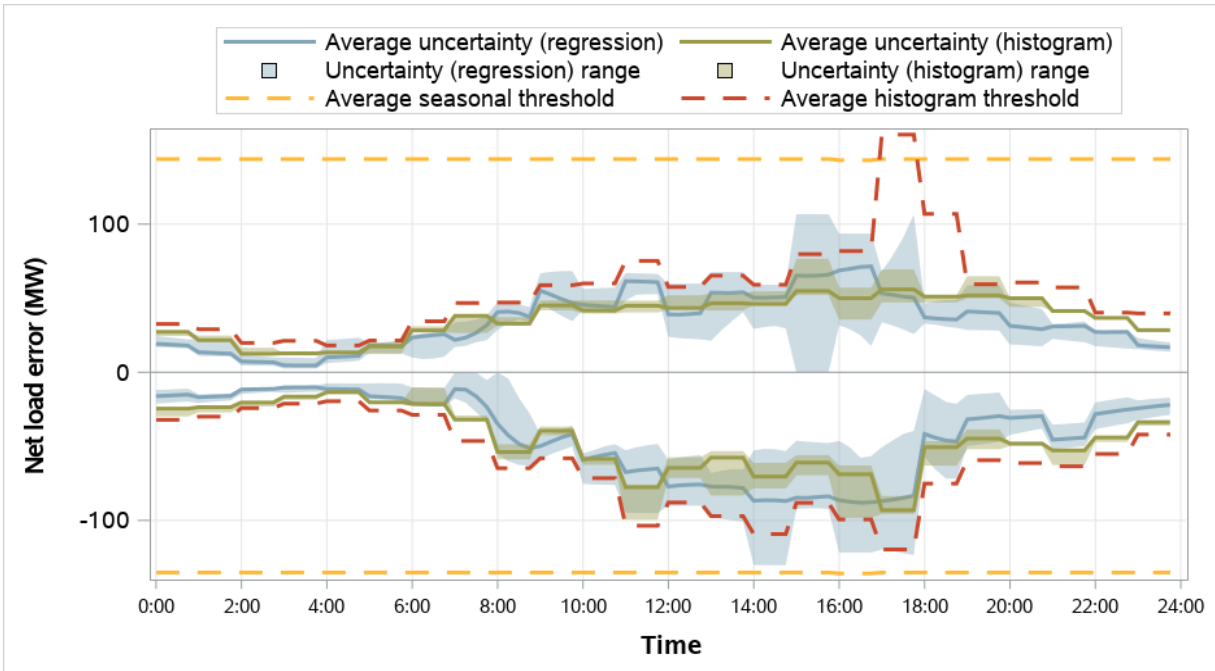


Figure 5.9 BPA resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

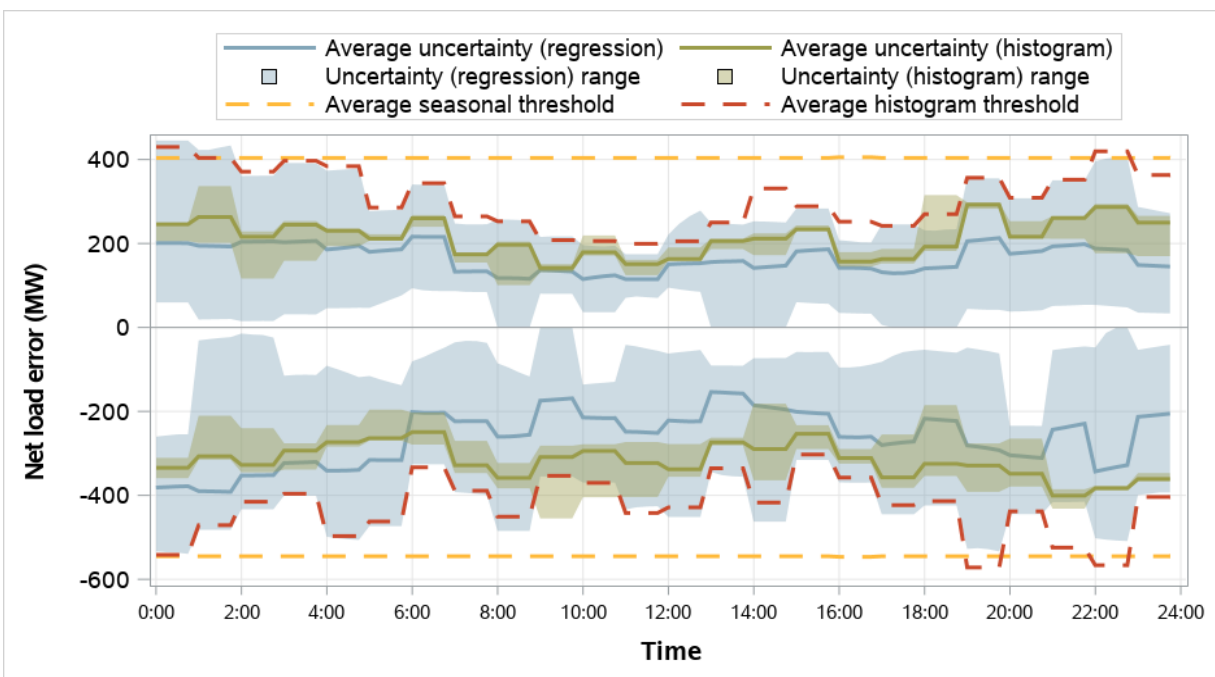


Figure 5.10 El Paso Electric resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

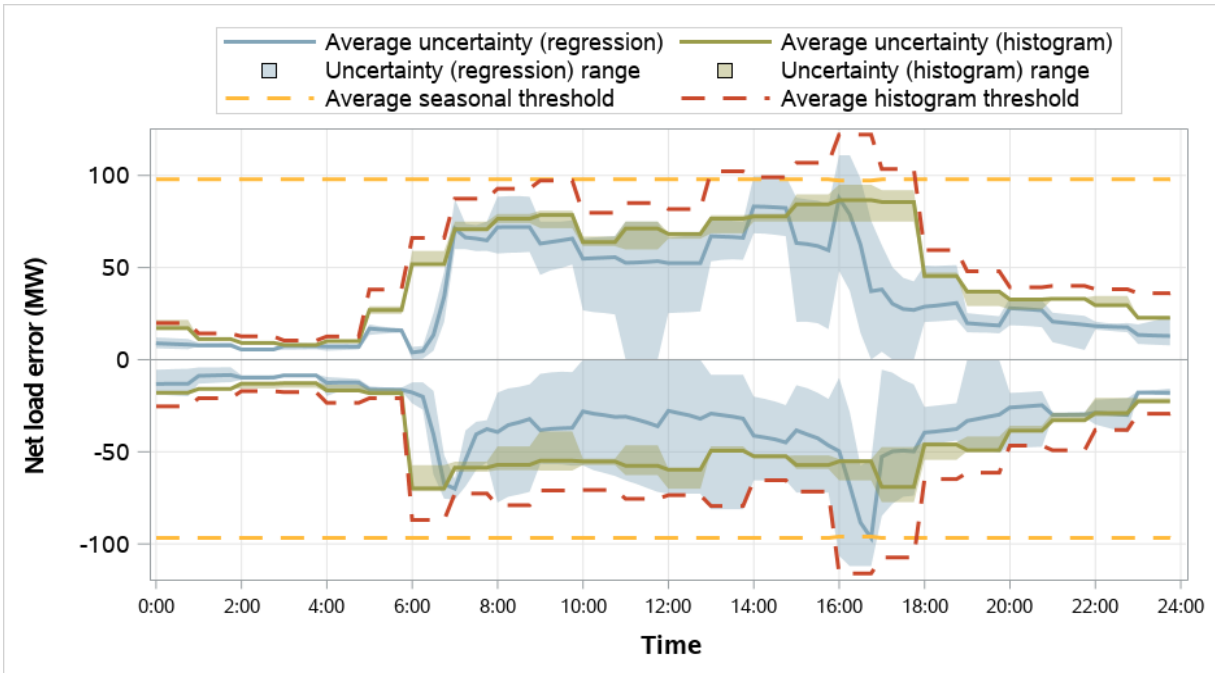


Figure 5.11 Idaho Power resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

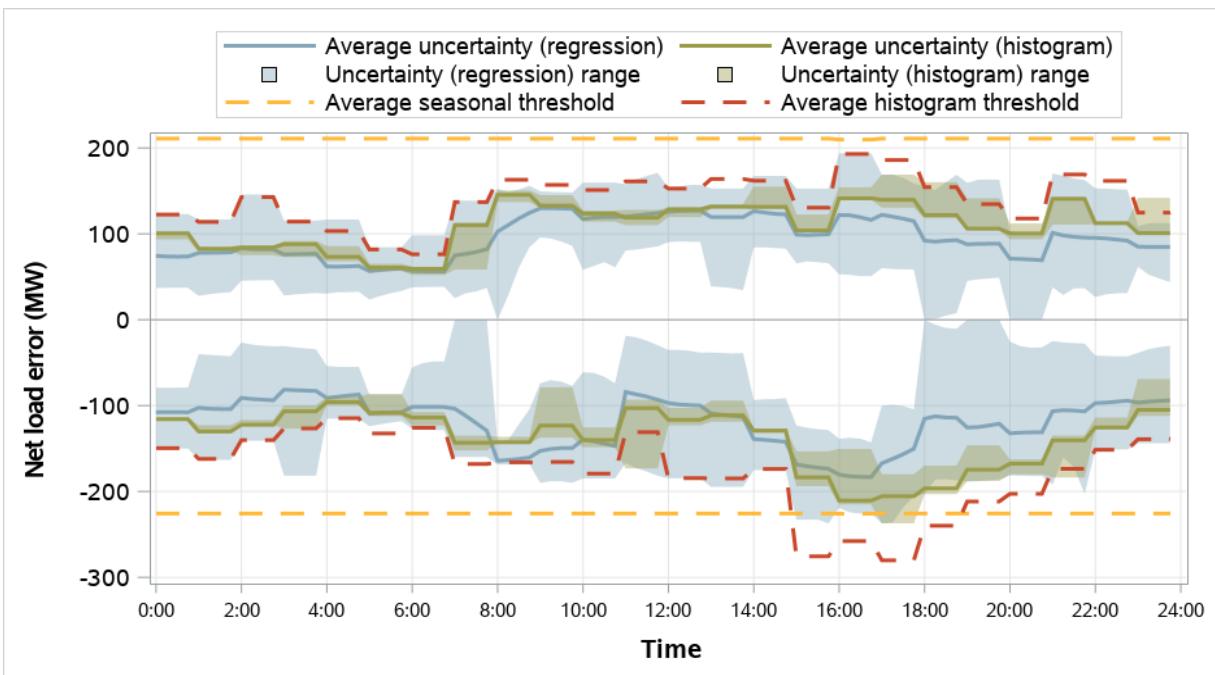


Figure 5.12 LADWP resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

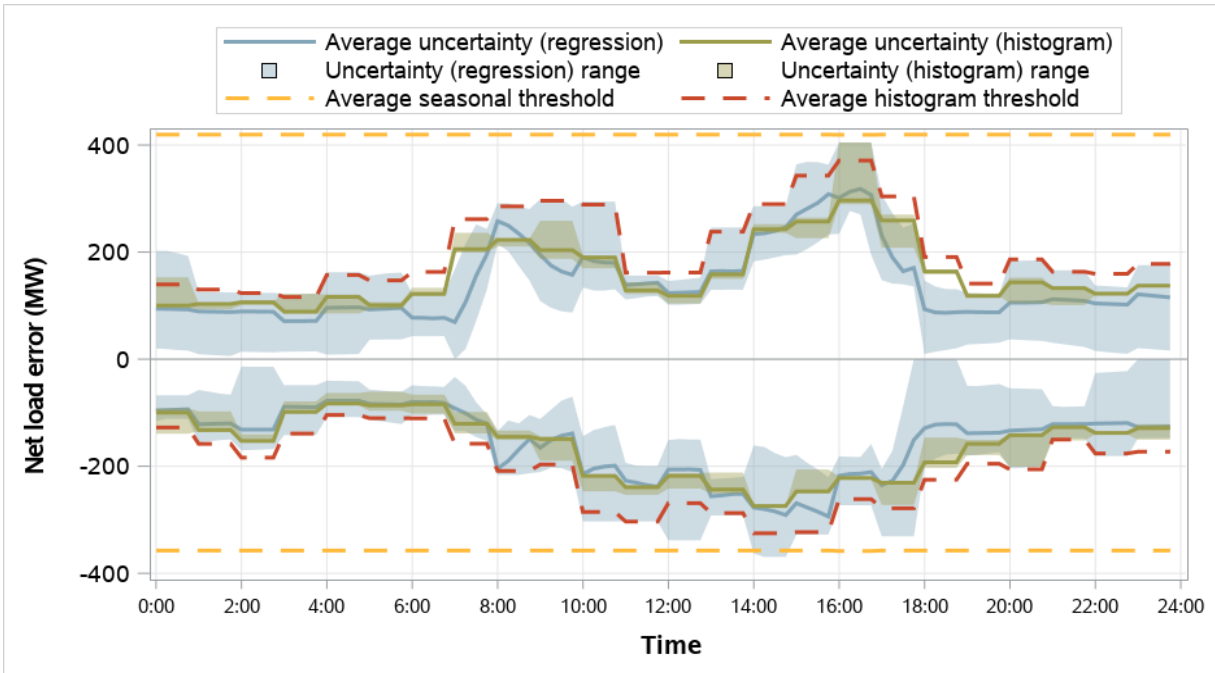


Figure 5.13 NorthWestern Energy resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

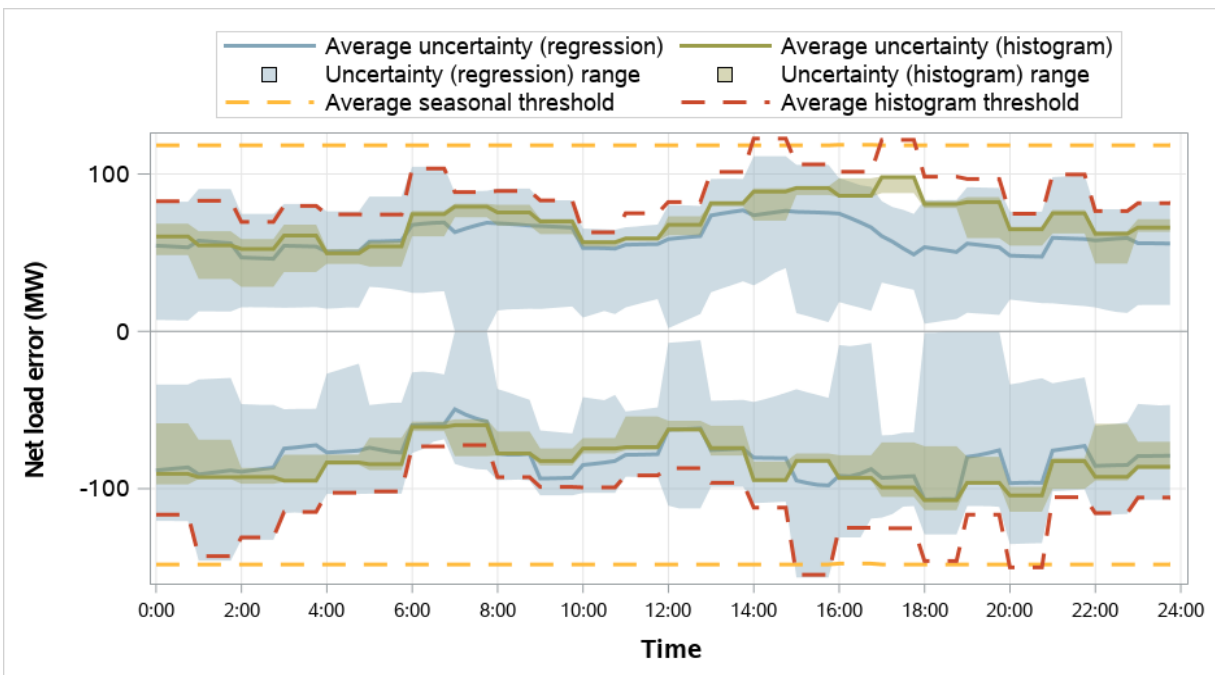


Figure 5.14 NV Energy resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

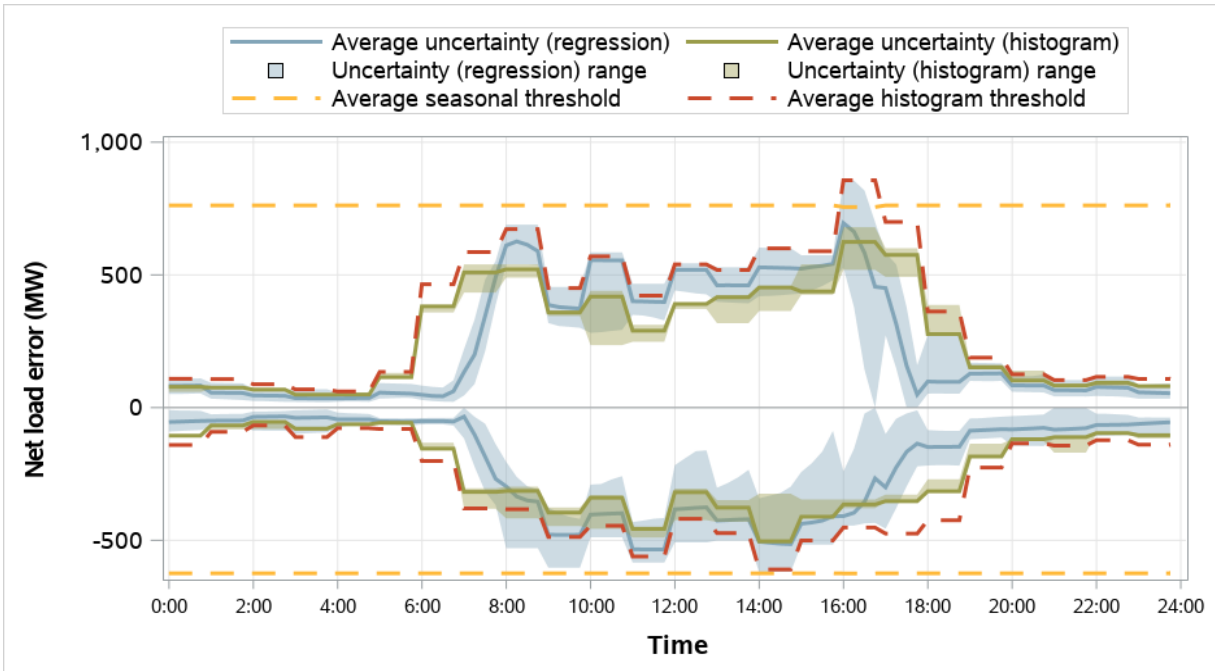


Figure 5.15 PacifiCorp East resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

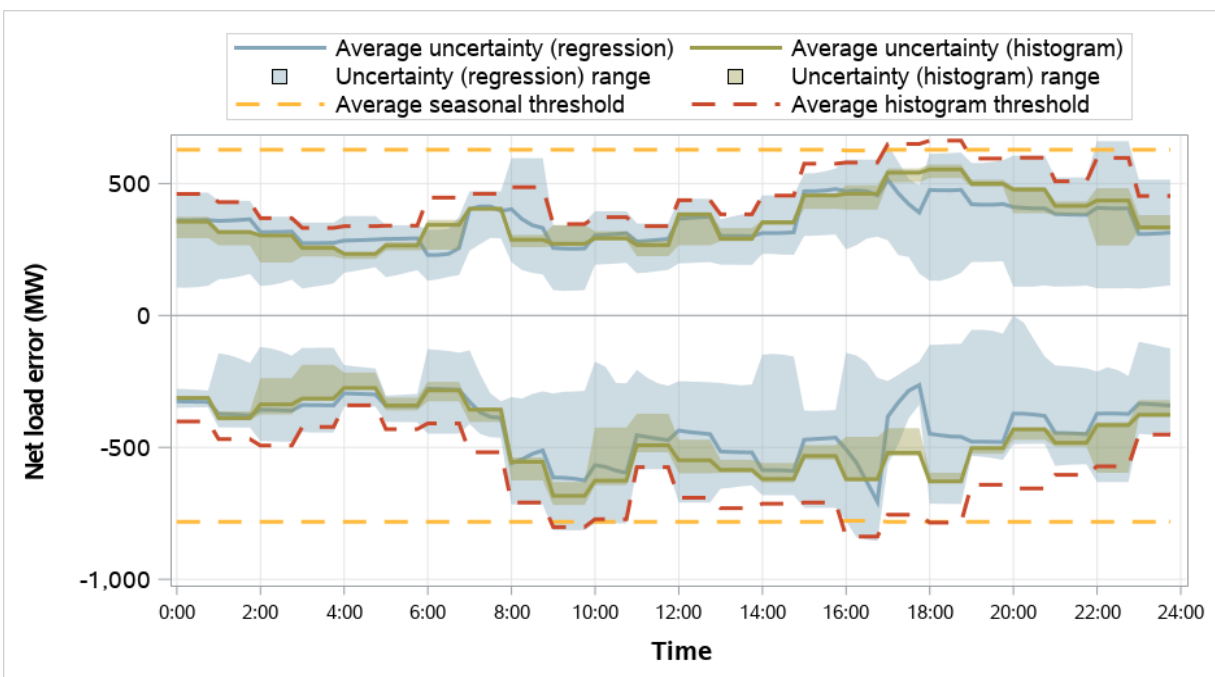


Figure 5.16 PacifiCorp West resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

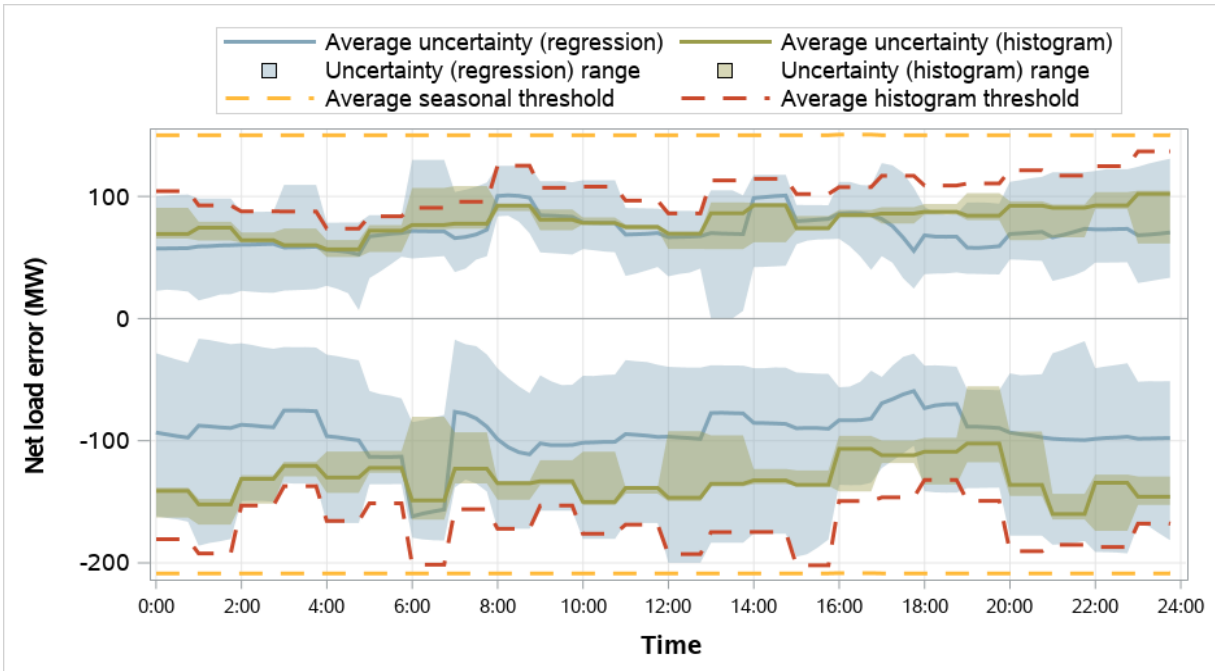


Figure 5.17 Portland General Electric resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

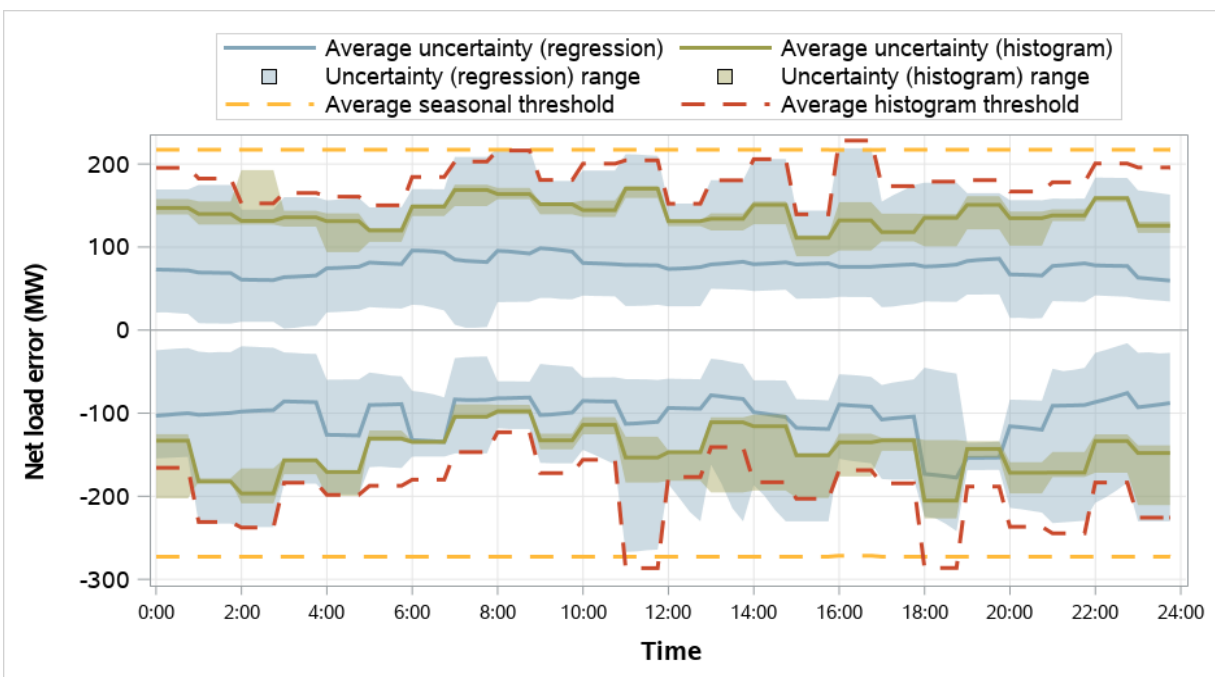


Figure 5.18 Powerex resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

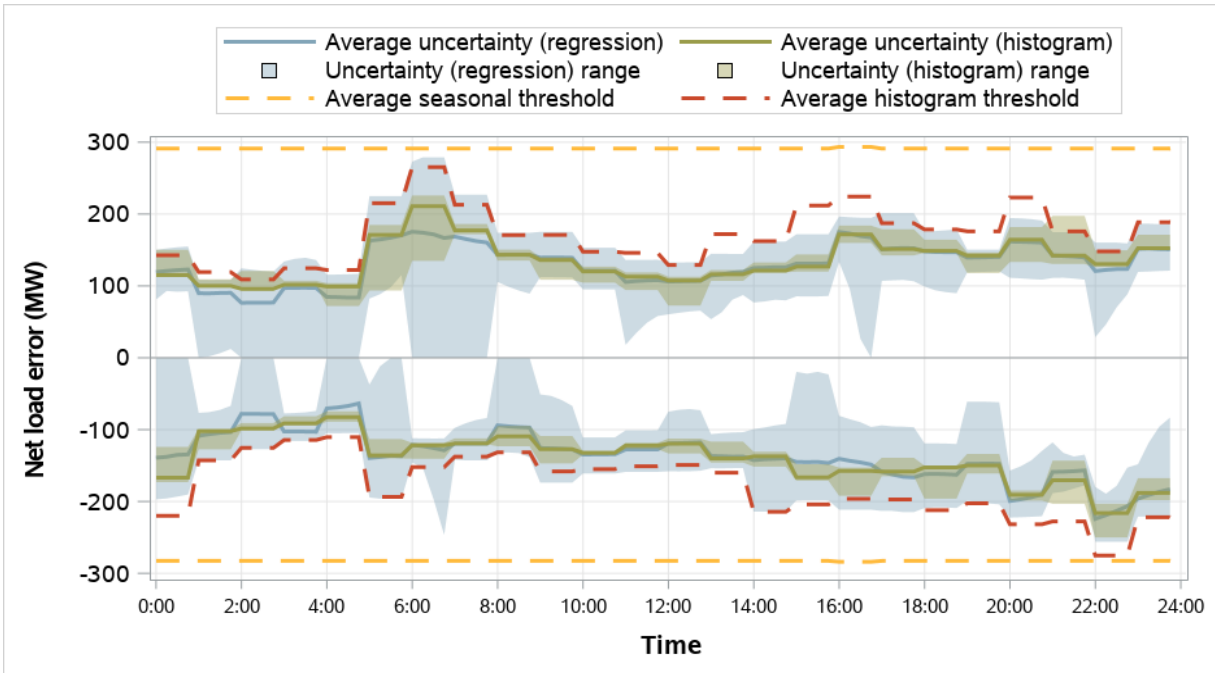


Figure 5.19 PNM resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

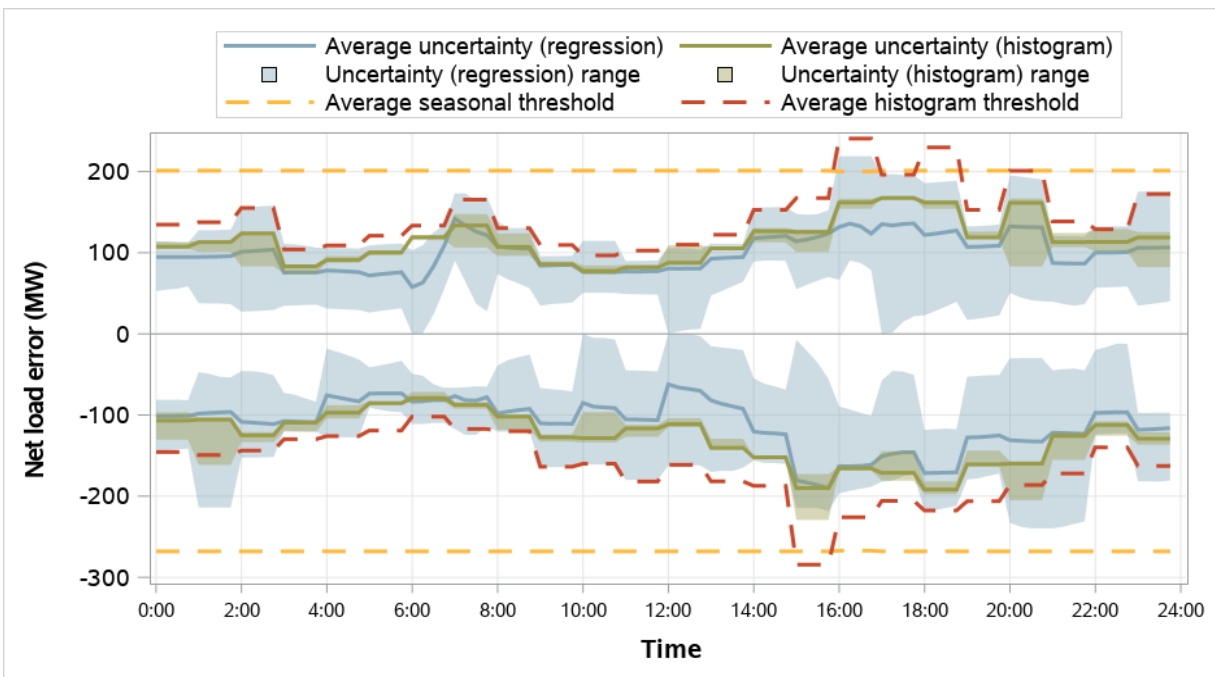


Figure 5.20 Puget Sound Energy resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

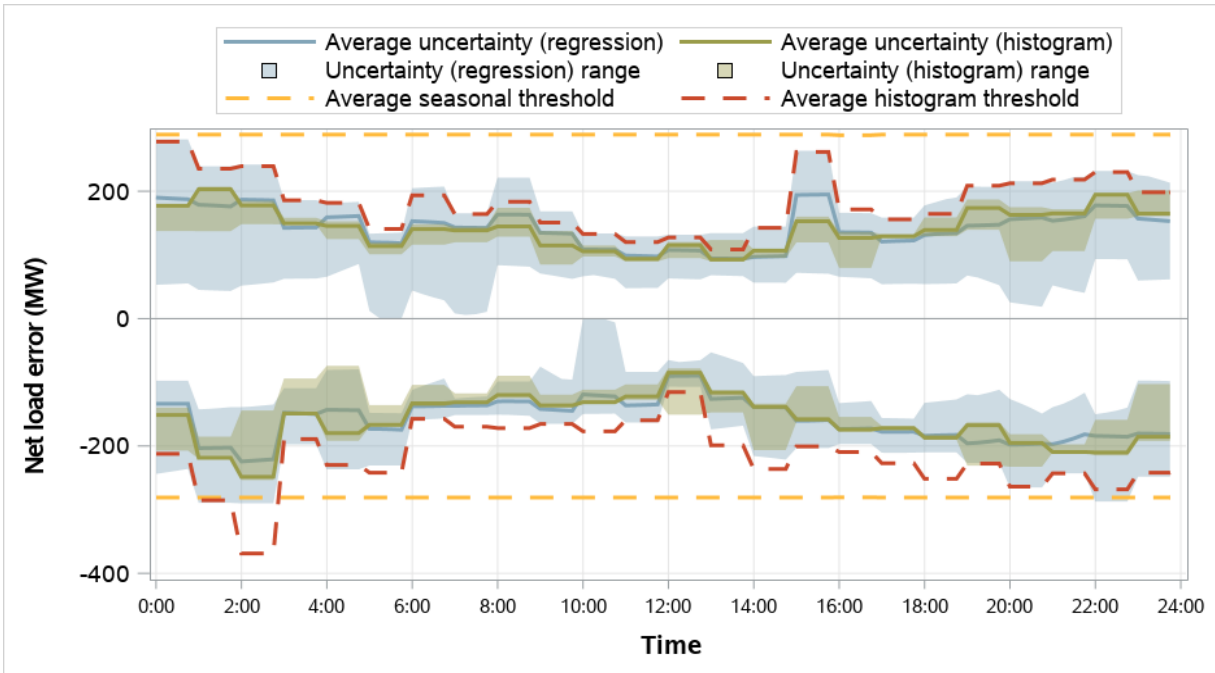


Figure 5.21 Salt River Project resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

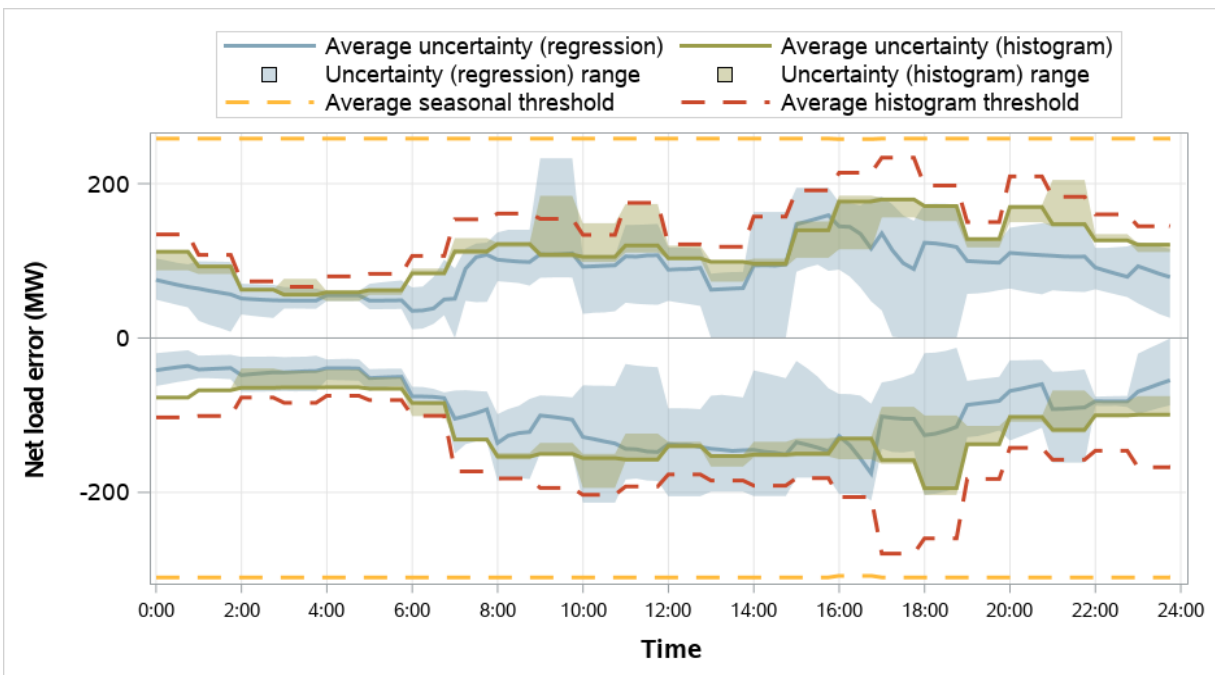


Figure 5.22 Seattle City Light resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

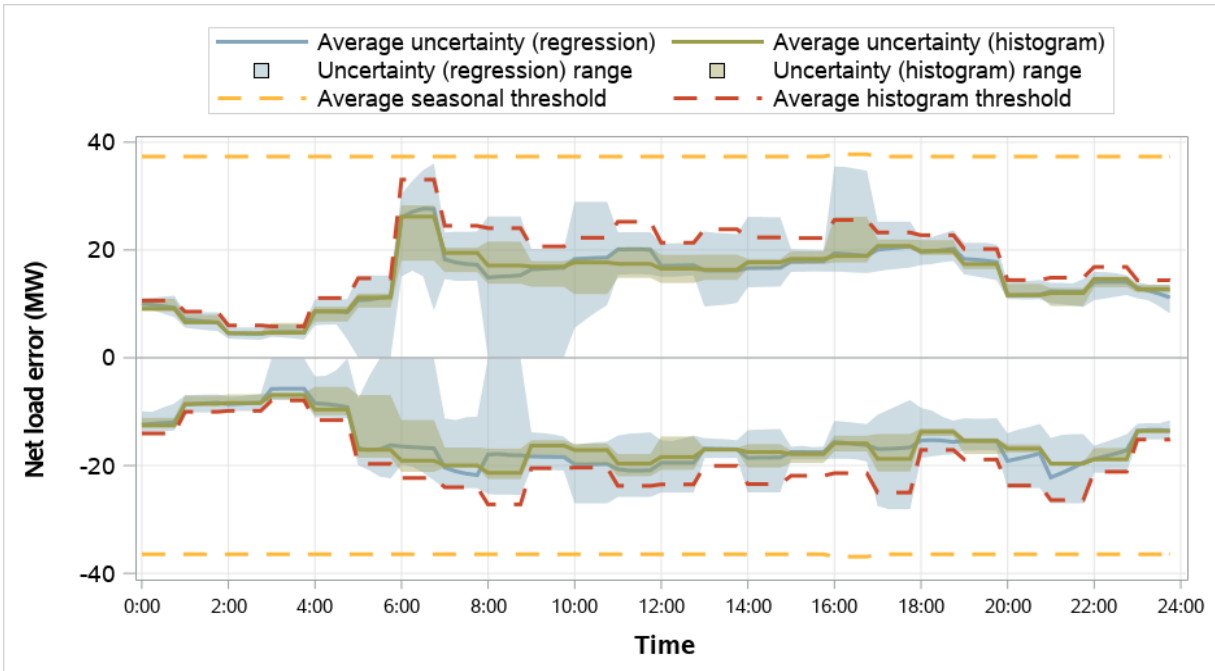


Figure 5.23 Tacoma Power resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

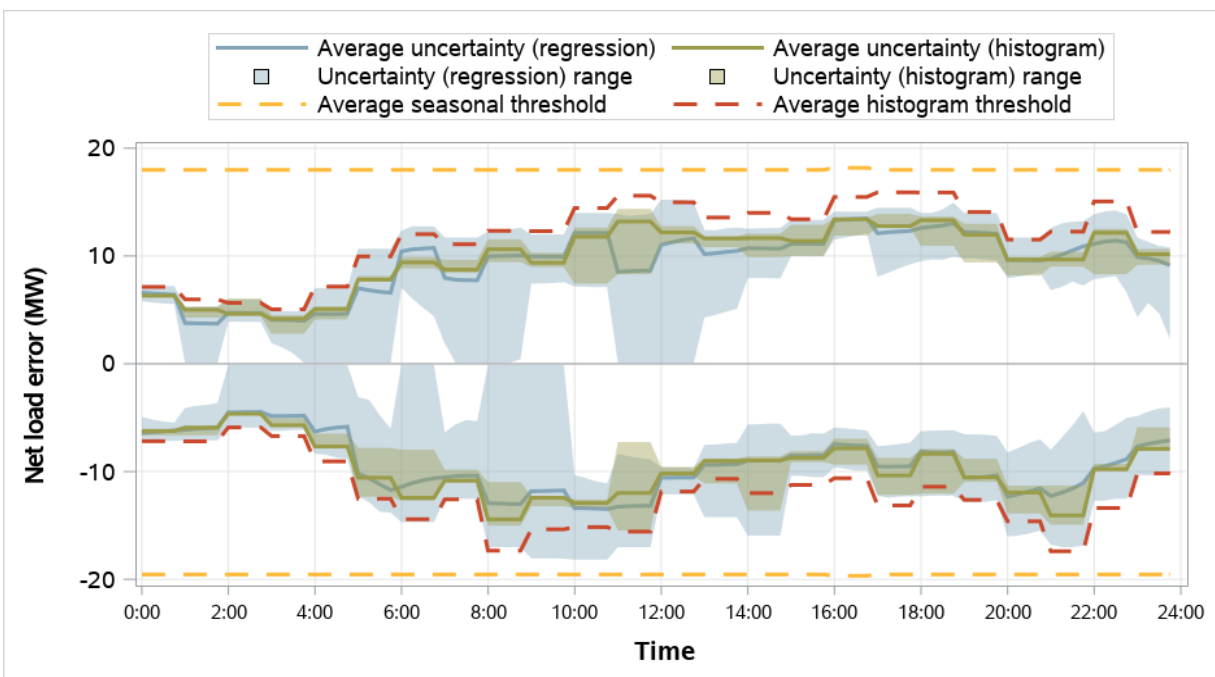


Figure 5.24 Tucson Electric Power resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

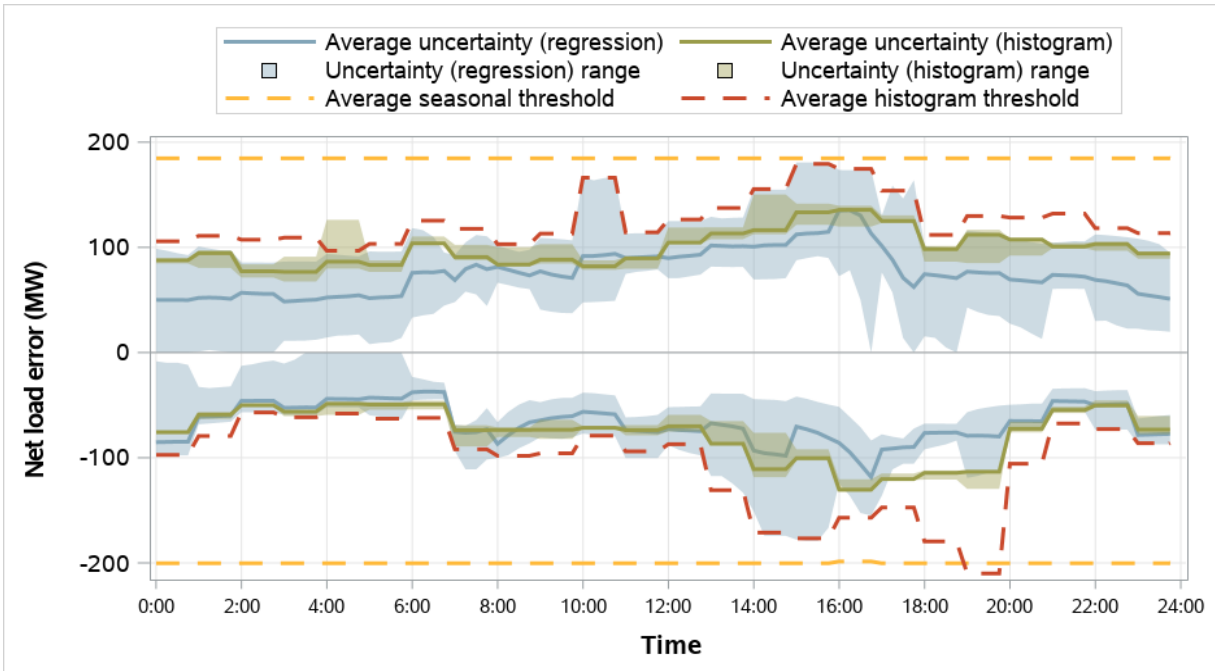


Figure 5.25 Turlock Irrigation District resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)


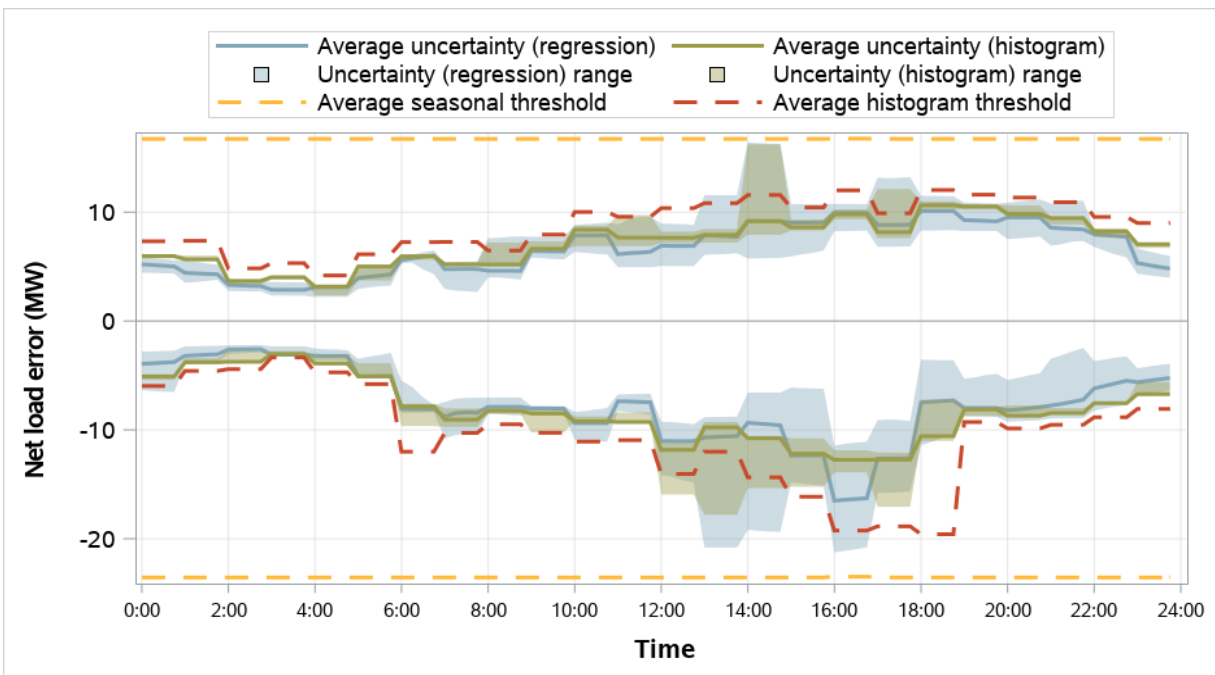


Figure 5.26 WAPA Desert Southwest resource sufficiency evaluation uncertainty requirements (weekdays, October 2023)

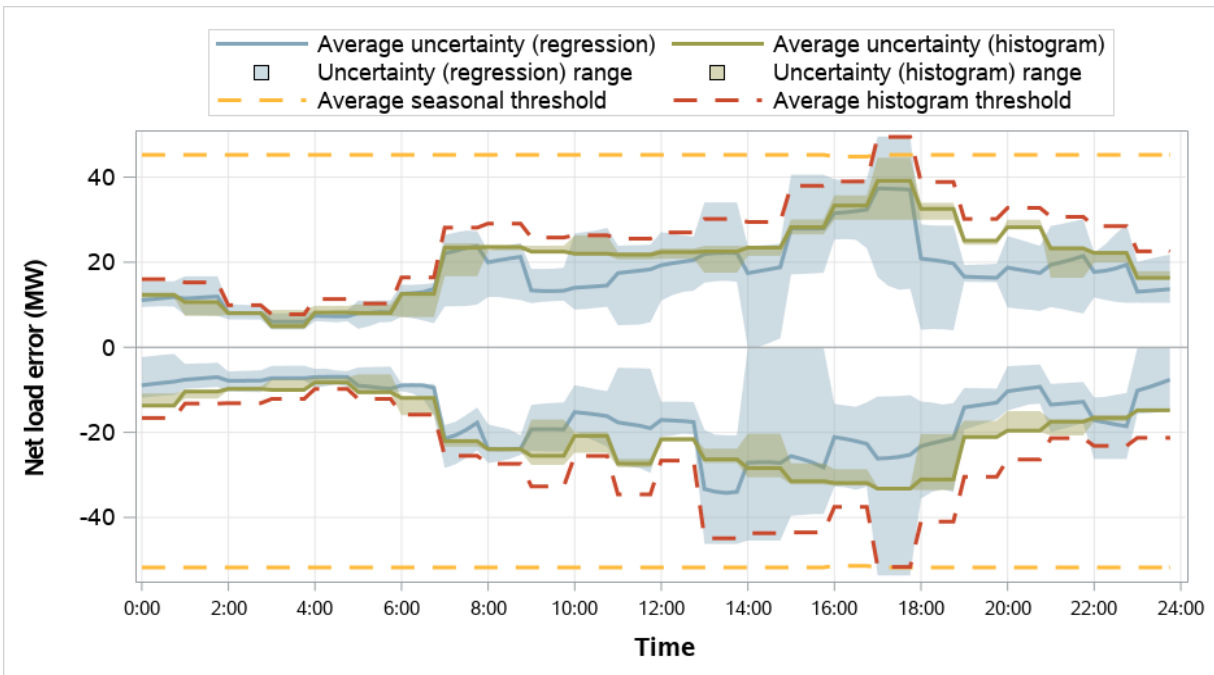

Performance measurements of quantile regression uncertainty

Table 5.1 summarizes the average requirements calculated using both the histogram and mosaic quantile regression methods. On average across all hours, the uncertainty calculated from the regression method was less than the histogram method for all balancing areas in both directions. For Portland General Electric, the regression-based uncertainty was 47 percent less for upward uncertainty and 33 percent less for downward uncertainty.

Table 5.2 summarizes the *actual net load error* — as measured by the difference between binding 5-minute market net load forecasts and *net load forecasts in the resource sufficiency evaluation* — and how that compares to the mosaic regression uncertainty requirements for the same interval.³⁰ The left side of the table summarizes the closeness of the actual net load error to the uncertainty requirements when the actual net load error was within (or covered) by the upward and downward requirements.³¹ The calculated uncertainty from the mosaic regression covered between 80 and 95 percent of actual net load errors across all balancing areas. Only coverage for LADWP reached 95 percent with the regression-based uncertainty. The right side of the table summarizes when the actual net load error instead exceeded upward or downward uncertainty requirements.

³⁰ In comparing the 15-minute resource sufficiency evaluation forecasts to the three corresponding 5-minute forecasts, all three observations of error were used as a separate observation for calculating coverage, closeness, and exceedance.

³¹ To the extent that the actual net load error averages around zero MW, this measurement largely matches the upward and downward uncertainty requirements.

Table 5.3 shows the same information except with requirements calculated from the histogram method. Coverage from the histogram method was more than the regression method for all balancing areas.

Table 5.1 Average uncertainty requirements in the resource sufficiency evaluation (October 2023)

<i>Balancing area</i>	Upward uncertainty			Downward uncertainty		
	Histogram	Mosaic	Percent difference	Histogram	Mosaic	Percent difference
Arizona Public Service	214.0	175.2	-18%	-193.6	-180.3	-7%
Avangrid	211.5	130.4	-38%	-194.1	-144.9	-25%
Avista	46.8	35.4	-24%	-65.0	-54.2	-17%
BANC	38.3	35.6	-7%	-47.1	-43.1	-9%
Bonneville Power Admin.	210.4	153.4	-27%	-314.1	-230.7	-27%
California ISO	1,176.8	1,057.8	-10%	-742.7	-711.7	-4%
El Paso Electric	48.7	34.6	-29%	-41.2	-30.4	-26%
Idaho Power	111.5	95.4	-14%	-136.6	-117.3	-14%
LADWP	161.2	144.8	-10%	-165.0	-157.3	-5%
NorthWestern Energy	67.6	55.2	-18%	-81.8	-76.5	-6%
NV Energy	269.7	244.3	-9%	-236.8	-216.1	-9%
PacifiCorp East	356.2	324.0	-9%	-457.7	-410.3	-10%
PacifiCorp West	79.9	67.7	-15%	-129.7	-86.0	-34%
Portland General Electric	137.8	72.8	-47%	-147.7	-98.9	-33%
Powerex	134.6	128.5	-4%	-139.1	-132.5	-5%
PNM	113.5	101.1	-11%	-130.5	-116.5	-11%
Puget Sound Energy	138.2	132.5	-4%	-156.8	-151.5	-3%
Salt River Project	115.4	85.4	-26%	-115.8	-91.7	-21%
Seattle City Light	14.5	14.1	-3%	-15.4	-14.8	-3%
Tacoma Power	9.5	8.9	-6%	-9.5	-9.1	-4%
Tucson Electric Power	100.3	78.4	-22%	-76.3	-65.6	-14%
Turlock Irrigation District	7.4	7.0	-6%	-8.4	-7.7	-9%
WAPA Desert Southwest	20.4	16.8	-18%	-19.9	-15.5	-22%

Table 5.2 Actual net load error versus mosaic regression uncertainty requirements (October 2023)

<i>Balancing area</i>	Actual net load error falls within calculated uncertainty requirements			Actual net load error exceeds ...			
	Percent of intervals	Distance to up requirement (MW)	Distance to down requirement (MW)	upward requirement		downward requirement	
				Percent of intervals	Amount (MW)	Percent of intervals	Amount (MW)
Arizona Public Service	87%	168.0	193.2	7%	66.5	5%	58.4
Avangrid	91%	124.1	151.9	5%	36.1	4%	59.7
Avista	90%	39.2	52.5	6%	8.3	4%	14.8
BANC	90%	35.4	43.7	6%	17.5	4%	13.0
Bonneville Power Admin.	88%	174.0	221.0	5%	75.5	6%	71.8
California ISO	90%	795.0	1,011.4	7%	185.8	3%	289.7
El Paso Electric	89%	36.1	30.7	5%	8.1	6%	13.1
Idaho Power	86%	107.3	109.1	8%	43.6	6%	45.0
LADWP	95%	146.9	157.0	3%	27.7	3%	40.4
NorthWestern Energy	90%	59.4	75.2	6%	16.0	4%	21.8
NV Energy	91%	227.8	258.9	8%	31.0	2%	51.1
PacifiCorp East	91%	329.2	407.4	5%	114.6	4%	119.3
PacifiCorp West	84%	72.0	85.0	8%	23.2	7%	38.2
Portland General Electric	91%	79.1	97.4	6%	54.1	4%	21.5
Powerex	85%	128.8	142.3	8%	46.1	7%	60.7
PNM	92%	94.0	125.2	7%	41.0	1%	33.5
Puget Sound Energy	90%	127.0	161.7	7%	36.7	3%	41.9
Salt River Project	87%	93.3	88.5	6%	30.0	7%	32.6
Seattle City Light	83%	15.5	14.5	7%	5.8	9%	8.4
Tacoma Power	81%	8.9	9.7	12%	4.3	7%	5.2
Tucson Electric Power	92%	68.1	77.9	6%	19.0	2%	30.7
Turlock Irrigation District	86%	6.7	8.0	9%	2.5	4%	2.8
WAPA Desert Southwest	80%	15.5	17.3	11%	7.3	9%	8.9

Table 5.3 Actual net load error versus histogram uncertainty requirements (October 2023)

<i>Balancing area</i>	Actual net load error falls within calculated uncertainty requirements			Actual net load error exceeds ...			
	Percent of intervals	Distance to up requirement (MW)	Distance to down requirement (MW)	upward requirement		downward requirement	
				Percent of intervals	Amount (MW)	Percent of intervals	Amount (MW)
Arizona Public Service	92%	202.4	206.2	4%	87.4	4%	61.5
Avangrid	96%	204.3	202.2	2%	74.7	2%	84.2
Avista	96%	48.9	63.0	1%	12.5	2%	15.4
BANC	94%	37.4	47.1	4%	22.1	2%	23.1
Bonneville Power Admin.	95%	230.1	295.4	3%	120.0	2%	120.9
California ISO	94%	893.6	1,026.6	4%	224.0	2%	306.8
El Paso Electric	97%	48.9	40.7	1%	9.9	2%	10.4
Idaho Power	91%	118.9	129.0	4%	57.8	4%	44.5
LADWP	96%	162.0	164.5	2%	31.7	2%	48.2
NorthWestern Energy	93%	69.7	80.3	3%	23.1	3%	19.4
NV Energy	97%	240.4	270.2	3%	49.1	1%	54.4
PacifiCorp East	94%	363.4	452.4	3%	172.8	2%	144.2
PacifiCorp West	93%	83.6	126.4	4%	27.5	3%	43.4
Portland General Electric	98%	141.5	144.2	1%	213.1	1%	30.8
Powerex	90%	130.8	143.6	5%	42.5	5%	65.3
PNM	94%	105.0	140.1	5%	48.6	1%	27.1
Puget Sound Energy	93%	130.9	165.7	5%	46.9	2%	33.6
Salt River Project	96%	119.9	110.8	1%	43.1	3%	32.3
Seattle City Light	86%	15.4	14.6	6%	4.4	8%	7.7
Tacoma Power	84%	9.0	10.0	10%	3.8	7%	5.3
Tucson Electric Power	97%	87.5	89.4	2%	27.0	1%	40.6
Turlock Irrigation District	90%	7.1	8.6	7%	2.5	3%	2.9
WAPA Desert Southwest	90%	18.9	21.2	6%	6.5	4%	10.6

Variability of quantile regression uncertainty

Prior to February 2023, uncertainty used in the resource sufficiency evaluation was known in advance of the trade date based on the lower and upper percentiles of observations over the historical period for the same hour (*histogram approach*). Under this approach, the uncertainty was also the same in each interval for the evaluation hour. The *mosaic quantile regression* approach combines regression results with current load, solar, and wind forecast information to calculate uncertainty in each 15-minute interval of the evaluation hour. With this approach, the regression coefficients for individual balancing areas are known in advance, but the exact uncertainty is dependent on current forecast information. A natural consequence of this is that calculated uncertainty has greater variability and is more difficult to predict in advance.

Changes in uncertainty between resource sufficiency evaluation runs

Figure 5.27 shows the difference in the calculated upward uncertainty from the first run of the resource sufficiency evaluation at 75 minutes prior to the evaluation hour, to the second run of the resource sufficiency evaluation at 55 minutes prior to the evaluation hour. Figure 5.28 shows the same information for downward uncertainty. Load and renewable forecasts are held fixed between the second (T-55) and final (T-40) resource sufficiency evaluations such that uncertainty is also unchanged between these runs. Therefore, these figures summarize how effective the T-75 uncertainty is in predicting the final uncertainty used in the resource sufficiency evaluation. The dashed gray region shows effectively no difference from the first resource sufficiency evaluation (less than one MW change). The regions above or below this show increased or decreased uncertainty relative to the T-75 results. The uncertainty difference from the first run of the resource sufficiency evaluation was typically less than 10 MW. More significant increases in the uncertainty requirement also occurred in rare instances and may lead to unexpected resource sufficiency evaluation failures.

Figure 5.27 Megawatt change in upward quantile regression uncertainty between T-75 and T-55 resource sufficiency evaluation runs (October 2023)


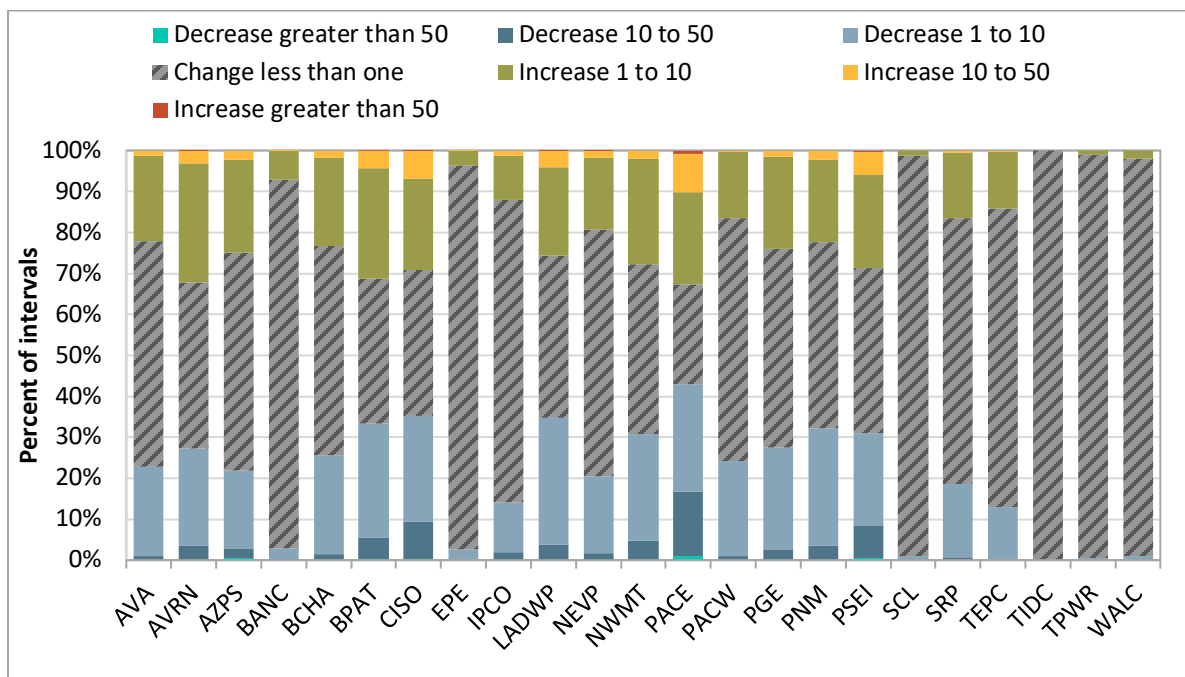



Figure 5.28 Megawatt change in downward quantile regression uncertainty between T-75 and T-55 resource sufficiency evaluation runs (October 2023)

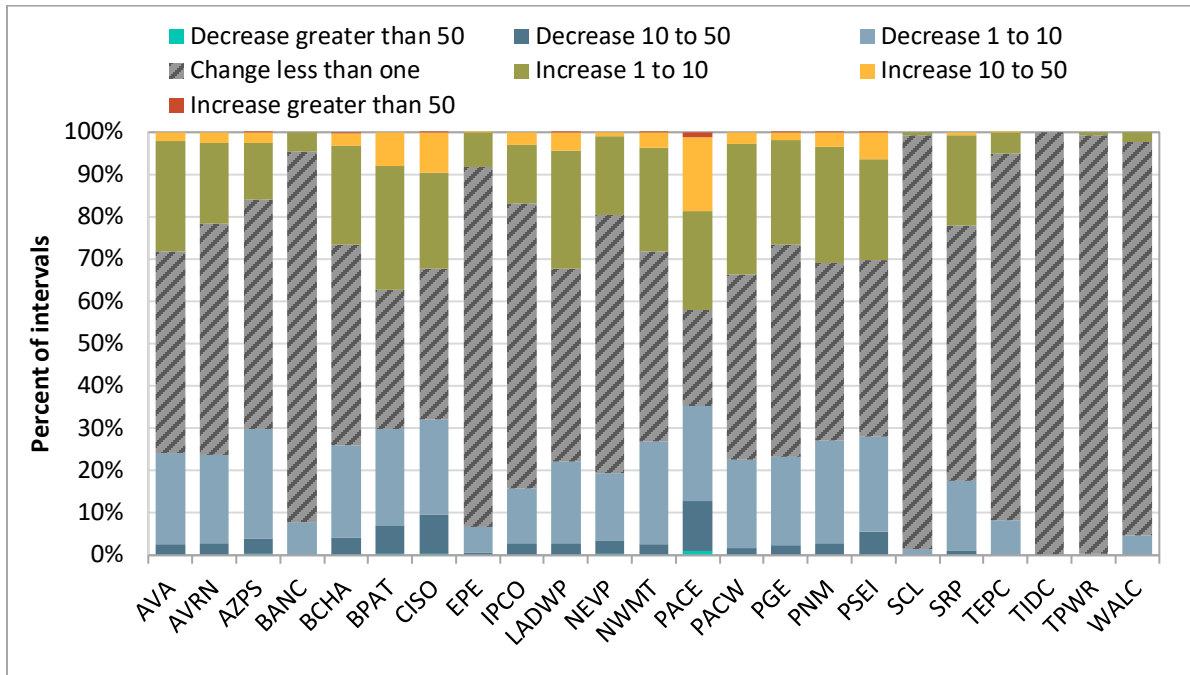

6 Additional demand in the real-time market compared to the resource sufficiency evaluation

The real-time market and resource sufficiency evaluation use different measurements for the total load. The resource sufficiency evaluation uses the raw (or initial) real-time load forecast directly in the requirement for both the capacity and the flexibility test. However, in the real-time market, the software adds operator load conformance, adds non-participating pump load, removes the portion that is estimated to be from losses, and finally recalculates the losses in the market.³² This is illustrated below in Figure 6.1 for the ISO area during an example interval. The example compares the total load and losses between the resource sufficiency evaluation with a corresponding advisory interval from the latest 15-minute market run.³³ In this example, the raw load forecast used in both cases (35,010 MW) was identical based on the timing of when the two market processes were run.

Figure 6.1 Example — difference between load used in the real-time market and in the resource sufficiency evaluation (CAISO, July 20, 2023. Hour-ending 23. Interval 1.)

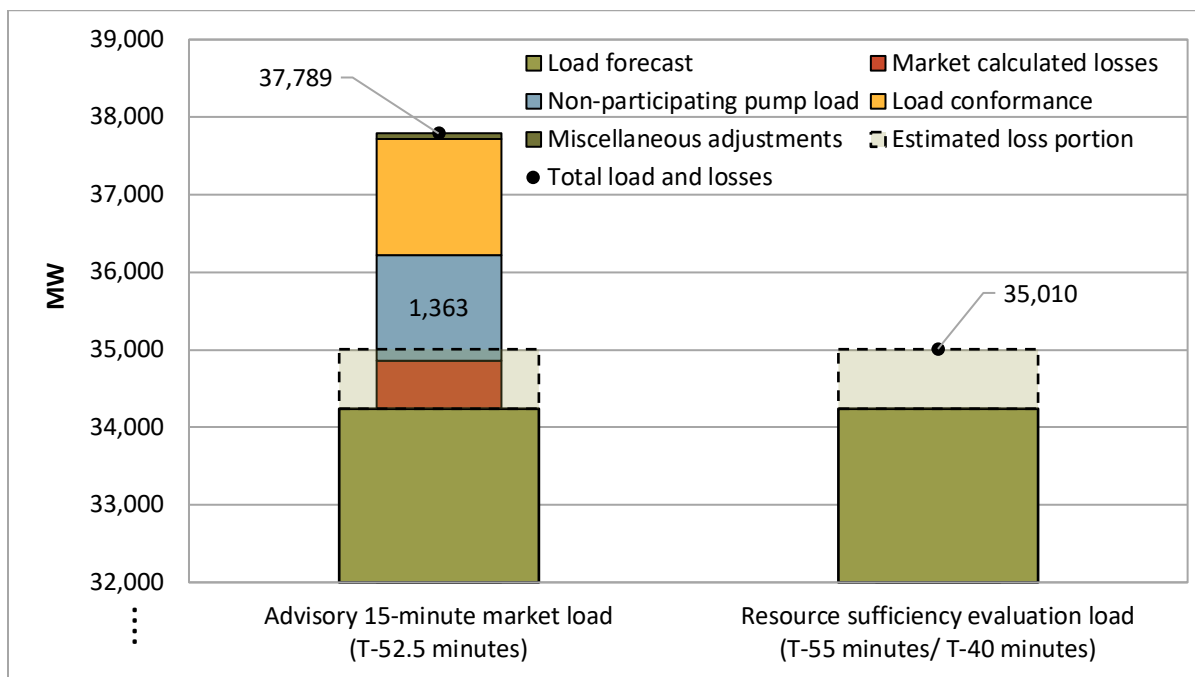

The potential inclusion of load conformance was discussed as part of a resource sufficiency evaluation enhancements stakeholder process. In this process, the ISO confirmed no changes in the tests to account for load conformance following findings that the use of load conformance does not regularly benefit any balancing area from passing the resource sufficiency evaluation.³⁴

³² The total load also adjusts for a few other miscellaneous components that cannot be accounted for elsewhere. The amounts here are typically small.

³³ Load and renewable forecasts are held fixed between the second run of the resource sufficiency evaluation (T-55) and final run (T-40).

³⁴ California ISO, EIM Resource Sufficiency Evaluation Enhancements Phase 2 Straw Proposal, July 1, 2022: <http://www.caiso.com/InitiativeDocuments/StrawProposal-WEIMResourceSufficiencyEvaluationEnhancementsPhase2.pdf>

Non-participating pump load within the ISO balancing area is not counted in the resource sufficiency evaluation. This is pumping load that is bid and scheduled as non-participating load in the day-ahead market and included as a component of the total load in the real-time market optimization. This pumping load can be significant (above 1,000 MW).

Non-participating pump load is included in the real-time market but not in the resource sufficiency evaluation. This can create differences in the conditions observed between both processes. This can also be a factor in hours during which the ISO passes the resource sufficiency evaluation while an Energy Emergency Alert is issued. Other factors can also contribute to this outcome. First, rapidly evolving and declining conditions might prompt an EEA, but may not be observed by the resource sufficiency evaluation based on the latest information in advance of the evaluation hour. Also, real-time low priority and economic exports that clear the hour-ahead scheduling process would be included in the real-time market as additional demand but are no longer counted as such in the resource sufficiency evaluation because of enhancements implemented on July 1, 2023.³⁵

DMM recommends that the ISO and stakeholders consider whether non-participating pump load should be included in the resource sufficiency evaluation. This would better align the conditions in the real-time market with the conditions considered in the resource sufficiency evaluation.

³⁵ For more information on the enhancement, see Section 3.

7 WEIM import limits following test failure

This section summarizes the import limits that are imposed when a WEIM entity fails either the bid-range capacity or the flexible ramping sufficiency test in the upward direction.

Balancing areas can voluntarily opt in to receiving assistance energy transfers. When a balancing area opts in to the program, their WEIM transfers will not be affected by any limits that would exist following an upward resource sufficiency evaluation failure — allowing the market to freely and optimally schedule WEIM transfers based on supply and demand conditions in the system. The import limits summarized in this section cover both balancing areas that opted out or opted in to the assistance energy transfer program. For balancing areas that opted in to the program, these limits reflect what would have been in place had the balancing area not opted in.

When either test fails in the upward direction, imports will be capped at the greater of (1) the base transfer or (2) the transfer from the last 15-minute market interval. Figure 7.1 summarizes the import limits after failing either test by the source of the limit. The black horizontal line (right axis) shows the number of 15-minute intervals with either a capacity or a flexibility test failure while the bars (left axis) show the percent of failure intervals in which the WEIM import limit was capped by either the base transfer or the last 15-minute market transfer. In some cases, the import limit after failing the test (i.e. the greater of the base transfer or last 15-minute interval transfer) is at or above the unconstrained total import capacity. In these cases, the import limit imposed after failing the test has no impact.

Figure 7.1 Upward capacity/flexibility test failure intervals by source of import limit (October 2023)

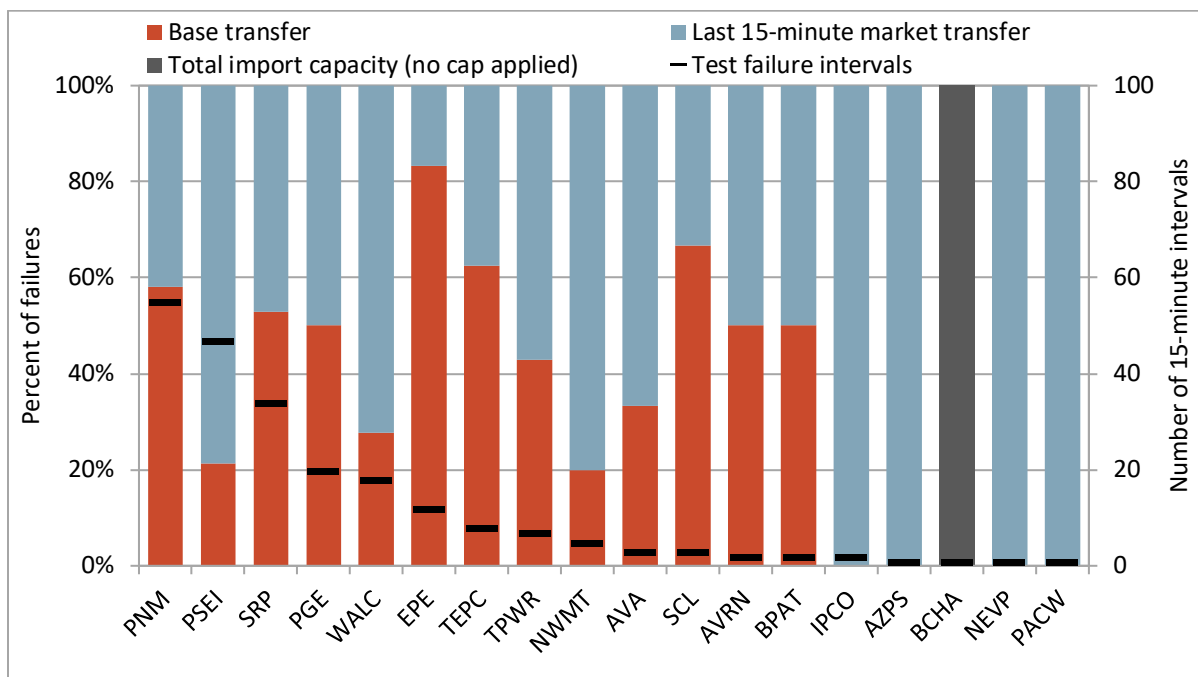


Figure 7.2 summarizes dynamic WEIM import limits above base transfers (fixed bilateral transactions between WEIM entities) after failing either test in the upward direction.³⁶ From this perspective, the incremental WEIM import limit after a test failure is set by the greater of (1) zero or (2) the transfer from the last 15-minute market interval minus the current base transfer. Therefore, the dynamic import limits show the incremental flexibility available through the WEIM after a resource sufficiency evaluation failure. The black horizontal line (right axis) shows the number of 15-minute intervals with an import limit imposed after a test failure. Areas without any upward test failures during the month were excluded.

Figure 7.2 Upward capacity/flexibility test failure intervals by dynamic import limit (October 2023)

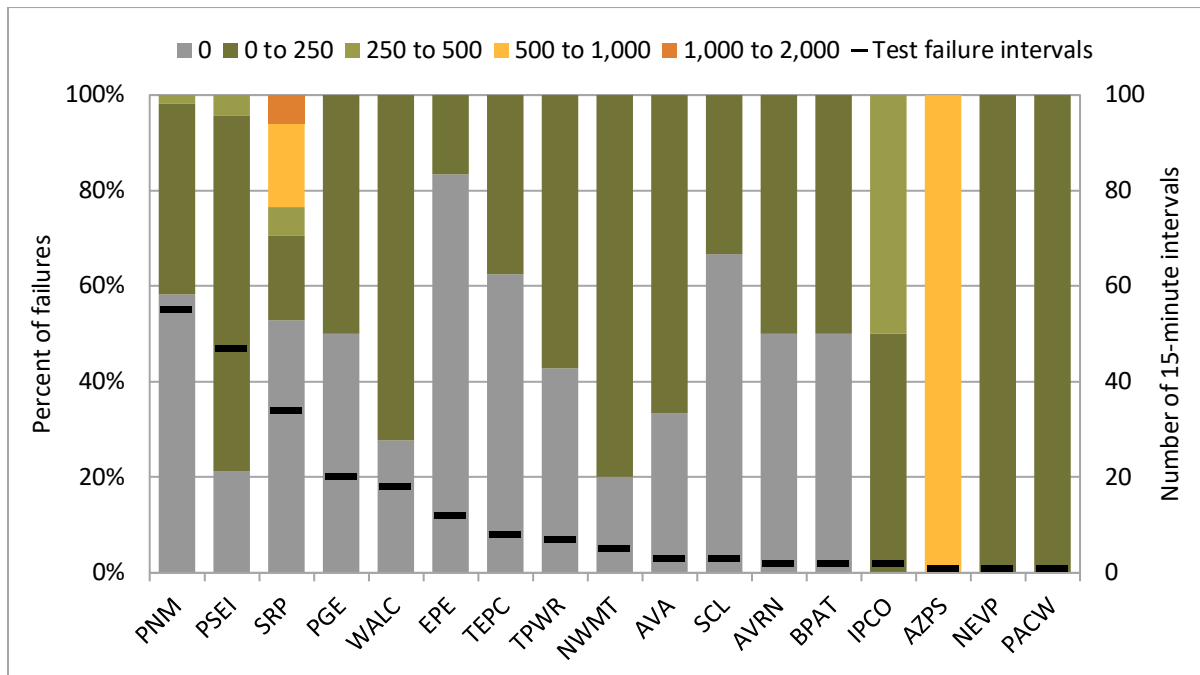


Figure 7.3 summarizes whether the import limit that was imposed after failing either test in the upward direction impacted market transfers (or would have impacted market transfers had the balancing area not opted in to the assistance energy transfer program).³⁷ The black horizontal line (right axis) shows the number of 15-minute market intervals with either a capacity or flexibility test failure. The blue bars (left axis) show the percent of failure intervals in which the resulting transfers after failing the resource sufficiency evaluation were *below* the import limit that was imposed (or would have been imposed for opt-in balancing areas). In all other failure intervals (red bars), the resulting transfers were either constrained to the limit imposed after failing the test or would have been constrained by the limit

³⁶ Test failure intervals in which an import limit was not imposed because it was at or above the unconstrained total import capacity were excluded from this summary.

³⁷ Test failure intervals in which an import limit was not imposed because it was at or above the unconstrained total import capacity were excluded from this summary.

without an opt-in designation. These results are shown separately for the 15-minute (FMM) and 5-minute (RTD) markets.

Figure 7.3 Percent of upward failure intervals in which WEIM imports were constrained or would have been constrained by test failure limits (October 2023)

