




EOR - SCIT Nomogram

Distribution Restriction:
NONE



East-of-River/Southern California Import Transmission Nomogram


Based upon:
Three Palo Verde units
All transmission facilities in service

Reduction in SCIT Import Limit

For Palo Verde Status:

3 units on Line	0 MW
2 units on Line	200 MW
1 unit on Line	400 MW
0 unit on Line	700 MW

NO MARGIN

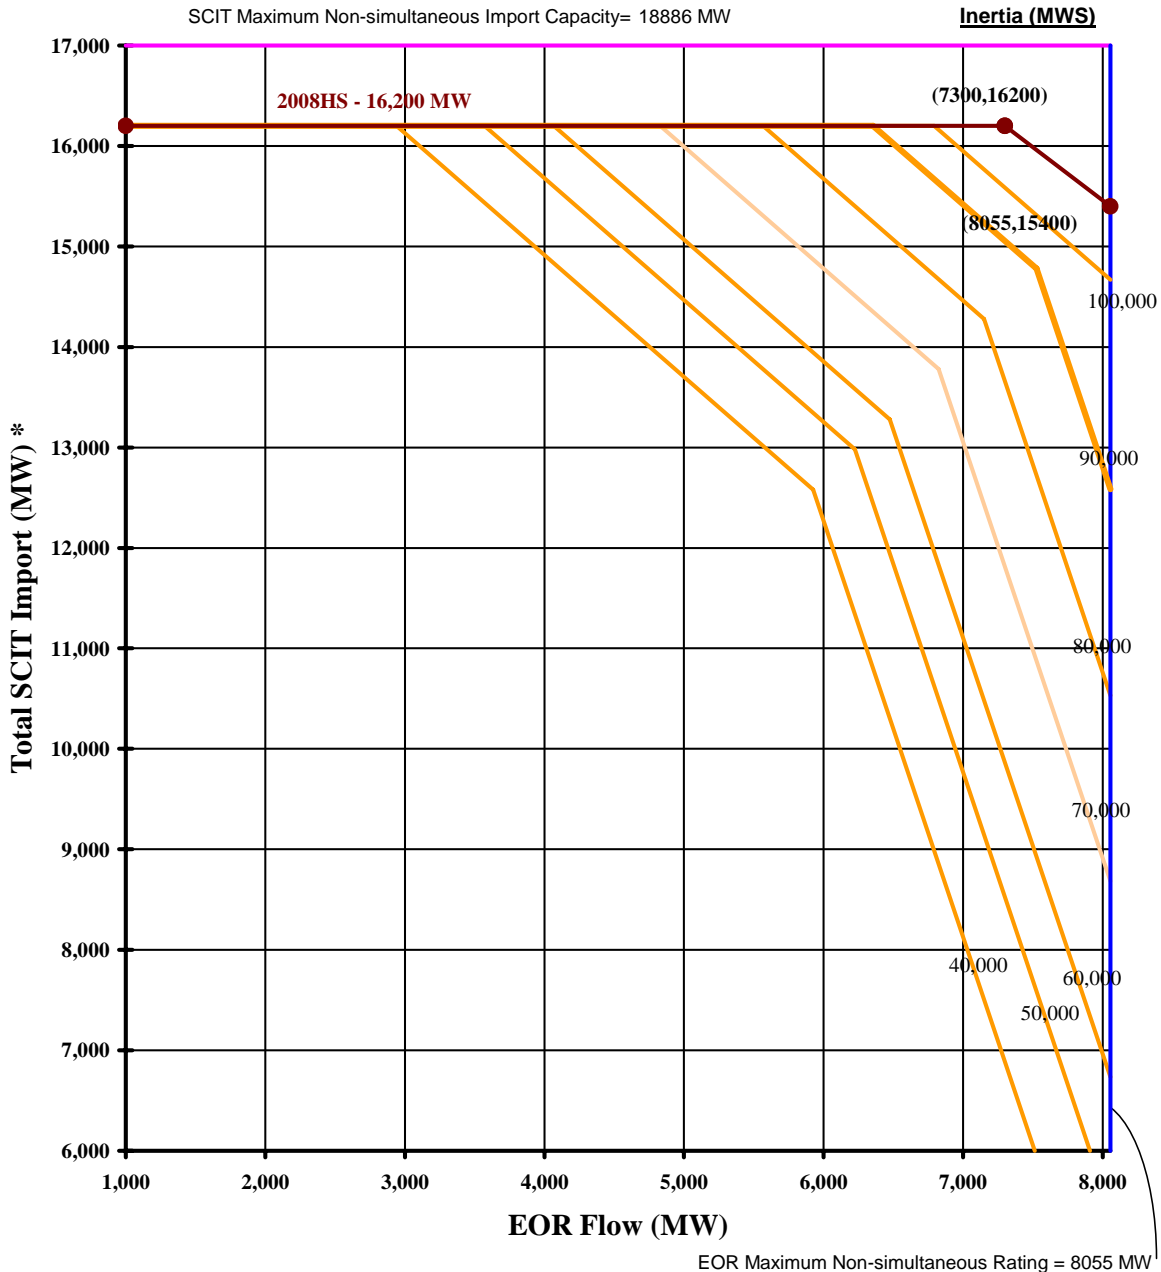

*Sum of flows on Midway-Vincent, PDCI, IPP, North of Lugo, and WOR.