

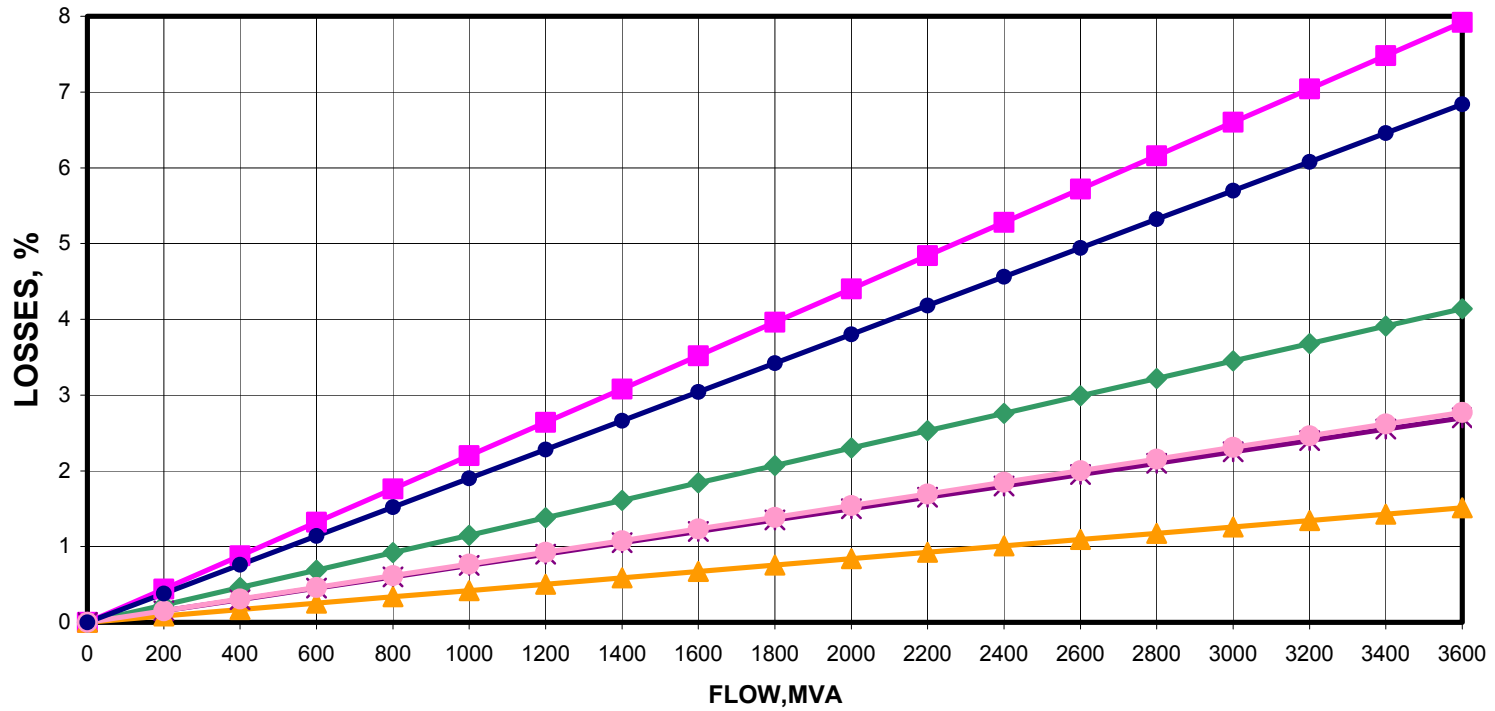





REAL LOSSES IN 500 KV LINES IN PERCENT OF FLOW

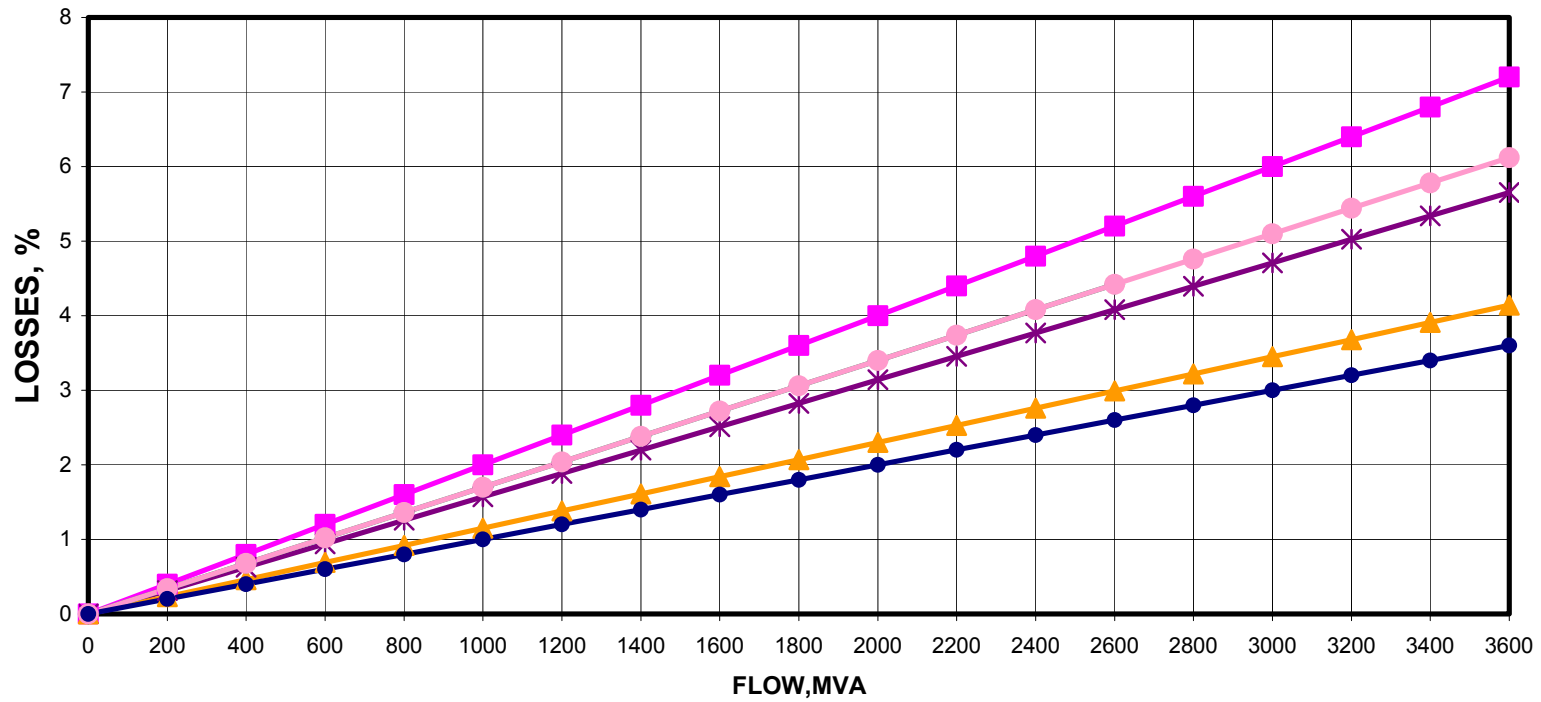



REAL LOSSES IN 500 KV LINES IN PERCENT OF FLOW





REAL LOSSES IN 500 KV LINES IN MW

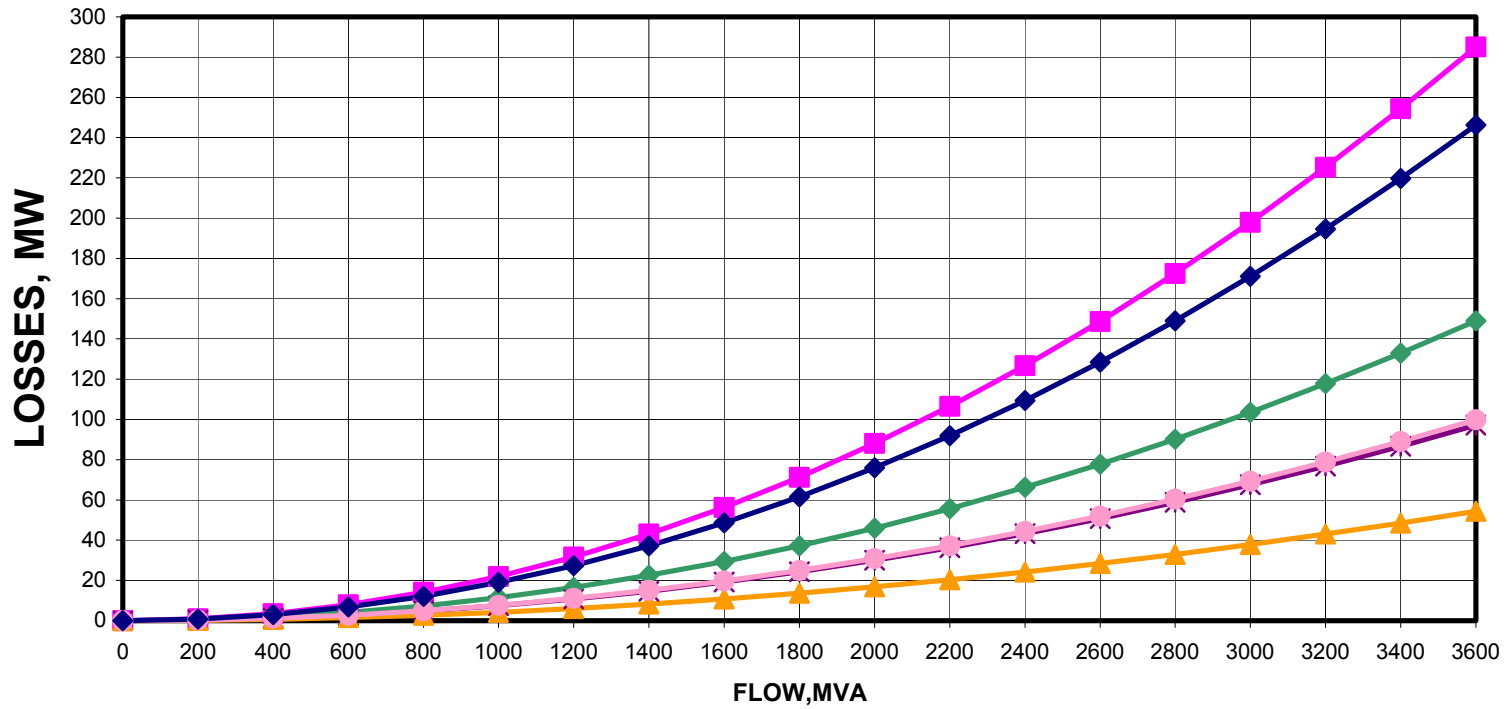


REAL LOSSES IN 500 KV LINES IN MW

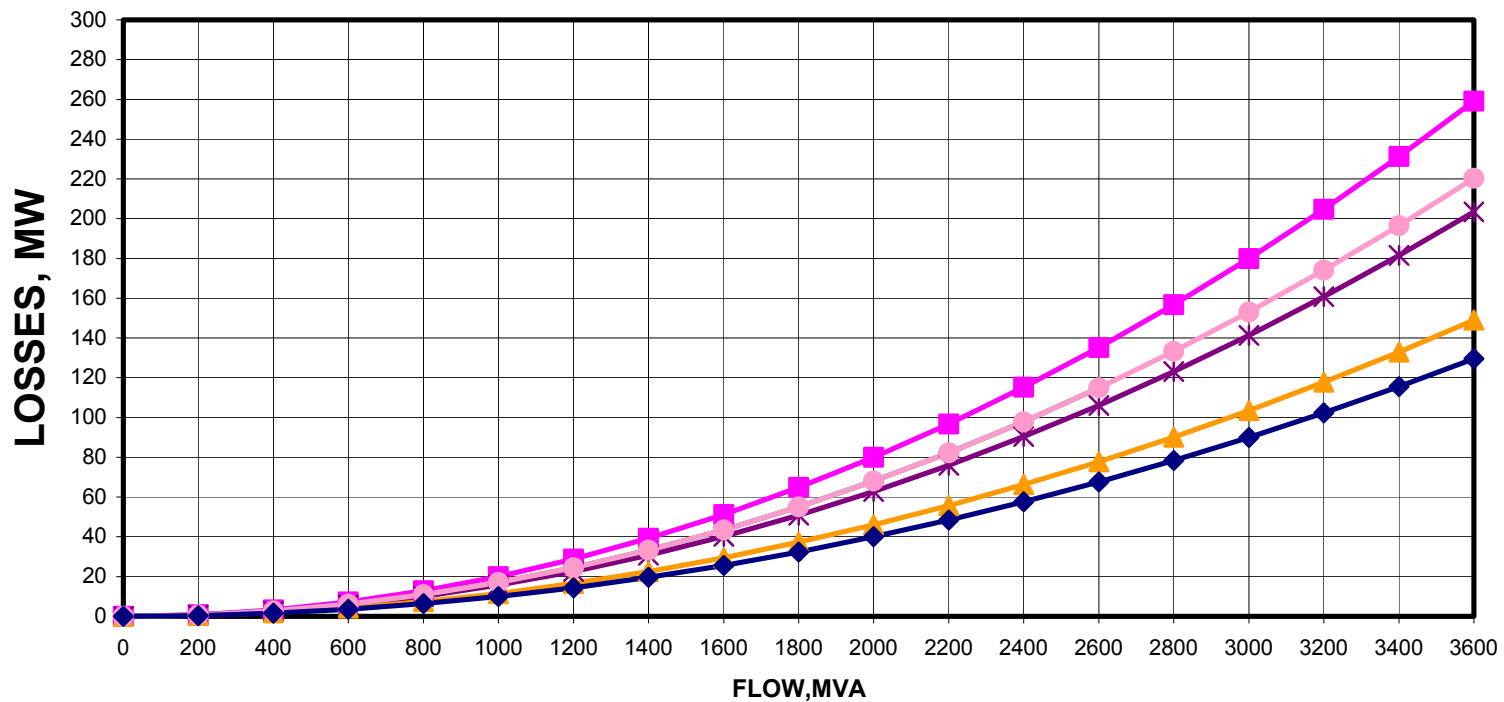



REACTIVE LOSSES IN 500 KV LINES IN PERCENT OF FLOW

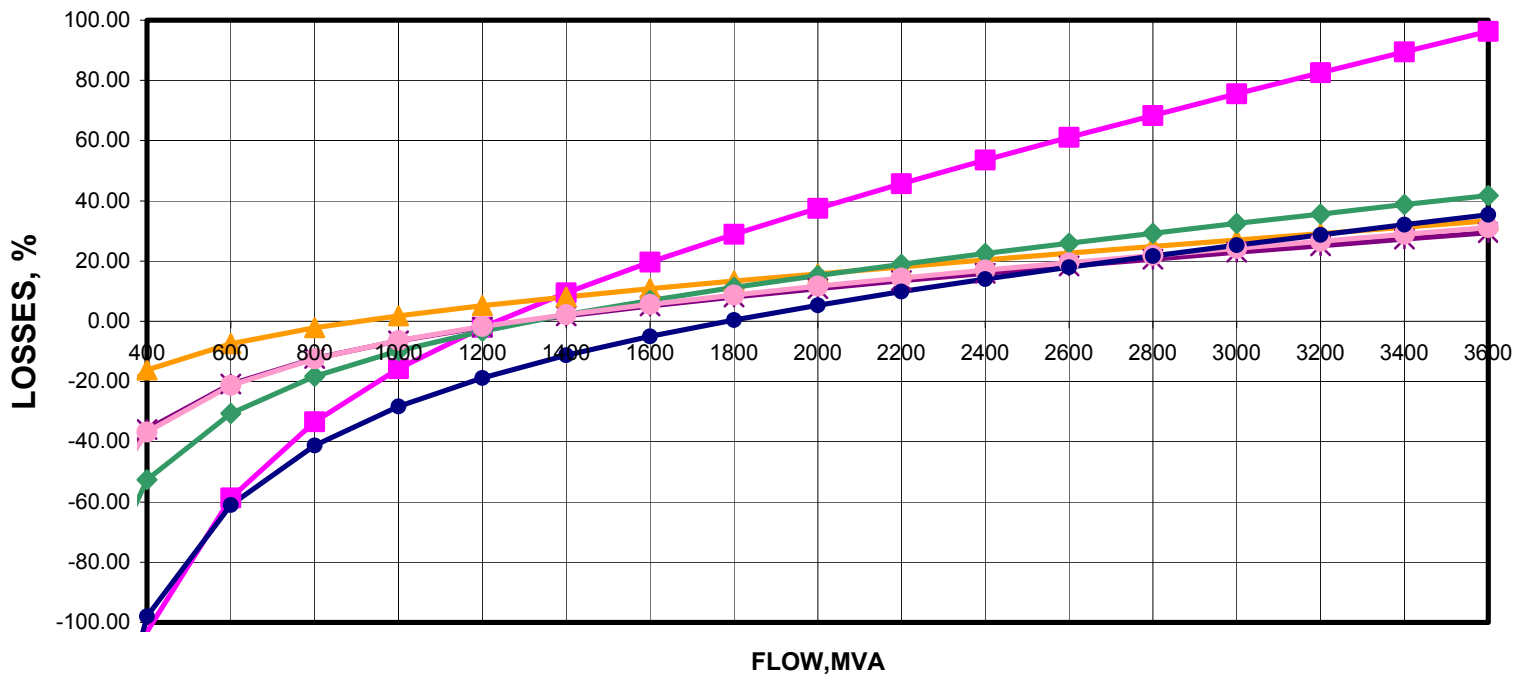



REACTIVE LOSSES IN 500 KV LINES IN PERCENT OF FLOW

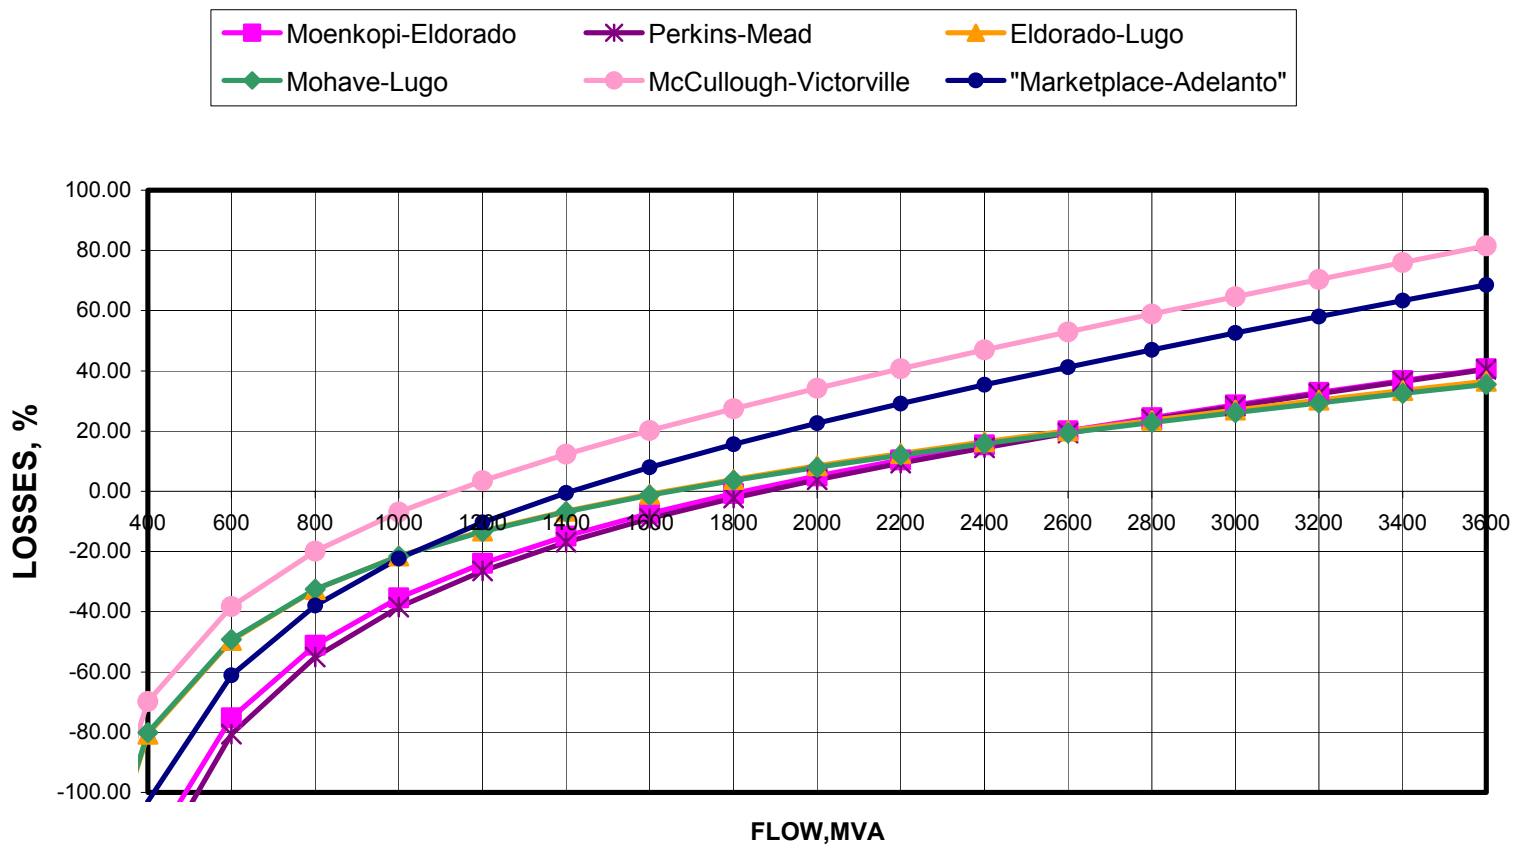



REACTIVE LOSSES IN 500 KV LINES IN MVAR

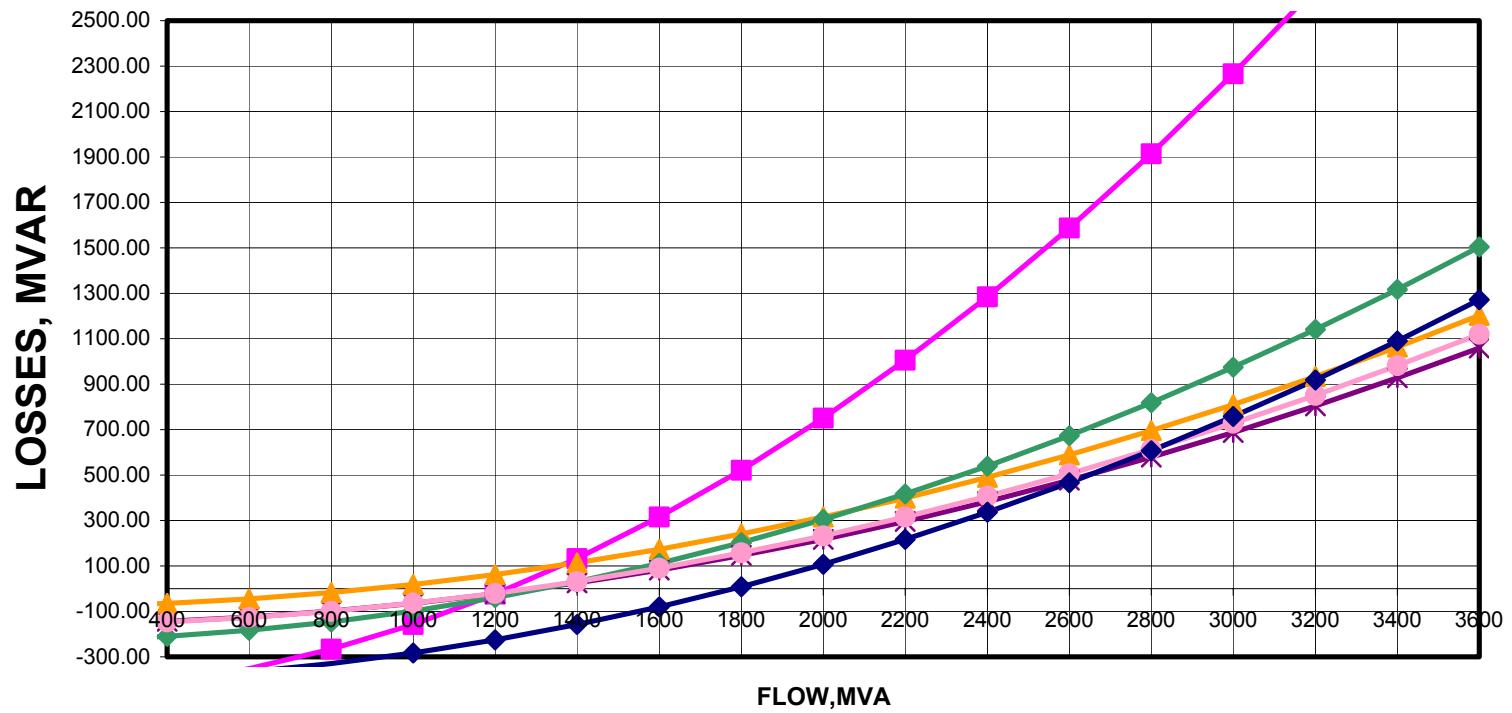



REACTIVE LOSSES IN 500 KV LINES IN MVAR

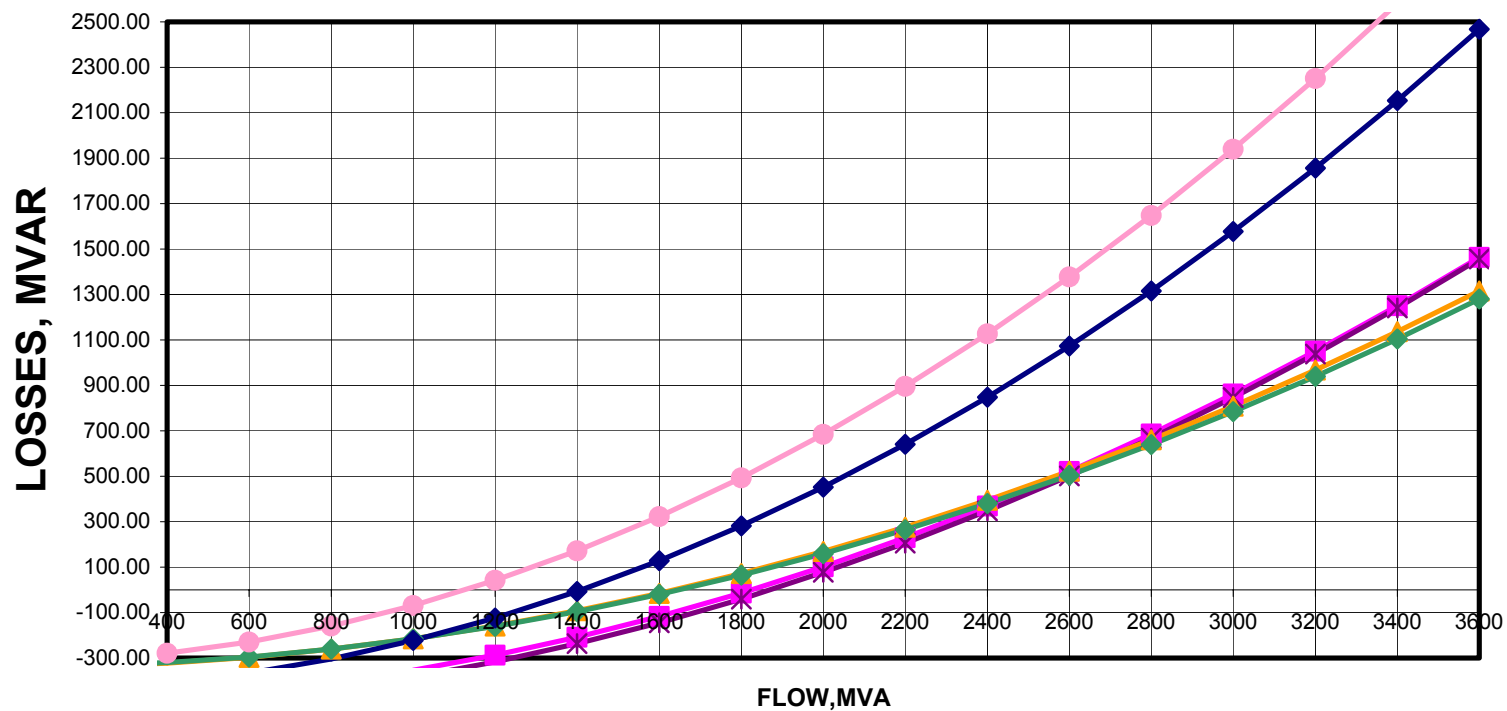



INCREMENTAL REAL LOSSES

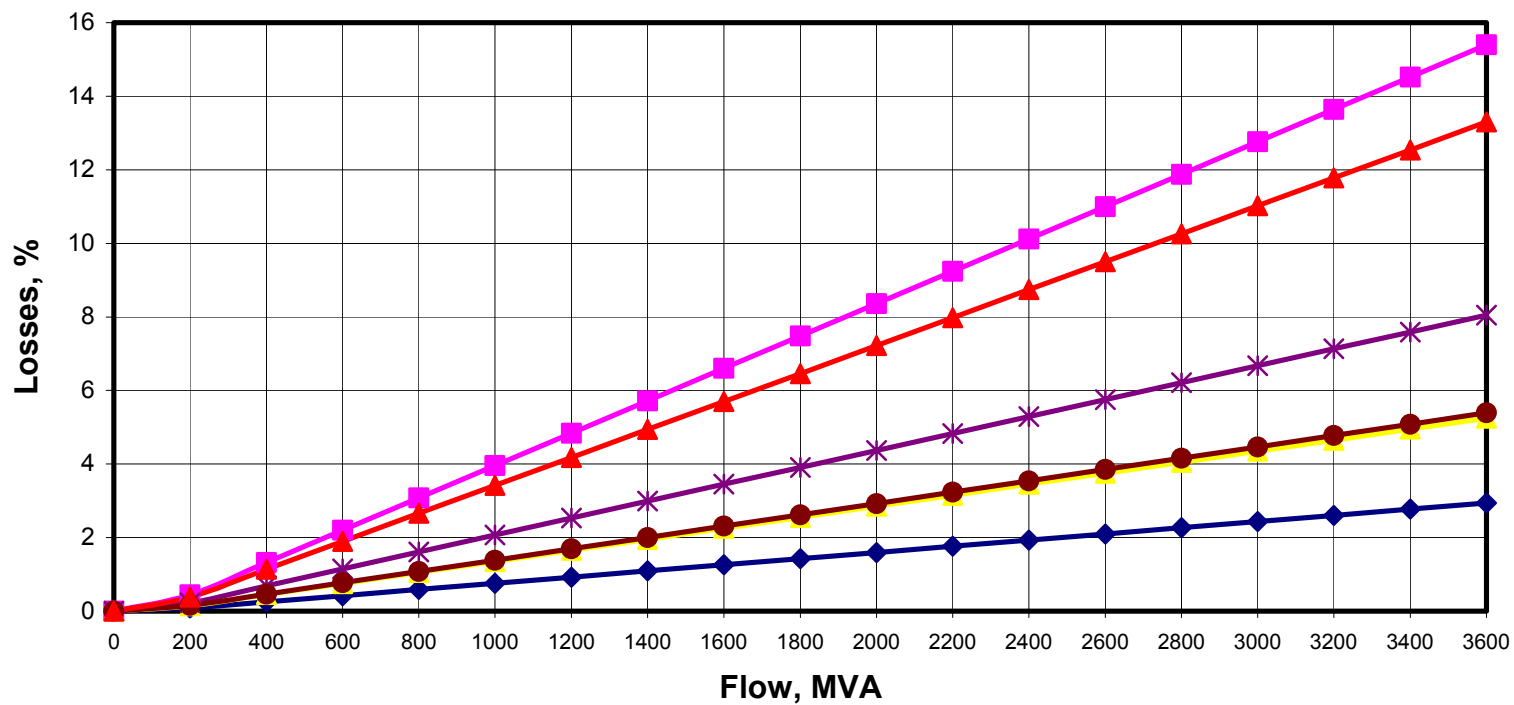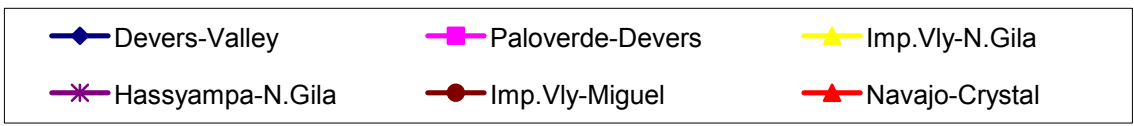



INCREMENTAL REAL LOSSES

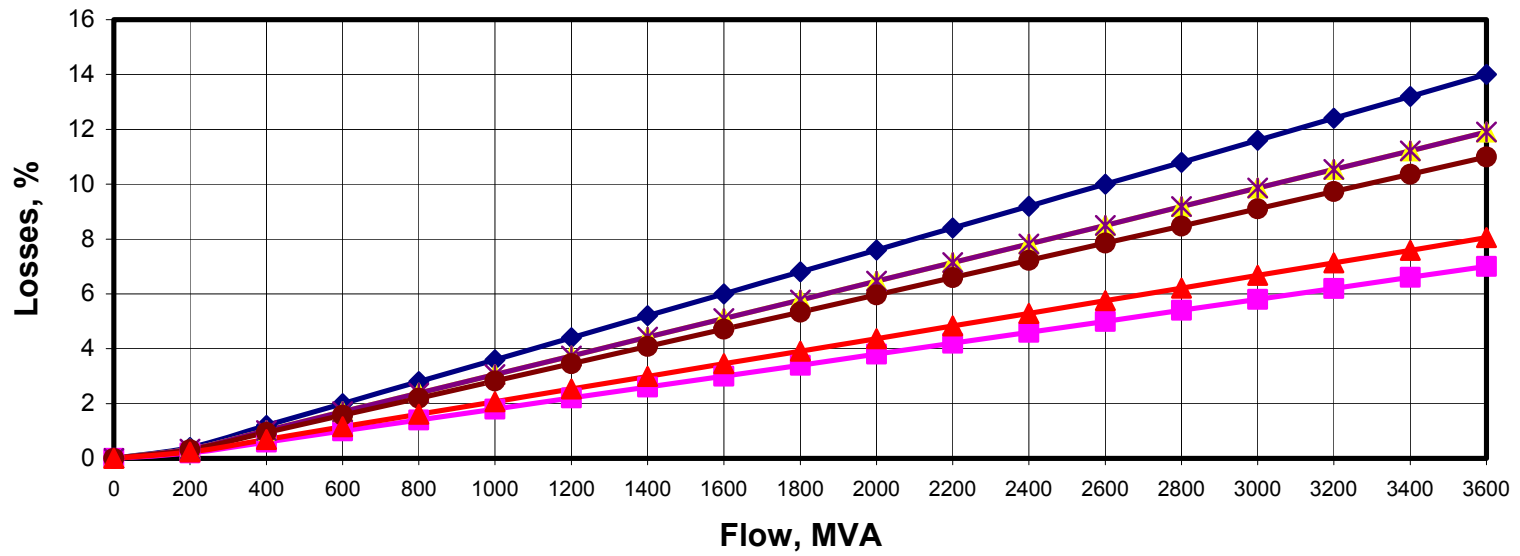



INCREMENTAL REACTIVE LOSSES

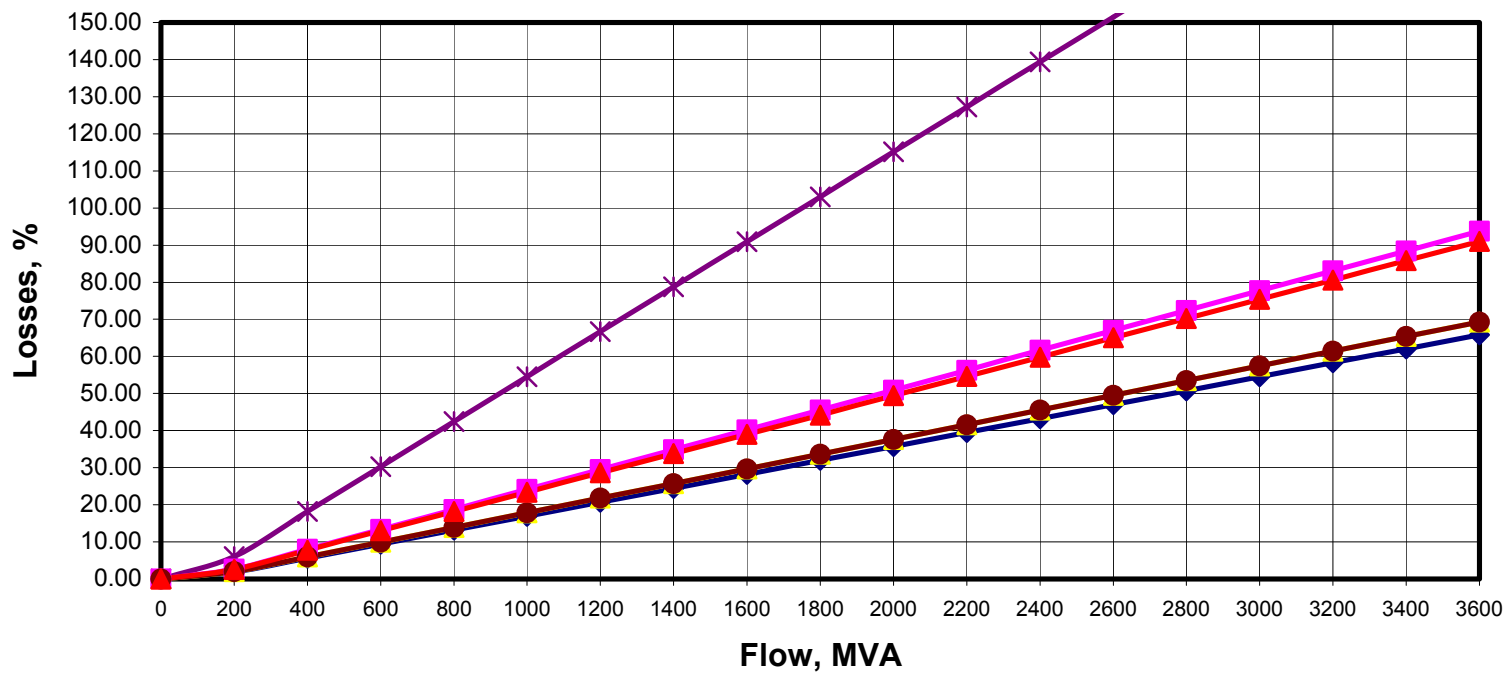



INCREMENTAL REACTIVE LOSSES

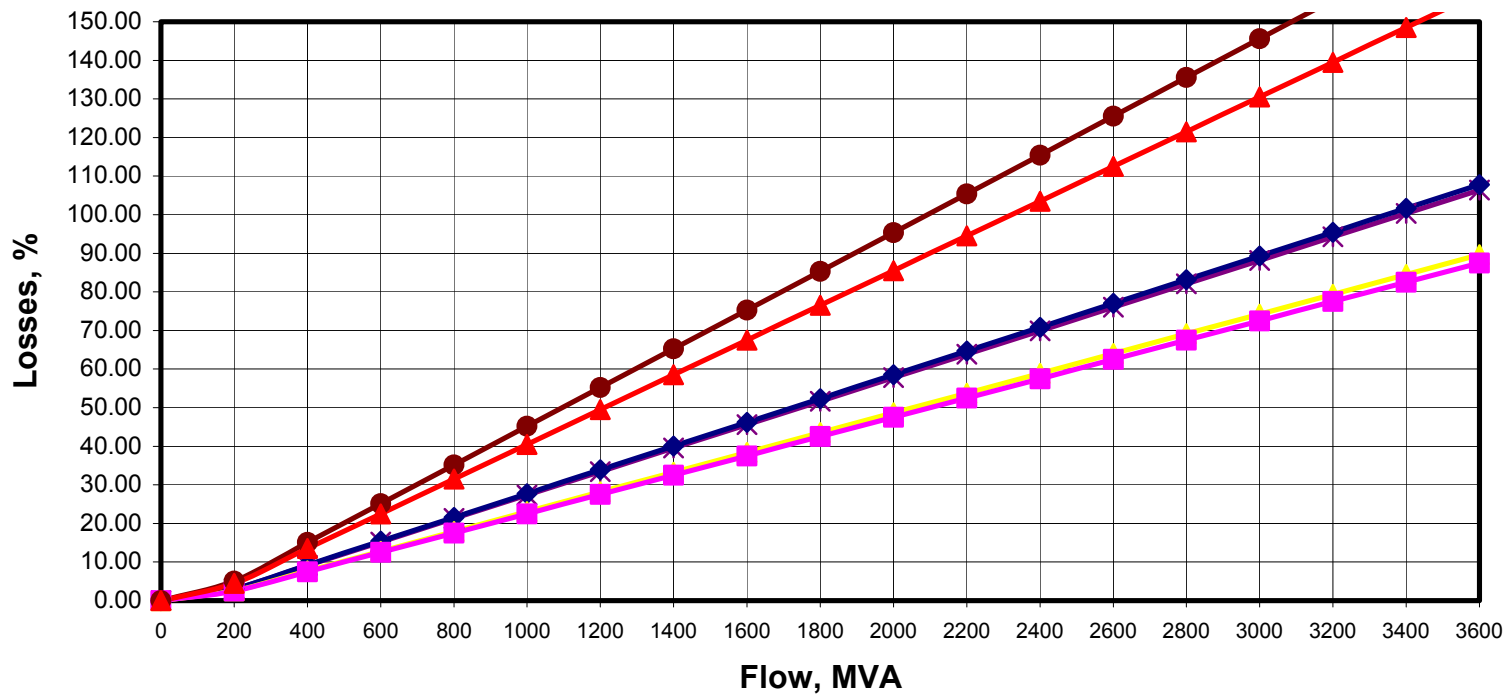



REAL LOSSES IN 500 KV LINES IN MW IN STEP CASES

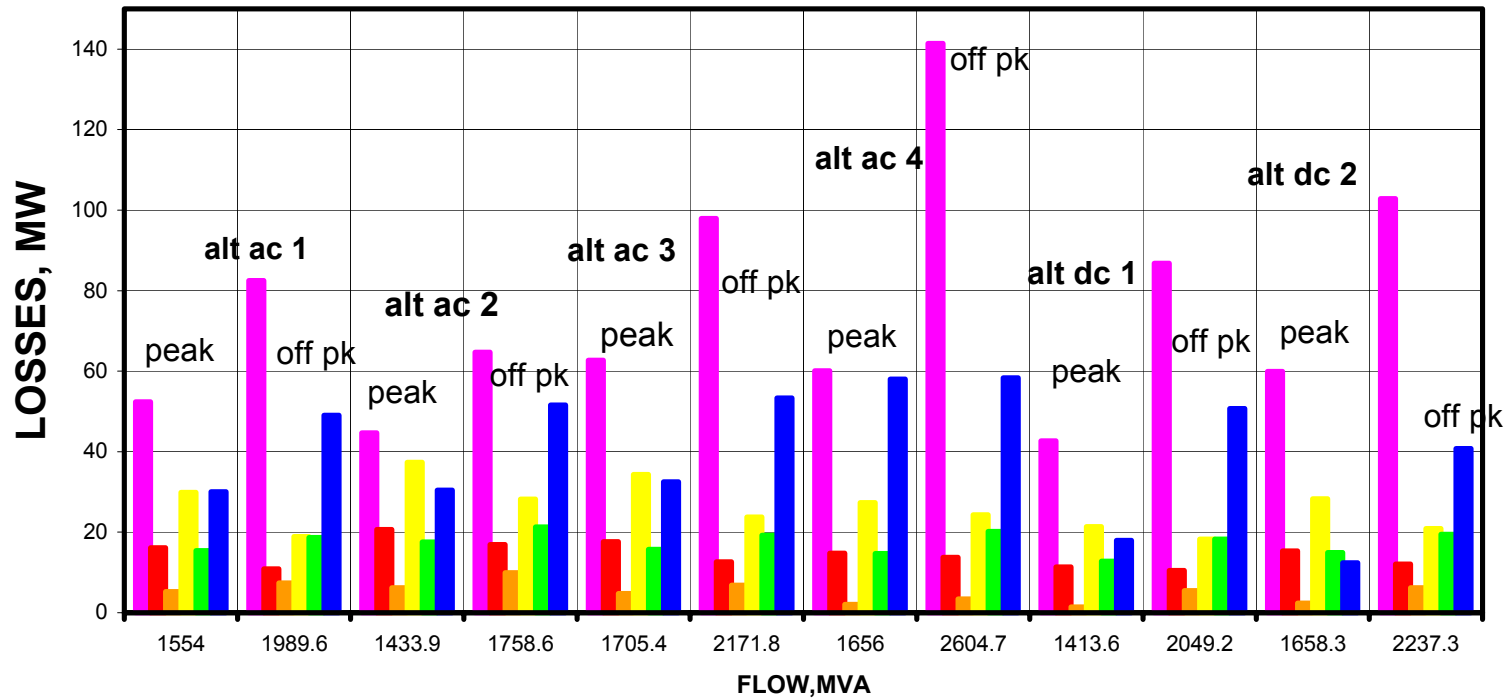



REAL LOSSES IN 500 KV LINES IN MW IN STEP CASES

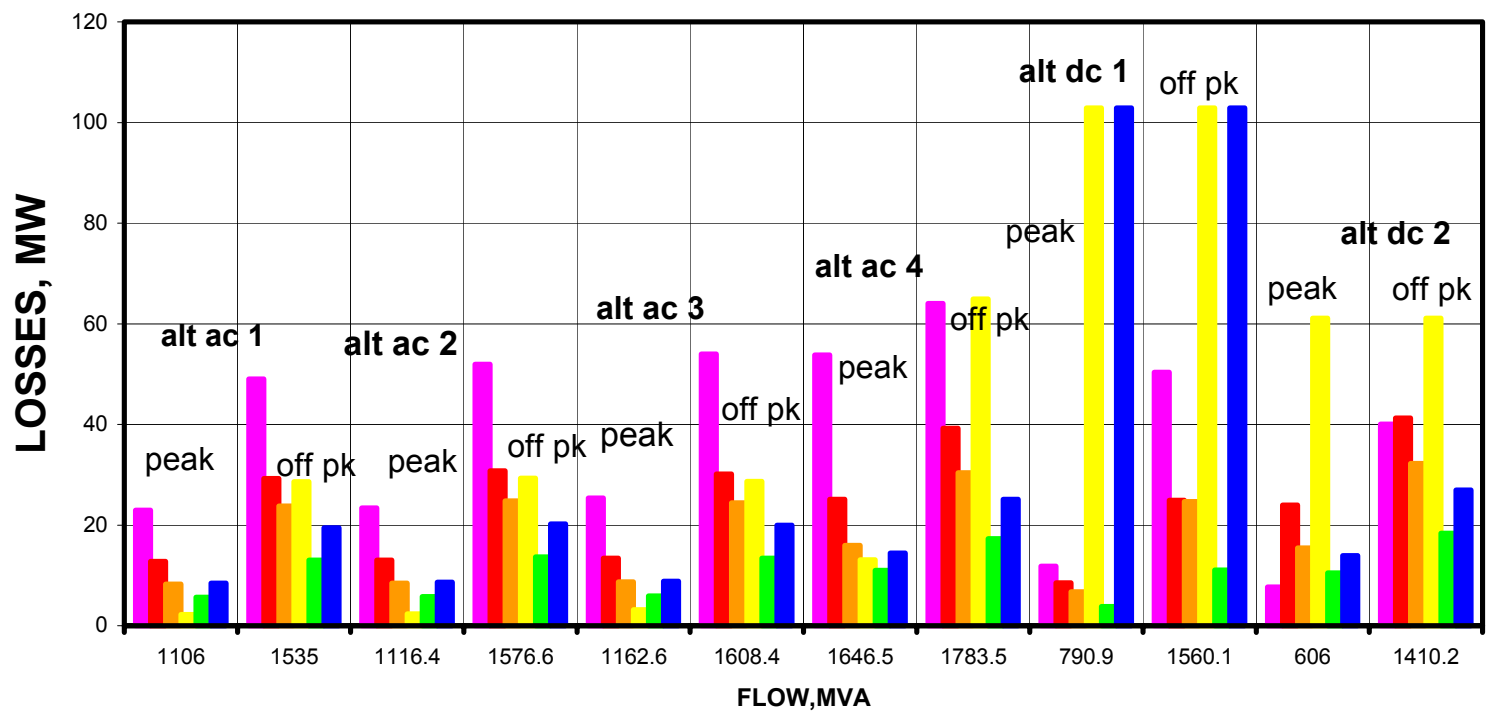

REACTIVE LOSSES IN 500 KV LINES IN MW IN STEP CASES

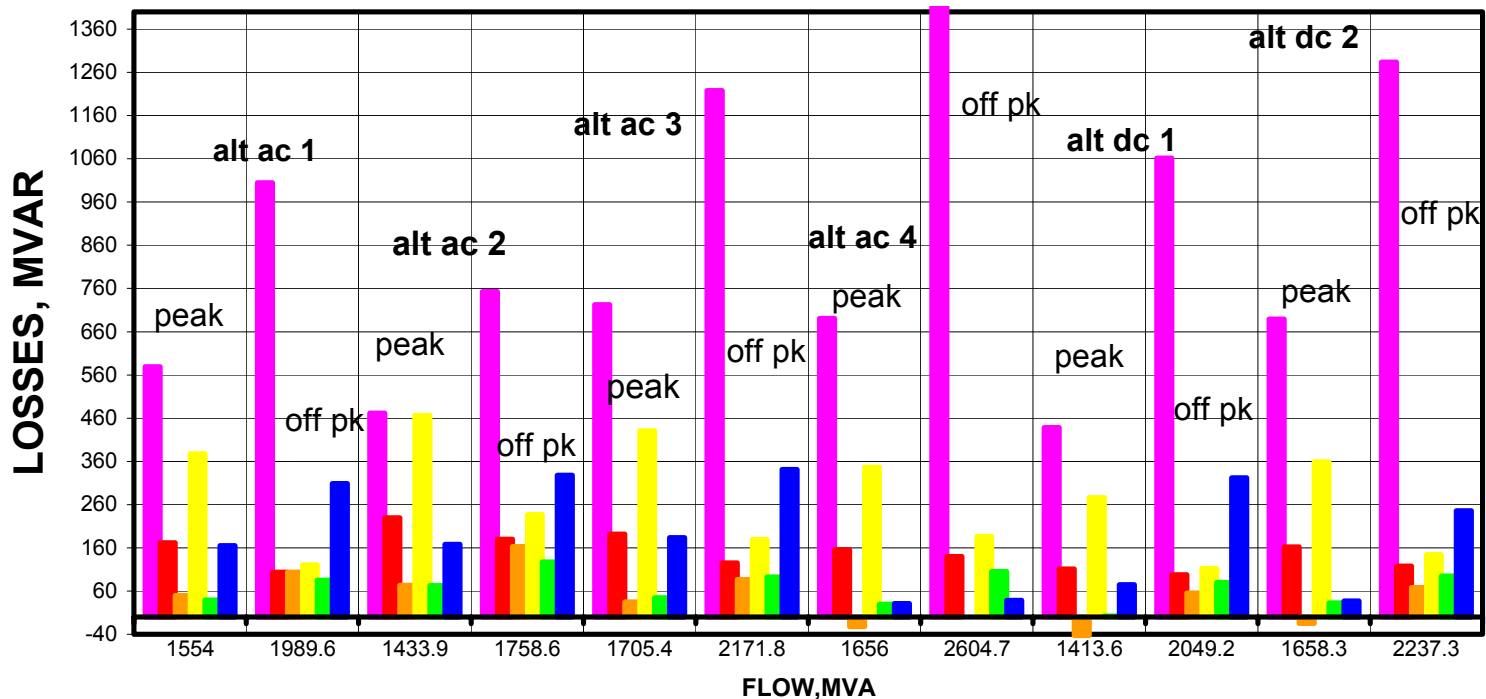

REACTIVE LOSSES IN 500 KV LINES IN MW IN STEP CASES

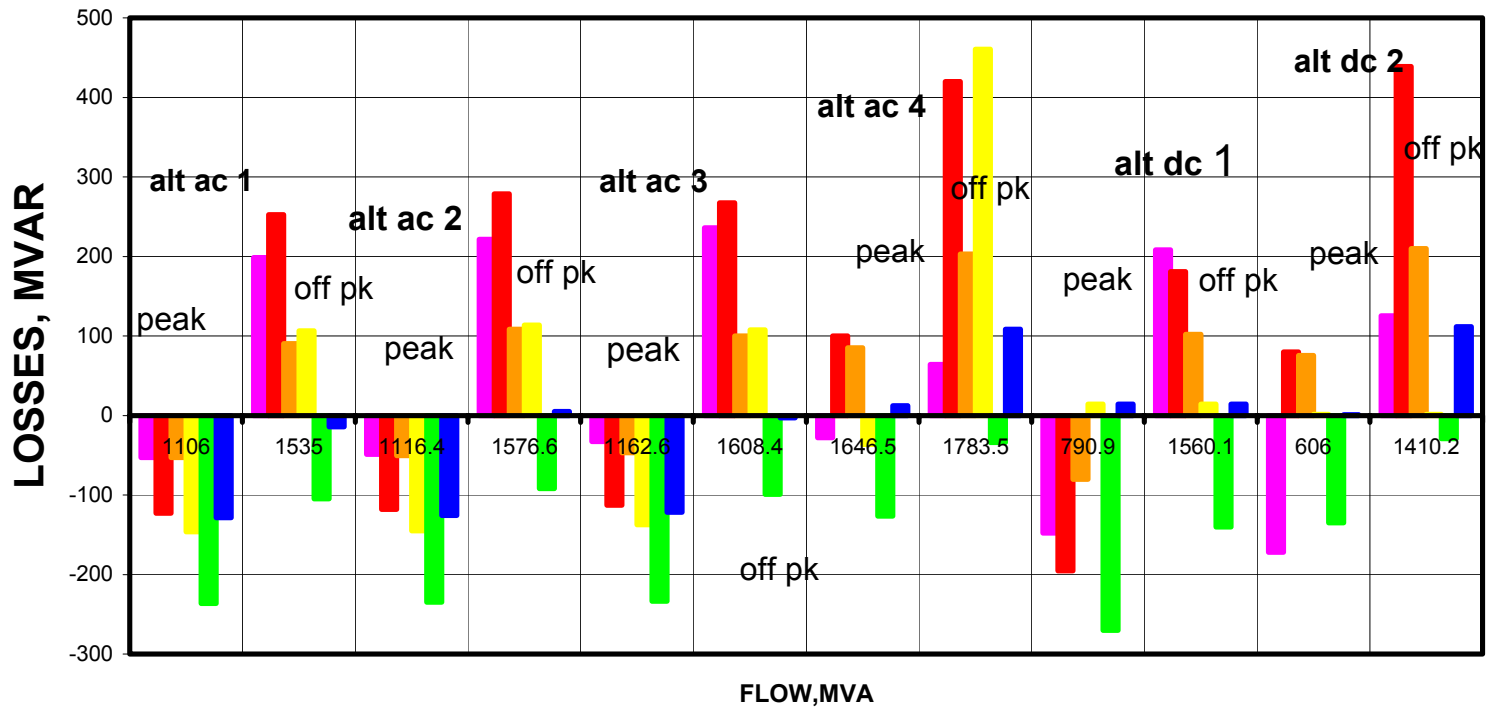

WECC SYSTEM LOSSES IN STEP CASES

■ Losses

