



California ISO

Ensuring energy adequacy through resource adequacy

Energy Adequacy Session

2023 Annual Meeting of the Market Monitors

June 1, 2023

Pat Prendergast, Ph.D.


Department of Market Monitoring

California Independent System Operator


Overview

- **Background**
 - Large increase in solar and battery storage driving need for changes in resource adequacy
 - Critical “net peak” hours are now hours 18-22
- **Current resource adequacy framework**
 - Availability of many resources relatively low in net peak hours
 - Solar and wind
 - Demand response
 - Batteries?
- **New “slice of day” resource adequacy framework**


CAISO system load has been re-shaped by significant behind-the-meter solar over last decade.

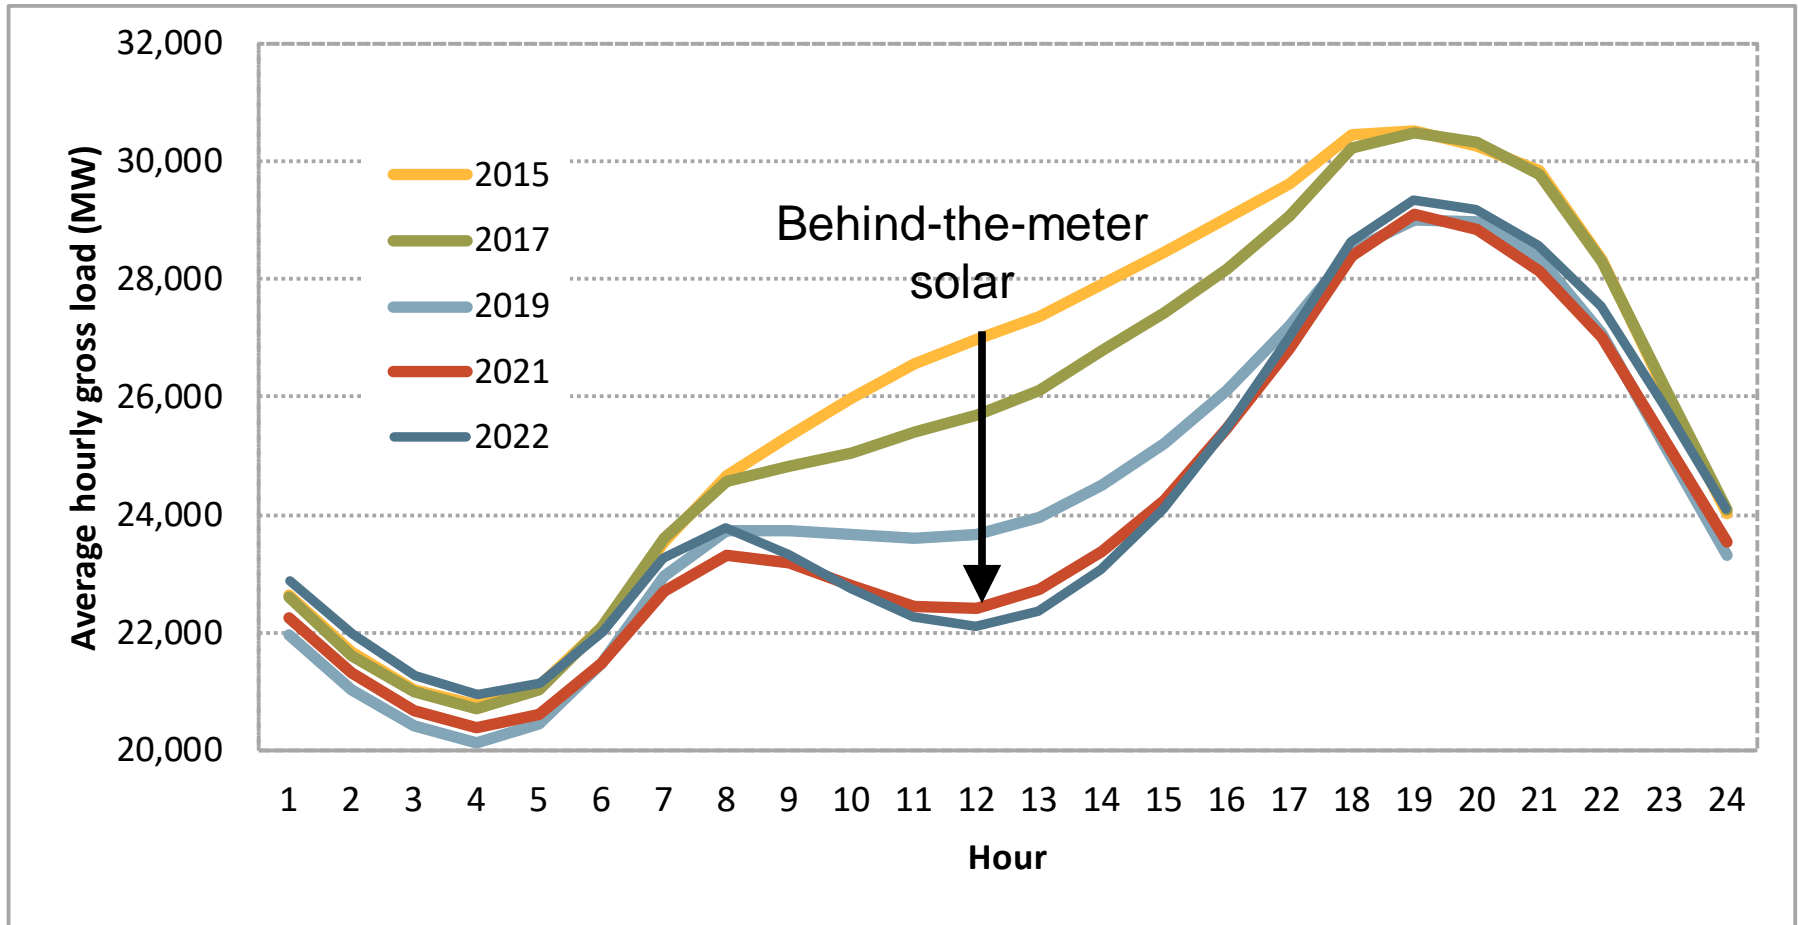

CAISO operation and market now focused on “net load” (or load not met by wind and solar)

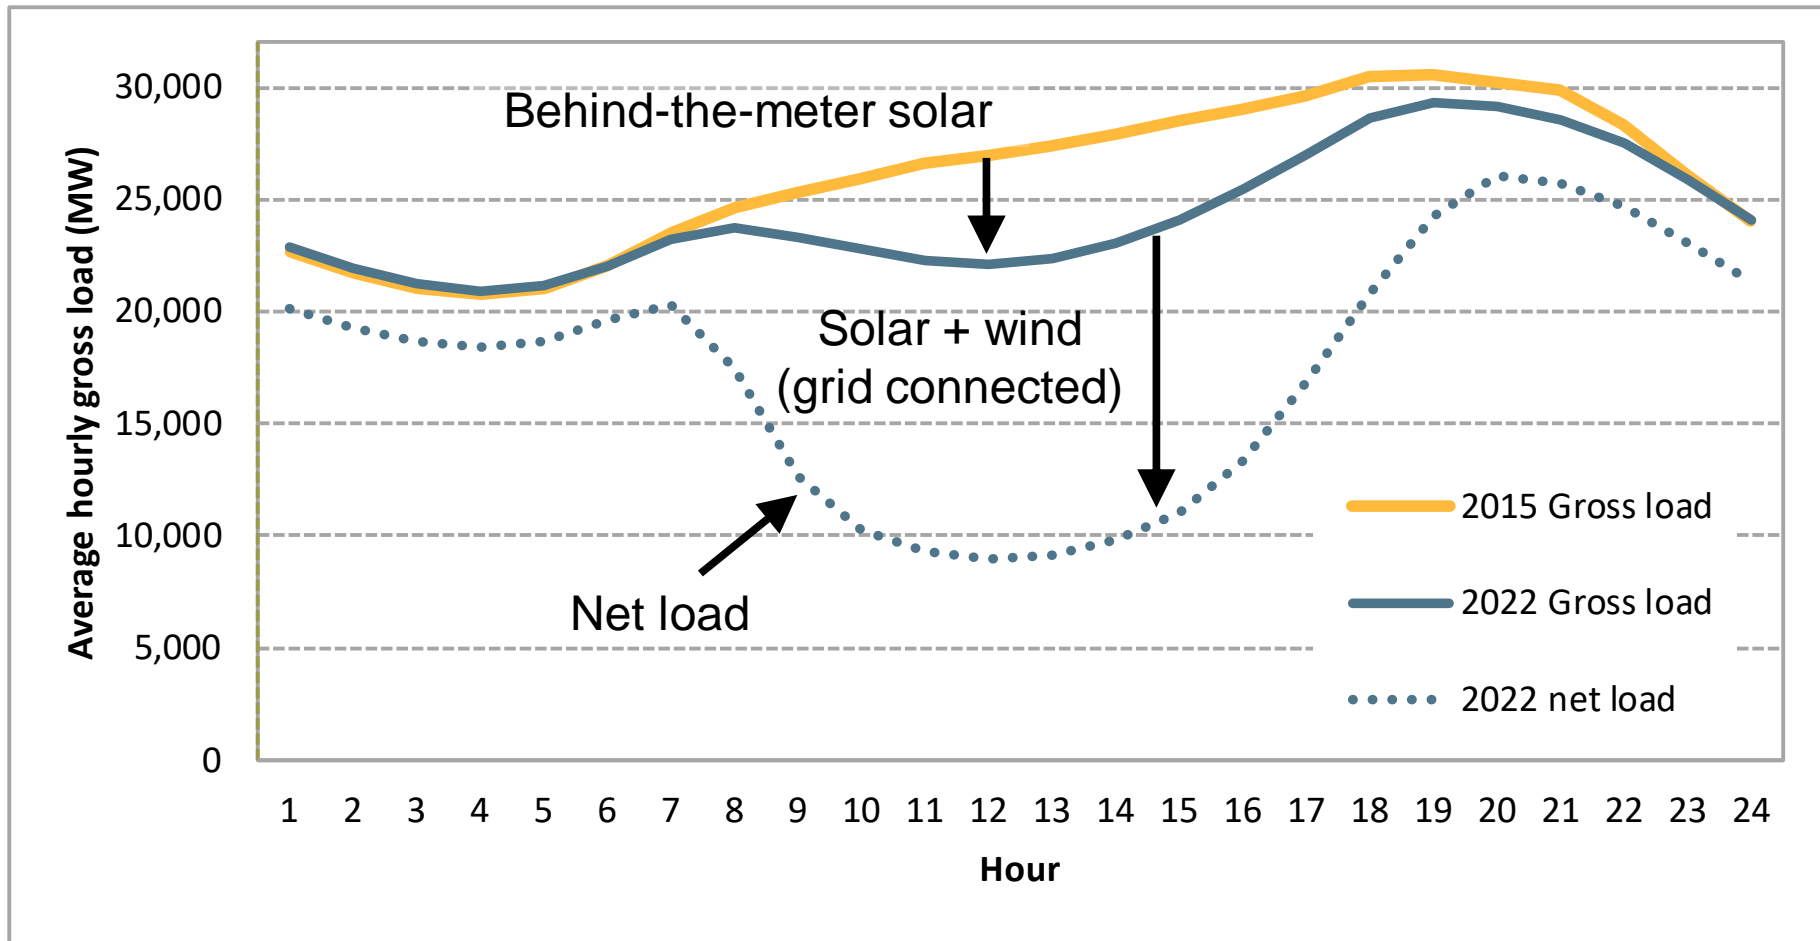


CAISO fuel mix comprised of about 30% solar and wind in 2022 (excluding “behind-the-meter” solar)

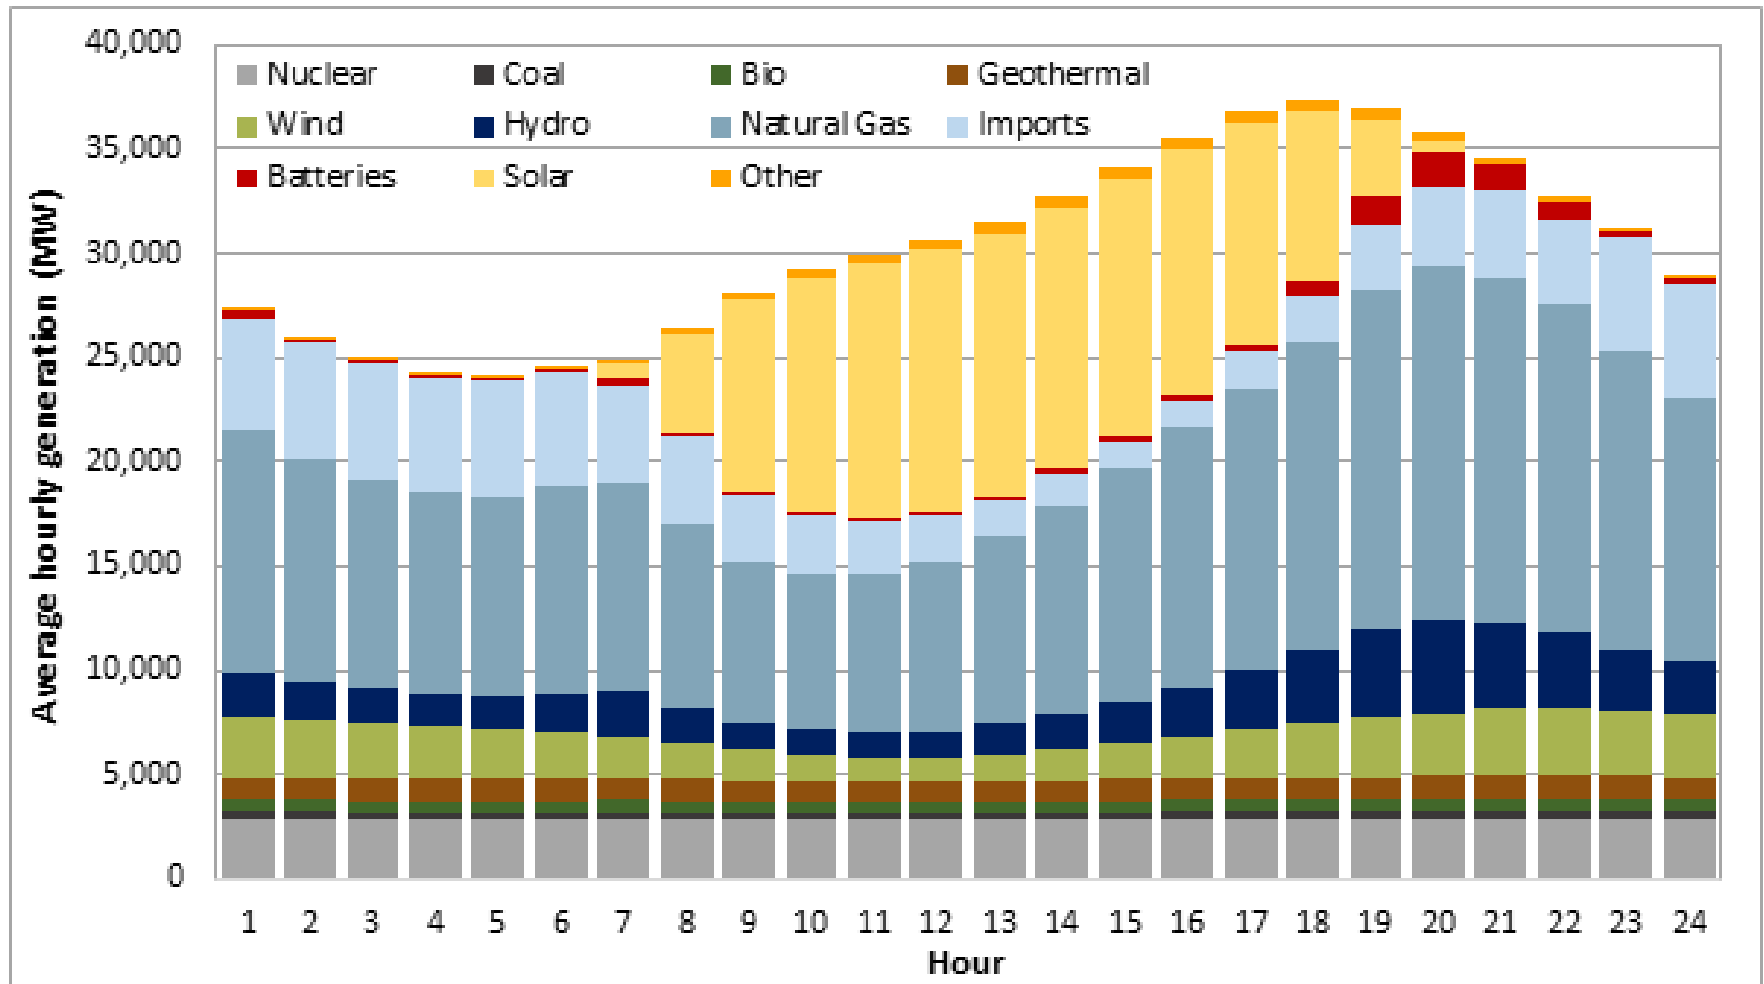


Current resource adequacy framework

- Capacity requirements set based on peak demand (gross vs net load)
 - Separate requirements for system, local areas, and flexible capacity
- Capacity ratings depend on resource:
 - Deliverable nameplate (e.g. gas)
 - Historic production during HE17 to HE21 (e.g. hydro)
 - Effective Load Carrying Capacity (e.g. wind, solar, storage)
- Availability of many resources relatively low (compared to RA ratings) in critical summer net peak hours

Current resource adequacy framework

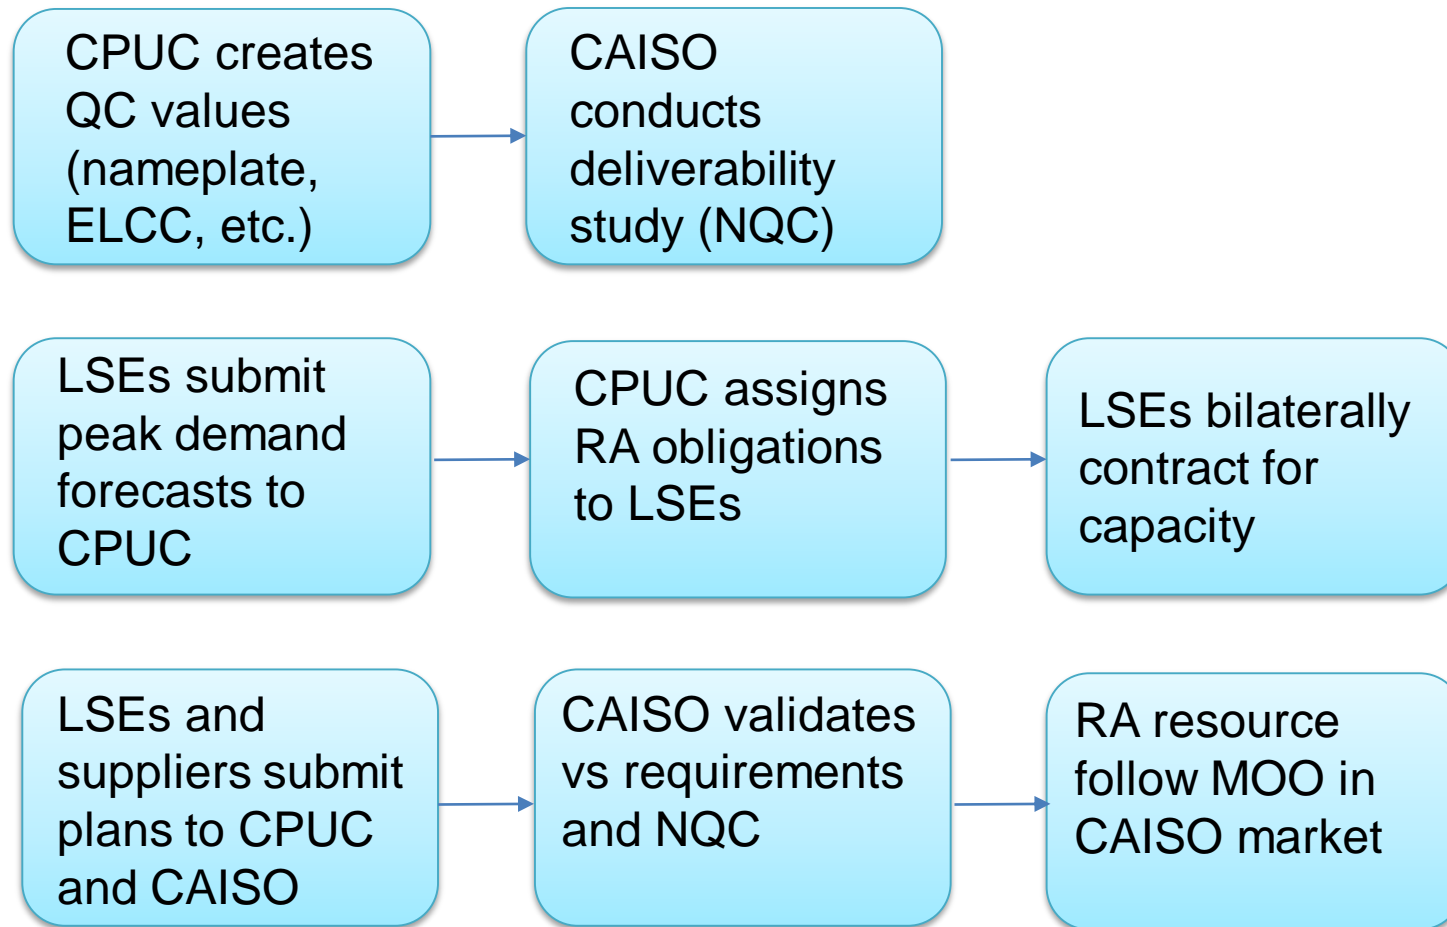

September 6, 2022 Net peak (6:58pm). Real-time supply vs resource adequacy capacity

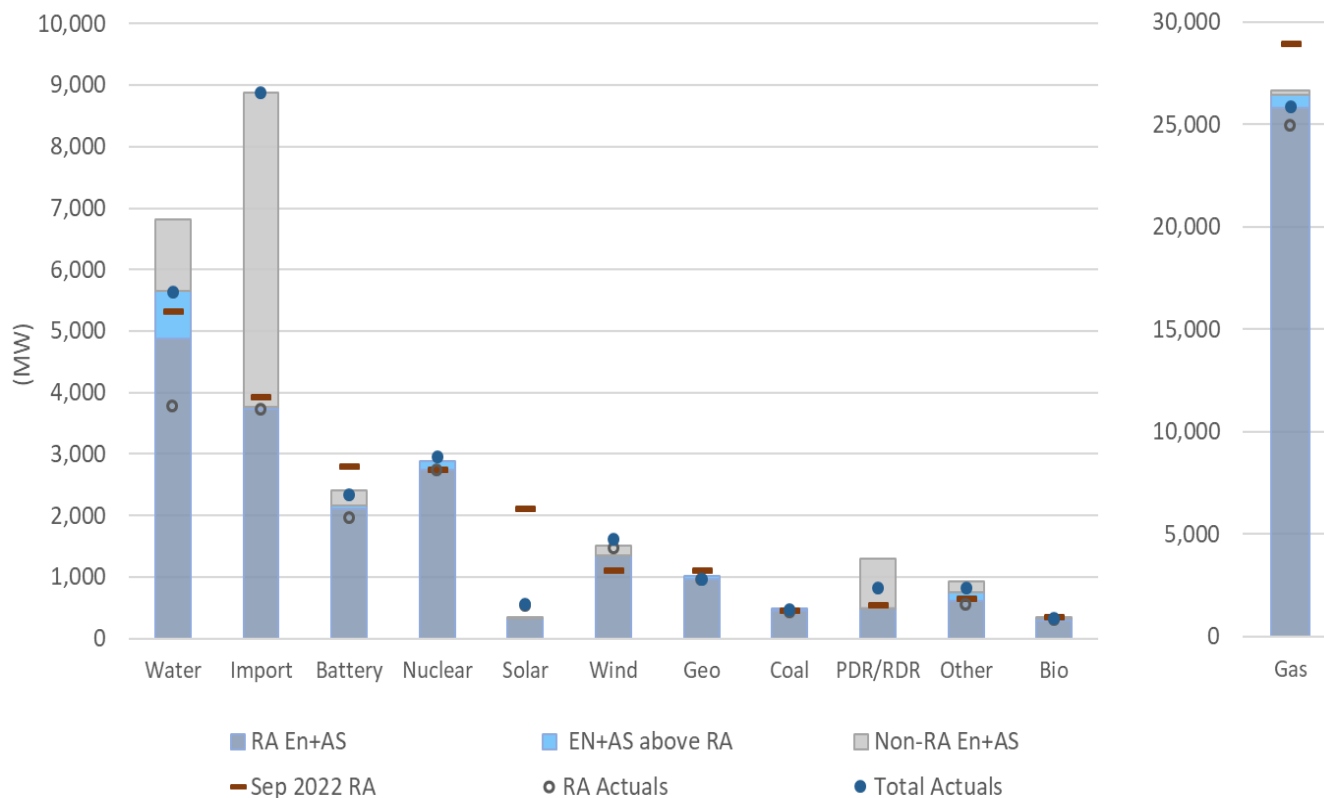

Source: *Summer Market Performance Report September 2022*, by California ISO, 2022
<http://www.caiso.com/Documents/SummerMarketPerformanceReportforSeptember2022.pdf>

Resource availability under current resource adequacy framework (during 35 critical hours in 2022)


Procured RA resource capacity and bid availability* during "EEA Watch+" hours

Fuel Category	Pmax total	NQC total	Procured capacity	DA bids and self-schedules	RT bids and self-schedules
Gas	29,835	29,083	28,413	93%	90%
Solar	13,495	2,085	2,036	51%	57%
Hydro	8,334	6,005	5,335	93%	92%
Wind	7,448	1,157	1,141	56%	80%
Imports	3,444	3,444	3,444	91%	91%
Storage	3,163	2,819	2,774	92%	92%
Nuclear	2,935	2,915	2,774	100%	100%
Utility DR ⁺	1,441	1,234	1,345	17%	63%
Supply plan DR	1,389	475	417	67%	51%
Other	4,725	3,287	3,044	93%	91%
Total	76,209	52,504	50,723	88%	87%

* Bids and self-schedules are capped at individual resource RA values


+ Utility DR NQC is RA credits and the procured capacity includes adders

Most batteries being designed so that they can discharge at maximum capacity for 4 hours.

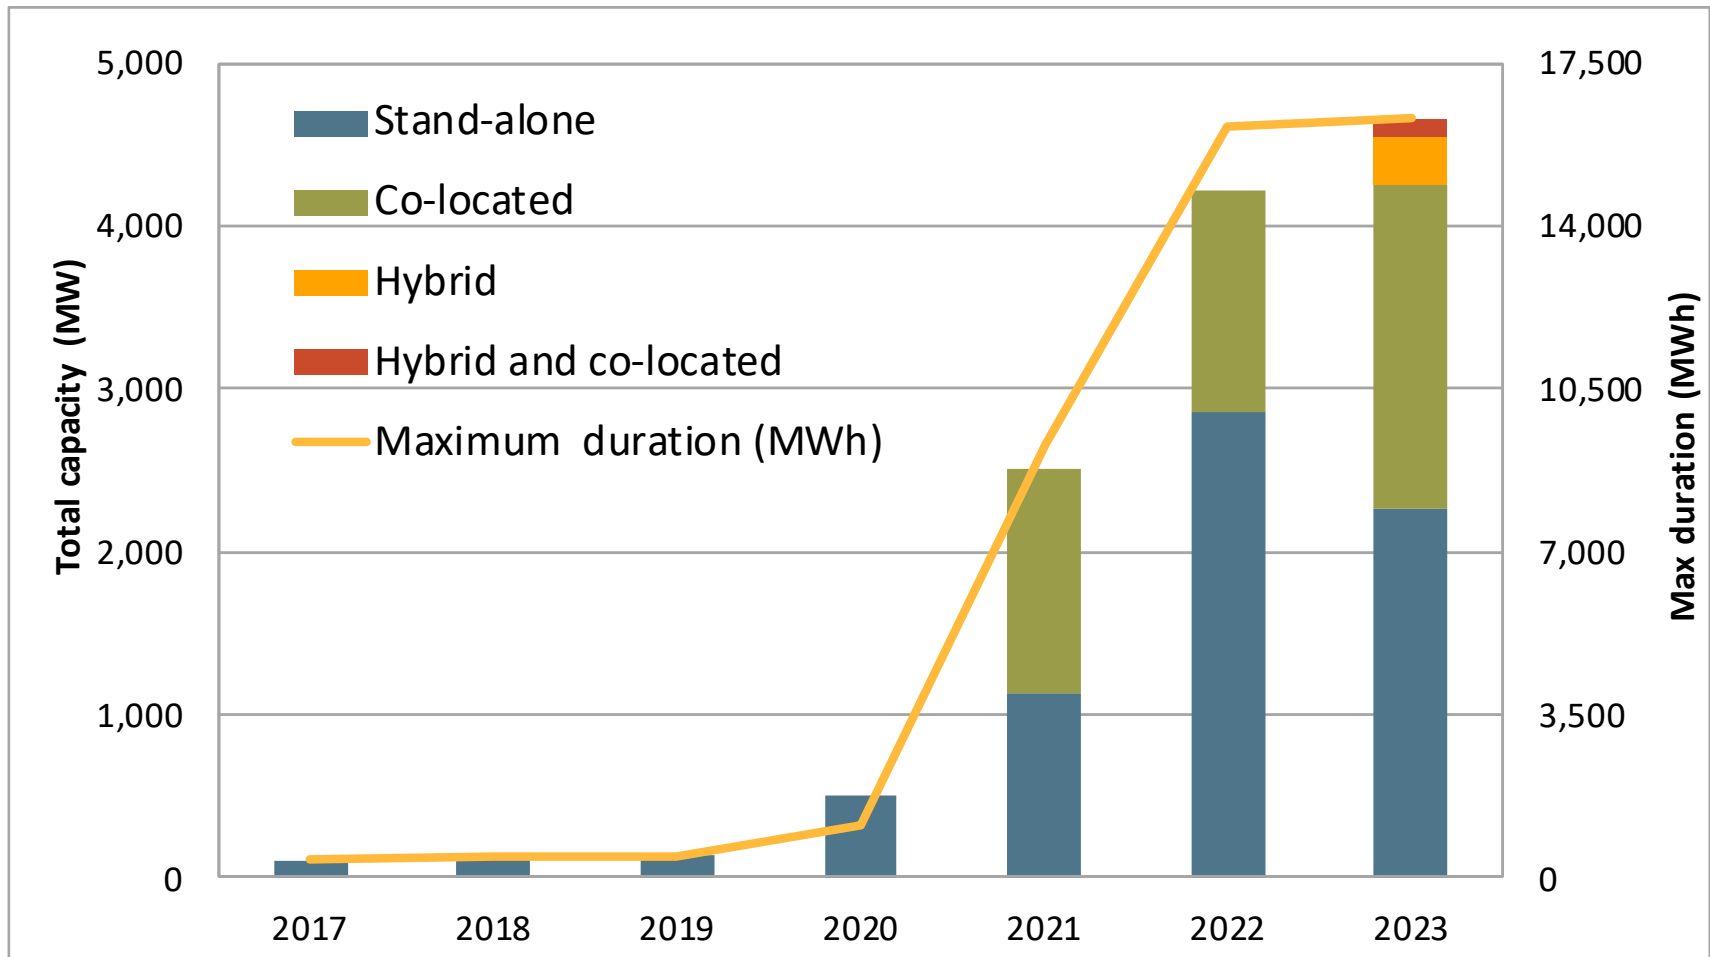


Batteries provided average of 4.4% of energy during hour ending 20 during 2022.

Hourly average battery schedules (2022)

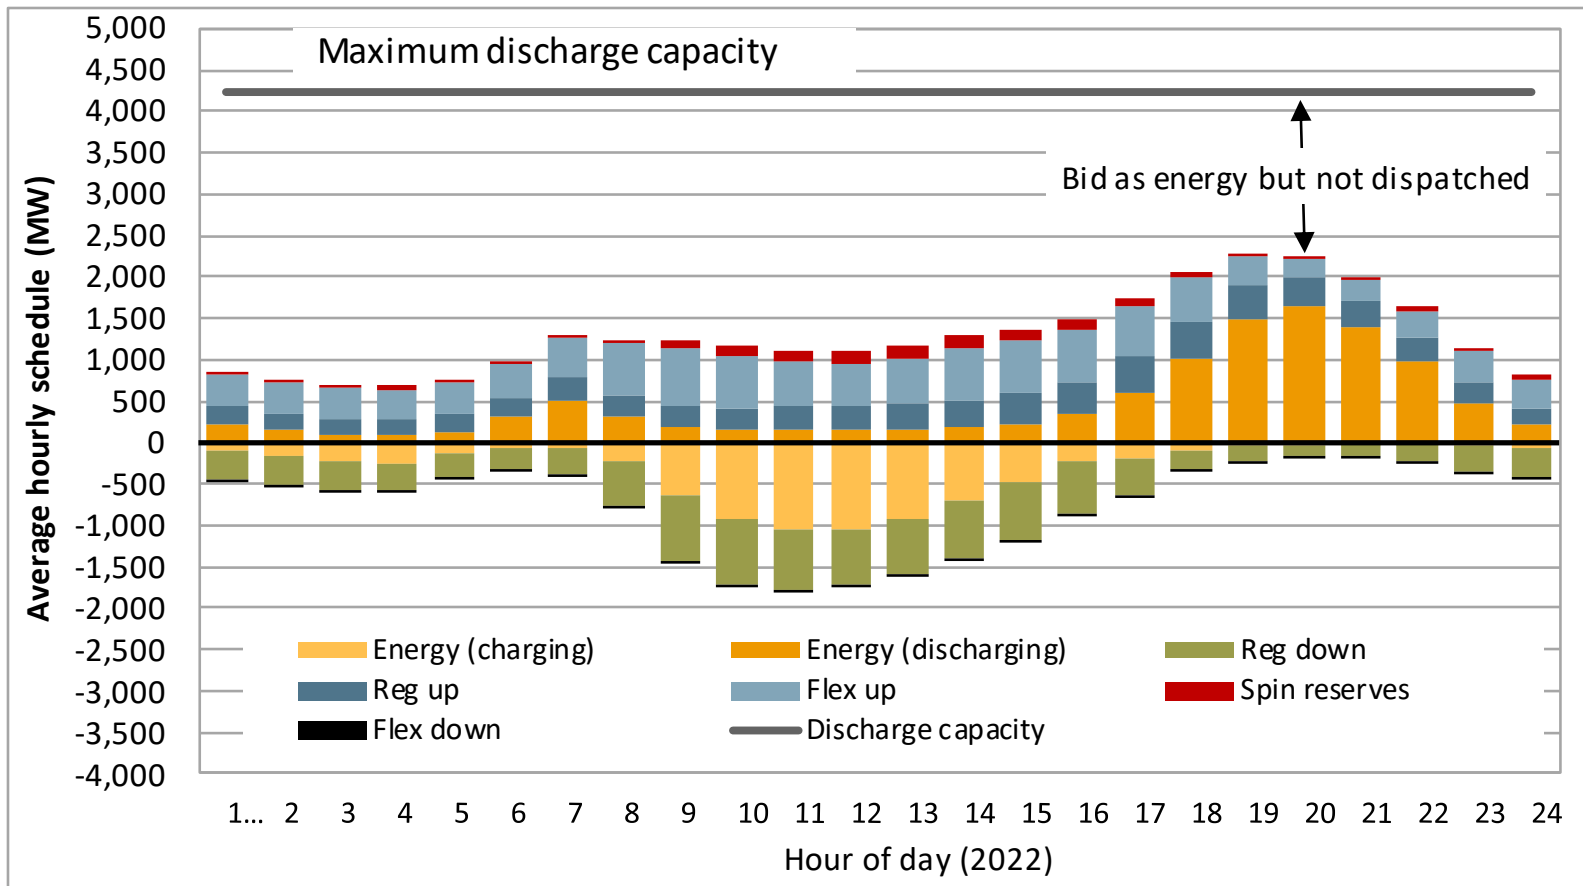

Up to 20% battery capacity may not be available in critical net peak hours due to resource and energy limitations.


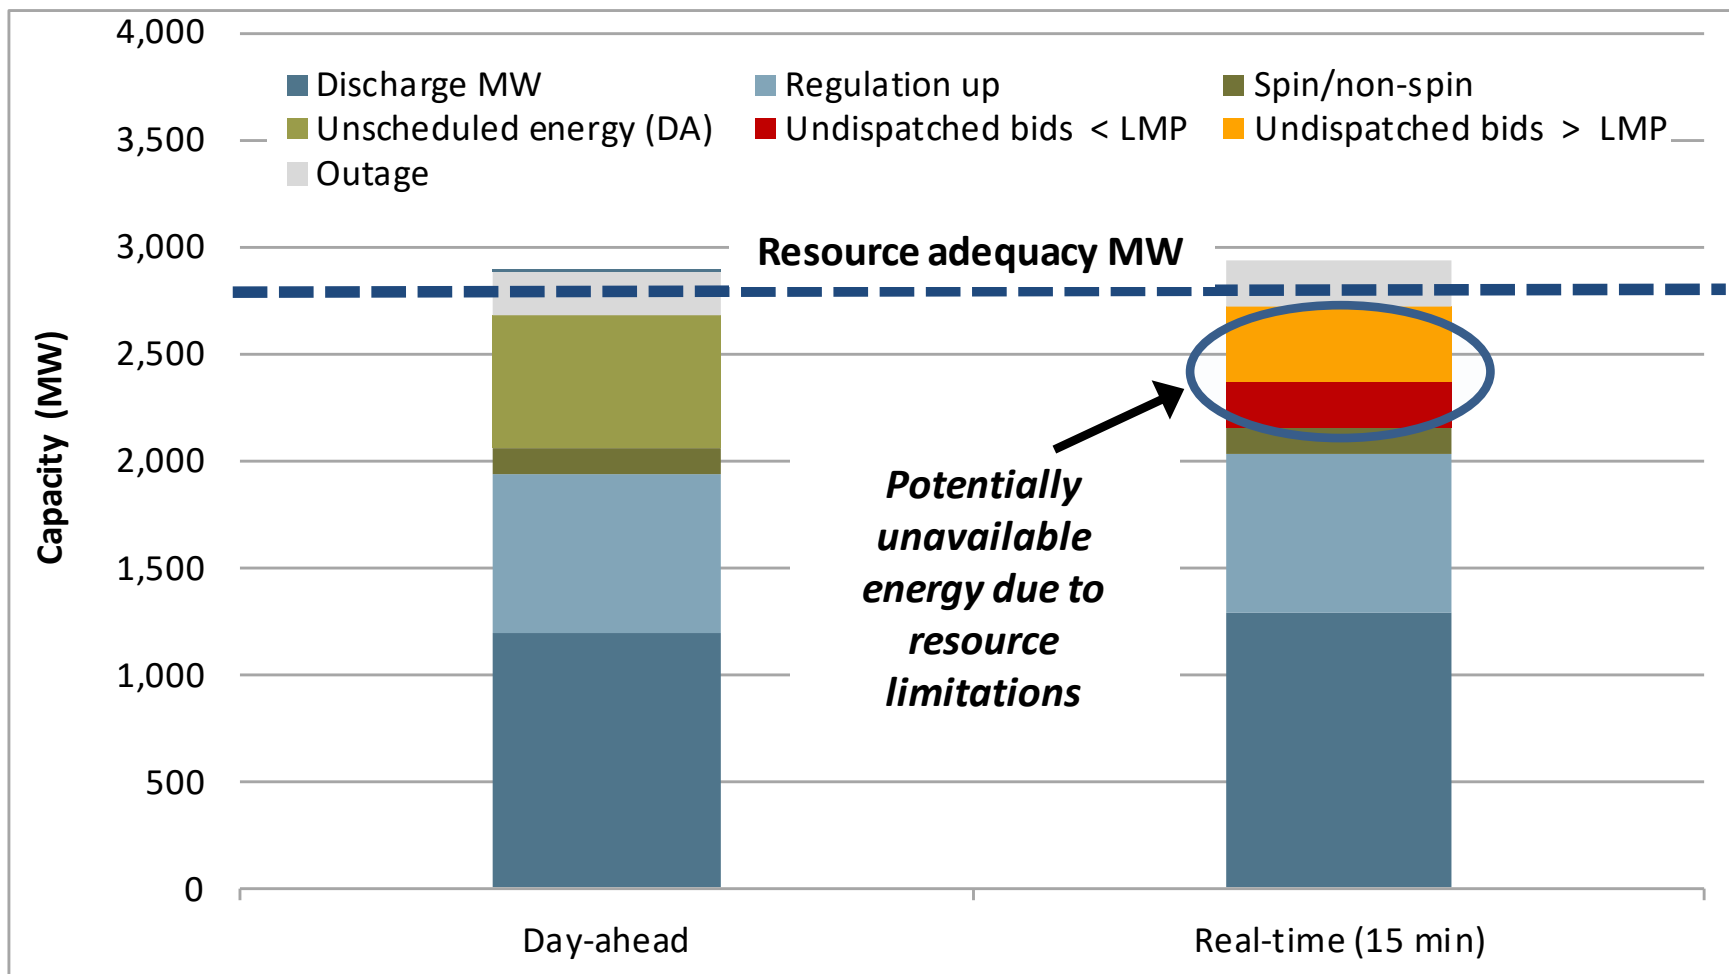


New slice-of-day framework

- LSEs show they have procured sufficient capacity to cover 24-hour obligations
 - Need excess capacity for storage
- Counting rules for solar and wind switch to “exceedance” methodology on worst days
- Storage can be shown for multiple cycles per day
- Test run for 2024 RA compliance year
 - Year-ahead showings due Nov 30
 - Full adoption for 2025 compliance year

New slice-of-day framework

Moving from ELCC to Slice of Day

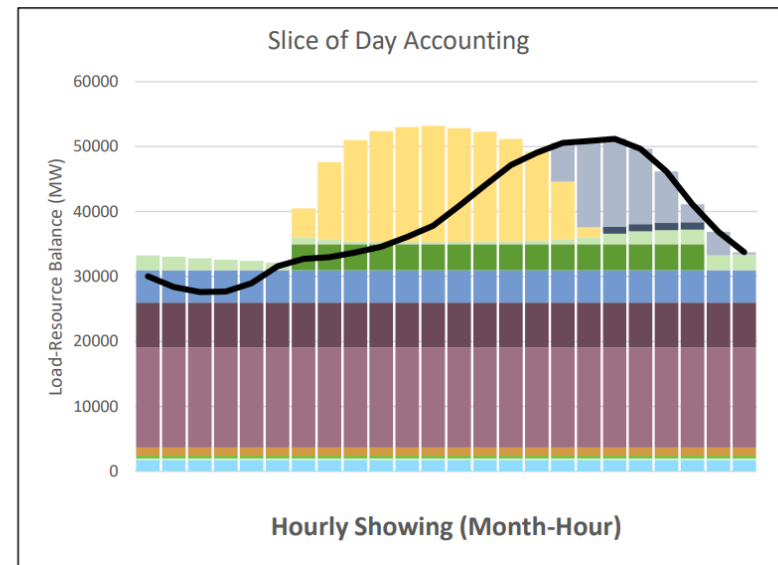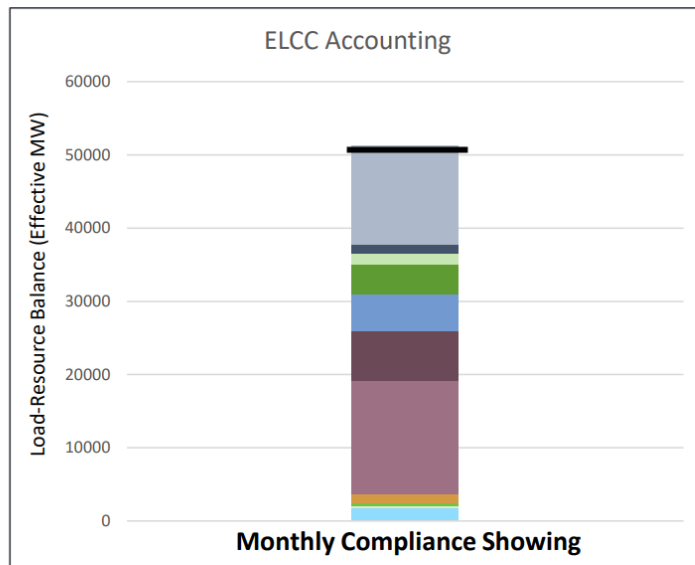


Slice of Day disaggregates monthly capacity values into month-hour capacity values using probabilistic modeling and statistics.

Source: Papas, Nick (2023). *Resource Adequacy Reform in California: Slice of Day* [PowerPoint slides]. OMS. [PowerPoint Presentation \(misostates.org\)](https://www.misostates.org)

New slice-of-day framework

The Hourly Framework: September 2024, LOLE Study Baseline Portfolio

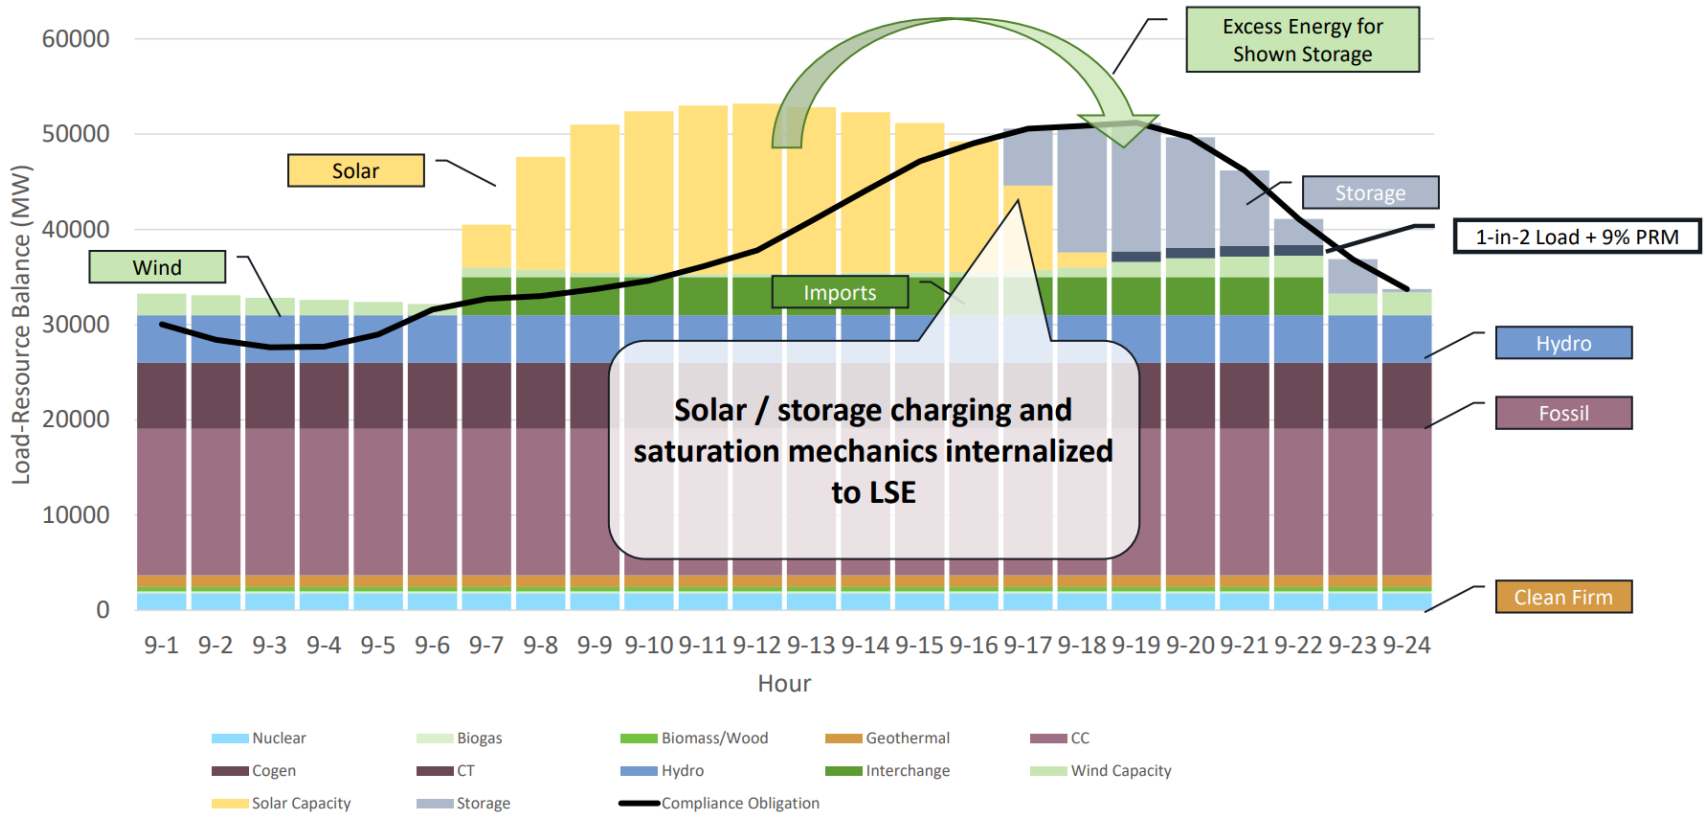

Source: Papas, Nick (2023). *Resource Adequacy Reform in California: Slice of Day* [PowerPoint slides]. OMS. [PowerPoint Presentation \(misostates.org\)](https://www.misostates.org/)