



California ISO
Shaping a Renewed Future


2015 and 2019 Draft LCR Study Results - Fresno and Kern

Joseph E Meier, P.E.

Senior Regional Transmission Engineer

Stakeholder Web Conference

March 5, 2014

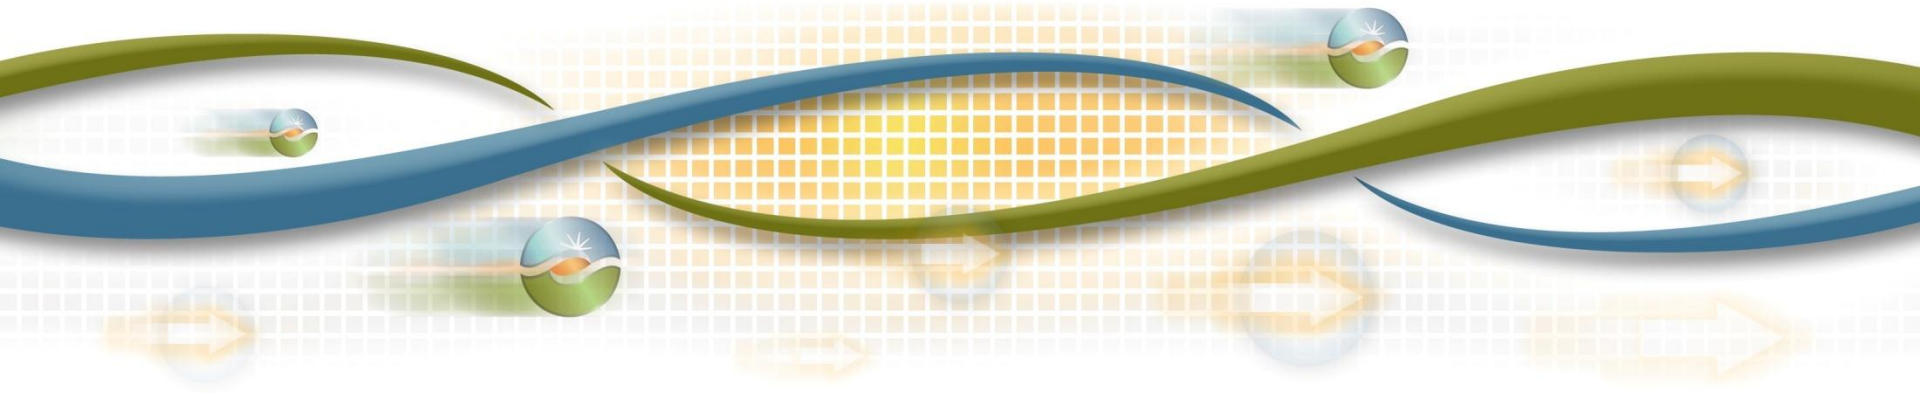

Fresno and Kern LCR Areas



Kern Area Overview

Area Generation, Load and Transmission

Kern LCR Area

Total Generation and Load for 2015:

- **Generation (NQC plus new unit): 641 MW**
- **Load (1-in-10 Summer-Peak): 731 MW**

Total Generation and Load for 2019:

- **Generation (NQC plus new unit): 641 MW**
- **Load (1-in-10 Summer-Peak): 745 MW**

Kern Area LCR

2015 West Park Sub-Area

Limiting Contingencies:

Category B:

- G-1/L-1: Kern-West Park #1 OR #2 115 kV with PSE-Bear generation out of service
- Constraint: Remaining Kern-West Park 115 kV line

Category C:


- Same as Category B

LCR Results (MW):

Contingency	Cat. B	Cat. C
LCR	71	71

Including:

QF	44	44
Muni	0	0
Deficiency	27	27

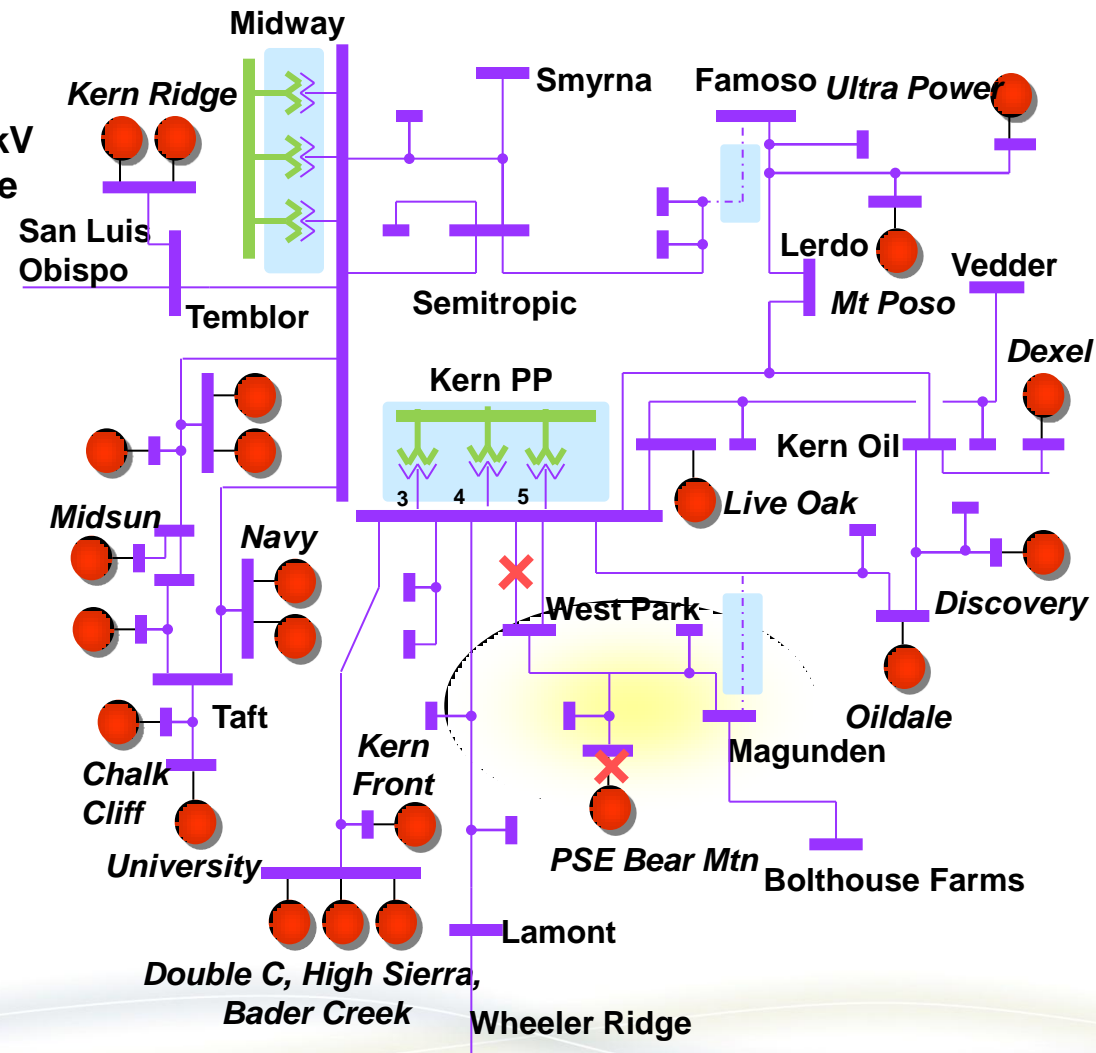

Kern Area LCR

2015 South Kern PP Sub-Area

Limiting Contingencies:

Category B:

- G-1/L-1: Kern-Magunden-Witco 115 kV with Mt Poso generation out of service
- Constraint: Kern-Live Oak 115kV

Category C:


- Kern-Kern Front 115 kV & Kern #5 230/115 kV
- Constraint: Kern #4 230/115 kV

LCR Results (MW):

Contingency	Cat. B	Cat. C
LCR	108	411


Including:

QF	108	411
Muni	0	0
Deficiency	0	0

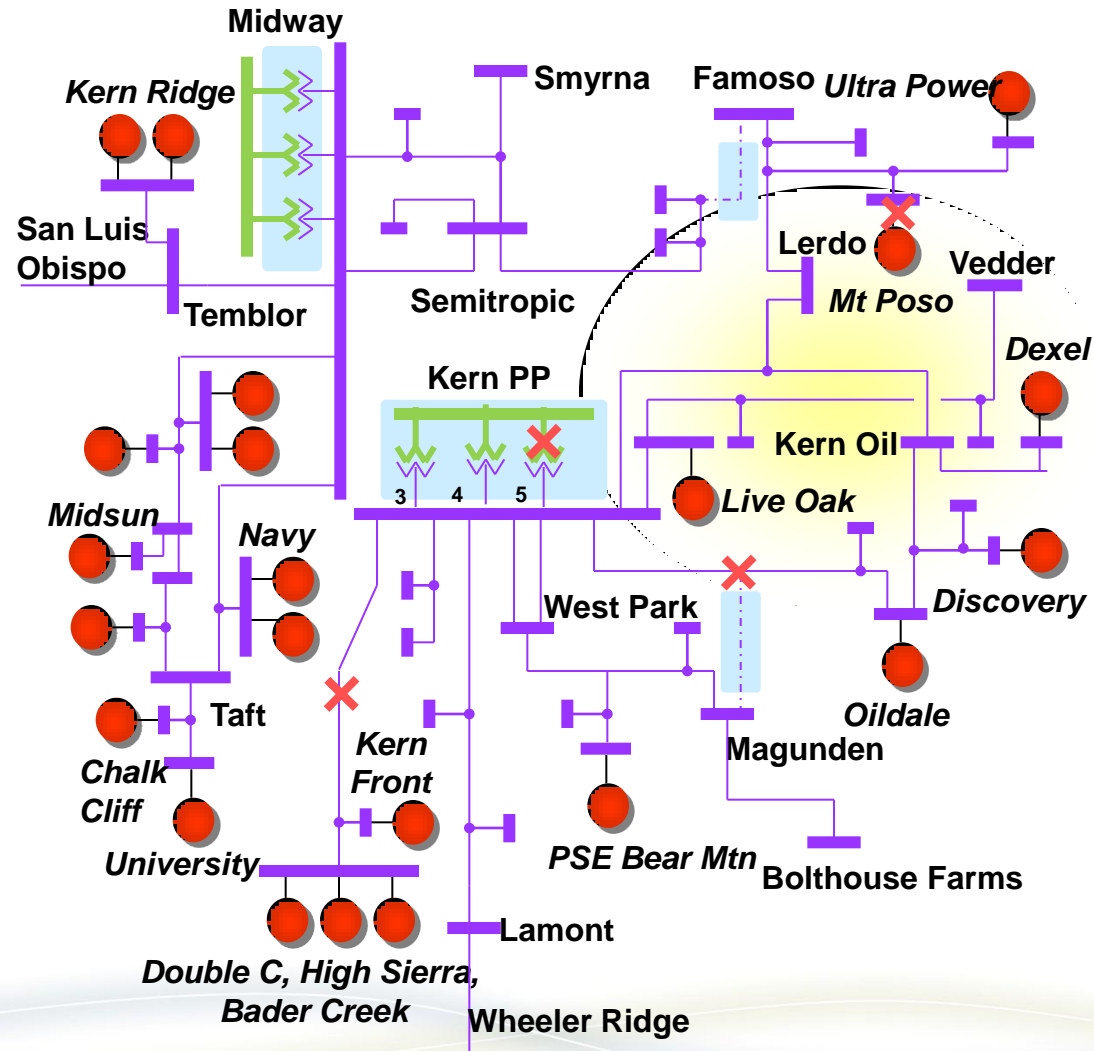

Kern Area LCR

Summary of 2015 LCR

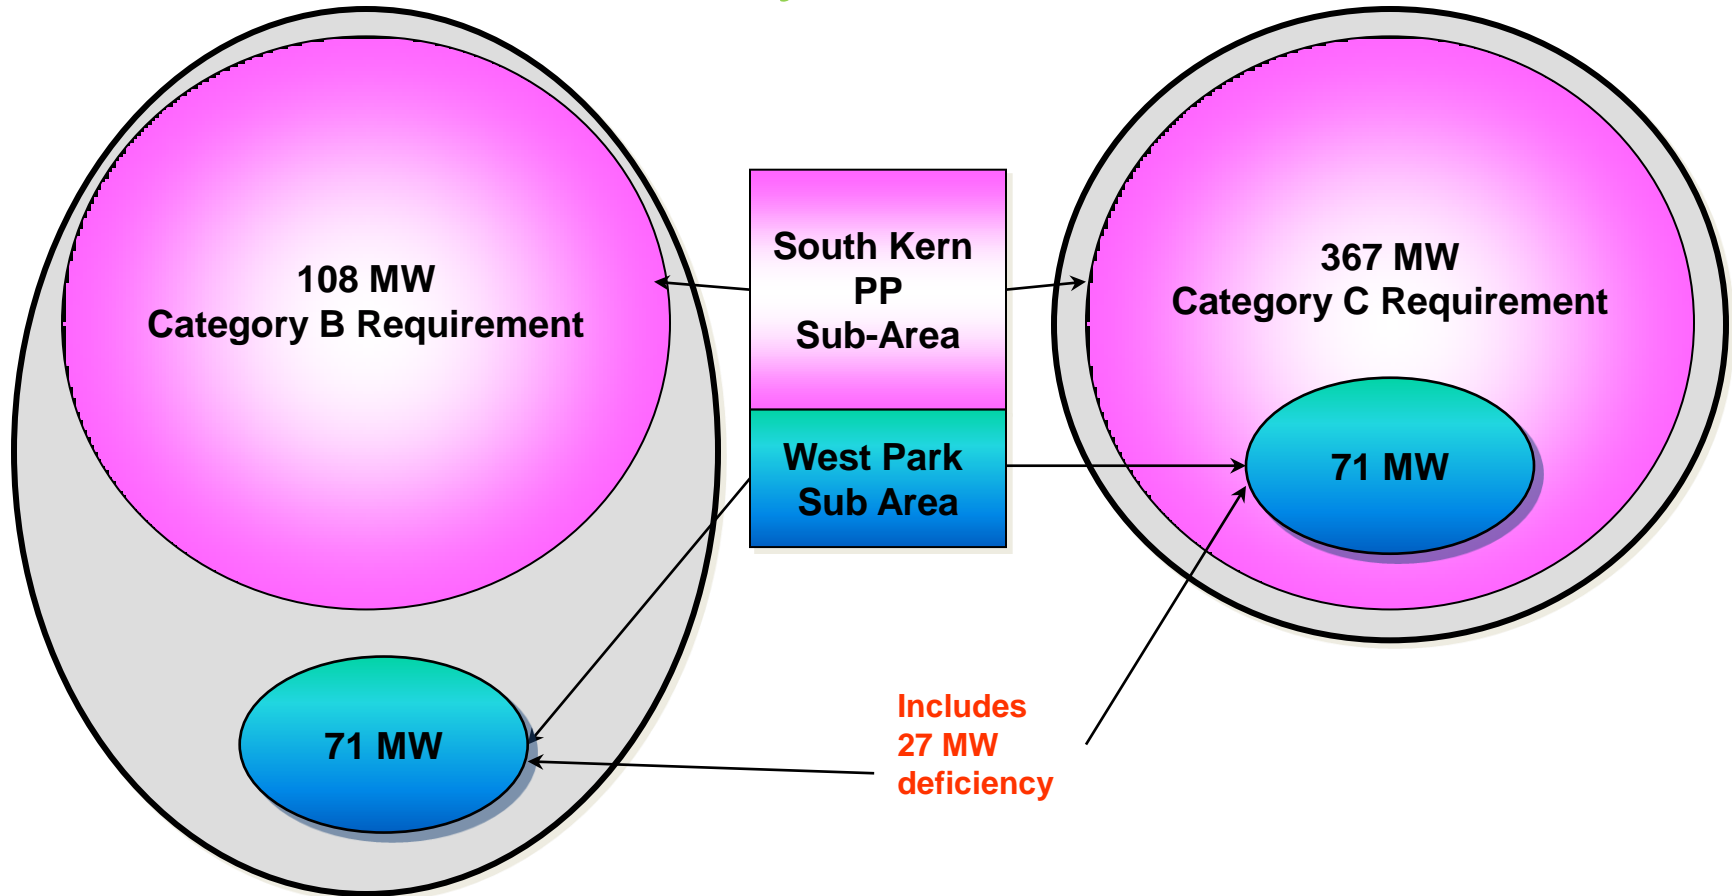

**Includes
27 MW
deficiency**

Note:

Category B sub-areas no longer overlap with the Kern-Magunden-Witco 115 kV open at Magunden for Category B. These sub-areas overlap for Category C until Kern #4 230/115 kV is upgraded

Kern Area LCR

2019 West Park Sub-Area

Limiting Contingencies:

Category B:

- G-1/L-1: Kern-West Park #1 OR #2 115 kV with PSE-Bear generation out of service
- Constraint: Remaining Kern-West Park 115 kV line

Category C:


- Same as Category B

LCR Results (MW):

Contingency	Cat. B	Cat. C
LCR	77	77

Including:

QF	44	44
Muni	0	0
Deficiency	33	33

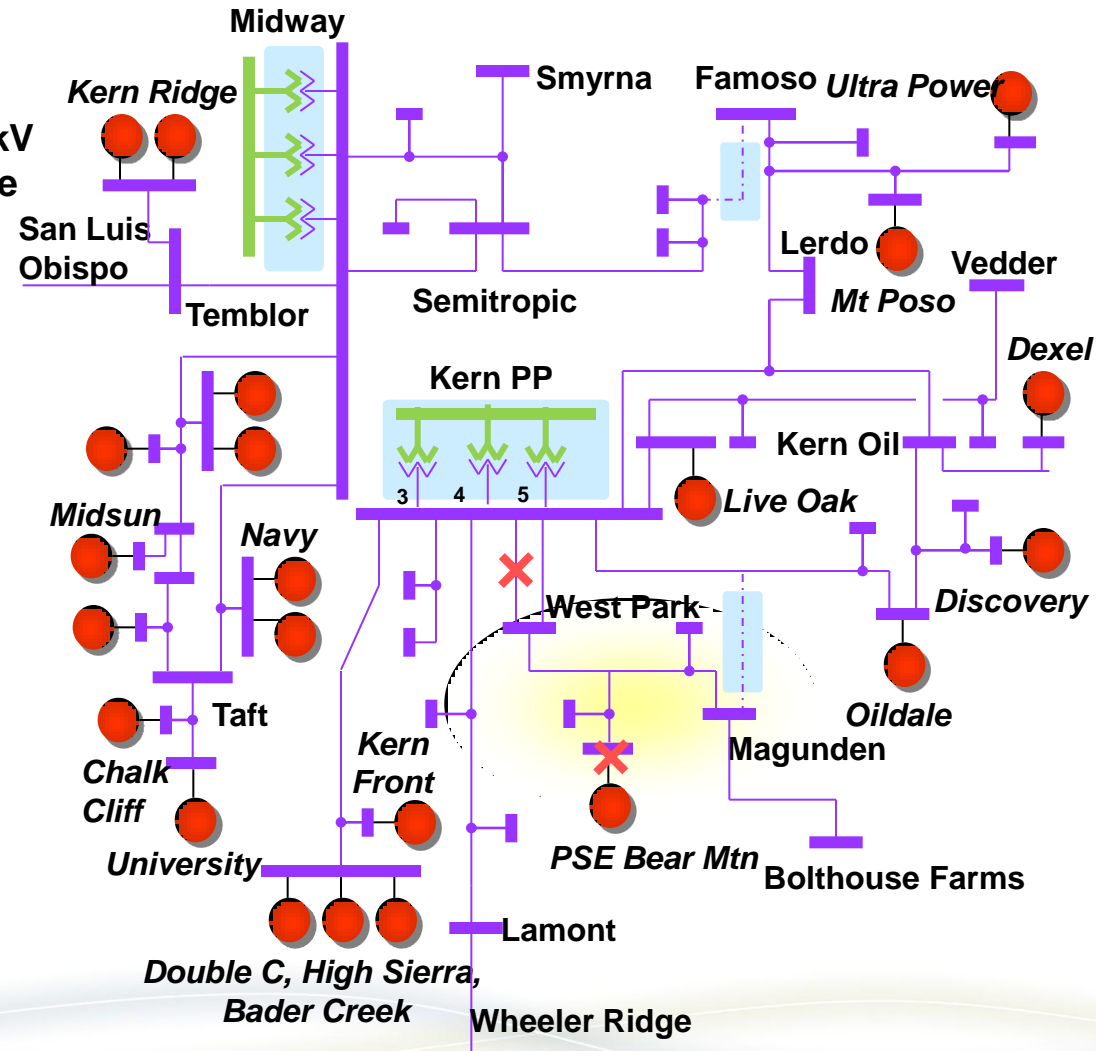

Kern Area LCR

2019 South Kern PP Sub-Area

Limiting Contingencies:

Category B:

- G-1/L-1: Kern-Magunden-Witco 115 kV with Mt Poso generation out of service
- Constraint: Kern-Live Oak 115 kV line

Category C:


- Kern-Magunden-Witco & Kern-7th Standard 115 kV lines
- Constraint: Kern-Live Oak 115 kV line

LCR Results (MW):

Contingency	Cat. B	Cat. C
LCR	111	116


Including:

QF	111	116
Muni	0	0
Deficiency	0	0

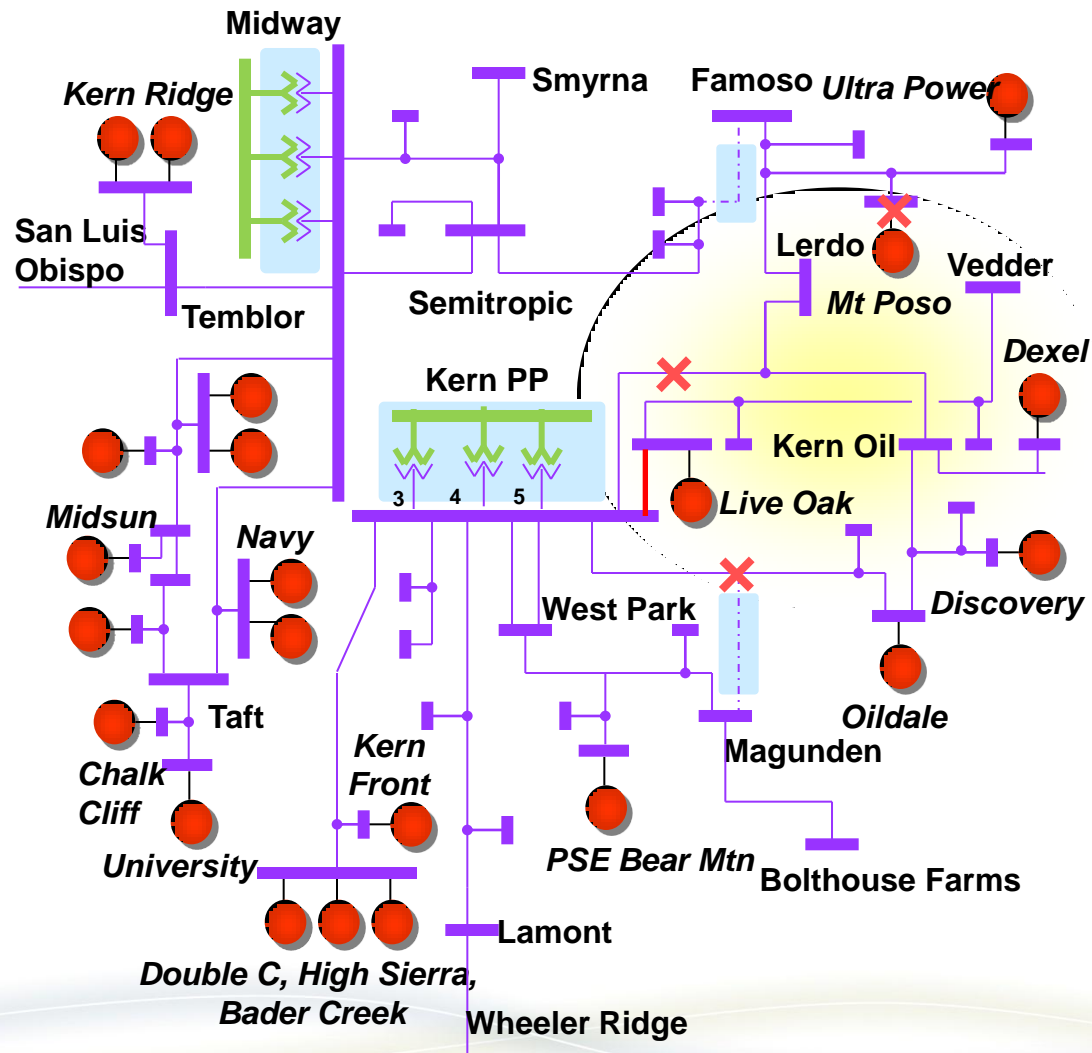

Kern Area LCR

Summary of 2019 LCR

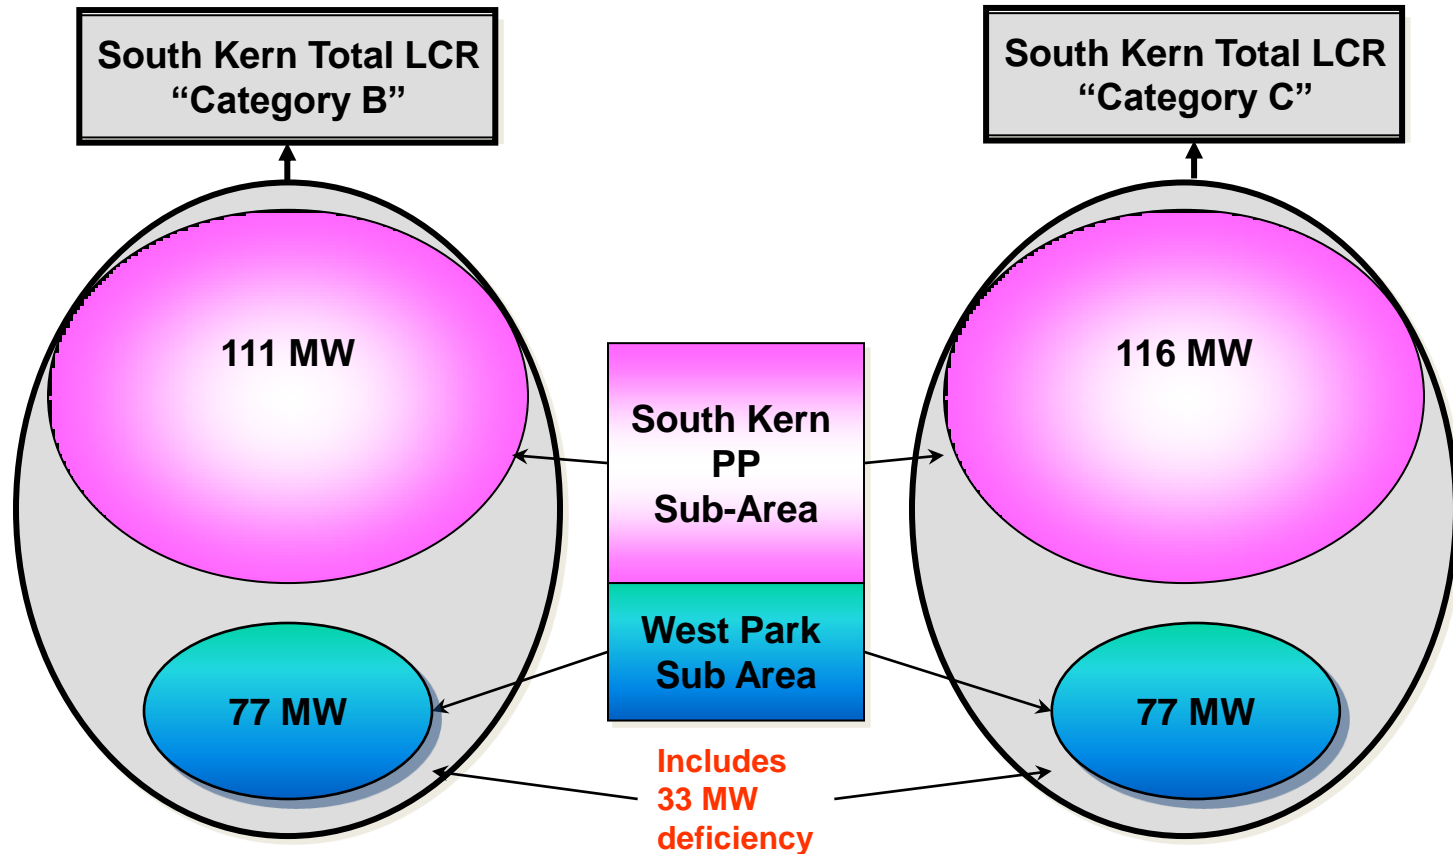

Note:

These sub-areas no longer overlap with the Kern-Magunden-Witco 115 kV open at Magunden and Kern PP #4 230/115 kV upgrade.

Changes

Since last year:

- 1) Famoso-Charca 115 kV normally opened
- 2) Kern-Magunden-Witco 115 kV normally opened at Magunden
- 3) LCR area split into three sub areas, Midway, West Park, & Kern South (Midway sub-area has no LCR requirement)
- 4) Local area needs redefinition
- 5) 2015 LCR has decreased by about 24 MW from 2014
- 6) Kern PP #4 230/115 kV no longer limiting in 2019 vs. 2015
- 7) 2019 LCR has decreased by about 281 MW from 2018 mostly due to Famoso-Charca 115 kV normally open

Your comments and questions are welcome.

For written comments, please send to: RegionalTransmission@caiso.com


Greater Fresno Area

Electrical Boundaries and LCR Sub-Areas

Electrical Boundaries:


- Gates – McCall 230 kV line
- Gates – Gregg 230 kV line
- Gates 230/70 kV transformer #1
- Panoche 230/115 kV transformer #1
- Panoche 230/115 kV transformer #2
- Panoche – Kearney 230 kV line
- Panoche – Helm 230 kV line
- Warnerville – Wilson 230 kV line
- Melones – Wilson 230 kV line
- Los Banos #3 230/70 kV transformer
- Los Banos #4 230/70 kV transformer
- San Miguel – Coalinga #1 70 kV line
- Smyrna – Alpaugh – Corcoran 115 kV line

LCR Sub-Areas:

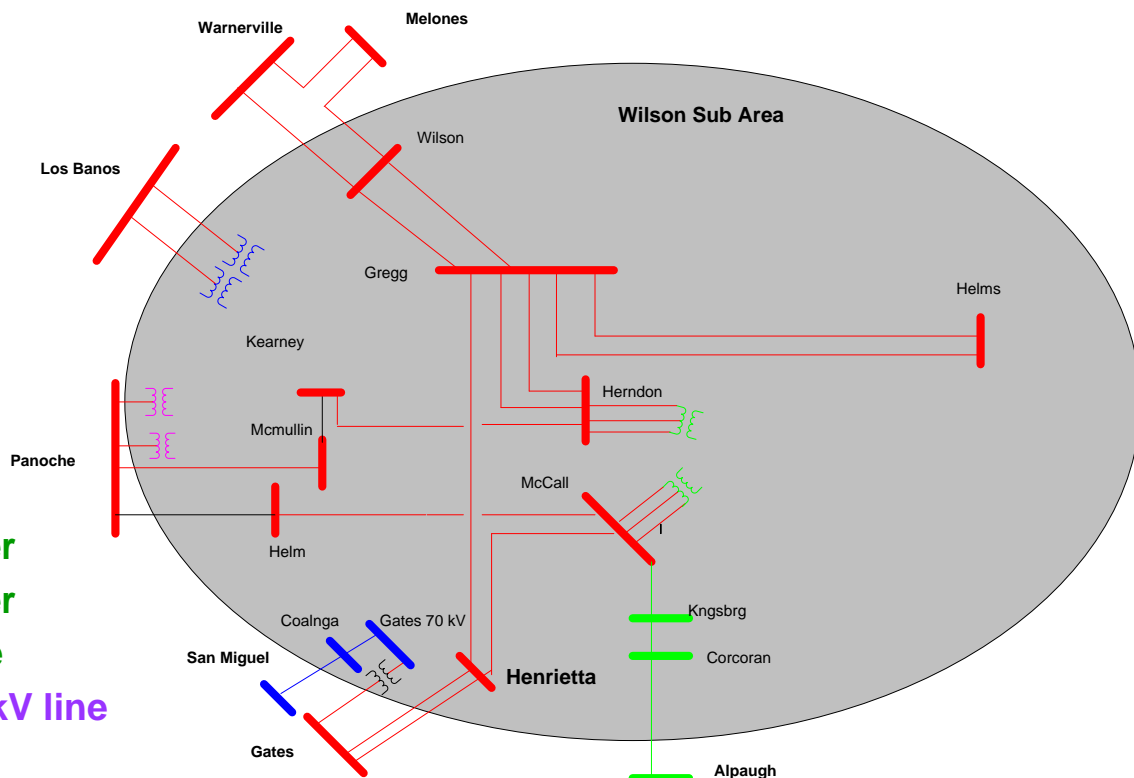

Fresno Area Overview

Area Generation, Load, Transmission and Path Flows

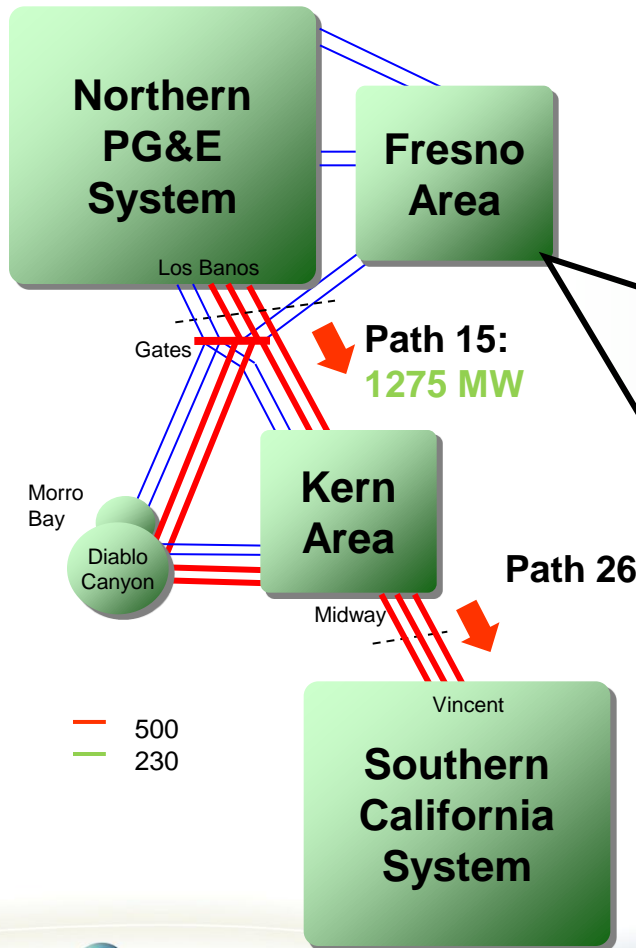

Fresno LCR Area

Total Generation and Load:

- Generation (NQC): **2702 MW**
- Load (1-in-10 Summer-Peak): **3215 MW (2015)**
- Load (1-in-10 Summer-Peak): **3258 MW (2019)**

Transmission Upgrades:

- Wilson Area Reinforcement in 2019 model
- Le Grand-Chowchilla 115 kV line reconducted in 2019 model
- Loop Gregg-Helms #1 & #2 230 kV and Kerckhoff-Clovis-Sanger #1 & #2 through new "E2" substation

New Generation:

- None – added units are EO

Fresno Area LCR

2015 Hanford Sub-Area

Limiting Contingencies:

Category B:

- G-1/L-1: McCall-Kingsburg #2 115 kV with GWF Hanford unit #1 out of service
- Constraint: McCall-Kingsburg #1 115 kV

Category C:


- L-2: McCall-Kingsburg #1 & #2 115 kV
- Constraint: Henrietta-GWF 115 kV

LCR Results (MW):

Contingency	Cat. B	Cat. C
LCR	64	100

Including:

QF	0	0
Muni	0	0
Deficiency	0	16

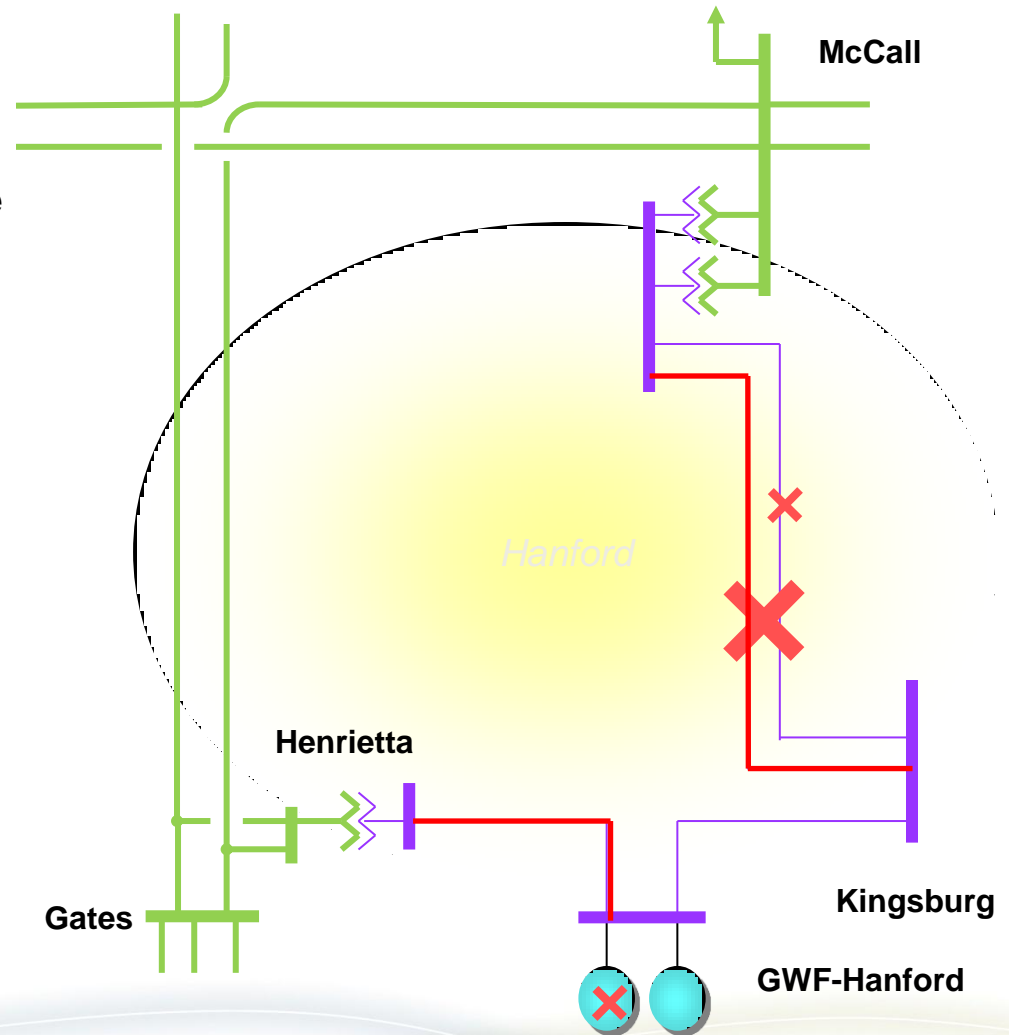

Fresno Area LCR

2015 Reedley Sub-Area

Limiting Contingencies:

Category C:


- L-1-1: McCall-Reedley (McCall-Wahtoke) 115 kV & Sanger-Reedley 115kV
- Constraint: Kings River-Sanger-Reedley 115 kV

LCR Results (MW):

Contingency	Cat. C
LCR	56

Including:

QF	10
Muni	0
Deficiency	46

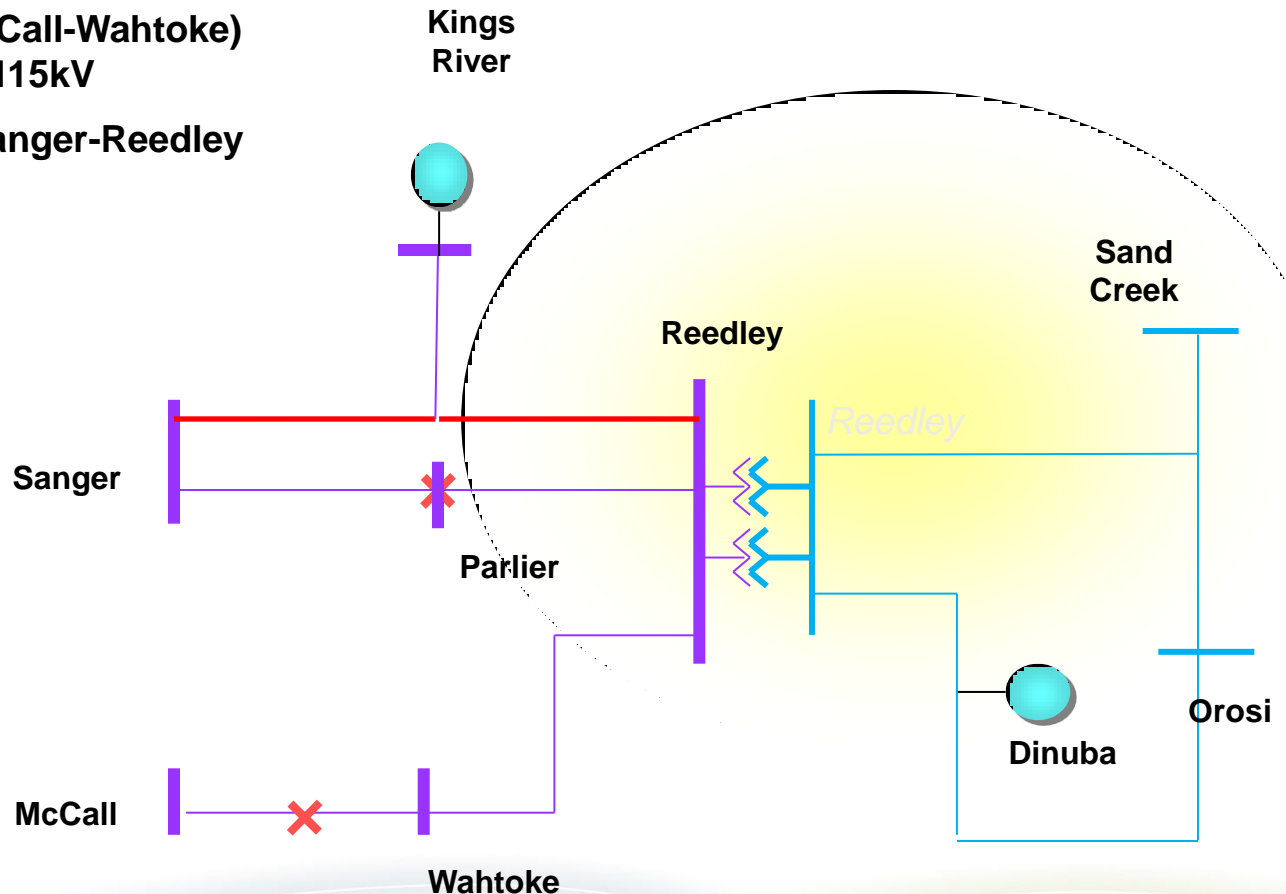

Fresno Area LCR

2015 Wilson Sub-Area


Limiting Contingencies:

Category B:

- G-1/L-1: Melones – Wilson 230 kV with one Helms unit out of service
- Constraint: Warnerville-Wilson 230 kV

Category C:

- See next page

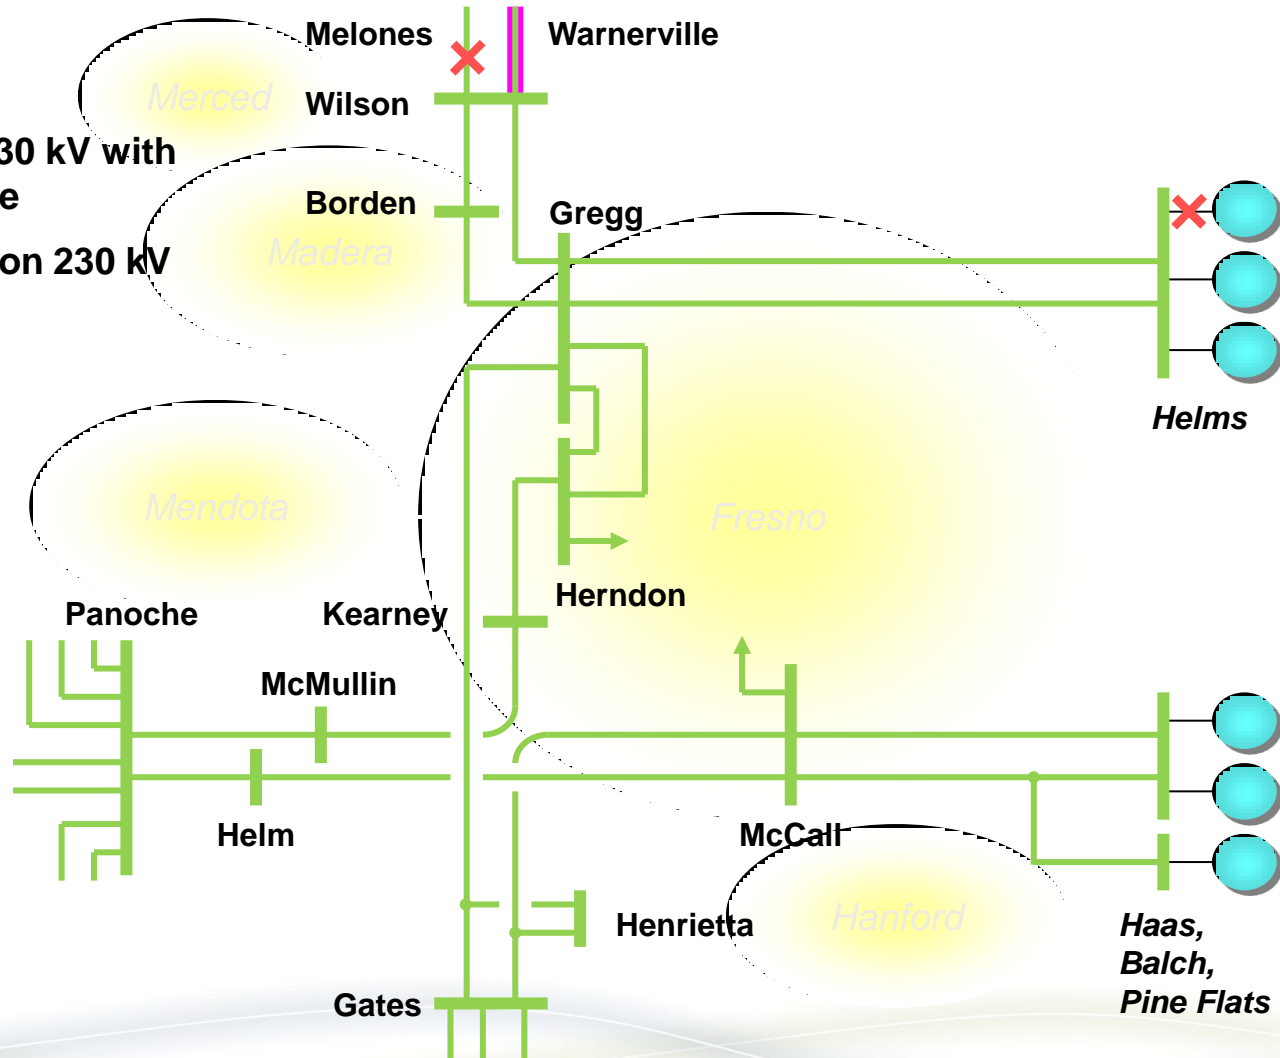

LCR Results (MW):

Contingency	Cat. B
LCR	2393

Including:

QF	185
Muni	146
Deficiency	0

Fresno Area LCR

2015 Wilson Sub-Area

Limiting Contingencies:

Category C: - Contingency 1

- L-1/G-1: Melones – Wilson 230 kV followed by one Helms unit out
- Constraint: Warnerville-Wilson 230 kV
- LCR: 2393 MW

Category C: - Contingency 2


- L-2: Gregg-Helms #1 & #2 230 kV
- Constraint: Warnerville-Wilson 230 kV
- LCR: 1615 MW (with 130 MW deficiency)

LCR Results (MW):

Contingency	Cat. C
LCR	2523

Including:

QF	185
Muni	146
Deficiency	130

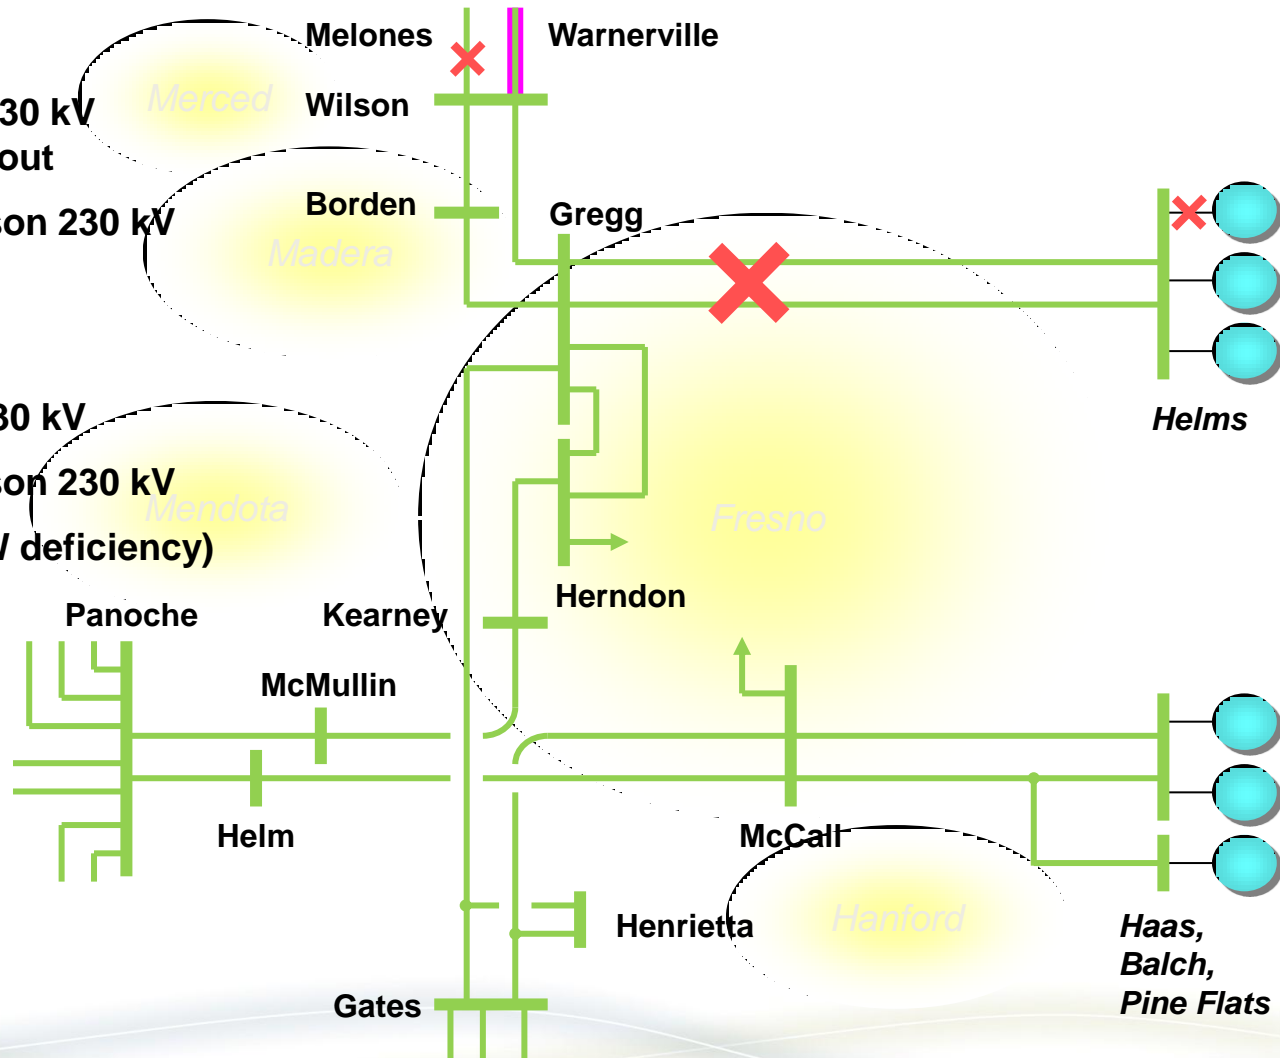

Fresno Area LCR

2019 Hanford Sub-Area

Limiting Contingencies:

Category B:

- L-1/G-1: McCall-Kingsburg #2 115 kV with GWF Hanford unit #1 out of service
- Constraint: McCall-Kingsburg #1 115 kV

Category C:


- L-2: McCall-Kingsburg #1 & #2 115 kV
- Constraint: Henrietta-GWF 115 kV

LCR Results (MW):

Contingency	Cat. B	Cat. C
LCR	51	96

Including:

QF	0	0
Muni	0	0
Deficiency	0	12

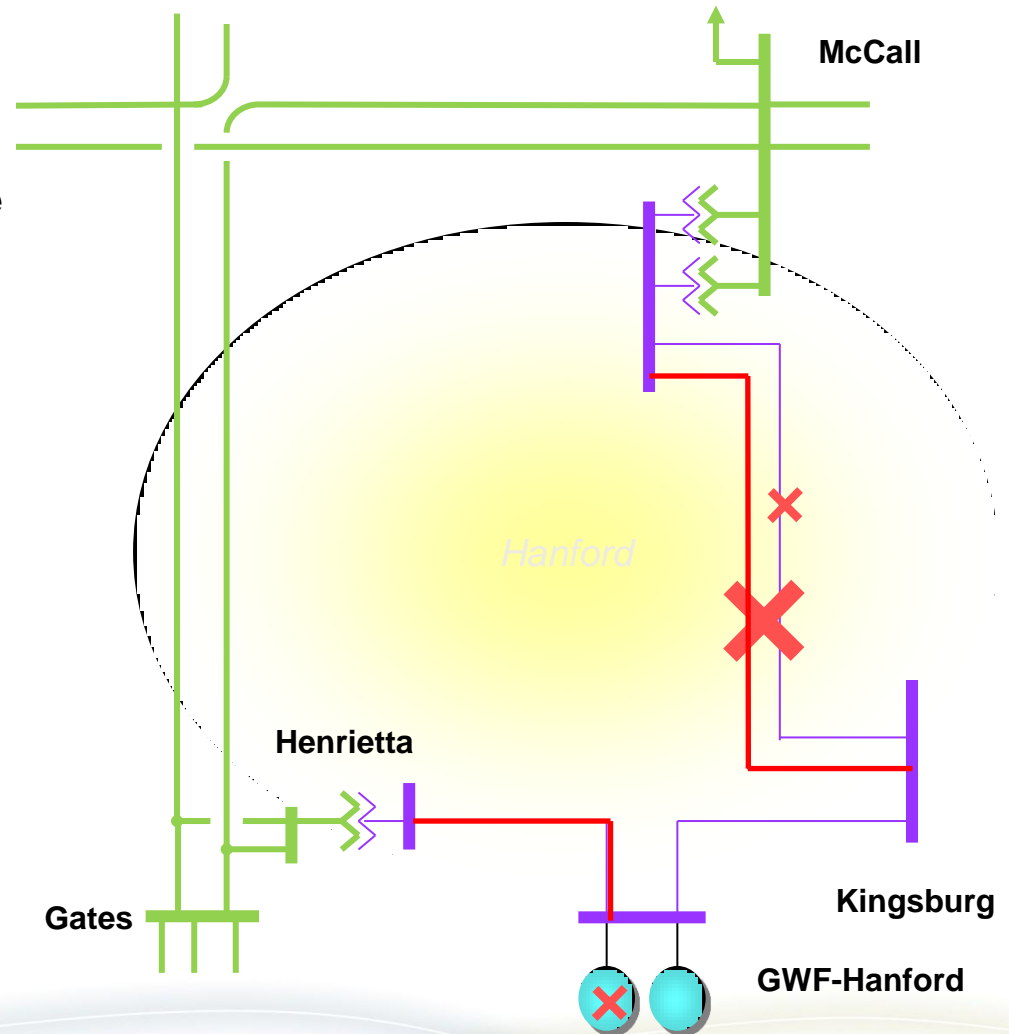

Fresno Area LCR

2019 Reedley Sub-Area

Limiting Contingencies:

Category C:


- L-1-1: McCall-Reedley (McCall-Wahtoke) 115 kV & Sanger-Reedley 115kV
- Constraint: Kings River-Sanger-Reedley 115 kV

LCR Results (MW):

Contingency	Cat. C
LCR	54

Including:

QF	10
Muni	0
Deficiency	44

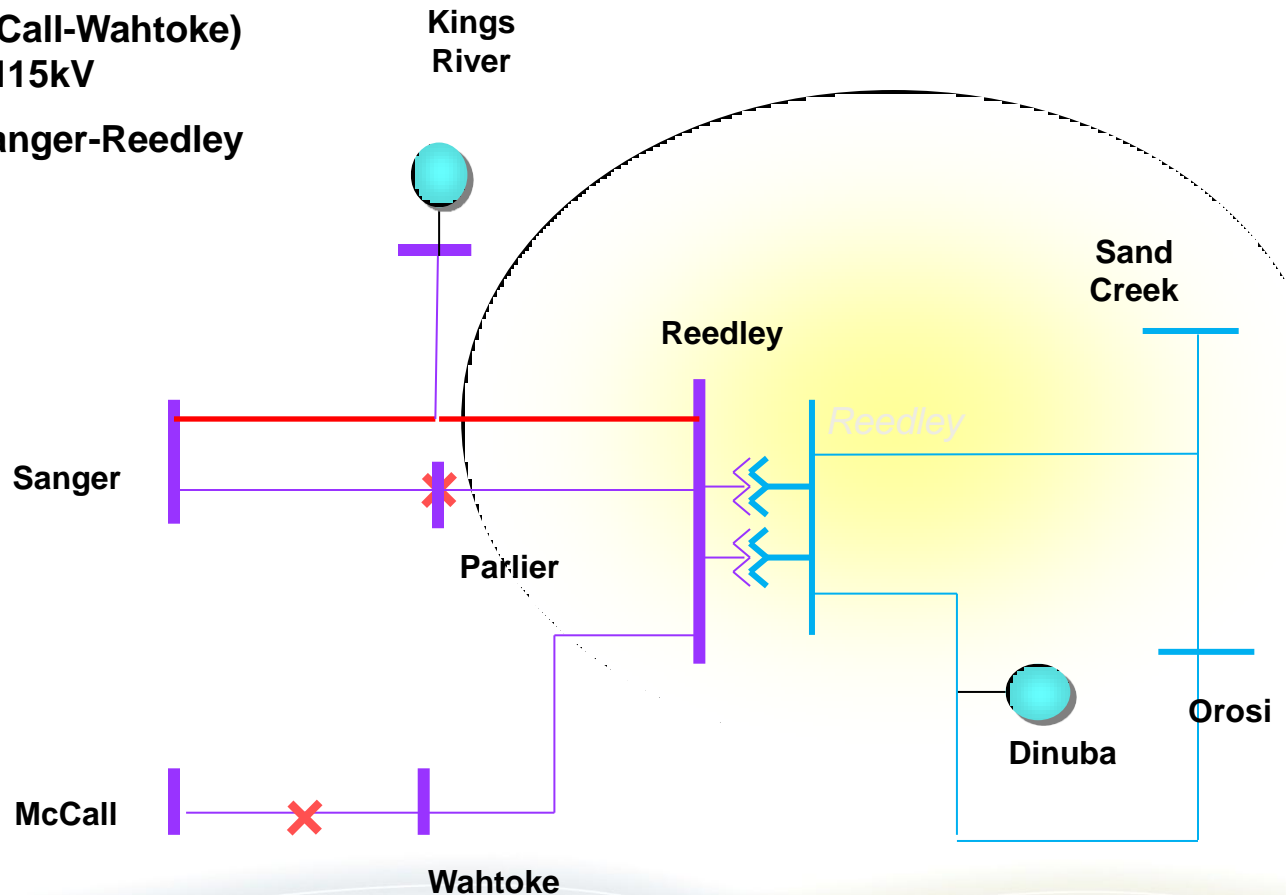

Fresno Area LCR

2019 Wilson Sub-Area


Limiting Contingencies:

Category B:

- G-1/L-1: Gates-Gregg 230 kV with one Helms unit out of service
- Constraint: Kearney-Herndon 230 kV

Category C:

- L-2: Panoche-Kearney 230 kV & Gates-Gregg 230 kV
- Constraint: Oro Loma-El Nido 115 kV

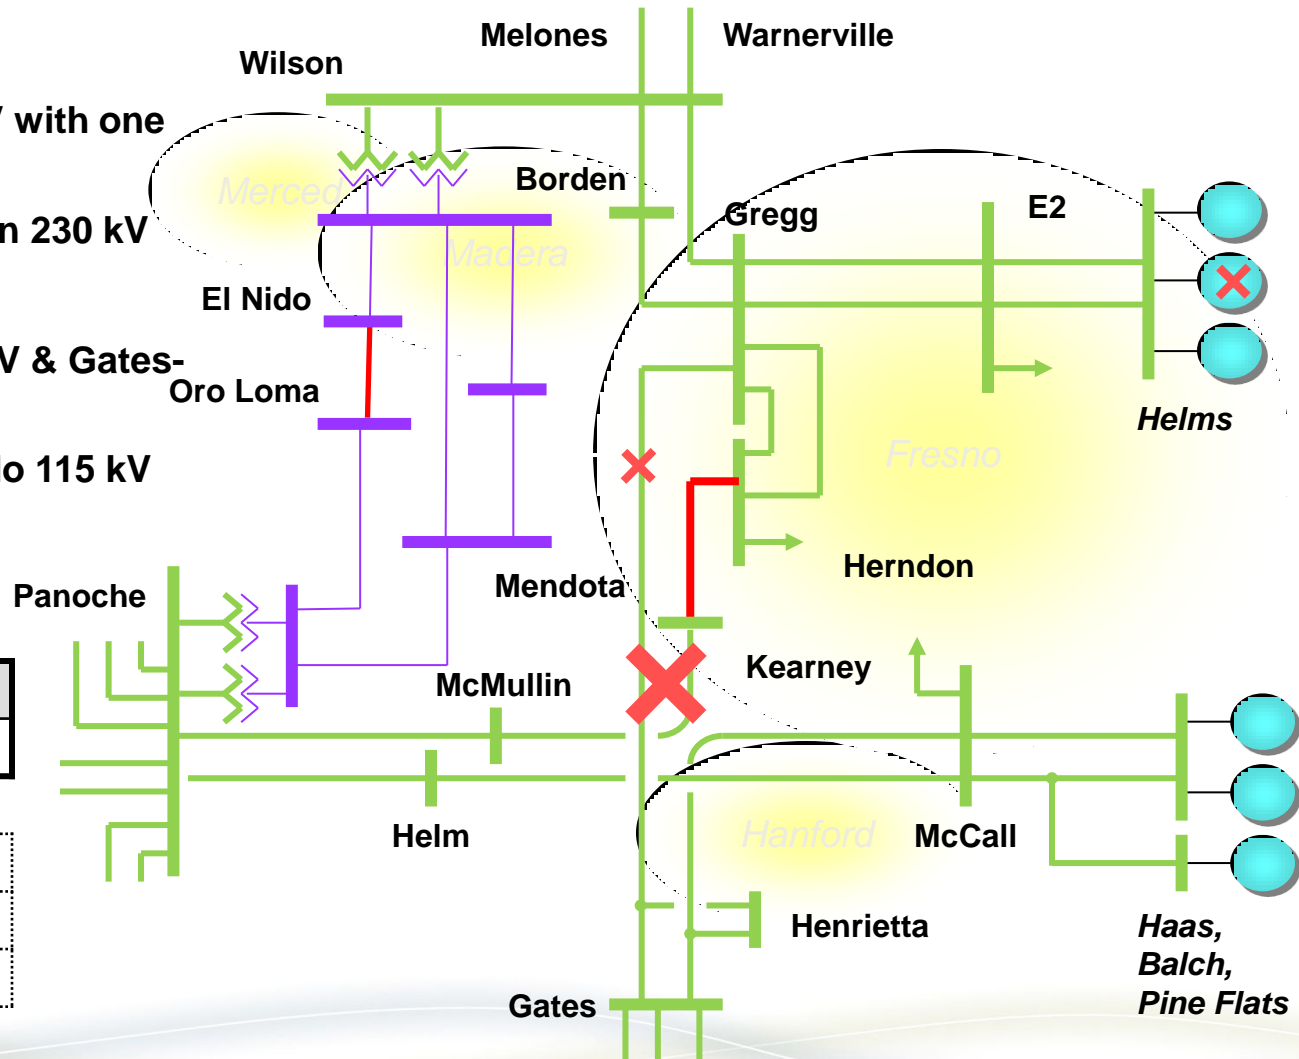

LCR Results (MW):

Contingency	Cat. B	Cat. C
LCR	1463	1545

Including:

QF	99	99
Muni	134	134
Deficiency	0	0

Changes

Since last year:

- 1) 2015 load decreased by 31 MW vs. 2014
- 2) LCR has increased by 665 MW of which 130 MW is deficiency due to effectiveness factors of resources required for the second most stringent contingency
- 3) 2019 series reactor at Wilson end of Warnerville-Wilson 230 kV
- 4) 2019 new “E2” sub station that loops Helms-Gregg #1 & #2 230 kV and Kerckhoff-Clovis-Sanger #1 & #2 115 kV lines and 2 new 420 MVA transformers
- 5) 2019 load decreased by 143 MW vs. 2018
- 6) LCR has decreased by 545 MW, mostly due to new reactor at Wilson.

Your comments and questions are welcome.

For written comments, please send to: RegionalTransmission@caiso.com