

Wind and Solar Curtailment April 22, 2021

This report is produced daily to provide a detailed accounting of the wind and solar renewable generation that was curtailed and the reasons why¹. This report should be read in the context of the Renewables Watch report for a more complete understanding of both renewable curtailment and generation².

Wind and solar curtailments are grouped into the following categories:

1. Economic - Local: Market dispatch of generators with economic bids to mitigate local congestion³.
2. Economic - System: Market dispatch of generators with economic bids to mitigate system-wide oversupply⁴.
3. SelfSchCut - Local: Market dispatch of self-schedules to mitigate local congestion.
4. SelfSchCut - System: Market dispatch of self-schedules to mitigate system-wide oversupply.
5. ExDispatch - Local: Exceptional dispatch to mitigate local congestion.
6. ExDispatch - System: Exceptional dispatch to mitigate system-wide oversupply.

Note: Amounts smaller than 1 MW are filtered out for simplicity. Such small curtailments are occasionally observed when forecasts are lower than Pmin when market will de-commit the unit and send the 0 MW dispatch.





¹Only wind and solar resources can be reported in this manner because these resources have a forecast. Curtailment is defined as the difference between actual production and the forecast when actual production is less than the forecast.

²The Renewables Watch report provides daily actual renewable production within the ISO grid. It is available at: <http://www.caiso.com/green/renewableswatch.html>.


³Congestion occurs when available, least-cost energy cannot be delivered to some loads because transmission facilities do not have sufficient capacity to deliver the energy.

⁴For more information on oversupply conditions, please see: https://www.caiso.com/Documents/FlexibleResourcesHelpRenewables_FastFacts.pdf


The following charts show the daily and 7-day wind and solar curtailment by category, if any.

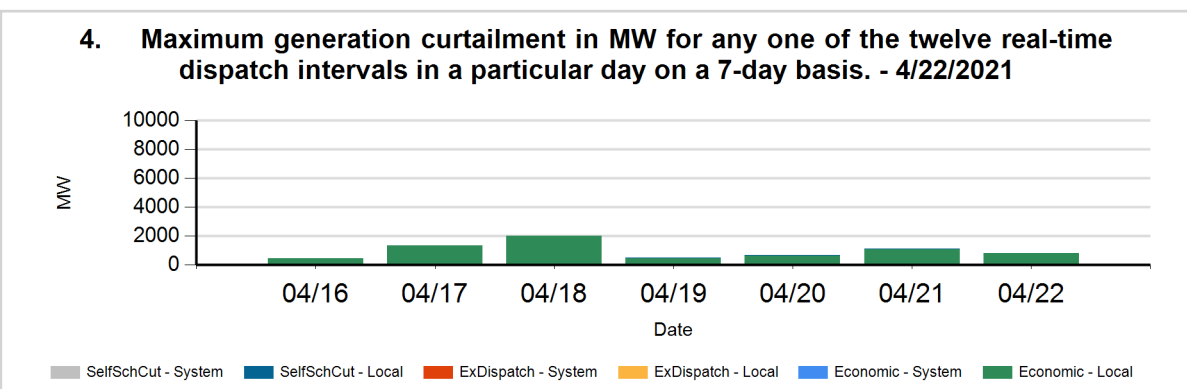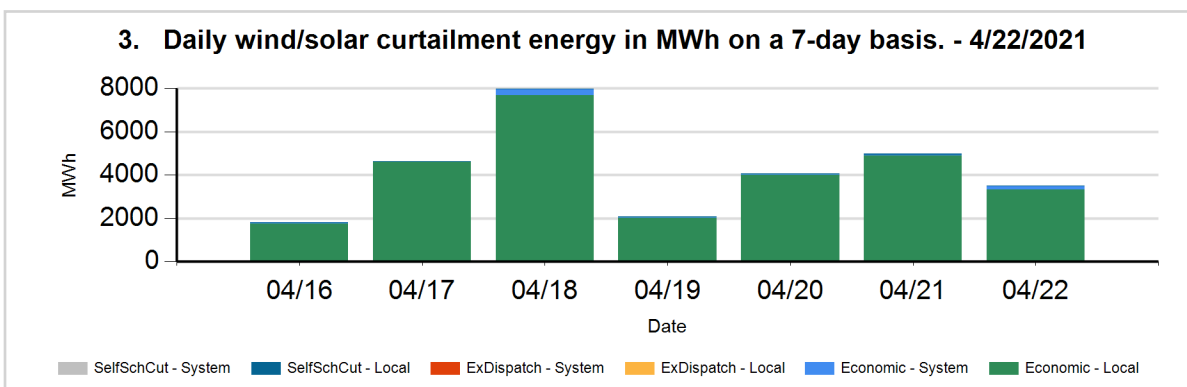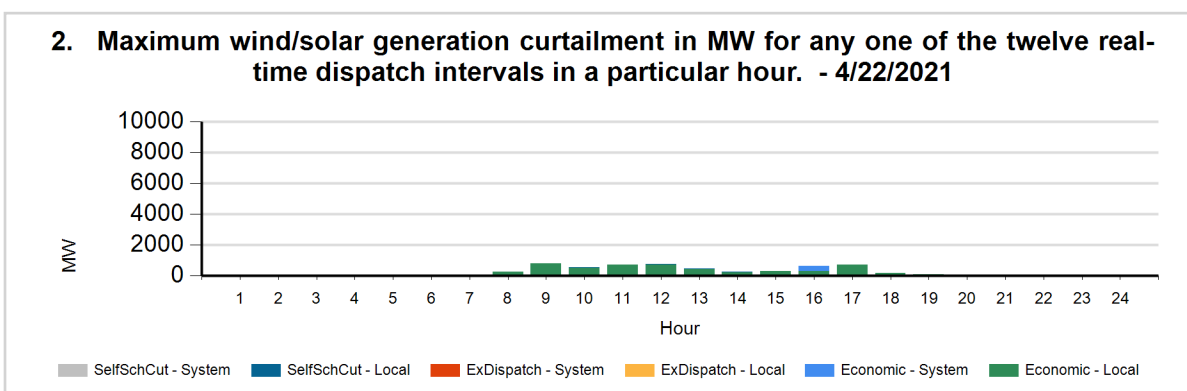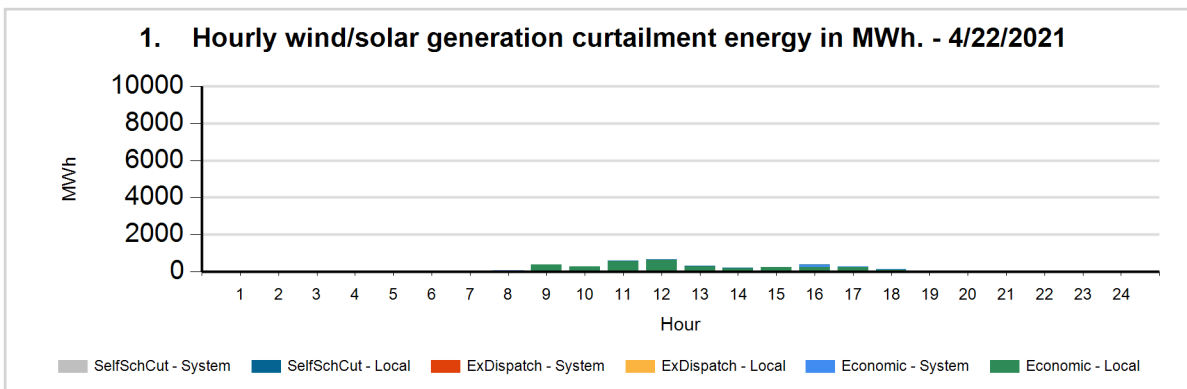

The following charts show hourly year to date wind and solar curtailment by category, if any.

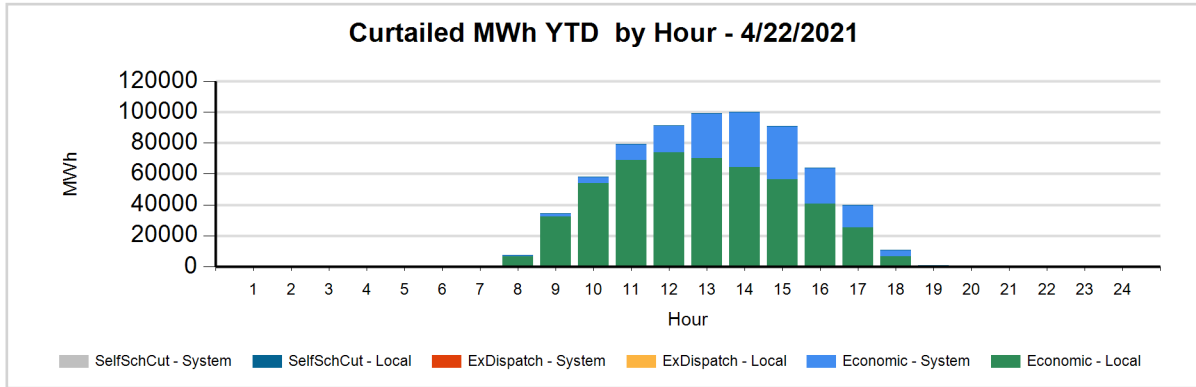

The following charts show monthly year to date wind and solar curtailment by category, if any.

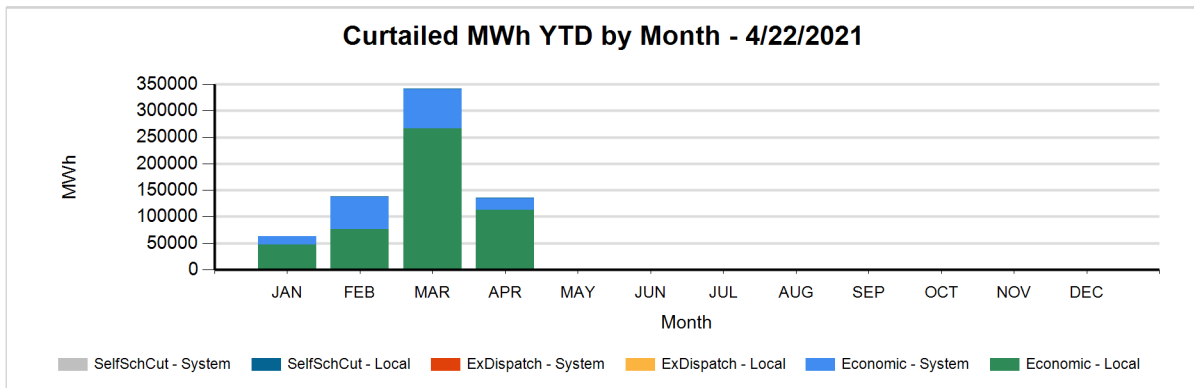

TYPE	YTD CURTAILED MWH - 4/22/2021
LocalEconomic	501,302
LocalSelfSchCut	2,285
SystemEconomic	174,303
TOTAL	677,890

Data used to produce hourly chart

DATE	HOUR	CURT TYPE	REASON	FUEL TYPE	CURTAILED MWH	CURTAILED MW
04/22	7	Economic	Local	SOLR	6	34
04/22	7	Economic	System	SOLR	1	
04/22	8	Economic	Local	SOLR	40	127
04/22	8	Economic	Local	WIND	18	117
04/22	8	Economic	System	SOLR	1	
04/22	9	Economic	Local	SOLR	298	689
04/22	9	Economic	Local	WIND	66	112
04/22	10	Economic	Local	SOLR	272	457
04/22	10	Economic	Local	WIND	13	81
04/22	10	SelfSchCut	Local	SOLR	0	1
04/22	11	Economic	Local	SOLR	493	556
04/22	11	Economic	Local	WIND	73	135
04/22	11	SelfSchCut	Local	SOLR	2	
04/22	12	Economic	Local	SOLR	643	647
04/22	12	Economic	Local	WIND	24	94
04/22	12	SelfSchCut	Local	SOLR	4	6
04/22	13	Economic	Local	SOLR	307	461
04/22	13	SelfSchCut	Local	SOLR	4	11
04/22	14	Economic	Local	SOLR	199	249
04/22	14	SelfSchCut	Local	SOLR	2	1
04/22	15	Economic	Local	SOLR	240	289
04/22	16	Economic	Local	SOLR	194	297
04/22	16	Economic	Local	WIND	56	
04/22	16	Economic	System	SOLR	44	157
04/22	16	Economic	System	WIND	70	163
04/22	16	SelfSchCut	Local	SOLR	2	
04/22	17	Economic	Local	SOLR	176	504
04/22	17	Economic	Local	WIND	66	206
04/22	17	Economic	System	SOLR	10	
04/22	17	Economic	System	WIND	20	
04/22	17	SelfSchCut	Local	SOLR	0	

04/22	18	Economic	Local	SOLR	116	144
04/22	18	Economic	System	SOLR	2	
04/22	19	Economic	Local	SOLR	24	62

The information contained in this report is preliminary and subject to change without notice. No inference, decision or conclusion should be made based on the information in this report or any series of these reports. All values are hourly average unless otherwise stated. Questions about this report should be directed to Short-Term Forecasting at ShortTermForecasting@caiso.com.