

Wind and Solar Curtailment June 04, 2017

This report is produced daily to provide a detailed accounting of the wind and solar renewable generation that was curtailed and the reasons why¹. This report should be read in the context of the Renewables Watch report for a more complete understanding of both renewable curtailment and generation².

Wind and solar curtailments are grouped into the following categories:

1. Economic - Local: Market dispatch of generators with economic bids to mitigate local congestion³.
2. Economic - System: Market dispatch of generators with economic bids to mitigate system-wide oversupply⁴.
3. SelfSchCut - Local: Market dispatch of self-schedules to mitigate local congestion.
4. SelfSchCut - System: Market dispatch of self-schedules to mitigate system-wide oversupply.
5. ExDispatch - Local: Exceptional dispatch to mitigate local congestion.
6. ExDispatch - System: Exceptional dispatch to mitigate system-wide oversupply.

Note: Amounts smaller than 1 MW are filtered out for simplicity. Such small curtailments are occasionally observed when forecasts are lower than Pmin when market will de-commit the unit and send the 0 MW dispatch.





¹Only wind and solar resources can be reported in this manner because these resources have a forecast. Curtailment is defined as the difference between actual production and the forecast when actual production is less than the forecast.

²The Renewables Watch report provides daily actual renewable production within the ISO grid. It is available at: <http://www.caiso.com/green/renewableswatch.html>.


³Congestion occurs when available, least-cost energy cannot be delivered to some loads because transmission facilities do not have sufficient capacity to deliver the energy.

⁴For more information on oversupply conditions, please see: https://www.caiso.com/Documents/FlexibleResourcesHelpRenewables_FastFacts.pdf


The following charts show the daily and 7-day rolling wind and solar curtailment by category, if any.

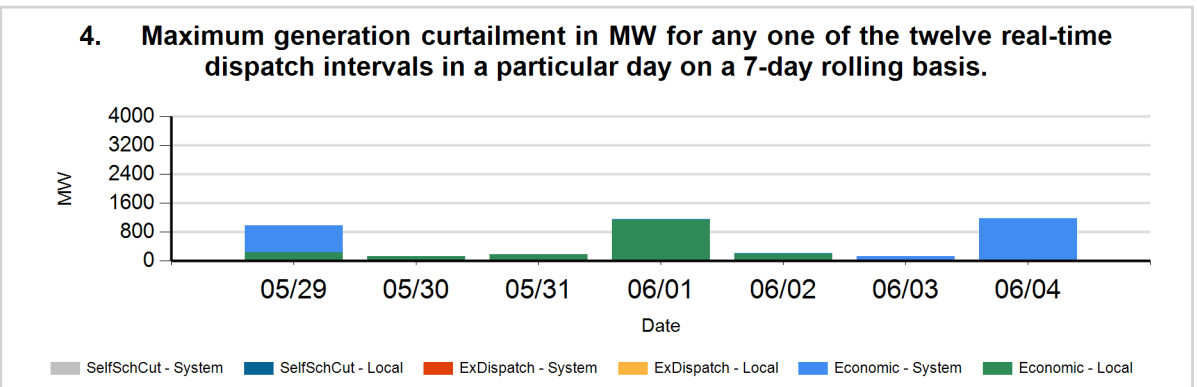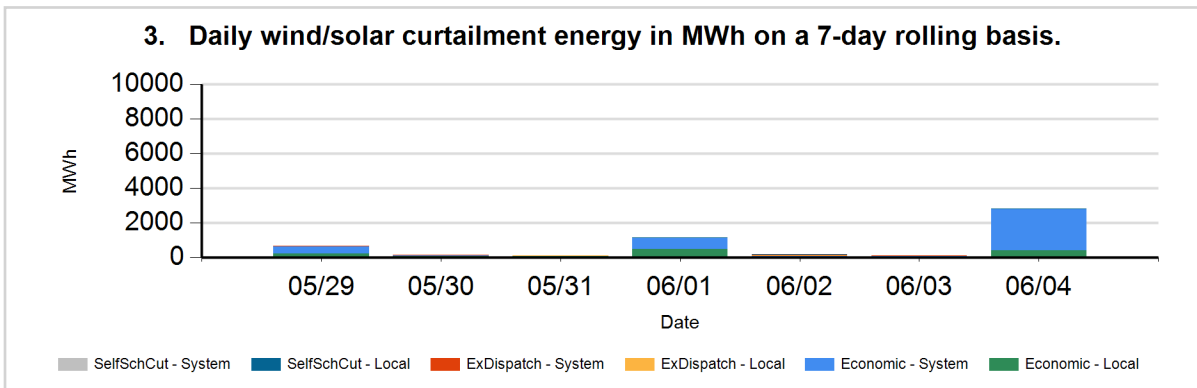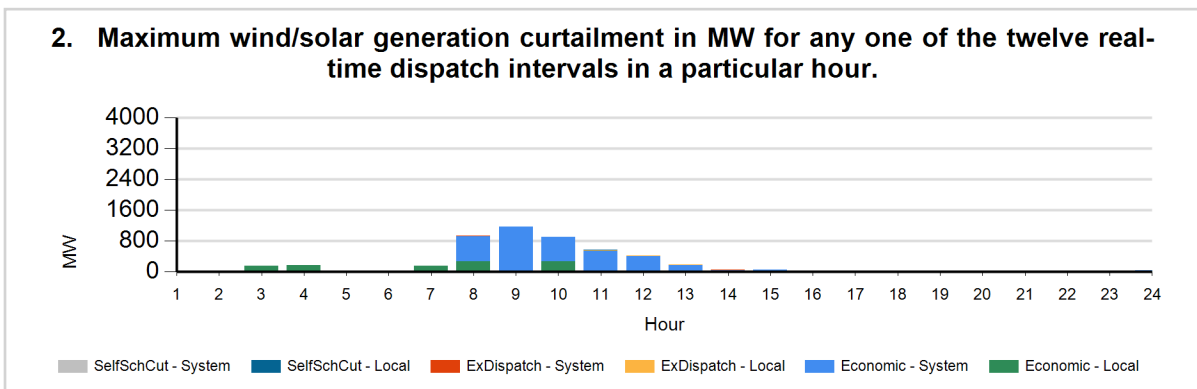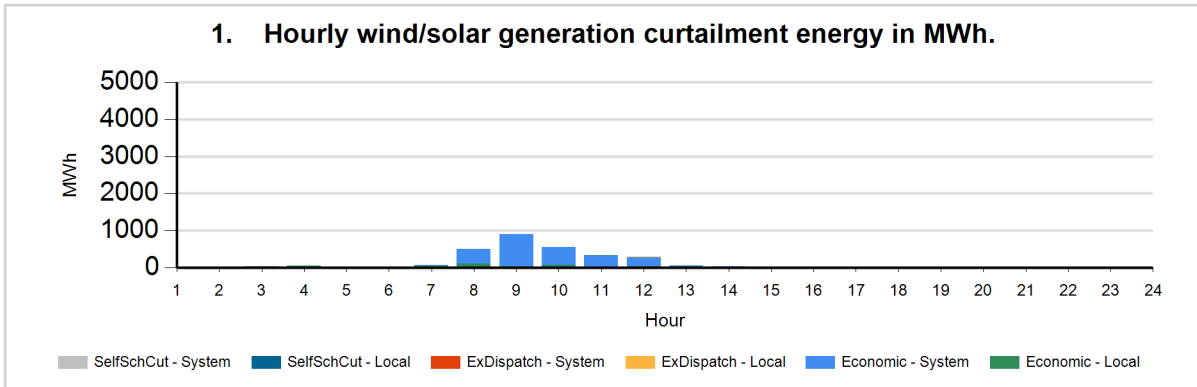

The following charts show hourly year to date wind and solar curtailment by category, if any.

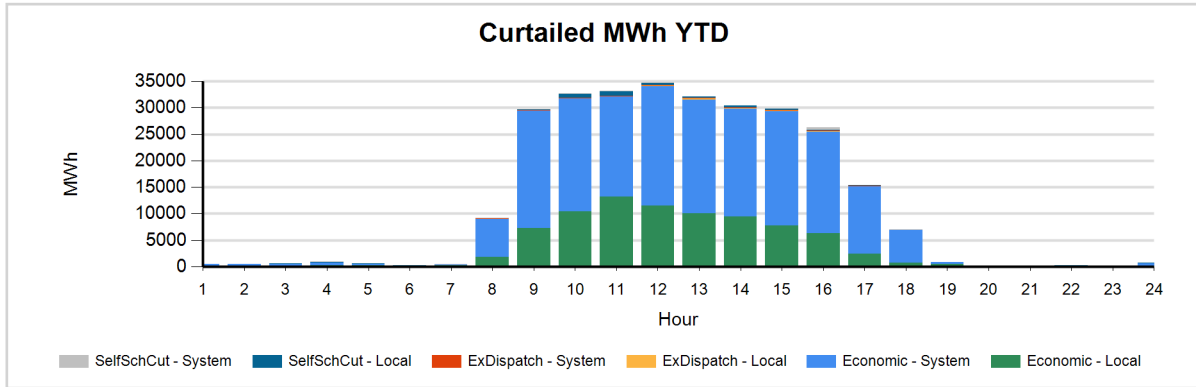

The following charts show monthly year to date wind and solar curtailment by category, if any.

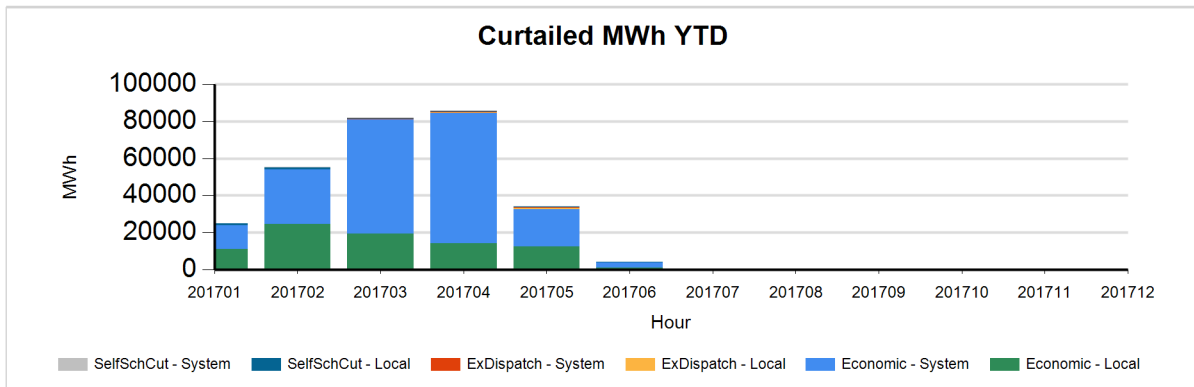

TYPE	YTD CURTAILED MWH
LocalEconomic	82,601
LocalExDispatch	1,240
LocalSelfSchCut	3,618
SystemEconomic	197,666
SystemExDispatch	395
SystemSelfSchCut	820
TOTAL	286,340

Data used to produce hourly chart

DATE	HOUR	CURT TYPE	REASON	FUEL TYPE	CURTAILED MWH	CURTAILED MW
06/04	3	Economic	Local	WIND	32	141
06/04	4	Economic	Local	WIND	51	164
06/04	6	Economic	Local	SOLR	0	
06/04	6	Economic	Local	WIND	3	16
06/04	7	Economic	Local	SOLR	1	
06/04	7	Economic	Local	WIND	66	142
06/04	7	Economic	System	SOLR	6	
06/04	8	Economic	Local	SOLR	78	253
06/04	8	Economic	Local	WIND	18	16
06/04	8	Economic	System	SOLR	396	663
06/04	8	ExDispatch	System	SOLR	0	0
06/04	9	Economic	Local	SOLR	1	1
06/04	9	Economic	Local	WIND	28	9
06/04	9	Economic	System	SOLR	862	1165
06/04	9	ExDispatch	System	SOLR	0	
06/04	10	Economic	Local	SOLR	64	255
06/04	10	Economic	Local	WIND	1	6
06/04	10	Economic	System	SOLR	492	647
06/04	10	Economic	System	WIND	1	
06/04	10	ExDispatch	System	SOLR	0	
06/04	11	Economic	Local	SOLR	1	2
06/04	11	Economic	System	SOLR	320	550
06/04	11	ExDispatch	Local	SOLR	1	1
06/04	11	ExDispatch	System	SOLR	0	
06/04	11	SelfSchCut	Local	SOLR	1	5
06/04	12	Economic	Local	SOLR	28	3
06/04	12	Economic	System	SOLR	257	415
06/04	12	ExDispatch	Local	SOLR	2	3
06/04	13	Economic	Local	SOLR	11	5
06/04	13	Economic	System	SOLR	42	170
06/04	13	ExDispatch	Local	SOLR	1	2

06/04	13	SelfSchCut	Local	SOLR	1	
06/04	14	Economic	Local	SOLR	12	
06/04	14	Economic	System	SOLR	14	43
06/04	14	ExDispatch	Local	SOLR	0	
06/04	14	ExDispatch	System	SOLR	0	0
06/04	14	SelfSchCut	Local	SOLR	0	
06/04	15	Economic	Local	SOLR	2	
06/04	15	Economic	System	SOLR	4	40
06/04	24	Economic	Local	WIND	4	24
06/04	24	Economic	System	WIND	1	10

The information contained in this report is preliminary and subject to change without notice. No inference, decision or conclusion should be made based on the information in this report or any series of these reports. All values are hourly average unless otherwise stated. Questions about this report should be directed to Hong Zhou at hzhou@caiso.com.