

## Wind and Solar Curtailment March 28, 2018

This report is produced daily to provide a detailed accounting of the wind and solar renewable generation that was curtailed and the reasons why<sup>1</sup>. This report should be read in the context of the Renewables Watch report for a more complete understanding of both renewable curtailment and generation<sup>2</sup>.

Wind and solar curtailments are grouped into the following categories:

- 1. Economic Local: Market dispatch of generators with economic bids to mitigate local congestion<sup>3</sup>.
- 2. Economic System: Market dispatch of generators with economic bids to mitigate systemwide oversupply.
- 3. SelfSchCut Local: Market dispatch of self-schedules to mitigate local congestion.
- 4. SelfSchCut System: Market dispatch of self-schedules to mitigate system-wide oversupply.
- 5. ExDispatch Local: Exceptional dispatch to mitigate local congestion.
- 6. ExDispatch System: Exceptional dispatch to mitigate system-wide oversupply.

Note: Amounts smaller than 1 MW are filtered out for simplicity. Such small curtailments are occasionally observed when forecasts are lower than Pmin when market will de-commit the unit and send the 0 MW dispatch.

<sup>1</sup>Only wind and solar resources can be reported in this manner because these resources have a forecast. Curtailment is defined as the difference between actual production and the forecast when actual production is less than the forecast.


<sup>2</sup>The Renewables Watch report provides daily actual renewable production within the ISO grid. It is available at: <u>http://www.caiso.com/green/renewableswatch.html</u>.


<sup>3</sup>Congestion occurs when available, least-cost energy cannot be delivered to some loads because transmission facilities do not have sufficient capacity to deliver the energy.


For more information on oversupply conditions, please see: <u>https://www.caiso.com/Documents/FlexibleResourcesHelpRenewables\_FastFacts.pdf</u>




The following charts show the daily and 7-day rolling wind and solar curtailment by category, if any.

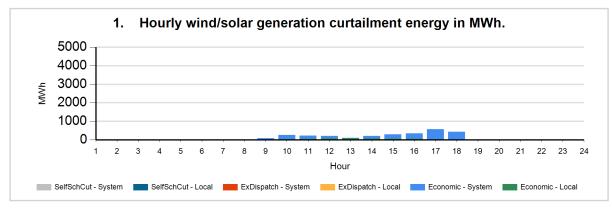

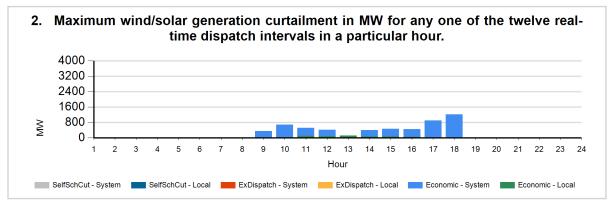

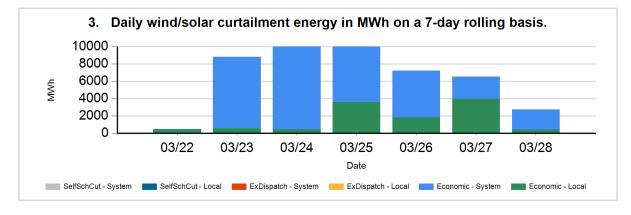


4. Maximum generation curtailment in MW for any one of the twelve real-time dispatch intervals in a particular day on a 7-day rolling basis.

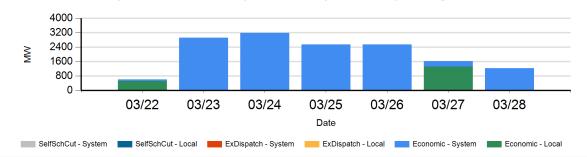




The following charts show hourly year to date wind and solar curtailment by category, if any.

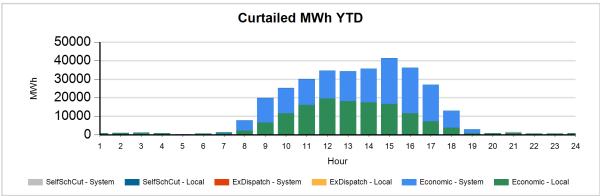

The following charts show monthly year to date wind and solar curtailment by category, if any.

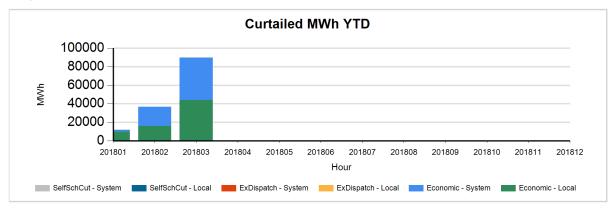

TYPE	YTD CURTAILED MWH
LocalEconomic	140,589
LocalSelfSchCut	1,370
SystemEconomic	175,893
SystemSelfSchCut	493
TOTAL	138,318



## Data used to produce hourly chart

DATE	HOU R	CURT TYPE	REASON	FUEL TYPE	CURTAILED MWH	CURTAILED MW
03/28	8	Economic	System	SOLR	3	18
03/28	9	Economic	Local	SOLR	12	21
03/28	9	Economic	System	SOLR	76	313
03/28	9	Economic	System	WIND	5	19
03/28	10	Economic	Local	SOLR	30	38
03/28	10	Economic	System	SOLR	231	638
03/28	10	Economic	System	WIND	5	2
03/28	11	Economic	Local	SOLR	42	99
03/28	11	Economic	System	SOLR	172	417
03/28	11	Economic	System	WIND	2	5
03/28	12	Economic	Local	SOLR	70	78
03/28	12	Economic	System	SOLR	138	344
03/28	13	Economic	Local	SOLR	85	109
03/28	14	Economic	Local	SOLR	60	63
03/28	14	Economic	System	SOLR	148	331
03/28	14	Economic	System	WIND	1	3
03/28	15	Economic	Local	SOLR	56	57
03/28	15	Economic	System	SOLR	235	396
03/28	15	Economic	System	WIND	2	4
03/28	16	Economic	Local	SOLR	42	42
03/28	16	Economic	System	SOLR	304	413
03/28	17	Economic	System	SOLR	571	901
03/28	18	Economic	System	SOLR	431	1216
03/28	18	Economic	System	WIND	3	7
03/28	19	Economic	System	SOLR	1	4

The information contained in this report is preliminary and subject to change without notice. No inference, decision or conclusion should be made based on the information in this report or any series of these reports. All values are hourly average unless otherwise stated. Questions about this report should be directed to Hong Zhou at hzhou@caiso.com.

