


Loading of the Newark 230/115 kV Transformers on June 13-15, 2000.

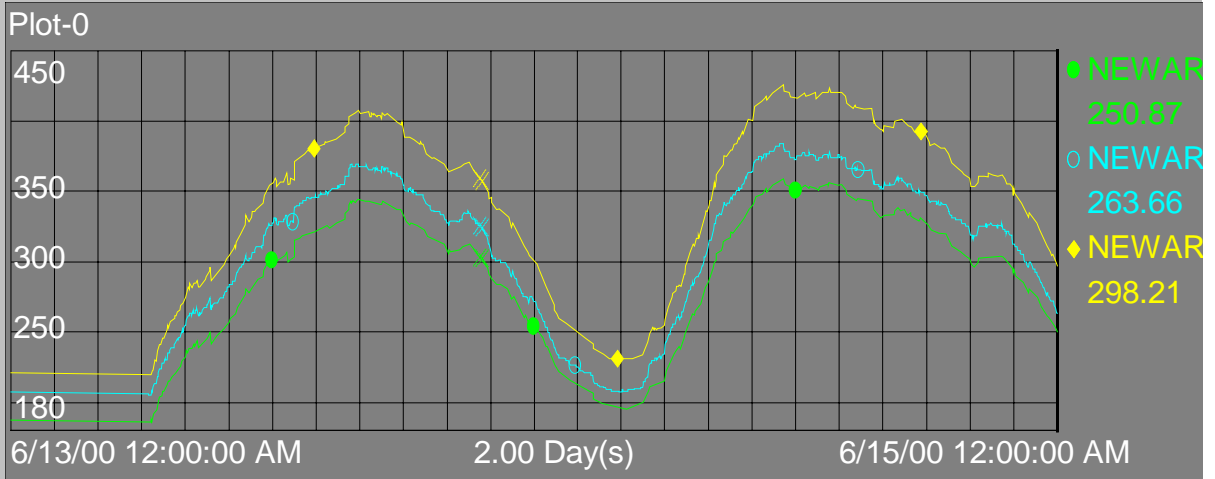

From the top: bank No 9, 7 and 11.

Normal ratings : bank No 9 490 MW
 bank No. 7 429 MW
 bank No. 11 403 MW