



2015-2016 Transmission Planning Process Unified Planning Assumptions and Study Plan

February 17, 2015

Draft

Intentionally left blank

Table of Contents

1.	Introduction.....	1
2.	Overview of 2015-2016 Stakeholder Process Activities and Communications	2
2.1	Stakeholder Meetings and Market Notices.....	2
2.2	Stakeholder Comments	5
2.3	Availability of Information	5
3.	Public Policy Objectives and the Conceptual Statewide Transmission Plan.....	6
3.1	Public Policy Objectives.....	6
3.1.1	Achieving 33% renewable energy on an annual basis	6
3.1.2	Supporting RA deliverability status for needed renewable resources outside the ISO balancing authority area.....	7
3.2	Conceptual Statewide Transmission Plan.....	7
4.	Reliability Assessments	9
4.1	Study Areas	9
4.2	Frequency of the study	10
4.3	Reliability Standards and Criteria.....	10
4.3.2	NERC Reliability Standards	11
4.3.3	WECC Regional Business Practice.....	11
4.3.4	California ISO Planning Standards.....	11
4.4	Study Horizon	11
4.5	Study Years	11
4.6	Study Scenarios.....	12
4.7	Contingencies:.....	16
4.8	Study Base Cases	18
4.9	Generation Projects	19
4.10	Transmission Projects.....	25
4.11	Demand Forecast	25
4.11.2	Pacific Gas and Electric Service Area.....	26
4.11.3	Southern California Edison Service Area	27
4.11.4	San Diego Gas and Electric Service Area.....	27
4.11.5	Valley Electric Association Service Area.....	28
4.12	Reactive Resources.....	28
4.13	Operating Procedures.....	28
4.14	Major Path Flows and Interchange.....	29
4.15	Protection System.....	30
4.16	Control Devices	30

4.17	Demand Response Programs and Energy Storage	31
4.17.2	Demand Response	31
4.17.3	Energy Storage.....	33
4.18	Study Tools.....	34
4.19	Study Methodology	34
4.19.1	Technical Analysis	34
4.19.2	Preferred Resource Methodology	37
5.	Local Capacity Requirement Assessment.....	39
5.1	Near-Term Local Capacity Requirement (LCR).....	39
5.2	Long-Term Local Capacity Requirement Assessment.....	40
6.	Special Studies	41
6.1	50% Renewable Energy Goal for 2030	41
6.2	Over Generation Frequency Response Assessment.....	42
7.	Policy Driven 33% RPS Transmission Plan Analysis	43
7.1	Study methodology	43
7.2	Study scope.....	43
7.3	Coordination with Phase II of GIP	44
8.	Economic Planning Study	45
9.	Long-Term Congestion Revenue Rights (LT CRR)	46
10.	Contact Information	47
11.	Stakeholder Comments and ISO Responses	47
APPENDIX A: System Data		
A1	Existing Generation	53
A2	Planned Generation.....	76
A3	Retired Generation	77
A4	Reactive Resources.....	78
A5	Special Protection Schemes	79

1. Introduction

As set forth in Section 24 of the California ISO tariff on the Transmission Planning Process and in the Transmission Planning Process (TPP) Business Practice Manual (BPM), the TPP is conducted in three phases. This document is being developed as part of the first phase of the TPP, which entails the development of the unified planning assumptions and the technical studies to be conducted as part of the current planning cycle. In accordance with revisions to the TPP that were approved by FERC in December 2010, this first phase also includes specification of the public policy objectives the ISO will adopt as the basis for identifying policy-driven transmission elements in Phase 2 of the TPP, as well as initiation of the development of a conceptual statewide transmission plan that will be an input to the comprehensive planning studies and transmission plan developed during Phase 2. Phase 3 will take place after the approval of the plan by the ISO Board if projects eligible for competitive solicitation were approved by the Board at the end of Phase 2. If you would like to learn more about the ISO's TPP, please go to:

- Section 24 of the California ISO tariff located at:
<http://www.caiso.com/rules/Pages/Regulatory/Default.aspx>
- Transmission Planning Process BPM at:
<http://www.caiso.com/rules/Pages/BusinessPracticeManuals/Default.aspx> .

The objectives of the unified planning assumptions and study plan are to clearly articulate the goals and assumptions for the various public policy and technical studies to be performed as part of Phase 2 of the TPP cycle. These goals and assumptions will in turn form the basis for ISO approval of specific transmission elements and projects identified in the 2015-2016 comprehensive transmission plan at the end of Phase 2. ISO intends to continue updating the High Voltage TAC model for inclusion in the final draft transmission plan, as it has in the past. An opportunity to review the previous year's model for comments will be provided during the year, and has not been scheduled at this time.

The ISO has collaboratively worked with the California Public Utilities Commission (CPUC) and the California Energy Commission (CEC) to align the planning assumptions between the ISO's TPP and the CPUC's Long-term Procurement Process (LTPP), as well as the demand forecast assumptions embodied in the 2013 IEPR (approved in January 2014). With this draft study plan, the base planning assumptions for the 2015-2016 TPP are effectively aligned for the 2016-2025 planning horizon with those of the LTPP proposed to be used transmission and procurement requirements.

2. Overview of 2015-2016 Stakeholder Process Activities and Communications

Section 2 of this document presents general information regarding stakeholder activities and communications that will occur during this planning cycle.

2.1 Stakeholder Meetings and Market Notices

During each planning cycle, the ISO will conduct at least four stakeholder meetings to present and acquire stakeholder input on the current planning effort. These stakeholder meetings are scheduled and designed around major activities in Phase 1 and Phase 2 of the TPP. Additional meetings for each stage may be scheduled as needed. These meetings provide an opportunity for the ISO to have a dialogue with the stakeholders regarding planning activities and to establish the foundation upon which stakeholders may comment and provide other necessary input at each stage of the TPP.

The current schedule for all three phases of the 2015-2016 transmission planning cycle is provided in Table 2-1. Should this schedule change or other aspects of the 2015-2016 transmission planning cycle require revision; the ISO will notify stakeholders through an ISO market notice which will provide stakeholders information about revisions that have been made. As such, the ISO encourages interested entities to register to receive transmission planning related market notices. To do so, go to: <http://caiso.com/1c67/1c678de462d10.html> and submit the Market Notice Subscription Form.

Table 2-1: Schedule for the 2015-2016 planning cycle

Phase	No	Due Date	2015-2016 Activity
Phase 1	1	December 15, 2014	The ISO sends a letter to neighboring balancing authorities, sub-regional, regional planning groups requesting planning data and related information to be considered in the development of the Study Plan and the ISO issues a market notice announcing a thirty-day comment period requesting demand response assumptions and generation or other non-transmission alternatives to be considered in the Unified Planning Assumptions.
	2	January 15, 2015	PTO's, neighboring balancing authorities, regional/sub-regional planning groups and stakeholders provide ISO the information requested No.1 above.
	3	February 17, 2015	The ISO develops the draft Study Plan and posts it on its website
	4	February 23, 2015	The ISO hosts public stakeholder meeting #1 to discuss the contents in the Study Plan with stakeholders
	5	February 23 - March 9, 2015	Comment period for stakeholders to submit comments on the public stakeholder meeting #1 material and for interested parties to submit Economic Planning Study Requests to the ISO
	6	March 31, 2015	The ISO specifies a provisional list of high priority economic planning studies, finalizes the Study Plan and posts it on the public website
	7	Q1	ISO Initiates the development of the Conceptual Statewide Plan
Phase 2	8	August 15, 2015	Request Window opens
	9	August 14, 2015	The ISO posts preliminary reliability study results and mitigation solutions
	10	September 15, 2015	PTO's submit reliability projects to the ISO
	11	September/October	ISO posts the Conceptual Statewide Plan on its website and issues a market notice announcing the posting
	12	September 21 – 22, 2015	The ISO hosts public stakeholder meeting #2 to discuss the reliability study results, PTO's reliability projects, and the Conceptual Statewide Plan with stakeholders
	13	September 22 – October 6, 2015	Comment period for stakeholders to submit comments on the public stakeholder meeting #2 material ¹

¹ The ISO will target responses to comments within three weeks of the close of comment periods, and that due to the analysis involved, this may limit the depth of the response to some of the comments received following the second and third stakeholder meetings.

Phase	No	Due Date	2015-2016 Activity
	14	October 15, 2015	Request Window closes
	15	October/November	Stakeholders have a 20 day period to submit comments on the Conceptual Statewide Plan in the next calendar month after posting conceptual statewide plan
	16	October 30, 2015	ISO post final reliability study results
	17	November 12, 2015	The ISO posts the preliminary assessment of the policy driven & economic planning study results and the projects recommended as being needed that are less than \$50 million.
	18	November 16 - 17, 2015	The ISO hosts public stakeholder meeting #3 to present the preliminary assessment of the policy driven & economic planning study results and brief stakeholders on the projects recommended as being needed that are less than \$50 million.
	19	November 17 – December 1, 2015	Comment period for stakeholders to submit comments on the public stakeholder meeting #3 material
	20	December 17 – 18, 2015	The ISO to brief the Board of Governors of projects less than \$50 million to be approved by ISO Executive
	21	January 2016	The ISO posts the draft Transmission Plan on the public website
	22	February 2016	The ISO hosts public stakeholder meeting #4 to discuss the transmission project approval recommendations, identified transmission elements, and the content of the Transmission Plan
	23	Approximately three weeks following the public stakeholder meeting #4	Comment period for stakeholders to submit comments on the public stakeholder meeting #4 material
	24	March 2016	The ISO finalizes the Transmission Plan and presents it to the ISO Board of Governors for approval
	25	End of March, 2016	ISO posts the Final Board-approved Transmission Plan on its site
	Phase 3	26 ²	April 1, 2016

² The schedule for Phase 3 will be updated and available to stakeholders at a later date.

2.2 Stakeholder Comments

The ISO will provide stakeholders with an opportunity to comment on all meetings and posted materials. Stakeholders are requested to submit comments in writing to regionaltransmission@caiso.com within two weeks after the stakeholder meetings. The ISO will post these comments on the ISO Website and will provide responses to these comments no later than the posting of the draft transmission plan.

2.3 Availability of Information

The ISO website is the central place for public and non-public information. For public information, the main page for documents related to 2015-2016 transmission planning cycle is the “Transmission Planning” section located at <http://www.caiso.com/planning/Pages/TransmissionPlanning/Default.aspx> on the ISO website.

Confidential or otherwise restricted data, such as Critical Energy Infrastructure Information (CEII) is stored on the ISO secure transmission planning webpage located on the market participant portal at <https://portal.caiso.com/tp/Pages/default.aspx>. In order to gain access to this secured website, each individual must have a Non-Disclosure Agreement (NDA) executed with the ISO.

The procedures governing access to different classes of protected information is set forth in Section 9.2 of the Transmission Planning BPM (BPM). As indicated in that section, access to specified information depends on whether a requesting entity meets certain criteria set forth in the ISO tariff. The NDA application and instructions are available on the ISO website at <http://www.caiso.com/planning/Pages/TransmissionPlanning/Default.aspx> under the *Accessing transmission data* heading.

3. Public Policy Objectives and the Conceptual Statewide Transmission Plan

With FERC's approval of the ISO's revised TPP in December 2010, two important new elements were incorporated into phase 1 of the TPP. These two new elements – the specification of public policy objectives for transmission planning, and the development of a conceptual statewide plan as an input for consideration in developing the ISO's comprehensive transmission plan – are discussed in this section.

3.1 Public Policy Objectives

The revised TPP created a category of transmission additions and upgrades to enable the ISO to plan for and approve new transmission needed to support state or federal public policy requirements and directives. The impetus for the “policy-driven” category was the recognition that California's renewable energy goal would drive the development of substantial amounts of new renewable supply resources over the next decade, which in turn would drive the majority of new transmission needed in the same time frame. It was also recognized that new transmission needed to support the state's renewable energy goal would most likely not meet the criteria for the two predominant transmission categories of reliability and economic projects.

Evaluating the need for policy-driven transmission elements begins in Phase 1 with the ISO's specification, in the context of the unified planning assumptions and study plan, of the public policy objectives it proposes to adopt for transmission planning purposes in the current cycle. For the 2015-2016 planning cycle, the overarching public policy objective is the state's mandate for 33% renewable energy by 2020. For purposes of the TPP study process, this high-level objective is comprised of two sub-objectives: first, to support the delivery of 33% renewable energy over the course of all hours of the year, and second, to support Resource Adequacy (RA) deliverability status for the renewable resources outside the ISO balancing authority area that are needed to achieve the 33% energy goal. Either of these sub-objectives could lead to the identification and approval of policy-driven transmission elements in the ISO's 2015-2016 transmission plan.

The ISO notes that recent energy storage rulings stemming from AB2514 have been suggested by stakeholders as additional policy input that may drive the need for policy driven transmission. Energy storage as an enabling technology may play a key role in renewables integration. The ISO considers that these needs and the potential transmission implications of energy storage as a flexibility need are not sufficiently developed to be considered at this time, and we note comments from CPUC staff that these resources should be modeled at most efficient locations in this 2015-2016 planning cycle. The ISO will continue to explore this issue, and considers that energy storage requirements could be factored into future portfolio development processes to inform future transmission planning cycles.

3.1.1 Achieving 33% renewable energy on an annual basis

The state's mandate for 33% renewable energy by 2020 refers to the share of total electricity consumed by California consumers over the course of a year that is provided by renewable resources. In the context of the transmission planning studies, the question to be investigated is whether a specified portfolio of renewable supply resources, in conjunction with the conventional resource fleet expected to be operating, will deliver a mix of energy over all 8760 hours of the year that is at least 33% supplied by the renewable portfolio on an annual basis. Through the studies the ISO performs to address this question, the ISO could identify policy-

driven transmission additions or upgrades that are necessary in order to achieve the 33% renewable share of annual consumption by 2020.

3.1.2 Supporting RA deliverability status for needed renewable resources outside the ISO balancing authority area

Deliverability for the purpose of a resource providing RA capacity is a distinct requirement and is integral to achieving the 33% RPS policy goal. Resources that are connected directly to the ISO grid can establish deliverability through the ISO's annual process to determine Net Qualifying Capacity (NQC) for each resource for the upcoming RA compliance year (i.e., calendar year). A new resource seeking to interconnect to the ISO grid can elect Full Capacity deliverability status in its interconnection request, and this election triggers a study process to identify any network upgrades needed for deliverability and ultimately leads to the construction of the needed network upgrades by the relevant PTO whose system needs to be upgraded.

For resources outside the ISO, however, there is no way under the current rules for the resource to obtain RA deliverability status. Rather, in conjunction with the annual NQC process the ISO assesses the Maximum Import Capability (MIC) at each intertie, and then conducts a multi-step process whereby load-serving entities inside the ISO can utilize shares of the MIC to procure external capacity to meet their RA requirements. Moreover, the determination of the intertie MIC values is based not on an assessment of maximum physical import capability in each area, but only on historic energy schedules under high-load system conditions. This approach has resulted in extremely small values for certain interties. As a result, areas outside the ISO that are rich in renewable energy potential and have been included in the ISO's 33% supply portfolios, have raised concerns that they will be unable to develop their projects if they are unable to offer RA capacity to their potential LSE buyers. The ISO therefore also includes, in each TPP cycle, the policy objective of expanding RA import capability in those areas outside the ISO BAA where (a) renewable resources are needed in the 33% RPS base case portfolio³ to meet the state's 33% RPS target, and (b) the RA import capability is not sufficient to enable these resources to provide RA capacity.

The fundamental concept behind RA is that the ISO should be able to utilize all the designated RA capacity simultaneously to provide energy and reserve capacity when needed to meet peak system demand. Pursuant to this concept, the assessment of deliverability focuses on the simultaneous operation of available internal RA capacity and import of external RA energy by designated RA capacity during system peak hours. Depending on the generation amounts and locations in the 33% supply portfolios, the RA deliverability assessment could result in the ISO identifying policy-driven transmission elements to support MIC needed for that renewable generation.

3.2 Conceptual Statewide Transmission Plan

Per the ISO tariff section 24.2, during Phase 1 the ISO will initiate the development of a conceptual statewide transmission plan. The plan will typically be completed during Phase 2 of the TPP, at which time it will become an input to the study process whereby the ISO evaluates the need for policy-driven transmission elements. The ISO incorporated an annual conceptual

³ Further discussion of the development of 33% RPS supply portfolios is provided in section 3.3 of this paper

statewide transmission plan into its revised TPP proposal in conjunction with the provision for public policy-driven transmission, based on the recognition that public policies such as the 33% RPS, which could necessitate the development of new transmission infrastructure, might not apply to the ISO Controlled Grid alone, but could apply to the entire state (or possibly an even broader geographic region). For this reason, although the ISO's responsibility is to plan and approve transmission projects for the ISO Controlled Grid, a statewide perspective, in collaboration with other California transmission providers if possible, on how to develop needed new transmission to most efficiently meet the statewide 33% RPS mandate would clearly be a valuable input into the ISO's TPP. At the same time, although such a plan would be useful in providing a broad geographic view of needed transmission development, the plan would be "conceptual" in the sense that it would be for informational purposes only and not binding on any of the California transmission providers as to which projects to approve.

During the 2015-2016 TPP cycle the ISO will seek to continue to work with the California Transmission Planning Group (CTPG) to coordinate with CTPG members as to their plans within their respective areas. While the CTPG has put further analytical studies on hold as the various regions establish their new roles and procedures to comply with FERC Order 1000 regional and interregional obligations, the ISO anticipates that CTPG will continue to play a role in the coordination and sharing of planning activities being conducted by CTPG members inside California.

4. Reliability Assessments

The ISO will analyze the need for transmission upgrades and additions in accordance with NERC Standards and WECC/ISO reliability criteria. Reliability assessments are conducted annually to ensure that performance of the system under the ISO controlled grid will meet or exceed the applicable reliability standards. The term “Reliability Assessments” encompasses several technical studies such as power flow, transient stability, and voltage stability studies. The basic assumptions that will be used in the reliability assessments are described in sections 4.1.1-4.1.16. Generally, these include the scenarios being studied, assumptions on the modeling of major components in power systems (such as demand, generation, transmission network topology, and imports), contingencies to be evaluated, reliability standards to be used to measure system performance, and software or analytical tools.

4.1 Study Areas

The reliability assessments will be performed on the bulk system (north and south) as well as the local areas under the ISO controlled grid. Figure 4-1 shows the approximate geographical locations of these study areas. The full-loop power flow base cases that model the entire WECC interconnection will be used in all cases. These 16 study areas are shown below.

- Northern California (bulk) system – 500 kV facilities and selected 230 kV facilities in the PG&E system
- PG&E Local Areas:
 - Humboldt area;
 - North Coast and North Bay areas;
 - North Valley area;
 - Central Valley area;
 - Greater Bay area;
 - Greater Fresno area;
 - Kern Area; and
 - Central Coast and Los Padres areas.
- Southern California (bulk) system – 500 kV facilities in the SCE and SDG&E areas and the 230 kV facilities that interconnect the two areas.
- SCE local areas:
 - Tehachapi and Big Creek Corridor;
 - North of Lugo area;
 - East of Lugo area;
 - Eastern area; and
 - Metro area.
- San Diego Gas Electric (SDG&E) area
- Valley Electric Association (VEA) area

Figure 4-1: Approximated geographical locations of the study areas



4.2 Frequency of the study

The reliability assessments are performed annually as part of the ISO's TPP.

4.3 Reliability Standards and Criteria

The 2015-2016 transmission plan will span a 10-year planning horizon and will be conducted to ensure the ISO-controlled grid is in compliance with the North American Electric Reliability Corporation (NERC) standards, WECC regional criteria, and ISO planning standards across the 2016-2025 planning horizon.

4.3.2 NERC Reliability Standards

System Performance Reliability Standards (TPL-001-4)

The ISO will analyze the need for transmission upgrades and additions in accordance with NERC reliability standards, which set forth criteria for system performance requirements that must be met under a varied but specific set of operating conditions. The following NERC reliability standards are applicable to the ISO as a registered NERC planning authority and are the primary driver of the need for reliability upgrades:⁴

- TPL-001-4: Transmission System Planning Performance Requirements⁵; and
- NUC-001-2.1 Nuclear Plant Interface Coordination.⁴

4.3.3 WECC Regional Business Practice

The WECC System Performance TPL-001-WECC-CRT-2.1⁶ Regional Criteria are applicable to the ISO as a planning authority and set forth additional requirements that must be met under a varied but specific set of operating conditions.⁷

4.3.4 California ISO Planning Standards

The California ISO Planning Standards specify the grid planning criteria to be used in the planning of ISO transmission facilities.⁸ These standards cover the following:

- address specifics not covered in the NERC reliability standards and WECC regional criteria;
- provide interpretations of the NERC reliability standards and WECC regional criteria specific to the ISO-controlled grid; and
- identify whether specific criteria should be adopted that are more stringent than the NERC standards or WECC regional criteria.

4.4 Study Horizon

The studies that comply with TPL-001-4 will be conducted for both the near-term (2016-2020) and longer-term (2021-2025) per the requirements of the reliability standards.

4.5 Study Years

Within the identified near⁹ and longer¹⁰ term study horizons the ISO will be conducting detailed analysis on years 2017, 2020 and 2025. If in the analysis it is determined that additional years

⁴ <http://www.nerc.com/page.php?cid=2%7C20>

⁵ Analysis of Extreme Events or NUC-001 are not included within the Transmission Plan unless these requirements drive the need for mitigation plans to be developed.

⁶ <https://www.wecc.biz/Reliability/TPL-001-WECC-CRT-2.1.pdf>

⁷ <http://compliance.wecc.biz/application/ContentPageView.aspx?ContentId=71>

⁸ http://www.caiso.com/Documents/FinalISOPlanningStandards-April12015_v2.pdf

⁹ System peak load for either year one or year two, and for year five as well as system off-peak load for one of the five years.

¹⁰ System peak load conditions for one of the years and the rationale for why that year was selected.

are required to be assessed the ISO will consider conducting studies on these years or utilize past studies¹¹ in the areas as appropriate.

4.6 Study Scenarios

The main study scenarios cover critical system conditions driven by several factors such as:

Generation:

Existing and future generation resources are modeled and dispatched to reliably operate the system under stressed system conditions. More details regarding generation modeling is provided in section 4.9.

Demand Level:

Since most of the ISO footprint is a summer peaking area, summer peak conditions will be evaluated in all study areas. However, winter peak, spring off-peak, summer off-peak or summer partial-peak will also be studied for areas in where such scenarios may result in more stress on system conditions. Examples of these areas are the coastal sub-transmission systems in the PG&E service area (e.g. Humboldt, North Coast/North Bay, San Francisco, Peninsula and Central Coast), which will be studied for both the summer and winter peak conditions. Table 4-1 lists the scenarios that will be conducted in this planning cycle.

Path flows:

For local area studies, transfers on import and monitored internal paths will be modeled as required to serve load in conjunction with internal generation resources. For bulk system studies, major import and internal transfer paths will be stressed as described in Section 4.14 to assess their FAC-013-2 Transfer Capability or FAC-014-2 System Operating Limits (SOL) for the planning horizon, as applicable.

¹¹ Past studies may be used to support the Planning Assessment if they meet the following requirements:

1. For steady state, short circuit, or stability analysis: the study shall be five calendar years old or less, unless a technical rationale can be provided to demonstrate that the results of an older study are still valid. 2. For steady state, short circuit, or stability analysis: no material changes have occurred to the System represented in the study. Documentation to support the technical rationale for determining material changes shall be included.

Table 4-1: Summary of Study Base Scenarios in the ISO Reliability Assessment

Study Area	Near-term Planning Horizon		Long-term Planning Horizon
	2017	2020	2025
Northern California (PG&E) Bulk System	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak Summer Partial Peak Spring Off-Peak
Humboldt	Summer Peak Winter Peak Spring Off-Peak	Summer Peak Winter Peak Spring Light Load	Summer Peak Winter Peak
North Coast and North Bay	Summer Peak Winter peak Spring Off-Peak	Summer Peak Winter Peak Spring Light Load	Summer Peak Winter peak
North Valley	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
Central Valley (Sacramento, Sierra, Stockton)	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
Greater Bay Area	Summer Peak Winter peak - (SF & Peninsula) Spring Off-Peak	Summer Peak Winter peak - (SF & Peninsula) Spring Light Load	Summer Peak Winter peak - (SF Only)
Greater Fresno	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
Kern	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
Central Coast & Los Padres	Summer Peak Winter Peak Spring Off-Peak	Summer Peak Winter Peak Spring Light Load	Summer Peak Winter Peak
Southern California Bulk transmission system	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak Summer Partial Peak
SCE Metro Area	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
SCE Northern Area	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
SCE North of Lugo Area	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
SCE East of Lugo Area	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
SCE Eastern Area	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak

San Diego Gas and Electric (SDG&E) area	Summer Peak Spring Off-Peak	Summer Peak Spring Light Load	Summer Peak
Valley Electric Association	Summer Peak Summer Off-Peak	Summer Peak Summer Light Load	Summer Peak

Note:

- Peak load conditions are the peak load in the area of study.
- Off-peak load conditions are approximately 50-65 per cent of peak loading conditions, such as weekend.
- Light load conditions are the system minimum load condition.
- Partial peak load condition represents a critical system condition in the region based upon loading, dispatch and facilities rating conditions.

Sensitivity study cases:

In addition to the base scenarios that the ISO will be assessing in the reliability analysis for the 2015-2016 transmission planning process, the ISO will also be assessing the sensitivity scenarios identified in Table 4-2. The sensitivity scenarios are to assess impacts of specific assumptions on the reliability of the transmission system. These sensitivity studies include impacts of load forecast, generation dispatch, generation retirement and transfers on major paths.

Table 4-2: Summary of Study Sensitivity Scenarios in the ISO Reliability Assessment

Sensitivity Study	Near-term Planning Horizon		Long-Term Planning Horizon
	2017	2020	2025
Summer Peak with high CEC forecasted load	-	-	PG&E Local Areas SCE Metro SCE Northern SDG&E Area
Summer Peak with heavy renewable output	-	PG&E Bulk PG&E Local Areas SCE Bulk SCE Northern SCE North of Lugo SCE East of Lugo SCE Eastern SDG&E Area	-
Summer Off-peak with heavy renewable output (generation addition)	-	VEA Area	-
Summer Peak with OTC plants replaced	-	SCE Metro Area	-
Summer Peak with low hydro output	-	SCE Northern Area	-
Retirement of QF Generations	-	-	PG&E Local Areas

4.7 Contingencies:

In addition to the system under normal conditions (P0), the following contingencies will be evaluated as part of the study. These contingencies lists will be made available on the ISO secured website.

Single contingency (Category P1)

The assessment will consider all possible Category P1 contingencies based upon the following:

- Loss of one generator (P1.1)¹²
- Loss of one transmission circuit (P1.2)
- Loss of one transformer (P1.3)
- Loss of one shunt device (P1.4)
- Loss of a single pole of DC lines (P1.5)
- Loss of both poles of the Pacific DC Intertie (WECC exemption)

Single contingency (Category P2)

The assessment will consider all possible Category P2 contingencies based upon the following:

- Loss of one transmission circuit without a fault (P2.1)
- Loss of one bus section (P2.2)
- Loss of one breaker (internal fault) (non-bus-tie-breaker) (P2.3)
- Loss of one breaker (internal fault) (bus-tie-breaker) (P2.4)

Multiple contingency (Category P3)

The assessment will consider the Category P3 contingencies with the loss of a generator unit followed by system adjustments and the loss of the following:

- Loss of one generator (P3.1)¹³
- Loss of one transmission circuit (P3.2)
- Loss of one transformer (P3.3)
- Loss of one shunt device (P3.4)
- Loss of a single pole of DC lines (P3.5)
- Loss of both poles of the Pacific DC Intertie (WECC exemption)

Multiple contingency (Category P4)

The assessment will consider the Category P4 contingencies with the loss of multiple elements caused by a stuck breaker (non-bus-tie-breaker for P4.1-P4.5) attempting to clear a fault on one of the following:

- Loss of one generator (P4.1)

¹² Includes per California ISO Planning Standards – Loss of Combined Cycle Power Plant Module as a Single Generator Outage Standard.

¹³ Includes per California ISO Planning Standards – Loss of Combined Cycle Power Plant Module as a Single Generator Outage Standard.

- Loss of one transmission circuit (P4.2)
- Loss of one transformer (P4.3)
- Loss of one shunt device (P4.4)
- Loss of one bus section (P4.5)
- Loss of a bus-tie-breaker (P4.6)

Multiple contingency (Category P5)

The assessment will consider the Category P5 contingencies with delayed fault clearing due to the failure of a non-redundant relay protecting the faulted element to operate as designed, for one of the following:

- Loss of one generator (P5.1)
- Loss of one transmission circuit (P5.2)
- Loss of one transformer (P5.3)
- Loss of one shunt device (P5.4)
- Loss of one bus section (P5.5)

Multiple contingency (Category P6)

The assessment will consider the Category P6 contingencies with the loss of two or more (non-generator unit) elements with system adjustment between them, which produce the more severe system results.

Multiple contingency (Category P7)

The assessment will consider the Category P7 contingencies for the loss of a common structure as follows:

- Any two adjacent circuits on common structure¹⁴ (P7.1)
- Loss of a bipolar DC lines (P7.2)

Extreme contingencies (TPL-001-4)

As a part of the planning assessment the ISO assesses Extreme Event contingencies per the requirements of TPL-001-4; however the analysis of Extreme Events will not be included within the Transmission Plan unless these requirements drive the need for mitigation plans to be developed.

¹⁴ Excludes circuits that share a common structure or common right-of-way for 1 mile or less.

4.8 Study Base Cases

The power flow base cases from WECC will be used as the starting point of the ISO transmission plan base cases. Table 4-3 shows WECC base cases will be used to represent the area outside the ISO control area for each study year. For dynamic stability studies, the latest WECC Master Dynamics File (from January 26, 2015) will be used as a starting point. Dynamic load models will be added to this file.

Table 4-3: Summary of WECC Base Cases used to represent system outside ISO

Study Year	Season	WECC Base Case
2017	Summer Peak	2015 HS4
	Winter Peak	2015 HW3
	Summer Off-Peak	2015 LS1
	Spring Off-Peak	2017 LSP1SA
2020	Summer Peak	2020 HS2
	Winter Peak	2020 HW1S
	Summer Light	2015 LS1
	Spring Off-Peak	2017 LSP1SA
	Spring Light	2017 LSP1SA
2025	Summer Peak	2024 HS1S
	Winter Peak	2023-24 HW1
	Summer Off-Peak	2022 LA1-S
	Summer Partial Peak	2024 HS1S

During the course of developing the transmission plan base cases, the portion of areas that will be studied in each WECC base case will be updated by the latest information provided by the PTOs. After the updated topology has been incorporated, the base cases will be adjusted to represent the conditions outlined in the Study Plan. For example, a 2020 summer peak base case for the northern California will use 2020 HS2 base case from WECC as the starting point. However, the network representation in northern California will be updated with the latest information provided by the PTO followed by some adjustments on load level or generation dispatch to ensure the case represents the assumptions described in this document. This practice will result in better accuracy of network representation both inside and outside the study area.

4.9 Generation Projects

In addition to generators that are already in-service, new generators will be modeled in the studies as generally described below. Depending on the status of each project, new generators will be assigned to one of the five levels below:

- Level 1: Under construction
- Level 2: Regulatory approval received
- Level 3: Application under review
- Level 4: Starting application process
- Level 5: Press release only

Based on this classification, the following guidelines will be used to model new generators in the base cases for each study.

Up to 1-year Operating Cases: Only generation that is under construction (Level 1) and has a planned in-service date within the time frame of the study will be modeled in the initial power flow case.

2-5-year Planning Cases: Generation that is under construction (Level 1) and has a planned in-service date within the time frame of the study will be modeled in the initial power flow case.

Conventional generation in pre-construction phase with executed LGIA and progressing forward will be modeled off-line but will be available as a non-wire mitigation option.

Renewable generation with all permitting and necessary transmission approved and expected to be in-service within 5-years may also be modeled in the relevant cases. The CPUC's discounted core and ISO's interconnection agreement status will be utilized as criteria for modeling specific generation. For 2020, generation from the CPUC and CEC provided portfolios described below will be used, as necessary, to ensure generation needed to be in-service to meet the 33% RPS requirement is represented. Given the data availability, generic dynamic data may be used for this future generation.

6-10-year Planning Cases: Only generation that is under construction or has received regulatory approval (Levels 1 and 2) will be modeled in the area of interest of the initial power flow case. If additional generation is required to achieve an acceptable initial power flow case, then generation from Levels 3, 4, and 5 may be used. However, Level 3, 4, and 5 generation should only be used when they are outside the area of study, so that the generation's impact on the facility addition requirements will be minimized.

The CPUC and CEC will provide the ISO with the RPS portfolios to be used in the 2015-2016 transmission planning process in February, 2015. The RPS portfolio submission letter will be posted on the ISO website on the 2015-2016 Transmission Planning Process page. For the reliability assessment the commercial interest portfolio will be used.

Generation included in this year's baseline scenario described in Section 24.4.6.6 of the ISO Tariff will also be included in the 10-year Planning Cases. Given the data availability, generic dynamic data may be used for the future generation.

Thermal generation projects in construction or pre-construction phase: For the latest updates on new generation projects, please refer to CEC website under the licensing section

(http://www.energy.ca.gov/sitingcases/all_projects.html) the ISO relies on other databases to track the statuses of additional generator projects to determine the starting year new projects may be modeled in the base cases. Table A2-1 of Appendix A lists new thermal generation projects in construction or pre-construction phase that will be modeled in the base cases.

Generation Retirements: Existing generators that have been identified as retiring are listed in Table A3-1 of Appendix A. These generators along with their step-up transformer banks will be modeled as out of service starting in the year they are assumed to be retired. Their models are to be removed from base cases only when they have been physically taken apart and removed from the site. Exception: models can be removed prior to physical removal only when approved plans exist to use the site for other reasons.

In addition to the identified generators the following assumptions will be made for the retirement of generation facilities.

- Nuclear Retirements – As indicated above Diablo Canyon will be modeled on-line and is assumed to have obtained renewal of licenses to continue operation,
- Once Through Cooled Retirements – As identified below.
- Renewable and Hydro Retirements – Assumes these resource types stay online unless there is an announced retirement date.
- Other Retirements – Unless otherwise noted, assumes retirement based resource age of 40 years or more.

OTC Generation: Modeling of the once-through cooled (OTC) generating units follows the compliance schedule from the SWRCB's Policy on OTC plants with the following exception:

- Base-load Diablo Canyon Power Plant (DCPP) nuclear generation units are modeled on-line;
- Generating units that are repowered, replaced or having firm plans to connect to acceptable cooling technology, as illustrated in Table 4-4;
- All other OTC generating units will be modeled off-line beyond their compliance dates;

OTC replacement local capacity amounts in southern California that were authorized by the CPUC under the LTPP Tracks 1 and 4 will be considered along with the procurement activities to date from the utilities. Table 4-5 provides the local capacity resource additions and the study year in which the amounts will be first modeled based on the CPUC LTPP Tracks 1 and 4 authorizations. Table 4-6 provides details of the study assumptions using the utilities' procurement activities to date, as well as the ISO's assumptions for potential preferred resources for San Diego area.

Table 4-4: Once-through cooled generation in the California ISO BAA

Area	Generating Facility (Total Plant MW)	Owner	Unit	State Water Resources Control Board (SWRCB) Compliance Date	Net Qualifying Capacity (NQC) (MW)	Final Capacity, if Already Repowered or Under Construction (MW)
Humboldt LCR Area	Humboldt Bay (135 MW)	PG&E	1	12/31/2010	52	Retired 135 MW (Mobile 2&3 non-OTC) and repowered with 10 CTs (163 MW) - (July 2010)
			2	12/31/2010	53	
Greater Bay Area LCR	Contra Costa (674 MW)	GenOn	6	12/31/2017	337	Replaced by Marsh Landing power plant (760 MW) – (May 2013)
			7	12/31/2017	337	
	Pittsburg (1,311 MW) Unit 7 is non-OTC	GenOn	5	12/31/2017	312	GenOn proposed to utilize cooling tower of Unit 7 for Units 5&6 if it can obtain long-term Power Purchase & Tolling Agreement (PPTA) with the CPUC and the utilities.
			6	12/31/2017	317	
Potrero (362 MW)	GenOn	3	10/1/2011	206	Retired 362 MW (Units 4, 5 & 6 non-OTC)	
Central Coast (non-LCR area) *Non-LCR area has no local capacity requirements	Moss Landing (2,530 MW)	Dynergy	1	12/31/2017*	510	These two OTC combined cycle plants were placed in service in 2002
			2	12/31/2017*	510	
			6	12/31/2017*	754	
			7	12/31/2017*	756	
	Morro Bay (650 MW)	Dynergy	3	12/31/2015	325	Retired 650 MW (February 5, 2014)
			4	12/31/2015	325	
Diablo Canyon (2,240 MW)	PG&E	1	12/31/2024	1122	Alternatives of cooling system were evaluated by the consultants to the utility and the State Water Resources Control Board (SWRCB). Review process on the Special Studies Final Report is on-going at the SWRCB.	
		2	12/31/2024	1118		
Big Creek-Ventura LCR Area	Mandalay (560 MW)	GenOn	1	12/31/2020	215	Unit 3 is non-OTC
			2	12/31/2020	215	
	Ormond Beach (1,516 MW)	GenOn	1	12/31/2020	741	
			2	12/31/2020	775	
Los Angeles (LA) Basin LCR Area	El Segundo (670 MW)	NRG	3	12/31/2015	335	Replaced by El Segundo Power Redevelopment (560 MW) – (August 2013)
			4	12/31/2015	335	
	Alamitos (2,011 MW)	AES	1	12/31/2020	175	AES proposes to repower with non-OTC generating facilities. This plan is dependent on whether AES can obtain Power Purchase and Tolling Agreement (PPTA) from the CPUC and the utilities.
			2	12/31/2020	175	
			3	12/31/2020	332	
			4	12/31/2020	336	
			5	12/31/2020	498	
			6	12/31/2020	495	

Area	Generating Facility (Total Plant MW)	Owner	Unit	State Water Resources Control Board (SWRCB) Compliance Date	Net Qualifying Capacity (NQC) (MW)	Final Capacity, if Already Repowered or Under Construction (MW)
	Huntington Beach (452 MW)	AES	1	12/31/2020	226	Retired 452 MW and converted to synchronous condensers (2013). Modeled as off-line in the post 2017 studies as contract expires.
			2	12/31/2020	226	
			3	12/31/2020	227	
			4	12/31/2020	227	
	Redondo Beach (1,343 MW)	AES	5	12/31/2020	179	
			6	12/31/2020	175	
			7	12/31/2020	493	
			8	12/31/2020	496	
	San Onofre (2,246 MW)	SCE/SDG&E	2	12/31/2022	1122	Retired 2246 MW (June 2013)
			3	12/31/2022	1124	
San Diego/I.V. LCR Area	Encina (946 MW)	NRG	1	12/31/2017	106	NRG proposes repowering with a new 558 MW project (Carlsbad Energy Center) – this plan is dependent on whether NRG can obtain PPTA from the CPUC and the utilities.
			2	12/31/2017	103	
			3	12/31/2017	109	
			4	12/31/2017	299	
			5	12/31/2017	329	
	South Bay (707 MW)	Dynegy	1-4	12/31/2011	692	Retired 707 MW (CT non-OTC) – (2010-2011)

Notes:

* A 12/31/2020 compliance date will be a proposed Amendment to the OTC Policy to be considered for adoption by the State Water Resources Control Board at the April 7, 1015 Board Meeting.

Table 4-5: Summary of 2012 LTPP Track 1 & 4 Authorized Procurement

LCR Area	LTPP Track-1		LTPP Track-4 ¹⁵	
	Amount (MW) ⁽¹⁾	Study year in which addition is to be first modeled	Amount (MW) ⁽¹⁾	Study year in which addition is to be first modeled
Greater Bay Area	0	N/A	0	N/A
Moorpark Sub-area	290	2021	0	N/A
West LA Basin / LA Basin	1400-1800	2021	500-700	2021
San Diego	308	2018	500-800	2018

(1) Amounts shown are total including gas-fired generation, preferred resources and energy storage

Table 4-6: Summary of 2012 LTPP Track 1 & 4 Procurement Activities to date

	LTPP EE (MW)	Behind the Meter Solar PV (NQC MW)	Storage 4-hr (MW)	Demand Response (MW)	Conventional resources (MW)	Total Capacity (MW)
SCE-submitted procurement selection	130	44	261	75	1,382	1,892
SDG&E's procurement	0	82*	25	0	600**	707

Notes:

* The ISO is making an assumption of solar distributed generation to meet preferred resources procurement in San Diego at this time. Upon further detailed information is available from SDG&E regarding its firm plan for preferred resources, the ISO will update this assumption accordingly.

** Pio Pico (300 MW) from LTPP Track 1 already received Power Purchase Agreement from the CPUC and is treated as existing generation for long-term reliability studies. The 600 MW conventional resources assume Carlsbad Energy Center project, which was filed by SDG&E at the CPUC in seeking for approval of Power Purchase Agreement.

¹⁵ CPUC Decision for LTPP Track 4
<http://docs.cpuc.ca.gov/PublishedDocs/Published/G000/M089/K008/89008104.PDF>

As proxy, generic resources, at the existing sites, will be used for modeling purposes up to the total conventional capacity authorized in LTTP Track-1 and Track-4 decisions until such time as new resource models, with CEC license, signed GIA and in good standing, become available. For further details on new resources see Table A2-1 "Planned generation". The portion of authorized local capacity derived from energy limited preferred resources such as demand response and battery storage will be modeled offline in the initial base cases and will be used as mitigation once reliability concerns are identified.

Renewable generation dispatch: The ISO has done a qualitative and quantitative assessment of hourly Grid View renewable output for stressed conditions during hours and seasons of interest. Available data of pertinent hours was catalogued by renewable technology and location on the grid. The results differ somewhat between locations and seasons as follows:

Table 4-7: Summary of renewable output in PG&E

All years	Biomass/Biogas /Geothermal	Solar PV, ST	Wind	Stressed case
Sum Min Load	NQC~P Max	0	3xNQC~Pmax	High Output
Sum Off-Peak	NQC~P Max	NQC~Pmax	3xNQC~Pmax	High Output
Sum Partial-Peak	NQC~P Max	0	0	Low Output
Sum Peak	NQC~P Max	25%xNQC~ 25%xPmax	NQC~33%xPmax	Low Output
Winter Peak	NQC~P Max	0	50%xNQC~ 16.6%xPmax	Low Output

Table 4-8: Summary of renewable output in SCE

	Biomass/Biogas /Geothermal	Solar PV, ST	Wind	Stressed case
Sum Min Load	NQC~P Max	0	2.8xNQC~ 93%xPmax	High Output
Sum Off-Peak	NQC~P Max	93%xNQC~ 93%xPmax	2.8xNQC~ 93%xPmax	High Output
Sum Partial-Peak	NQC~P Max	TBD	TBD	Low output
Sum Peak	NQC~P Max	36%xNQC~ 36%xPmax	0	Low Output

Table 4-9: Summary of renewable output in SDG&E

All years	Biomass/Biogas /Geothermal	Solar PV, ST	Wind	Stressed case
Sum Min Load	NQC~P Max	0	3xNQC~Pmax	High Output
Sum Off-Peak	NQC~P Max	81%xNQC~ 81%xPmax	2.9xNQC~ 96%xPmax	High Output
Sum Peak	NQC~P Max	55%xNQC~ 55%xPmax	NQC~ 33%xPmax	Low Output

Table 4-10: Summary of renewable output in VEA

All years	Biomass/Biogas /Geothermal	Solar PV, ST	Wind	Stressed case
Sum Min Load	NQC~P Max	0	N/A	High Output
Sum Off-Peak	NQC~P Max	97% \times NQC~P 97% \times Pmax	N/A	High Output
Sum Peak	NQC~P Max	47% \times NQC~P 47% \times Pmax	N/A	Low Output

Summer Peak = Peak time for the area of study – example PG&E hours 17:00 and 18:00

Summer Partial-Peak = Partial-Peak time the area of study – ex: PG&E hours 20:00 and 21:00

Summer Off-Peak = Load at 50-65% - summer weekend morning time.

Summer Min Load = Load at minimum – example PG&E hours 2:00 through 4:00 am

Winter Peak = Peak time for the area of study – example PG&E hours 17:00 and 18:00

4.10 Transmission Projects

The transmission projects that the ISO has approved will be modeled in the study. This includes existing transmission projects that have been in service and future transmission projects that have received ISO approval in the 2014-2015 or earlier ISO transmission plans. Currently, the ISO anticipates the 2014-2015 transmission plan will be presented to the ISO board of governors for approval in March 2015.

4.11 Demand Forecast

The assessment will utilize the California Energy Demand Updated Final Forecast 2015-2025 adopted by California Energy Commission (CEC) on January 14, 2015 (posted February 9, 2015) using the Mid Case LSE and Balancing Authority Forecast spreadsheet of January 20, 2015.

During 2013, the CEC, CPUC and CAISO engaged in collaborative discussion on how to consistently account for reduced energy demand from energy efficiency in the planning and procurement processes. To that end, the 2013 IEPR final report, published on January 23, 2013, based on the IEPR record and in consultation with the CPUC and the CAISO, recommends using the Mid Additional Achievable Energy Efficiency (AAEE) scenario for system-wide and flexibility studies for the CPUC LTPP and CAISO TPP cycles. Because of the local nature of reliability needs and the difficulty of forecasting load and AAEE at specific locations and estimating their daily load-shape impacts, using the Low-Mid AAEE scenario for local studies is more prudent at this time.

The CEC forecast information is available on the CEC website at:

http://www.energy.ca.gov/2014_energypolicy/documents/index.html#adoptedforecast

In general, the following are guidelines on how load forecasts are used for each study area.

- The 1-in-10 load forecasts will be used in PG&E, SCE, SDG&E, and VEA local area studies including the studies for the LA Basin/San Diego local capacity area.
- The 1-in-5 load forecast will be used for system studies

Since load forecasts from the CEC are generally provided for a larger area, these load forecasts may not contain bus-level load forecasts which are necessary for reliability assessment. Consequently, the augmented local area load forecasts developed by the participating transmission owners (PTOs) will also be used where the forecast from the CEC does not provide detailed load forecasts. Descriptions of the methodologies used by each of the PTOs to derive bus-level load forecasts using CEC data as a starting point are described below.

4.11.2 Pacific Gas and Electric Service Area

The method used to develop the PG&E base case loads is an integrative process that extracts, adjusts and modifies the information from the transmission and distribution systems and municipal utility forecasts. The melding process consists of two parts. Part 1 deals with the PG&E load. Part 2 deals with the municipal utility loads.

PG&E Loads in Base Case

The method used to determine the PG&E loads is similar to the one used in the previous year's studies. The method consists of determining the division loads for the required 1-in-5 system or 1-in-10 area base cases as well as the allocation of the division load to the transmission buses.

Determination of Division Loads

The annual division load is determined by summing the previous year division load and the current division load growth. The initial year for the base case development method is based heavily on the most recent recorded data. The division load growth in the system base case is determined in two steps. First, the total PG&E load growth for the year is determined. Then this total PG&E load growth is allocated to the division, based on the relative magnitude of the load growths projected for the divisions by PG&E's distribution planners. For the 1-in-10 area base case, the division load growth determined for the system base case is adjusted to the 1-in-10 temperature using the load temperature relation determined from the most recent load and temperature data of the division.

Allocation of Division Load to Transmission Bus Level

Since the base case loads are modeled at the various transmission buses, the division loads developed need to be allocated to those buses. The allocation process is different depending on the load types. PG&E classifies its loads into four types: conforming, non-conforming, self-generation and generation-plant loads. The conforming, non-conforming and self-generation loads are included in the division load. Because of their variability, the generation-plant loads are not included in the division load. Since the non-conforming and self-generation loads are assumed to not vary with temperature, their magnitude would be the same in the 1-in-2 system, 1-in-5 system or the 1-in-10 area base cases of the same year. The remaining load (the total division load developed above, less the quantity of non-conforming and self-generation load) is the conforming load, which is then allocated to the transmission buses based on the relative magnitude of the distribution level forecast.

Muni Loads in Base Case


Municipalities provide PG&E their load forecast information. If no information is provided, PG&E supplements such forecast. For example, if a municipal utility provided only the 1-in-5 loads, PG&E would determine the 1-in-2 and 1-in-10 loads by adjusting the 1-in-5 loads for temperature in the same way that PG&E would for its load in that area.

For the 1-in-5 system base cases, the 1-in-5 loads are used. For the 1-in-10 area base cases, the 1-in-10 loads are used if the municipal loads are in the area of the area base case, otherwise, the 1-in-2 loads would be used.

4.11.3 Southern California Edison Service Area

The following figure identifies the steps in developing SCE’s A-Bank load model.

Figure 4-2: SCE A-Bank load model

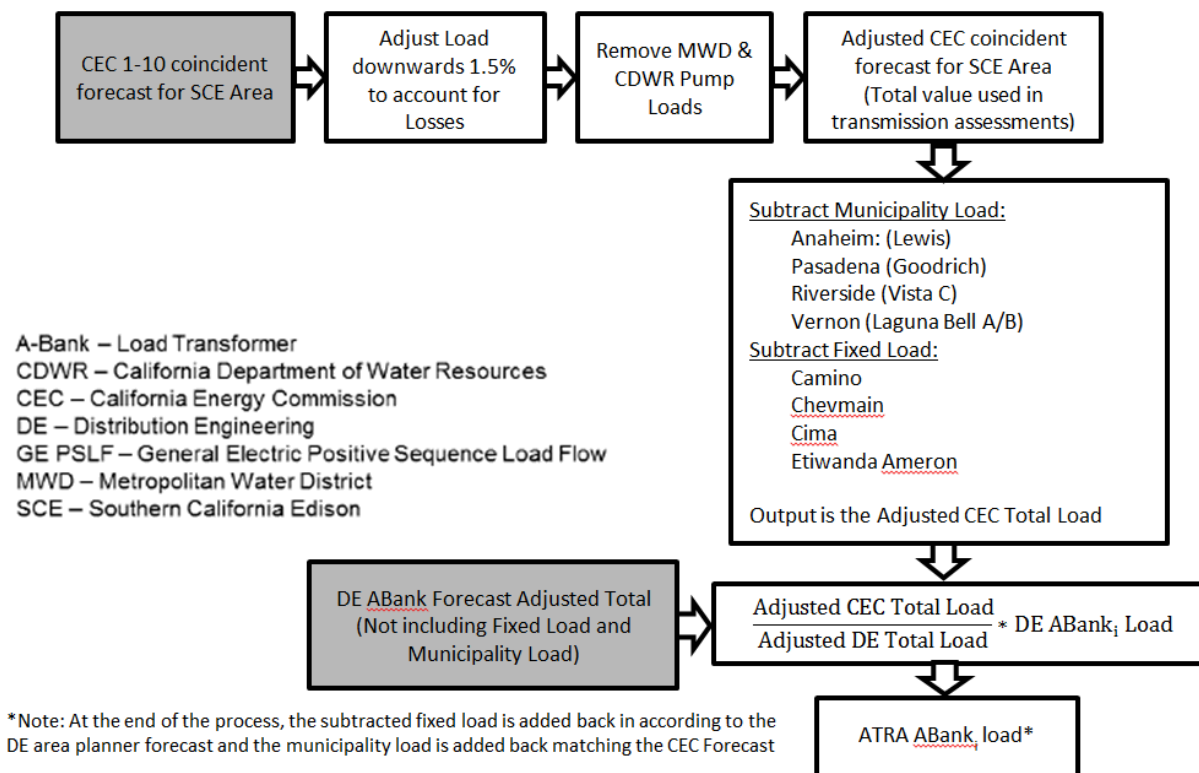

4.11.4 San Diego Gas and Electric Service Area

The substation load forecast reflects the actual, measured, maximum coincident load on the substation distribution transformers. This max load is obtained either from SCADA historical data or in a few cases from mechanical charts. That measured max load is then weather normalized to produce the adverse substation load. The adverse substation loads are then adjusted across SDG&E so that area loads plus losses sum to the CEC 90/10 forecast. Thus, two substation loads for each distribution bus are modeled: the adverse load, and the coincident load. The difference between the adverse and coincident loads includes about 3% of transmission losses - while simulating a single substation or zone peak, transmission losses are neglected because the system is not adjusted to reflect a system-wide coincident peak.

The distribution substation annual load forecast uses the actual peak load on the low side of each substation bank transformer or transformers if running in parallel. Once the peaks are determined, weather factors, i.e. normalizing and ‘adversing’ factors are applied to the peaks.

The Normalizing Factor is used to take the Total MVA for the summer and adjust it to a normal year (50/50) value.

- 50/50 value – the value you would expect 5 years out of 10.
- If the weather condition on the summer peak date was abnormally hot, the normalizing factor would be <1.0 .
- If the weather condition on the summer peak date was abnormally cool, the normalizing factor would be ≥ 1.0
- Normalized Peak = Total Peak MVA * Normalizing Factor

The Adverse Factor takes the normalized peak value and ‘adverses’ it up to what the load would be if the peak occurred in an adverse year.

- The adverse peak is the adjusted peak that would be expected 1 out of 10 years.
- Adverse Peak = Normalized Peak * Adverse Factor

The distribution substation annual forecast submitted to transmission planning is an Adverse Peak forecast. The distribution substation forecast will always be higher than the system forecast which is a coincident forecast that is ‘adversed’. The distribution circuits are de-coupled from the substation banks and buses, and are therefore not used to complete the substation forecast.

4.11.5 Valley Electric Association Service Area

The VEA substation load forecast is obtained from historical SCADA data and VEA long range study and load plans. The historical SCADA data reflects the actual, measured load on the substation distribution transformers. Both sets of data are compared against the CEC forecast and adjusted as needed.

4.12 Reactive Resources

The study models the existing and new reactive power resources in the base cases to ensure that realistic reactive support capability will be included in the study. These include generators, capacitors, static var compensators (SVCs) and other devices. In addition, Table A4-1 of Appendix A provides a list of key existing reactive power resources that will be modeled in the studies. For the complete list of these resources, please refer to the base cases which are available through the ISO secured website.

4.13 Operating Procedures

Operating procedures, for both normal (pre-contingency) and emergency (post-contingency) conditions, are modeled in the studies.

Please refer to <http://www.caiso.com/thegrid/operations/opsdoc/index.html> for the list of publicly available Operating Procedures.

4.14 Major Path Flows and Interchange

Power flow on the major internal paths and paths that cross Balancing Authority boundaries represents the transfers that will be modeled in the study. Firm Transmission Service and Interchange represents only a small fraction of these path flows, and is clearly included. In general, the northern California (PG&E) system has 4 major interties with the outside system and southern California. Table 4-11 lists the capability and power flows that will be modeled in each scenario on these paths in the northern area assessment¹⁶.

Table 4-11: Major Path flows in northern area (PG&E system) assessment¹⁷

Path	Transfer Capability/SOL (MW)	Scenario in which Path will be stressed
Path 26 (N-S)	4000	Summer Peak
PDCI (N-S)	3100	
Path 66 (N-S)	4800 ¹⁸	
Path 15 (N-S)	-5400	Summer Off Peak
Path 26 (N-S)	-3000	
Path 66 (N-S)	-3675	Winter Peak

For the summer off-peak cases in the northern California study, Path 15 flow is adjusted to a level close to its rating limit of 5400 MW (S-N). This is typically done by increasing the import on Path 26 (S-N) into the PG&E service territory. The Path 26 is adjusted between 1800 MW south-to-north and 1800 MW north-to-south to maintain the stressed Path 15 as well as to balance the loads and resources in northern California. Some light load cases may model Path 26 flow close to 3000 MW in the south-to-north direction which is its rating limit.

Similarly, Table 4-12 lists major paths in southern California along with their current Transfer Capability (TC) or System Operating Limit (SOL) for the planning horizon and the target flows to be modeled in the southern California assessment.

¹⁶ These path flows will be modeled in all base cases.

¹⁷ The winter coastal base cases in PG&E service area will model Path 26 flow at 2,800 MW (N-S) and Path 66 at 3,800 MW (N-S)

¹⁸ The Path 66 flows will be modeled to the applicable seasonal nomogram for the base case relative to the northern California hydro dispatch.

Table 4-12: Major Path flows in southern area (SCE and SDG&E system) assessment

Path	Transfer Capability/SOL (MW)	Target Flows (MW)	Scenario in which Path will be stressed, if applicable
Path 26 (N-S)	4,000	4,000	Summer Peak
PDCI (N-S)	3,100	3,100	
West of River (WOR)	11,200	5,000 to 11,200	N/A
East of River (EOR)	9,600	4,000 to 9,600	N/A
San Diego Import	2,850	2,400 to 3,500	Summer Peak
SCIT	17,870	15,000 to 17,870	Summer Peak

4.15 Protection System

To help ensure reliable operations, many special protection systems (SPS), safety nets, UVLS and UFLS schemes have been installed in some areas. Typically, these systems trip load and/or generation by strategically tripping circuit breakers under select contingencies or system conditions after detecting overloads, low voltages or low frequency. The major new and existing SPS, safety nets, and UVLS that will be included in the study are listed in section A5 of Appendix A.

4.16 Control Devices

Several control devices will also be modeled in the studies. These control devices are:

- All shunt capacitors in SCE and other areas
- Static Var Compensators and Synchronous Condensers at several locations such as Potrero, Newark, Rector, Devers, and Talega substations
- DC transmission line such as PDCI, IPPDC, and Trans Bay Cable Projects
- Imperial Valley flow controller; the details on which technology to use (i.e., phase shifting transformer or back-to-back DC) will be provided prior to commencement of studies.

4.17 Demand Response Programs and Energy Storage

According to tariff Section 24.3.3(a), the ISO sent a market notice to interested parties seeking suggestions about demand response programs and generation or non-transmission alternatives that should be included as assumptions in the study plan. In response, the ISO received demand response and energy storage information for consideration in planning studies from the following:

- California Public Utilities Commission (CPUC)
- Pacific Gas & Electric (PG&E)

CPUC staff made the following recommendations with regard to demand response (DR) assumptions appropriate for use in the 2015-16 TPP studies.

1. Demand response assumptions used in the TPP should reflect the guidelines described in the CPUC's ruling on standardized planning assumptions and scenarios.
2. The TPP studies should use the allocations of demand response capacity to busbar provided by the IOUs, public versions of which were provided with the response.
3. The TPP studies should count any new demand response capacity specifically contracted by the IOUs, and approved by the CPUC, to fulfill local capacity needs and other demand response procurement mechanisms.
4. The CAISO should continue to participate in the CPUC's Demand Response rulemaking to better inform program development and future policy direction.

PG&E also recommended that the estimated load impacts from demand response programs allocated to the bus bar level using the methodology that was provided to the CPUC, adjusted for line losses, be used in the 2015-2016 TPP. PG&E also identified the following two energy storage facilities for inclusion in the TPP Planning assumptions within their system.

- Vaca-Dixon 2 MW, 2 MWh Battery Energy Storage System
- Yerba Buena 4 MW, 28 MWh Battery Energy Storage System.

4.17.2 Demand Response

In reliability studies, only capacity from DR programs that can be relied upon to mitigate "first contingencies", as described in the 2012 LTPP Track 4 planning assumptions, are counted. DR that can be relied upon to mitigate first contingencies in local reliability studies participates in, and is dispatched from, the CAISO market in sufficiently less time than 30 minutes¹⁹ from when it is called upon.

There is uncertainty as to what amount of DR can be projected to meet this criteria within the TPP planning horizon given that few current programs meet this criteria and the current DR Rulemaking R.13-09-011 expects to restructure DR programs to better meet CAISO operational

¹⁹ The 30 minute requirement is based on meeting NERC Standard TOP-004-02. Meeting this requirement implies that programs may need to respond in 20 minutes, from customer notification to load reduction, in order to allow for other transmission operator activities in dealing with a contingency event.

needs and has already produced one major policy decision towards that goal.²⁰ The rulemaking is expected to issue additional decisions that enable demand response to be more useful for grid needs, but CAISO has several tasks it must complete in order to make integration of DR possible. The 2012 LTPP Track 4 planning assumptions estimated that approximately 200 MW of DR would be available to mitigate first contingencies within the combined LA Basin and San Diego local reliability areas by 2022. The 2014 LTPP planning assumptions, however, estimates that approximately 1,100 MW would be available to mitigate first contingencies within the combined LA Basin and San Diego local reliability areas by 2024. CPUC staff developed this latter estimate by screening DR projections in the Load Impact reports for programs that deliver load reductions in 30 minutes or less from customer notification. The table below identifies for each IOU the programs and capacities that meet this criteria.

Table 4-13: Existing DR Capacity Range in Local Area Reliability Studies

“Fast Response” DR Program MW in 2024	PG&E	SCE	SDG&E
BIP	287	627	1
API	n/a	69	n/a
AC Cycling Residential	82	298	12
AC Cycling Non-Residential	1	76	3

Given the uncertainty as to what amount of DR can be relied upon for mitigating first contingencies, the CAISO’s 2014-2015 TPP Base local area reliability studies examined two scenarios, one consistent with the 2012 LTPP Track 4 DR assumptions and one consistent with the 2014 LTPP DR assumptions. The ISO will examine the same two scenarios in the 2015-2016 TPP.

DR capacity will be allocated to bus-bar using the method defined in D.12-12-010, or specific bus-bar allocations provided by the IOUs. The DR capacity amounts will be modeled offline in the initial reliability study cases and will be used as potential mitigation in those planning areas where reliability concerns are identified.

²⁰ Commission Decision 14-03-026 approved the bifurcation of DR programs into two categories: Supply DR (DR that is integrated into CAISO markets and dispatched when and where needed) and Load-Modifying DR (DR that is not integrated into CAISO markets. This decision determined that bifurcation will occur by 2017.

The following factors will be applied to the DR projections to account for avoided distribution losses.

Table 4-14: Factors to Account for Avoided Distribution Losses

	PG&E	SCE	SDG&E
Distribution loss factors	1.067	1.051	1.071

4.17.3 Energy Storage

CPUC Decision (D.)13-10-040 established a 2020 procurement target of 1,325 MW installed capacity of new energy storage units within the CAISO planning area. Of that amount, 700 MW shall be transmission-connected, 425 MW shall be distribution-connected, and 200 MW shall be customer-side. D.13-10-040 also allocates procurement responsibilities for these amounts to each of the three major IOUs. Energy storage that will be procured by SCE and SDG&E to fill the local capacity amounts authorized under the CPUC 2012 LTPP decision is subsumed within the 2020 procurement target.

As the 2015-2016 TPP studies identify transmission constraints in the local areas, the ISO will identify the effective busses that the storage capacity identified in the table below can be distributed amongst within the local area as potential development sites. The table below describes the assumptions that shall be used for the technical characteristics and accounting of the three classes of storage mandated by D.13-10-040. These storage capacity amounts will not be included in the initial reliability analysis. The storage capacity amounts will be used as potential mitigation in those planning areas where reliability concerns have been identified.

Table 4-15: Storage Operational Attributes

Values are MW in 2024	Transmission-connected	Distribution-connected	Customer-side
Total Installed Capacity	700	425	200
Amount providing capacity/ ancillary services	700	212.5	0
Amount with 2 hours of storage	280	170	100
Amount with 4 hours of storage	280	170	100
Amount with 6 hours of storage	140	85	0

Charging rate: If a unit is discharged and charged at the same power level, assume it takes 1.2 times as long to charge as it does to discharge. Example: 50 MW unit with 2 hours of storage. If the unit is charged at 50 MW, it will take 2.4 hours to charge. If the unit is charged at 25 MW, it will take 4.8 hours to charge.

4.18 Study Tools

The GE PSLF is the main study tool for evaluating system performance under normal conditions and following the outages (contingencies) of transmission system components for steady state, post-transient and transient stability studies. However, other tools such as TARA for contingency processing or DSA tools software may be used in other studies such as voltage stability, small signal stability analyses and transient stability studies. The studies in the local areas focus on the impact from the grid under system normal conditions and following the Categories P1-P7 outages of equipment at the voltage level 60 through 230 kV. In the bulk system assessments, governor power flow will be used to evaluate system performance following the contingencies of equipment at voltage level 230 kV and higher.

4.19 Study Methodology

The section explains the methodology that will be used in the study:

4.19.1 Technical Analysis

Power Flow Contingency Analysis

The ISO will perform power flow contingency analyses based on the ISO Planning Standards²¹ which are based on the NERC reliability standards and WECC regional criteria for all local areas studied in the ISO controlled grid and with select contingencies outside of the ISO controlled grid. The transmission system will be evaluated under normal system conditions NERC Category P0 (TPL 001-4), against normal ratings and normal voltage ranges, as well as emergency conditions NERC Category P1-P7 (TPL 001-4) contingencies against emergency ratings and emergency voltage range as identified in Section 4.1.6.

Depending on the type and technology of a power plant, several G-1 contingencies represent an outage of the whole power plant (multiple units)²². Examples of these outages are combined cycle power plants such as Delta Energy Center and Otay Mesa power plant. Such outages are studied as G-1 contingencies.

Line and transformer bank ratings in the power flow cases will be updated to reflect the rating of the most limiting component. This includes substation circuit breakers, disconnect switches, bus position related conductors, and wave traps.

Power flow studies will be performed in accordance with PRC-023 to determine which of the facilities (transmission lines operated below 200 kV and transformers with low voltage terminals

²¹ California ISO Planning Standards are posted on the ISO website at http://www.caiso.com/Documents/FinalISOPlanningStandards-April12015_v2.pdf

²² Per California ISO Planning standards Loss of Combined Cycle Power Plant Module as a Single Generator Outage Standard

connected below 200 kV) in the Planning Coordinator Area are critical to the reliability of the Bulk Electric System to identify the facilities below 200 kV that must meet PRC-023 to prevent potential cascade tripping that may occur when protective relay settings limit transmission load ability.

Post Transient Analyses

Post Transient analyses will be conducted to determine if the system is in compliance with the WECC Post Transient Voltage Deviation Standard in the bulk system assessments and if there are thermal overloads on the bulk system.

Post Transient Voltage Stability Analyses

Post Transient Voltage stability analyses will be conducted as part of bulk system assessment for the outages for which the power flow analyses indicated significant voltage drops, using two methodologies: Post Transient Voltage Deviation Analyses and Reactive Power Margin analyses.

Post Transient Voltage Deviation Analyses

Contingencies that showed significant voltage deviations in the power flow studies will be selected for further analysis using WECC standards of 5% voltage deviation for “N-1” contingencies and 10% voltage deviation for “N-2” contingencies.

Voltage Stability and Reactive Power Margin Analyses

As per WECC regional criterion, voltage stability is required for the area modeled at a minimum of 105% of the reference load level or path flow for system normal conditions (Category P0) and for single contingencies (Category P1). For other contingencies (Category P2-P7), post-transient voltage stability is required at a minimum of 102.5% of the reference load level or path flow. The approved guide for voltage support and reactive power, by WECC TSS on March 30, 2006, will be utilized for the analyses in the ISO controlled grid. According to the guideline, load will be increased by 5% for Category P1 and 2.5% for other contingencies Category P2-P7 and will be studied to determine if the system has sufficient reactive margin. This study will be conducted in the areas that have voltage and reactive concerns throughout the system.

Transient Stability Analyses

Transient stability analyses will also be conducted as part of bulk area system assessment for critical contingencies to determine if the system is stable and exhibits positive damping of oscillations and if transient stability criteria as in Table 4-16 are met.

Table 4-16: WECC Transient Stability Criteria²³

Performance Level	Disturbance	Transient Voltage Dip Criteria	Minimum Transient Frequency
P1 and P2.1	Generator	Max V Dip – 25% Max Duration of V Dip Exceeding 20% - 20 cycles Not to exceed 30% at non-load buses.	59.6 Hz for 6 cycles or more at a load bus.
	Circuit		
	Transformer		
	Shunt Device		
	Single pole of a DC line		
	PDCI		
P2 ²⁴ -P7	Bus Section Fault	Max V Dip – 30% at any bus. Max Duration of V Dip Exceeding 20% - 40 cycles at load buses	59.0 Hz for 6 cycles or more at a load bus.
	Internal Breaker Fault		
	Multiple contingency events		

²³ Table 4-15 represents CAISO's interpretation of how NERC categories B and C would relate to the contingency categories defined in TPL-001-4. WECC Regional Criterion that addresses TPL_001-4 is currently under development.

²⁴ Performance level for P2.1 is to be the same as P1.

In addition, the reliability assessment included the following study assumptions:

Power Factor Assumption

In the SCE area assessment, an active to reactive power (WATT / VAR) ratio of 25-to-1 (or power factor of 0.999) measured at the high side of the A-Bank (230/115 kV or 230/66 kV) will be assumed for the SCE transmission substation loads. The value of this ratio recorded has ranged between 35 to 1 in 2006 to a leading power factor from 2008 through 2010.

The increase in the WATT/VAR ratio is a result of SCE commitment to its program to optimize reactive power planning and capacitor bank availability during heavy summer peak load periods in its distribution and sub-transmission systems. The objective of the SCE's reactive power program was to ensure a WATT/VAR ratio of 25 to 1.

Recent Historical System WATT / VAR Ratio:

The WATT / VAR ratio recorded for SCE transmission substation loads during the annual peak load for the following years:

- 2006 – 35
- 2007 – 52
- 2008 – leading power factor
- 2009 – leading power factor
- 2010 – leading power factor

In the SDG&E area, power factors at all substations will be modeled using the most recent historical values obtained at peak loads. Bus load power factor for the year 2014 and 2015 will be modeled based on the actual peak load data recorded in the EMS system. For the subsequent study years a power factor of 0.992 will be used.

The technical studies mentioned in this section will be used for identifying mitigation plans for addressing reliability concerns. As per section 24.4.6.2 of the tariff, the ISO, in coordination with each Participating TO with a PTO Service Territory will, as part of the Transmission Planning Process and consistent with the procedures set forth in the Business Practice Manual, identify the need for any transmission additions or upgrades required to ensure System reliability consistent with all Applicable Reliability Criteria and CAISO Planning Standards. In making this determination, the ISO, in coordination with each Participating TO with a PTO Service Territory and other Market Participants, shall consider lower cost alternatives to the construction of transmission additions or upgrades, such as acceleration or expansion of existing projects, Demand-side management, Remedial Action Schemes, appropriate Generation, interruptible Loads, storage facilities or reactive support.

4.19.2 Preferred Resource Methodology

The ISO issued a paper²⁵ on September 4, 2013, in which it presented a methodology to support California's policy emphasis on the use of preferred resources – specifically energy

efficiency, demand response, renewable generating resources and energy storage – by considering how such resources can constitute non-conventional solutions to meet local area needs that otherwise would require new transmission or conventional generation infrastructure. The general application for this methodology is in grid area situations where a non-conventional alternative such as demand response or some mix of preferred resources could be selected as the preferred solution in the ISO's transmission plan as an alternative to the conventional transmission or generation solution.

In previous planning cycles, the ISO applied a variation of this new approach in the LA Basin and San Diego areas to evaluate the effectiveness of preferred resource scenarios developed by SCE as part of the procurement process to fill the authorized local capacity for the LA Basin and Moor Park areas. In addition to these efforts focused on the overall LA Basin and San Diego needs, the ISO also made further progress in integrating preferred resources into its reliability analysis focusing on other areas where reliability issues were identified.

As in the 2014-15 planning cycle, reliability assessments in the current planning cycle will consider a range of existing demand response amounts as potential mitigations to transmission constraints. The reliability studies will also incorporate the incremental uncommitted energy efficiency amounts as projected by the CEC, distributed generation based on the CPUC Commercial-Interest RPS Portfolio and a mix of proxy preferred resources including energy storage based on the CPUC LTPP 2012 local capacity authorization. These incremental preferred resource amounts are in addition to the base amounts of energy efficiency, demand response and “behind the meter” distributed or self-generation that is embedded in the CEC load forecast.

For each planning area, reliability assessments will be initially performed without using preferred resources other than the additional energy efficiency and the base amounts of preferred resources that are embedded in the CEC load forecast to identify reliability concerns in the area. If reliability concerns are identified in the initial assessment, additional rounds of assessments will be performed using potentially available demand response, distributed generation, energy storage to determine whether these resources are a potential solution. If preferred resources are identified as a potential mitigation, a second step - a preferred resource analysis as described in September 4, 2013 ISO paper - may then be performed, if considered necessary given the mix of resources in the particular area, to account for the specific characteristic of each resource including diurnal variation in the case of solar DG and use or energy limitation in the case of demand response and energy storage.

5. Local Capacity Requirement Assessment

5.1 Near-Term Local Capacity Requirement (LCR)

The local capacity studies focus on determining the minimum MW capacity requirement within each of local areas inside the ISO Balancing Authority Area. The Local Capacity Area Technical Study determines capacity requirements used as the basis for procurement of resource adequacy capacity by load-serving entities for the following resource adequacy compliance year and also provides the basis for determining the need for any ISO “backstop” capacity procurement that may be needed once the load-serving entity procurement is submitted and evaluated.

Scenarios: The near-term local capacity studies will be performed for at least 2 years:

- 2016 – Local Capacity Area Technical Study
- 2020 – Mid-Term Local Capacity Requirements

Please note that in order to meet the CPUC deadline for capacity procurement by CPUC-jurisdictional load serving entities, the ISO will complete the LCR studies approximately by May 1, 2015.

Load Forecast: The latest available CEC load forecast, at the time of base case development, will be used as the primary source of future demand modeled in the base cases. The 1-in-10 load forecast for each local area is used.

Transmission Projects: ISO-approved transmission projects will be modeled in the base case. These are the same transmission project assumptions that are used in the reliability assessments and discussed in the previous section.

Imports: The LCR study models historical imports in the base case; the same as those used in the RA Import Allocation process

Methodology: A study methodology documented in the LCR manual will be used in the study. This document is posted on ISO website at:

<http://www.caiso.com/Documents/Local%20capacity%20requirements%20process%20-%20studies%20and%20papers>

Tools: GE PSLF version 18 will be used in the LCR study.

Since LCR is part of the overall ISO Transmission Plan, the Near-Term LCR reports will be posted on the 2015-2016 ISO Transmission Planning Process webpage.

5.2 Long-Term Local Capacity Requirement Assessment

In the 2014-2015 Transmission Plan, the ISO evaluated long-term local capacity requirements (LCR) for all ten LCR areas. Based on the alignment²⁶ of the ISO transmission planning process with the CEC Integrated Energy Policy Report (IEPR) demand forecast and the CPUC Long-Term Procurement Plan (LTPP) proceeding, the long-term LCR assessment is to take place every two years. Therefore, the next official long-term LCR assessment for all ISO LCR areas will be performed in the 2016-2017 transmission planning process. However, due to critical nature of local capacity need for maintaining reliability in Southern California, especially for the LA Basin and San Diego areas, it is prudent to perform the long-term local capacity requirements studies for these two areas in this planning cycle. This also allows the ISO the opportunity to update the studies in the 2014-2015 transmission planning cycle with the new updated demand forecast from the CEC, as well as updating with any potential early decisions regarding Power Purchase Agreements for the procurement selection submitted by the Load Serving Entities to the CPUC.

Scenarios: The local capacity studies will be performed:

- 2025 – Long-Term Local Capacity Requirements (for LA Basin and San Diego local areas only)

Methodology: The study methodology used in the Near-Term LCR Assessment is documented in the LCR manual and will also be used in the study. This document is posted on ISO website at:

<http://www.caiso.com/Documents/Local%20capacity%20requirements%20process%20-%20studies%20and%20papers>

²⁶ http://www.caiso.com/Documents/TPP-LTPP-IEPR_AlignmentDiagram.pdf

6. Special Studies

6.1 50% Renewable Energy Goal for 2030

During the current planning cycle the ISO will perform a special study to provide information regarding the potential need for public policy-driven transmission additions or upgrades to support a state 50% renewable energy goal. The ISO is performing this study for information purposes only; its results will not be used to support a need for policy-driven transmission in the 2015-2016 planning cycle. As of the date of this draft study plan, the 50% renewable energy goal has been announced by Governor Brown but is not yet a formal state requirement, so in accordance with the ISO tariff the ISO cannot use it as a basis for approving policy-driven transmission.

Moreover, the target date associated with the 50% renewable energy goal is 2030, which is beyond the 10-year horizon of the TPP. Therefore, even if the 50% renewable energy goal becomes a formal state requirement in the near future, either in legislation or as a Governor's executive order, it would be premature and unnecessary to approve any associated transmission projects in the current or even the next TPP cycle.

At the same time, the ISO and the CPUC believe there would be great value in performing this study to anticipate potential transmission needs to meet the 50% renewable energy goal, as this will help inform the state's procurement processes about the cost impacts of achieving 50% renewable energy goal largely through the addition of new ISO grid-connected generating facilities. In addition, the CPUC has expressed interest in assessing the transmission requirements that would result if the incremental new renewable generation – i.e., the generation required to go from 33% RPS to 50% renewable energy goal– is procured as energy-only capacity.

To date, in identifying needed transmission for 33% RPS the ISO has sought to provide full capacity deliverability status to the renewable resources, based on the CPUC's and the load-serving entities' desire to obtain resource adequacy capacity from the same resources that provide renewable energy. For going beyond 33%, the ISO will now assume the incremental renewable generation to be energy-only, and on that basis will estimate the expected amount of congestion-related curtailment of renewables that would likely result. Although there is no formal link between a resource's deliverability status and the amount of curtailment it might experience, the fact is that providing deliverability status to generating resources generally requires deliverability network upgrades which have the effect of reducing the likelihood of congestion-related curtailment of generation. Thus a primary objective of the special study will be to assess how energy-only status for the incremental renewable generation could lead to curtailment and thereby compromise the higher RPS target. Additional details about the proposed study methodology are provided later in this section.

The ISO intends to perform the special study starting about the end of August, after the completion of the reliability planning studies, and during the period when the TPP typically assesses the need for public policy-driven transmission. The ISO therefore expects to present preliminary results of the special study for discussion with stakeholders in November 2015.

6.2 Over Generation Frequency Response Assessment

In the 2014-2015 transmission planning process the ISO conducted initial studies into frequency response for potential over-generation conditions. The following conclusions were identified in the 2014-2014 transmission planning process.

- The initial study results indicated acceptable frequency performance within WECC. However, the ISO's frequency response was below the ISO frequency response obligation specified in BAL-003-1.
- Compared to the ISO's actual system performance during disturbances, the study results seem optimistic because actual frequency responses for some contingencies were lower than the dynamic model indicated.
 - Optimistic results were partly due to large headroom of responsive generation modeled in the study case. For future studies, production simulation unit commitment and dispatch levels would have to incorporate operational requirements and available headroom on governor responsive resources would have to be aligned with actual operating conditions.
 - Amount of headroom on responsive governors is a good indicator of the Frequency Response Metric, but it is not the only indicator. Higher available headroom on a smaller number of governor responsive resources can result in less frequency response than lower available headroom on a larger number of governor responsive resources for the same contingency.
 - Further model validation is needed to ensure that governor response in the simulations matches their response in the real life.
 - Exploration of other sources of governor response is needed.

In the 2015-2016 TPP the ISO will conduct further analysis to investigate measures to improve the ISO frequency response post contingency. These measures may include the following: load response, response from storage and frequency response from inverter-based generation. Other contingencies may also need to be studied, as well as other cases with reduced headroom. Future work will also include validation of models based on real-time contingencies and studies with modeling of behind the meter generation.

7. Policy Driven 33% RPS Transmission Plan Analysis

7.1 Study methodology

The goal of the 33% renewable resource analysis is to identify the transmission needed to meet the 33% renewable resource target in the study year which, for this cycle, is 2025. The first step in this analysis is to establish renewable portfolios to be considered that are aligned closely with the portfolios developed by CPUC and used by the ISO in its renewable integration studies. In accordance with ISO Tariff Section 24.4.6.6, the renewable portfolios reflect such considerations as environmental impact, commercial interest and available transmission capacity, among other criteria.

In the last planning cycle, the ISO performed the 33% renewable resource analysis for 2024. Because the base portfolio was modeled in the reliability studies, the results of that study were also considered to be part of the 33% renewable resource analysis. To supplement those study results, additional studies were performed as described below:

- 1) Conduct production simulation of the developed portfolios using the ISO unified economic assessment database with renewable portfolios modeled.
- 2) Conduct additional power flow and stability assessments including
 - Contingency analysis using regular power flow (GE PSLF)
 - Voltage stability assessment using governor power flow (post-transient)
 - Transient stability using GE PSLF
 - Deliverability assessment
- 3) Categorize any identified transmission upgrade or addition elements based on the ISO Tariff Section 24.4.6.6 requirements.

In the 2015-2016 planning cycle, similar methodology will be used to identify the transmission needs to meet 33% RPS in 2025.

The CPUC and CEC will be providing the ISO with the RPS portfolios to be used in the 2015-2016 transmission planning process in February, 2015. The RPS portfolio submission letter will be posted on the ISO website on the 2015-2016 Transmission Planning Process page.

7.2 Study scope

The study scope of the 33% renewable resource analysis in this planning cycle includes the following items:

- Model base portfolio in the 2025 reliability assessment. Off-peak base cases will include a stressed renewable dispatch, so these results identify transmission needs associated with the 33% RPS base portfolio.
- Develop ISO supplemental 2025 power flow base cases starting from 2025 reliability base cases to model different load conditions based on the study methodology and assumptions.
- Establish portfolios and areas to be studied.
- Model those portfolios in production, power flow, and stability models
- Analyze stressed power flow models for peak, off-peak and other scenarios if needed. These should capture conditions for the CAISO's controlled grid and the entire Western Interconnection that show stressed patterns including cases possibly in different seasons. The peak load scenario uses CEC 1-in-5 coincident peak load with the Mid AAEE.
- Update 33% RPS transmission plan based on findings.

- Several sensitivity cases may be created to evaluate different scenarios as part of the comprehensive plan analysis

7.3 Coordination with Phase II of GIP

According to tariff Section 24.4.6.5 and in order to better coordinate the development of potential infrastructure from transmission planning and generation interconnection processes the ISO may coordinate the TPP with generator interconnection studies. In general, Network Upgrades and associated generation identified during the Interconnection Studies will be evaluated and possibly included as part of the TPP. The details of this process are described below.

Generator Interconnection Network Upgrade Criteria for TPP Assessment

Beginning with the 2012-2013 planning cycle, generator interconnection Network Upgrades may be considered for potential modification in the TPP if the Network Upgrade:

- Consists of new transmission lines 200 kV or above and have capital costs of \$100 million or more;
- Is a new 500 kV substation that has capital costs of \$100 million or more; or
- Has a capital cost of \$200 million or more.

Notification of Network Upgrades being assessed in the TPP

In approximately October 2015, the ISO will publish the list of generator interconnection Network Upgrades that meet at least one of these criteria and have been selected for consideration in TPP Phase 2. The comprehensive Transmission Plan will contain the results of the ISO's evaluation of the identified Network Upgrades. Network Upgrades evaluated by the ISO but not modified as part of the comprehensive Transmission Plan will proceed to Generator Interconnection Agreements (GIAs) through the Generator Interconnection and Deliverability Allocation Procedure (GIDAP) and will not be further addressed in the TPP. Similarly, GIP Network Upgrades that meet the tariff criteria but were not evaluated in the TPP will proceed to GIAs through the GIDAP.

All generation projects in the Phase II cluster study have the potential to create a need for Network Upgrades. As a result, the ISO may need to model some or all of these generation projects and their associated transmission upgrades in the TPP base cases for the purpose of evaluating alternative transmission upgrades. However, these base cases will be considered sensitivity base cases in addition to the base cases developed under the Unified Planning Assumptions. These base cases will be posted on the ISO protected web-site for stakeholder review. Study results and recommendations from these cases will be incorporated in the comprehensive transmission plan.

8. Economic Planning Study

The ISO will perform an Economic Planning Study as part of the current planning cycle to identify potential congestion and propose mitigation plans. The study will quantify the economic benefits for the ISO ratepayers based on Transmission Economic Assessment Methodology (TEAM). Production simulation is the main tool for this study.

The Economic Planning Study will be based on the same assumptions as the Reliability Assessment and 33% RPS Transmission Plan Analysis with the following exception:

- The 1-in-2 demand forecast will be used in the assessment with the Mid AAEE assumption.

The Economic Planning Study will conduct hourly analysis for year 2020 (the 5th planning year) and 2025 (the 10th planning year) respectively through production simulation.

As part of the requirements under the ISO tariff and Business Practice Manual, Economic Planning Study Requests are to be submitted to the ISO during the comment period following the stakeholder meeting to discuss this Study Plan. The ISO will consider the Economic Planning Study Requests as identified in section 24.3.4.1 of the ISO Tariff.

In evaluation of the congestion and review of the study requests, the ISO will determine the high priority studies during the 2015-2016 transmission planning cycle.

9. Long-Term Congestion Revenue Rights (LT CRR)

The ISO is obligated to ensure the continuing feasibility of Long Term CRRs (LT-CRRs) that are allocated by the ISO over the length of their terms. As such, the ISO, as part of its annual TPP cycle, shall test and evaluate the simultaneous feasibility of allocated LT-CRRs, including, but not limited to, when acting on the following types of projects: (a) planned or proposed transmission projects; (b) Generating Unit or transmission retirements; (c) Generating Unit interconnections; and (d) the interconnection of new Load. While the ISO expects that released LT-CRRs will remain feasible during their full term, changes to the interconnected network will occur through new infrastructure additions and/or modifications to existing infrastructure. To ensure that these infrastructure changes to the transmission system do not cause infeasibility in certain LT-CRRs, the ISO shall perform an annual Simultaneous Feasibility Test (SFT) analysis to demonstrate that all released CRRs remain feasible. In assessing the need for transmission additions or upgrades to maintain the feasibility of allocated LT- CRRs, the ISO, in coordination with the PTOs and other Market Participants, shall consider lower cost alternatives to the construction of transmission additions or upgrades, such as acceleration or expansion of existing projects, demand-side management, Remedial Action Schemes, constrained-on Generation, interruptible loads, reactive support, or in cases where the infeasible LT- CRRs involve a small magnitude of megawatts, ensuring against the risk of any potential revenue shortfall using the CRR Balancing Account and uplift mechanism in Section 11.2.4 of the ISO tariff.

10. Contact Information

This section lists the Subject Matter Experts (SMEs) for each technical study or major stakeholder activity addressed in this document. In addition to the extensive discussion and comment period during and after various ISO Transmission Plan-related Stakeholder meetings, stakeholders may contact these individuals directly for any further questions or clarifications.

Table 10-1: SMEs for Technical Studies in 2015-2016 Transmission Planning Process

Item/Issues	SME	Contact
Reliability Assessment in PG&E	Catalin Micsa	cmicsa@caiso.com
Reliability Assessment in SCE	Nebiyu Yimer	nyimer@caiso.com
Reliability Assessment in SDG&E	Frank Chen	fchen@caiso.com
Reliability Assessment in VEA	Sushant Barave	sbarave@caiso.com
33% RPS Transmission Plan Analysis	Sushant Barave	sbarave@caiso.com
Near-Term Local Capacity Requirements	Catalin Micsa	cmicsa@caiso.com
Long-Term Local Capacity Requirements in SCE and SDG&E	David Le	Dle@caiso.com
Economic Planning Study	Yi Zhang	yzhang@caiso.com
Long-term Congestion Revenue Rights	Bryan Fong	bfong@caiso.com
Preferred Resource and Storage Evaluation Studies	Nebiyu Yimer	nyimer@caiso.com

11. Stakeholder Comments and ISO Responses

All the comments the ISO receives from stakeholders on this 2015-2016 draft study plan and ISO's responses will be posted to the following link:

<http://www.caiso.com/planning/Pages/TransmissionPlanning/2015-2016TransmissionPlanningProcess.aspx>

APPENDIX A: System Data

A1 Existing Generation

Table A1-1: Existing generation plants in PG&E planning area

Planning Area	Generating Plant	Maximum Capacity
PG&E - Humboldt	Humboldt Bay	166
	Kekawaka	4.9
	Pacific Lumber	32.5
	LP Samoa	25
	Fairhaven	17.3
	Blue Lake	12
	Humboldt Area Total	258
PG&E - North Coast and North Bay	Santa Fe	160
	Bear Canyon	20
	Westford Flat	30
	Western Geo	38
	Geysers 5	53
	Geysers 6	53
	Geysers 7	53
	Geysers 8	53
	Geysers 11	106
	Geysers 12	106
	Geysers 13	133
	Geysers 14	109
	Geysers 16	118
	Geysers 17	118
	Geysers 18	118

Planning Area	Generating Plant	Maximum Capacity
	Geysers 20	118
	Bottle Rock	55
	SMUD Geo	72
	Potter Valley	11
	Geo Energy	20
	Indian Valley	3
	Sonoma Landfill	6
	Exxon	54
	Monticello	12
	North Coast and North Bay Area Total	1,619
PG&E - North Valley	Pit River	752
	Battle Creek	17
	Cow Creek	5
	North Feather River	736
	South Feather River	123
	West Feather River	26
	Black Butte	11
	CPV	717
	Hatchet Ridge Wind	103
	QFs	353
North Valley Area Total	2,843	
PG&E - Central Valley	Wadham	27
	Woodland Biomass	25
	UC Davis Co-Gen	4
	Cal-Peak Vaca Dixon	49

Planning Area	Generating Plant	Maximum Capacity
	Wolfskill Energy Center	60
	Lambie, Creed and Goosehaven	143
	EnXco	60
	Solano	100
	High Winds	200
	Shiloh	300
	Bowman Power House	4
	Camp Far West (SMUD)	7
	Chicago Park Power House	40
	Chili Bar Power House	7
	Colgate Power House	294
	Deer Creek Power House	6
	Drum Power House	104
	Dutch Plat Power House	49
	El Dorado Power House	20
	Feather River Energy Center	50
	French Meadow Power House	17
	Green Leaf No. 1	73
	Green Leaf No. 2	50
	Halsey Power House	11
	Haypress Power House	15
	Hellhole Power House	1
	Middle Fork Power House	130
	Narrows Power House	66
	Newcastle Power House	14

Planning Area	Generating Plant	Maximum Capacity
	Oxbow Power House	6
	Ralston Power House	83
	Rollins Power House	12
	Spaulding Power House	17
	SPI-Lincoln	18
	Ultra Rock (Rio Bravo-Rocklin)	25
	Wise Power House	20
	Yuba City Co-Generation	49
	Yuba City Energy Center	61
	Altamont Co-Generation	7
	Camanche Power House	11
	Co-generation National POSDEF	44
	Electra Power House	101
	Flowind Wind Farms	76
	GWF Tracy Peaking Plant	192
	Ione Energy	18
	Lodi CT	25
	Lodi Stigg	57
	Pardee Power House	29
	Salt Springs Power House	42
	San Joaquin Co-Generation	55
	Simpson Paper Co-Generation	50
	Stockton Co-Generation (Air Products)	50
	Stockton Waste Water Facility	2
	Thermal Energy	21

Planning Area	Generating Plant	Maximum Capacity
	Tiger Creek Power House	55
	US Wind Power Farms	158
	West Point Power House	14
	Lodi Energy Center	280
	GWF Tracy Expansion	145
	Beardsley Power House	11
	Donnells Power House	68
	Fiberboard (Sierra Pacific)	6
	Melones Power Plant	119
	Pacific Ultra Power Chinese Station	22
	Sand Bar Power House	15
	Spring Gap Power House	7
	Stanislaus Power House	83
	Stanislaus Waste Co-gen	24
	Tulloch Power House	17
	Central Valley Area Total	3,970
	PG&E - Greater Bay Area	Alameda Gas Turbines
Calpine Gilroy I		182
Crockett Co-Generation		243
Delta Energy Center		965
Marsh Landing		774
Russell City – East Shore EC		600
High Winds, LLC		162
Los Esteros Critical Energy Facility		293
Los Medanos Energy Center		678

Planning Area	Generating Plant	Maximum Capacity
	Mariposa Peaker	196
	Metcalf Energy Center	575
	Oakland C Gas Turbines	165
	Donald Von Raesfeld Power Plant	182
	Pittsburg Power Plant	1,360
	Riverview Energy Center	61
	Ox Mountain	13
	Gateway Generating Station	599
	Greater Bay Area Total	7048
	PG&E - Greater Fresno Area	Fresno Cogen-Agrico
Balch 1 PH		31
Balch 2 PH		25
Mendota Biomass Power		107
Chow 2 Peaker Plant		52.5
Chevron USA (Coalinga)		25
Chow II Biomass to Energy		12.5
Coalinga Cogeneration Company		46
CalPeak Power – Panoche LLC		49
Crane Valley		0.9
Corcoran PB		20
Dinuba Generation Project		13.5
El Nido Biomass to Energy		12.5
Exchequer Hydro		94.5
Fresno Waste Water		9
Friant Dam		27.3

Planning Area	Generating Plant	Maximum Capacity
	GWF Henrietta Peaker Plant	109.6
	HEP Peaker Plant Aggregate	102
	Hanford L.P.	23
	Hass PH Unit 1 & 2 Aggregate	146.2
	Helms Pump-Gen	1,212
	J.R. Wood	10.8
	Kerkhoff PH1	32.8
	Kerkhoff PH2	142
	Kingsburg Cogen	34.5
	Kings River Hydro	51.5
	Kings River Conservation District	112
	Liberty V Lost Hills	20
	Madera	28.7
	McSwain Hydro	10
	Merced Falls	4
	O'Neill Pump-Gen	11
	Panoche Energy Center	410
	Pine Flat Hydro	189.9
	Sanger Cogen	38
	San Joaquin 2	3.2
	San Joaquin 3	4.2
	Starwood Panoche	121.8
	Stratford	20
	Rio Bravo Fresno (AKA Ultrapower)	26.5
	Wellhead Power Gates, LLC	49

Planning Area	Generating Plant	Maximum Capacity
	Wellhead Power Panoche, LLC	49
	Wishon/San Joaquin #1-A Aggregate	20.4
	Greater Fresno Area Total	3,587.7
PG&E - Kern Area	Badger Creek (PSE)	49
	Chalk Cliff	48
	Cymric Cogen (Chevron)	21
	Cadet (Chev USA)	12
	Dexzel	33
	Discovery	44
	Double C (PSE)	45
	Elk Hills	623
	Frito Lay	8
	Hi Sierra Cogen	49
	Kern	177
	Kern Canyon Power House	11
	Kernfront	49
	Kern Ridge (South Belridge)	76
	La Paloma Generation	926
	Midsun	25
	Mt. Poso	56
	Navy 35R	65
	Oildale Cogen	40
	Bear Mountain Cogen (PSE)	69
Live Oak (PSE)	48	
McKittrick (PSE)	45	

Planning Area	Generating Plant	Maximum Capacity
	Rio Bravo Hydro	11
	Shell S.E. Kern River	27
	Solar Tannenhill	18
	Sunset	225
	North Midway (Texaco)	24
	Sunrise (Texaco)	338
	Sunset (Texaco)	239
	Midset (Texaco)	42
	Lost Hills (Texaco)	9
	Ultra Power (OGLE)	45
	University Cogen	36
	New RPS Units	55
	Kern Area Total	3,588
	PG&E - Central Coast and Los Padres	Moss Landing Power Plant
Soledad Energy		10
Basic Energy Cogen (King City)		120
King City Peaker		61
Sargent Canyon Cogen (Oilfields)		50
Salinas River Cogen (Oilfields)		45
Diablo Canyon Power Plant		2,400
Union Oil (Tosco)		6
Santa Maria		8
Vandenberg Air Force Base		15
Topaz		550
California Valley Solar		250

Planning Area	Generating Plant	Maximum Capacity
	Central Coast and Los Padres Area Total	6,115

Table A1-2: Existing generation plants in SCE planning area

Planning Area	Generating Plant	Maximum Capacity
SCE - Tehachapi and Big Creek Corridor	Big Creek 1-1 Gen 1	19.9
	Big Creek 1-1 Gen 2	21.6
	Big Creek 1-2 Gen 3	21.6
	Big Creek 1-2 Gen 4	31.2
	Big Creek 2-1 Gen 1	50.8
	Big Creek 2-1 Gen 2	52.0
	Big Creek 2-2 Gen 3	18.7
	Big Creek 2-2 Gen 4	19.7
	Big Creek 2-3 Gen 5	17.0
	Big Creek 2-3 Gen 6	18.5
	Big Creek 3-1 Gen 1	35.0
	Big Creek 3-1 Gen 2	35.0
	Big Creek 3-2 Gen 3	35.0
	Big Creek 3-2 Gen 4	41.0
	Big Creek 3-3 Gen 5	39.0
	Big Creek 4 Gen 41	50.4
	Big Creek 4 Gen 41	50.6
	Big Creek 8 Gen 81	24.4
	Big Creek 8 Gen 81	44.0
	Eastwood	207.0
Mammoth 1G	93.5	
Mammoth 2G	93.5	
Portal	9.6	
Warne 1	38.0	
Warne 2	38.0	

Planning Area	Generating Plant	Maximum Capacity
	Pandol 1	56.0
	Pandol 2	56.0
	Ultragen	41.0
	Omar 1G	90.8
	Omar 2G	90.8
	Omar 3G	90.8
	Omar 4G	90.8
	SYCCYN 1G	75.0
	SYCCYN 2G	75.0
	SYCCYN 3G	75.0
	SYCCYN 4G	75.0
	Pastoria Energy Facility	770.0
	Manzana Wind Project	189.0
	Pacific Wind Project	140.0
	Coram Brodie Wind Project Expansion	51.0
	Coram Brodie Wind Project Phase 2	51.0
	Suncreek (Alta 2012)	168.0
	CPC Alta Wind 4-5 (fka CPC East)	420.0
	CPC Alta Wind 1-3 (fka CPC West)	600.0
	Windstar I Alternate	120.0
	North Sky River Wind	162.0
	Alta 6	360.0
	Avalon Solar	110.0
	KR 3-1	22.8
	KR 3-2	21.5

Planning Area	Generating Plant	Maximum Capacity
	LakeGen	18.0
	Wellhead Power Delano	49.9
	Kawgen	18.0
	Avenue	310.0
	Kingsbird	270.0
	AV Solar 1	230.0
	Arbwind	21.8
	Canwind	65.0
	Enwind	47.1
	Flowind	40.8
	Dutchwind	14.0
	Northwind	19.4
	Oakwind	21.1
	Southwind	13.4
	Zondwind	26.0
	Breeze	12.5
	Midwind	18.0
	Morwind	56.0
	Kern River	24.0
	Borel	10.0
	Alta Vista Suntower Generating Station	66.0
	Antelope Power Plant	20.0
	Dawn Gen	20.0
	Twilight Gen	20.0
	Tehachapi and Big Creek Corridor Total	6,518

Planning Area	Generating Plant	Maximum Capacity
SCE - East of Lugo Area	Desert Star Energy Star	495
	Mountain Pass - Ivanpah Solar	389
	Copper Mountain Solar I	58
	Copper Mountain Solar II	92
	East of Lugo Area Total	1,034
SCE - North of Lugo	BSPHYD26	13.3
	BSPHYD34	15.9
	POOLE	10.9
	LUNDY	30
	RUSH	30
	CSA DIAB	24
	BLM E7G	24
	BLM E8G	24
	BLM W9G	30
	BORAX I	47
	CALGEN1G	32.2
	CALGEN2G	30
	CALGEN3G	30
	KERRMGEE	55
	LUZ (8 & 9)	184
	MC GEN	108
	MOGEN G	60
	NAVYII4G	30
NAVYII5G	30	
NAVYII6G	30	

Planning Area	Generating Plant	Maximum Capacity
	OXBOW G1	56
	SEGS 1G	20
	SEGS 2G	32.6
	SUNGEN3G	34
	SUNGEN4G	34
	SUNGEN5G	34
	SUNGEN6G	35
	SUNGEN7G	35
	ALTA 1G	65
	ALTA 2G	81
	ALTA31GT	66.5
	ALTA32GT	66.5
	ALTA 3ST	108
	ALTA41GT	66.5
	ALTA42GT	66.5
	ALTA 4ST	108
	HIDEDCT1	180
	HIDEDCT2	180
	HIDEDCT3	180
	HIDEDST1	330
	KERRGEN	17
	North of Lugo Area Total	2,626
	Blythe Energy Center	520
	Indigo Peaker	136
	Cabazon Wind	42.6

Planning Area	Generating Plant	Maximum Capacity
SCE - Eastern Area	Mountainview IV Wind	42
	Wintec 5 Wind	3.7
	Wintec 6 Wind	45
	Pacificorp Wind	2.1
	FPLE Green 1 Wind	8.7
	FPLE Green 2 Wind	3.0
	FPLE Green 3 Wind	6.8
	Wintec 2 Wind	16.5
	Wintec 3 Wind	11.6
	Wintec 4 Wind	16.5
	Seawest 1 Wind	44.4
	Seawest 2 Wind	22.2
	Seawest 3 Wind	22.4
	Renwind Wind	9.0
	Whitewater Wind	66
	Altamesa 4 Wind	40
	Painted Hills Wind	16.9
	Altwind QF 1	32.9
	Altwind QF 2	15.1
	Buchwind QF	17
	Capwind QF	20
	Garnet QF Wind	101.4
	Panaero Wind	30
Renwind QF 1	6.3	
Renwind QF 2	6.6	

Planning Area	Generating Plant	Maximum Capacity
	Sanwind QF 1	3.0
	Sanwind QF 2	28.0
	Seawind QF	27
	Terawind QF	22.5
	Transwind QF	40.0
	Venwind QF 1	25.5
	Venwind QF 2	19.3
	CPV Sentinel Peaker	850
	Genesis Solar Energy Project	250
	Desert Sunlight PV Project	550
	Eastern Area Total	3,120
	SCE Metro Area	Alamitos
Canyon Power Plant		195
Anaheim CT		41
Watson Cogeneration		271
Barre Peaker		45
Broadway 3		65
Center Area Lumped Units		18
MWD Rio Hondo Hydroelectric Recovery Plant		2
Center Peaker		45
Century		36
O.L.S. Energy Company- Chino-Mens Inst.		25
Ripon Cogeneration		27
Milliken Landfill Project		1
Agua Mansa Generating Facility		43

Planning Area	Generating Plant	Maximum Capacity
	Clearwater Power Plant	28
	Diamond Valley P-G Plant	1
	Drews	36
	Devil Canyon	235
	El Segundo 3 & 4	670
	Fontana/Lytle Creek Hydro	1
	Grapeland Peaker	43
	Etiwanda Hydro Recovery Plant	10
	Mid Valley Landfill Project	2
	Etiwanda 3 & 4	640
	Glen Arm Power Plant	132
	Harbor Cogen Combined Cycle	100
	BP West Coast Products	21
	Long Beach 1 – 4	260
	City Of Long Beach	28
	Huntington Beach 1 & 2	452
	Inland Empire Energy Center	670
	MWD Venice Hydroelectric Recovery Plant	4
	Carson Cogeneration Company	47
	MWD Corona Hydroelectric Recovery Plant	2
	MWD Temescal Hydroelectric Recovery Plant	2
	Corona Energy Partners, Ltd.	30
	Mira Loma Peaker	43
	Lake Mathews Hydro Recovery Plant	5
	Mojave Siphon PH	18

Planning Area	Generating Plant	Maximum Capacity
	MWD Coyote Creek Hydroelectric Recovery Plant	3
	Olinda Area Lumped Units	1
	Olinda Landfill	5
	Ontario/Sierra Hydro Project	1
	San Dimas Hydro Recovery Plant	8
	Padua Area Lumped Units	1
	San Dimas Wash Hydro	1
	Redondo	1,356
	Riverside Energy Resource Center (RERC)	194
	Springs Generation Plant	36
	Coyote Canyon	6
	Mountainview Power Plant	969
	Mill Creek Hydro Project	1
	MWD Perris Hydroelectric Recovery Plant	8
	MWD Red Mountain Hydroelectric Recovery Plant	2
	Badlands Landfill Gas to Energy Facility	1
	El Sobrante Landfill Gas Generation	1
	H. Gonzales Gas Turbine	12
	Malburg Generating Facility	134
	MWD Valley View Hydroelectric Recovery Plant	4
	L.A. County Sanitation District #2 (Puente Hills B)	47
	MM West Coast Covina, LLC	6
	Ellwood Generating Station	54
	Exxon Company, USA	1

Planning Area	Generating Plant	Maximum Capacity
	Gaviota Oil Heating Facility	1
	MM Tajiguas Energy, LLC	3
	Mandalay 1 & 2	430
	Mandalay 3 GT	130
	Calabasas Gas-to-Energy Facility	7
	Simi Valley Landfill Gas Generation	1
	Ormond Beach	1,516
	Toland Landfill Gas to Energy Project	1
	Foothill Hydro Recovery Plant	8
	County Of Los Angeles (Pitchess Honor Ranch)	19
	Saugus Area Lumped Units	1
	Chiquita Canyon Landfill Generating Facility	7
	MM Lopez Energy, LLC	5
	E. F. Oxnard, Incorporated	34
	Procter & Gamble Paper Prod. (Oxnard II)	46
	Weyerhaeuser Company (Formerly Willamette Industries)	13
	Berry Petroleum Placerita	37
	Walnut Creek Energy Park	500
	El Segundo Energy Center	570
	Metro Area Total	12,485

Table A1-3: Existing generation plants in SDG&E planning area

Planning Area	Generating Plant	Maximum Capacity
SDG&E	Encina 1	106
	Encina 2	103
	Encina 3	109
	Encina 4	299
	Encina 5	329
	Palomar	565
	Otay Mesa	603
	Encina GT	14
	Kearny GT1	15
	Kearny 2AB (Kearny GT2)	55
	Kearny 3AB (Kearny GT3)	57
	Miramar GT 1	17
	Miramar GT 2	16
	El Cajon GT	13
	Goalline	48
	Naval Station	47
	North Island	33
	NTC Point Loma	22
	Sampson	11
	NTC Point Loma Steam turbine	2.3
Ash	0.9	
Cabrillo	2.9	
Capistrano	3.3	
Carlton Hills	1.6	

Planning Area	Generating Plant	Maximum Capacity
	Carlton Hills	1
	Chicarita	3.5
	East Gate	1
	Kyocera	0.1
	Mesa Heights	3.1
	Mission	2.1
	Murray	0.2
	Otay Landfill I	1.5
	Otay Landfill II	1.3
	Covanta Otay 3	3.5
	Rancho Santa Fe 1	0.4
	Rancho Santa Fe 2	0.3
	San Marcos Landfill	1.1
	Miramar 1	46
	Larkspur Border 1	46
	Larkspur Border 2	46
	MMC-Electrovest (Otay)	35.5
	MMC-Electrovest (Escondido)	35.5
	El Cajon/Calpeak	42
	Border/Calpeak	42
	Escondido/Calpeak	42
	El Cajon Energy Center	48
	Miramar 2	46
	Orange Grove	94
	Kumeyaay	50

Planning Area	Generating Plant	Maximum Capacity
	Bullmoose	20
	Lake Hodges Pumped Storage	40
	Ocotillo Express	299
	Breggo Solar	21
	SDG&E Area Total	3,445

Table A1-4: Existing generation plants in VEA planning area

Planning Area	Generating Plant	Maximum Capacity
VEA	Not Applicable	0
	VEA Area Total	0

A2 Planned Generation

Table A2-1: Planned Generation – Thermal and Solar Thermal

PTO Area	Project²⁷	Capacity (MW)	First Year to be Modeled
PG&E	Oakley Generation Station (Construction)	624	2018
SCE	Blythe Solar Energy Center (Construction)	485	2015
	Huntington Beach Energy Project (Pre-Construction)	939	2019
SDG&E	Carlsbad (Pre-Construction)	633	2018
	Pio Pico Energy Center (Pre-Construction)	318	2017

²⁷ The ISO will be conducting the studies in the 2015-2016 TPP with Oakley, Huntington Beach Energy and Carlsbad off-line in the base case. The ISO will may also conduct sensitivity studies with these generating station resources on-line.

A3 Retired Generation

Table A3-1: Generation plants projected to be retired in planning horizon

PTO Area	Project	Capacity (MW)	First Year to be retired
PG&E	GWF Power Systems 1-5	100	2013
	Morro Bay 3	325	2014
	Morro Bay 4	325	2014
SCE	El Segundo 3	335	2013*
	Huntington Beach 3	225	2013
	Huntington Beach 4	225	2013
	San Onofre Nuclear Generating Station (SONGS)	2246	2013
	McGen	118	2014
	Kerrgen	26	2014
SDG&E	Kearny Peakers	135	2017
	Miramar GT1 and GT2	36	2017
	El Cajon GT	16	2017

Notes: * El Segundo unit 3 was retired when the El Segundo Power Redevelopment project became commercially available.

A4 Reactive Resources

Table A4-1: Summary of key reactive resources modeled in ISO reliability assessments

Substation	Capacity (Mvar)
Gates	225
Los Banos	225
Gregg	150
McCall	132
Mesa	100
Metcalf	350
Olinda	200
Table Mountain	454
Devers 230kV and Devers 500kV	156 MVAR; and 605 MVAR (based on 525kV)*
Sunrise San Luis Rey 230 kV	63
Southbay / Bay Boulevard 69 kV (expected in 2014)	100
Miraloma	158
Suncrest	126
Penasquitos 230 kV	126

* Dynamic capability

A5 Special Protection Schemes

Table A5-1: Existing key Special Protection Schemes in the PG&E area

PTO	Area	SPS Name
PG&E	Central Coast / Los Padres	Mesa and Santa Maria Under Voltage SPS
	Central Coast / Los Padres	Divide Under Voltage SPS
	Central Coast / Los Padres	Temblor-San Luis Obispo 115 kV Overload Scheme
	Central Coast / Los Padres	Carrizo SPS: Carrizo SPS Transient Voltage Dip Criteria Deviation Scheme, Carrizo SPS Overload Scheme and Midway Bank Overload Scheme
	Bulk	COI RAS
	Bulk	Colusa SPS
	Bulk	Diablo Canyon SPS
	Bulk	Gates 500/230 kV Bank #11 SPS
	Bulk	Midway 500/230 kV Transformer Overload SPS
	Bulk	Path 15 IRAS
	Bulk	Path 26 RAS North to South
	Bulk	Path 26 RAS South to North

PTO	Area	SPS Name
	Bulk	Table Mt 500/230 kV Bank #1 SPS
	Central Valley	Drum (Sierra Pacific) Overload Scheme (Path 24)
	Central Valley	Stanislaus – Manteca 115 kV Line Load Limit Scheme
	Central Valley	Vaca-Suisun 115 kV Lines Thermal Overload Scheme
	Central Valley	West Sacramento 115 kV Overload Scheme
	Central Valley	West Sacramento Double Line Outage Load Shedding SPS Scheme
	Central Valley	Schulte Sw Sta– Manteca 115kV Line Thermal Overload Scheme
	Greater Fresno Area	Ashlan SPS
	Greater Fresno Area	Atwater SPS
	Greater Fresno Area	Gates Bank 11 SPS
	Greater Fresno Area	Helms HTT RAS
	Greater Fresno Area	Helms RAS
	Greater Fresno Area	Henrietta RAS
	Greater Fresno Area	Kerckhoff 2 RAS
	Greater Bay Area	Metcalf SPS
	Greater Bay Area	SF RAS

PTO	Area	SPS Name
	Greater Bay Area	South of San Mateo SPS
	Greater Bay Area	Metcalf-Monta Vista 230kV OL SPS
	Greater Bay Area	San Mateo-Bay Meadows 115kV line OL
	Greater Bay Area	Moraga-Oakland J 115kV line OL RAS
	Greater Bay Area	Grant 115kV OL SPS
	Greater Bay Area	Oakland 115 kV C-X Cable OL RAS
	Greater Bay Area	Oakland 115kV D-L Cable OL RAS
	Greater Bay Area	Sobrante-Standard Oil #1 & #2-115kV line
	Greater Bay Area	Gilroy SPS
	Greater Bay Area	TransBay Cable Run Back Scheme
	Greater Bay Area	Contra Costa-Moraga 230 kV Lines Interim SPS
	Humboldt	Humboldt – Trinity 115kV Thermal Overload Scheme
	North Valley	Caribou Generation 230 kV SPS Scheme #1
	North Valley	Caribou Generation 230 kV SPS Scheme #2

PTO	Area	SPS Name
	North Valley	Cascade Thermal Overload Scheme
	North Valley	Hatchet Ridge Thermal Overload Scheme
	North Valley	Coleman Thermal Overload Scheme

Table A5-2: Existing key Special Protection Schemes in SCE area

PTO	Area	SPS Name
SCE	Big Creek Corridor	Antelope-RAS
	Big Creek Corridor	Big Creek / San Joaquin Valley RAS
	North of Lugo	Bishop RAS
	North of Lugo	High Desert Power Project RAS
	North of Lugo	Kramer RAS
	North of Lugo	Mohave Desert RAS
	North of Lugo	Victor Direct Load Tripping Scheme
	Big Creek Corridor	Midway-Vincent RAS
	Big Creek Corridor	Pastoria Energy Facility Existing RAS
	North of Lugo	Reliant Energy Cool Water Stability Tripping Scheme
	Eastern Area	West-of-Devers Remedial Action Scheme
	Eastern Area	Blythe Energy RAS and Eagle Mountain Thermal Overload Scheme

PTO	Area	SPS Name
	Metro Area	El Nido N-2 Remedial Action Scheme
	Metro Area	Mountainview Power Project Remedial Action Scheme
	Metro Area	South of Lugo N-2 Remedial Action Scheme
	Metro Area	Mira Loma Low Voltage Load Shedding
	Metro Area	Santiago N-2 Remedial Action Scheme
	Metro Area	Valley Direct Load Trip Remedial Action Scheme
	East of Lugo Area	Ivanpah Area RAS

Table A5-3: Existing key Special Protection Schemes in the SDG&E

PTO	Area	SPS Name
SDG&E	SDG&E	230kV Otay Mesa Energy Center Generation SPS
	SDG&E	ML (Miguel) Bank 80/81 Overload SPS
	SDG&E	CFE SPS to protect lines from La Rosita to Tijuana
	SDG&E	TL 50001 IV Generator SPS
	SDG&E	Path 44 South of SONGS Safety Net

PTO	Area	SPS Name
	SDG&E	230kV TL 23040 Otay Mesa – Tijuana SPS Note: This SPS is currently disabled and will be watched if there is any implications for CFE to reactive this scheme.
	SDG&E	500kV TL 50003 Gen Drop SPS
	SDG&E	500kV TL 50005 Gen Drop SPS