

Market Performance Report July 2017

October 16, 2017

ISO Market Quality and Renewable Integration

Executive Summary¹

The market performance in July 2017 is summarized below.

CAISO area performance,

- Peak loads for ISO exceeded 40,000 MW in 16 days due to high temperature.
- In the integrated forward market (IFM), SDG&E DLAP price was elevated on July 15 due to transmission congestion. In the fifteen-minute market (FMM) and the real-time market (RTD, all four DLAP prices were elevated on July 7, driven by upward load adjustment, renewable deviation, transmission congestion, and generation outages.
- Congestion rents for interties skidded to \$6.22 million from \$20.22 million in June. Majority of the congestion rents in July accrued on MALIN500 (15 percent) intertie and NOB (84 percent) intertie.
- In the congestion revenue rights market, revenue adequacy was 71.45 percent, decreasing from 86.12 percent in June. The nomogram RM_TM12_NG contributed largely to the revenue shortfall.
- The monthly average ancillary service cost to load decreased to \$0.43/MWh in July from \$0.85/MWh in June. There were no ancillary service scarcity events this month.
- The cleared virtual supply was well above the cleared demand in most days of July. The profits from convergence bidding fell to \$1.75 million in July from \$2.52 million in June.
- The bid cost recovery rose to \$11.11 million from \$8.53 million in June.
- The real-time energy offset cost dropped to \$0.08 million from \$4.96 million in June. The real-time congestion offset cost slid to \$3.64 million from \$4.54 million in June.
- The volume of exceptional dispatch increased to 94,578 MWh from 80,854 MWh in June, largely driven by load forecast uncertainty and planned transmission outage and constraint. The monthly average of total exceptional dispatch volume as a percentage of load edged down to 0.40 percent in July from 0.42 percent in June.

¹ This report contains the highlights of the reporting period. For a more detailed explanation of the technical characteristics of the metrics included in this report please download the Market Performance Metric Catalog, which is available on the CAISO web site at http://www.caiso.com/market/Pages/ReportsBulletins/Default.aspx.

Energy Imbalance market (EIM) performance,

- In the FMM and RTD, the prices were relatively stable.
- Bid cost recovery, real-time imbalance energy offset, and real-rime congestion offset costs for EIM entities (PACE, PACW, NEVP, AZPS, and PSEI) were \$0.73 million, -\$6.66 million and -\$1.40 million respectively.

TABLE OF CONTENTS

Market Characteristics 5 Loads 5 Resource Adequacy Available Incentive Mechanism 6 Direct Market Performance Metrics 7 Energy 7 Day-Ahead Prices 7 Real-Time Prices 7 Congestion 11 Congestion Rents on Interties 11 Congestion Revenue Rights 12 Ancillary Services 16 IFM (Day-Ahead) Average Price 16 Ancillary Service Cost to Load 17 Scarcity Events 17 Convergence Bidding 18 Renewable Generation Curtailment 19 Flexible Ramping Product 20 Flexible Ramping Product Payment 21 Indirect Market Performance Metrics 22 Bid Cost Recovery 22 Real-time Imbalance Offset Costs 33 Market Software Metrics 34 Manual Market Adjustment 36 Exceptional Dispatch 36 Energy Imbalance Market 38	Executive Summary	2
Resource Adequacy Available Incentive Mechanism 6 Direct Market Performance Metrics 7 Energy 7 Day-Ahead Prices 7 Real-Time Prices 7 Congestion 11 Congestion Rents on Interties 11 Congestion Revenue Rights 12 Ancillary Services 16 IFM (Day-Ahead) Average Price 16 Ancillary Service Cost to Load 17 Scarcity Events 17 Convergence Bidding 18 Renewable Generation Curtailment 19 Flexible Ramping Product 20 Flexible Ramping Product Payment 21 Indirect Market Performance Metrics 22 Bid Cost Recovery 22 Real-time Imbalance Offset Costs 33 Market Software Metrics 34 Manual Market Adjustment 36 Exceptional Dispatch 36	Market Characteristics	5
Direct Market Performance Metrics 7 Energy 7 Day-Ahead Prices 7 Real-Time Prices 7 Congestion 11 Congestion Rents on Interties 11 Congestion Revenue Rights 12 Ancillary Services 16 IFM (Day-Ahead) Average Price 16 Ancillary Service Cost to Load 17 Scarcity Events 17 Convergence Bidding 18 Renewable Generation Curtailment 19 Flexible Ramping Product 20 Flexible Ramping Product Payment 21 Indirect Market Performance Metrics 22 Bid Cost Recovery 22 Real-time Imbalance Offset Costs 33 Market Software Metrics 34 Market Disruption 34 Manual Market Adjustment 36 Exceptional Dispatch 36	Loads	5
Direct Market Performance Metrics 7 Energy 7 Day-Ahead Prices 7 Real-Time Prices 7 Congestion 11 Congestion Rents on Interties 11 Congestion Revenue Rights 12 Ancillary Services 16 IFM (Day-Ahead) Average Price 16 Ancillary Service Cost to Load 17 Scarcity Events 17 Convergence Bidding 18 Renewable Generation Curtailment 19 Flexible Ramping Product 20 Flexible Ramping Product Payment 21 Indirect Market Performance Metrics 22 Bid Cost Recovery 22 Real-time Imbalance Offset Costs 33 Market Software Metrics 34 Market Disruption 34 Manual Market Adjustment 36 Exceptional Dispatch 36	Resource Adequacy Available Incentive Mechanism	6
Day-Ahead Prices 7 Real-Time Prices 7 Congestion 11 Congestion Rents on Interties 11 Congestion Revenue Rights 12 Ancillary Services 16 IFM (Day-Ahead) Average Price 16 Ancillary Service Cost to Load 17 Scarcity Events 17 Convergence Bidding 18 Renewable Generation Curtailment 19 Flexible Ramping Product 20 Flexible Ramping Product Payment 21 Indirect Market Performance Metrics 22 Bid Cost Recovery 22 Real-time Imbalance Offset Costs 33 Market Software Metrics 34 Market Disruption 34 Manual Market Adjustment 36 Exceptional Dispatch 36		
Day-Ahead Prices 7 Real-Time Prices 7 Congestion 11 Congestion Rents on Interties 11 Congestion Revenue Rights 12 Ancillary Services 16 IFM (Day-Ahead) Average Price 16 Ancillary Service Cost to Load 17 Scarcity Events 17 Convergence Bidding 18 Renewable Generation Curtailment 19 Flexible Ramping Product 20 Flexible Ramping Product Payment 21 Indirect Market Performance Metrics 22 Bid Cost Recovery 22 Real-time Imbalance Offset Costs 33 Market Software Metrics 34 Market Disruption 34 Manual Market Adjustment 36 Exceptional Dispatch 36	Energy	7
Real-Time Prices 7 Congestion 11 Congestion Rents on Interties 11 Congestion Revenue Rights 12 Ancillary Services 16 IFM (Day-Ahead) Average Price 16 Ancillary Service Cost to Load 17 Scarcity Events 17 Convergence Bidding 18 Renewable Generation Curtailment 19 Flexible Ramping Product 20 Flexible Ramping Product Payment 21 Indirect Market Performance Metrics 22 Bid Cost Recovery 22 Real-time Imbalance Offset Costs 33 Market Software Metrics 34 Market Disruption 34 Manual Market Adjustment 36 Exceptional Dispatch 36		
Congestion 11 Congestion Rents on Interties 11 Congestion Revenue Rights 12 Ancillary Services 16 IFM (Day-Ahead) Average Price 16 Ancillary Service Cost to Load 17 Scarcity Events 17 Convergence Bidding 18 Renewable Generation Curtailment 19 Flexible Ramping Product 20 Flexible Ramping Product Payment 21 Indirect Market Performance Metrics 22 Bid Cost Recovery 22 Real-time Imbalance Offset Costs 33 Market Software Metrics 34 Market Disruption 34 Manual Market Adjustment 36 Exceptional Dispatch 36	•	
Congestion Rents on Interties11Congestion Revenue Rights12Ancillary Services16IFM (Day-Ahead) Average Price16Ancillary Service Cost to Load17Scarcity Events17Convergence Bidding18Renewable Generation Curtailment19Flexible Ramping Product20Flexible Ramping Product Payment21Indirect Market Performance Metrics22Bid Cost Recovery22Real-time Imbalance Offset Costs33Market Software Metrics34Market Disruption34Manual Market Adjustment36Exceptional Dispatch36		
Congestion Revenue Rights12Ancillary Services16IFM (Day-Ahead) Average Price16Ancillary Service Cost to Load17Scarcity Events17Convergence Bidding18Renewable Generation Curtailment19Flexible Ramping Product20Flexible Ramping Product Payment21Indirect Market Performance Metrics22Bid Cost Recovery22Real-time Imbalance Offset Costs33Market Software Metrics34Market Disruption34Manual Market Adjustment36Exceptional Dispatch36	O	
Ancillary Services		
IFM (Day-Ahead) Average Price16Ancillary Service Cost to Load17Scarcity Events17Convergence Bidding18Renewable Generation Curtailment19Flexible Ramping Product20Flexible Ramping Product Payment21Indirect Market Performance Metrics22Bid Cost Recovery22Real-time Imbalance Offset Costs33Market Software Metrics34Market Disruption34Manual Market Adjustment36Exceptional Dispatch36	<u> </u>	
Ancillary Service Cost to Load		
Scarcity Events	· · · · · · · · · · · · · · · · · · ·	
Convergence Bidding18Renewable Generation Curtailment19Flexible Ramping Product20Flexible Ramping Product Payment21Indirect Market Performance Metrics22Bid Cost Recovery22Real-time Imbalance Offset Costs33Market Software Metrics34Market Disruption34Manual Market Adjustment36Exceptional Dispatch36		
Renewable Generation Curtailment19Flexible Ramping Product20Flexible Ramping Product Payment21Indirect Market Performance Metrics22Bid Cost Recovery22Real-time Imbalance Offset Costs33Market Software Metrics34Market Disruption34Manual Market Adjustment36Exceptional Dispatch36		
Flexible Ramping Product		
Flexible Ramping Product Payment		
Indirect Market Performance Metrics22Bid Cost Recovery22Real-time Imbalance Offset Costs33Market Software Metrics34Market Disruption34Manual Market Adjustment36Exceptional Dispatch36	, e	
Bid Cost Recovery22Real-time Imbalance Offset Costs33Market Software Metrics34Market Disruption34Manual Market Adjustment36Exceptional Dispatch36		
Real-time Imbalance Offset Costs		
Market Software Metrics34Market Disruption34Manual Market Adjustment36Exceptional Dispatch36		
Market Disruption		
Manual Market Adjustment36 Exceptional Dispatch36		
Exceptional Dispatch36		
·	•	
	·	

Market Characteristics

Loads

Peak loads for ISO increased in July driven by high temperature, exceeding 40,000 MW in 16 days.

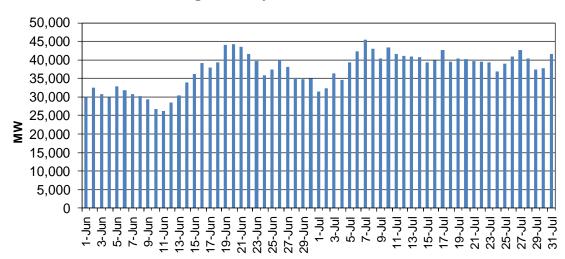


Figure 1: System Peak Load

Resource Adequacy Available Incentive Mechanism

Resource Adequacy Availability Incentive Mechanism (RAAIM) was activated on November 1, 2016 to track the performance of Resource Adequacy (RA) Resources. RAAIM is used to determine the availability of resources providing local and/or system Resource Adequacy Capacity and Flexible RA Capacity each month and then assess the resultant Availability Incentive Payments and Non-Availability Charges through the CAISO's settlements process. Table 1 below shows the monthly average actual availability, total non-availability charge, and total availability incentive payment.²

Table 1: Resource Adequacy Availability and Payment

	Average Actual Availability	Total Non-availbility Charge	Total Availability Incentive Payment
Nov-16	92.23%	\$3,616,895	-\$1,678,657
Dec-16	96.11%	\$1,872,061	-\$1,872,061
Jan-17	95.64%	\$2,866,734	-\$2,013,269
Feb-17	92.28%	\$3,262,889	-\$1,875,649
Mar-17	91.94%	\$3,046,829	-\$1,550,469
Apr-17	89.43%	\$4,096,806	-\$1,543,647
May-17	95.97%	\$1,812,398	-\$1,429,830
Jun-17	95.12%	\$2,456,737	-\$1,417,349
Jul-17	96.06%	\$1,369,890	-\$1,369,890

² On July 21, 2017, the ISO indicated in the market notice that it intended to file a petition with the FERC for a limited tariff waiver on section 40.9.6 to forego assessing any Resource Adequacy Availability Incentive Mechanism (RAAIM) charges for the period

April 1, 2017 through December 31, 2017 due to identified implementation issues. This waiver includes April, 2017 and May 2017. The ISO is currently estimating the penalties reflected in the charge code 8830 to be zero pursuant to tariff section 11.29.10.5.

Direct Market Performance Metrics

Energy

Day-Ahead Prices

Figure 2 shows daily prices of four default load aggregate points (DLAPs). Table 2 below lists the binding constraints along with the associated DLAP locations and the occurrence dates when the binding constraints resulted in relatively high or low DLAP prices.

Figure 2: Day-Ahead Simple Average LAP Prices (All Hours)

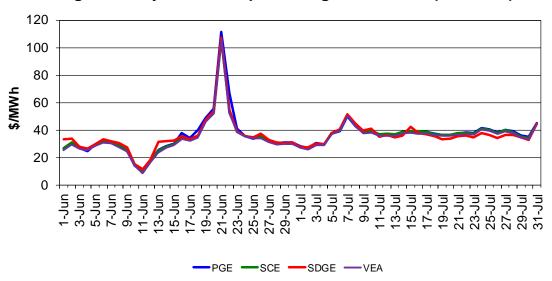


Table 2: Day-Ahead Transmission Constraints

DLAP	Date	Transmission Constraint		
SDG&E	July 15	SWTWTRTPSWEETWT-69 kV line		

Real-Time Prices

FMM daily prices of the four DLAPs are shown in Figure 3. Table 3 lists the binding constraints along with the associated DLAP locations and the occurrence dates when the binding constraints resulted in relatively high or low DLAP prices. On July 7, all four DLAP prices were high due to upward load adjustment, reduction of imports, the congestion on RM_TM12_NG, and generation outages.


Figure 3: FMM Simple Average LAP Prices (All Hours)

Table 3: FMM Transmission Constraints

DLAP	Date	Transmission Constraint		
SDG&E	July 11-12, 17-18, 21-22, 25, 28	DOUBLTTP-FRIARS -138 kV line		

Figure 4 below shows the daily frequency of positive price spikes and negative prices by price range for the default LAPs in the FMM. The cumulative frequency of prices above \$250/MWh decreased to 0.34 percent in July from 0.66 percent in June. The cumulative frequency of negative prices decreased to 0.08 percent in July from 4.25 percent in June.

Figure 4: Daily Frequency of FMM LAP Positive Price Spikes and Negative Prices

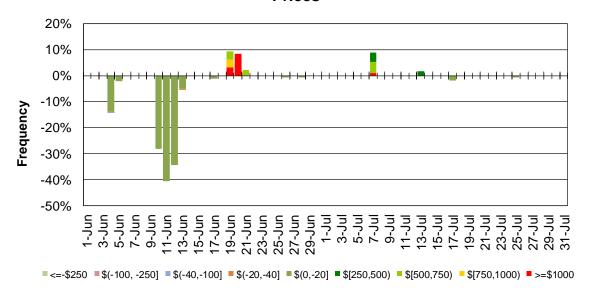

RTD daily prices of the four DLAPs are shown in Figure 5. Table 4 lists the binding constraints along with the associated DLAP locations and the occurrence dates when the binding constraints resulted in relatively high or low DLAP prices. July 7 saw high prices for all four DLAPs due to upward load adjustment, renewable deviation, the congestion on RM_TM12_NG, and generation outages.

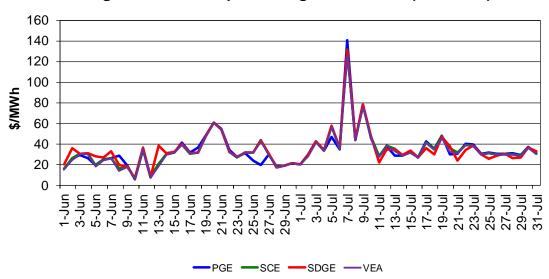



Figure 5: RTD Simple Average LAP Prices (All Hours)

Table 4: RTD Transmission Constraints

DLAP	Date	Transmission Constraint		
SDG&E	July 11-12, 17-18, 21-22, 25, 28	DOUBLTTP-FRIARS -138 kV line		

Figure 6 below shows the daily frequency of positive price spikes and negative prices by price range for the default LAPs in RTD. The cumulative frequency of prices above \$250/MWh increased to 1.17 percent in July from 0.59 percent in June. The cumulative frequency of negative prices dropped to 0.09 percent in July from 5.83 percent in June.

Figure 6: Daily Frequency of RTD LAP Positive Price Spikes and Negative Price

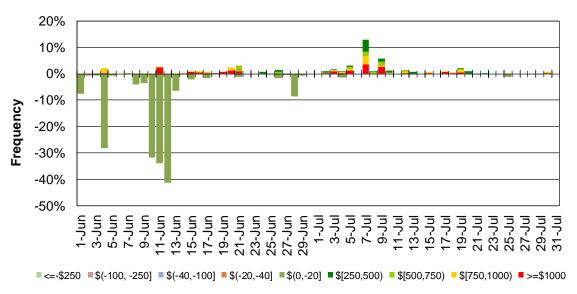

Congestion

Congestion Rents on Interties

Figure 7 below illustrates the daily integrated forward market congestion rents by interties. The cumulative total congestion rent for interties in July skidded to \$6.22 million from \$20.22 million in June. Majority of the congestion rents in July accrued on MALIN500 (15 percent) intertie and NOB (84 percent) intertie.

The congestion rent on MALIN500 slid to \$0.93 million in July from \$10.91 million in June. The congestion rent on NOB decreased to \$5.23 million in July from \$8.96 million in June.

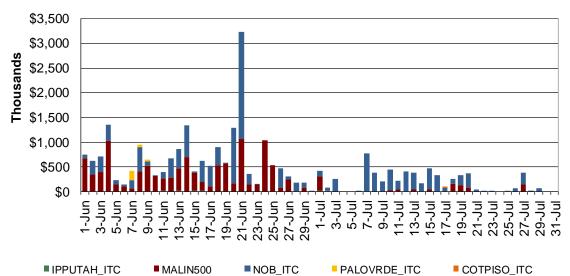


Figure 7: IFM Congestion Rents by Interties (Import)

Average Congestion Cost per Load Served

This metric quantifies the average congestion cost for serving one megawatt of load in the ISO system. Figure 8 shows the daily and monthly averages for the day-ahead and real-time markets respectively.

Figure 8: Average Congestion Cost per Megawatt of Served Load

The average congestion cost per MWh of load served in the integrated forward market decreased to \$0.83/MWh in July from \$1.52/MWh in June. The average congestion cost per load served in the real-time market went to -\$0.15/MWh in July from -\$0.22/MWh in June.

Congestion Revenue Rights

Figure 9 illustrates the daily revenue adequacy for congestion revenue rights (CRRs) broken out by transmission element. The average CRR revenue deficit in July increased to \$251,457 from the average revenue deficit of \$170,262 in June.

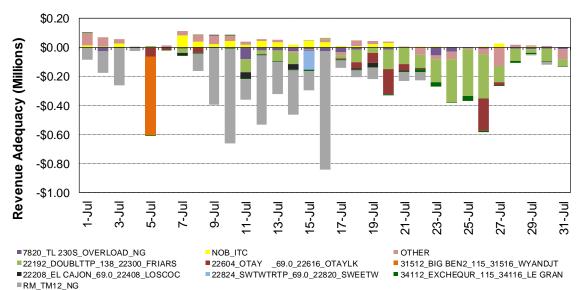


Figure 9: Daily Revenue Adequacy of Congestion Revenue Rights

Overall, July experienced a CRR revenue deficit. Revenue shortfalls were observed in most days of July. The main reasons are shown below.

- The line 22192_DOUBLTTP_138_22300_FRIARS was binding in 25 days of this month, resulting in revenue shortfall of \$2.18 million.
- The nomogram RM_TM12_NG was binding in 20 days of this month, resulting in revenue shortfall of \$4.11 million. This nomogram was enforced for the contingency related to operating procedure 6110.

The shares of the revenue surplus and deficit accruing on various congested transmission elements for the reporting period are shown in Figure 10 and the monthly summary for CRR revenue adequacy is provided in Table 5.


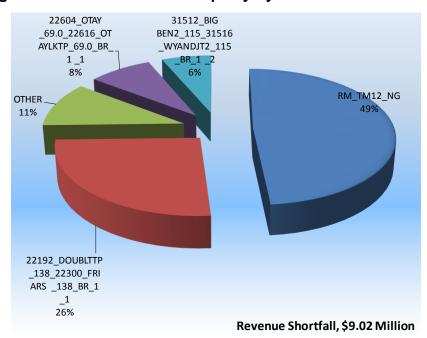


Figure 10: CRR Revenue Adequacy by Transmission Element

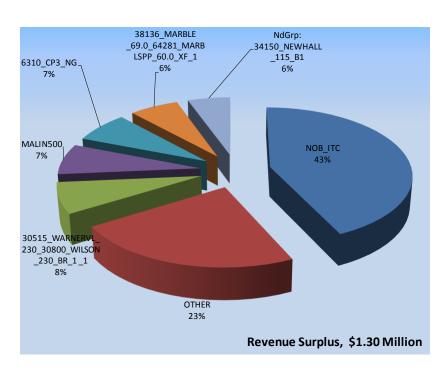

Overall, the total amount collected from the IFM was not sufficient to cover the net payments to congestion revenue right holders and the cost of the exemption for existing rights. The revenue adequacy level was 71.45 percent in July. Out of the total congestion rents, 5.11 percent was used to cover the cost of existing right exemptions. Net total congestion revenues in July were in deficit by \$7.80 million, compared to the deficit of \$5.06 million in June. The auction revenues credited to the balancing account for July were \$8.09 million. As a result, the balancing account for July had a surplus of approximately \$0.66 million, which will be allocated to measured demand.

Table 5: CRR Revenue Adequacy Statistics

IFM Congestion Rents	\$20,555,680.67
Existing Right Exemptions	-\$1,049,938.52
Available Congestion Revenues	\$19,505,742.15
CRR Payments	\$27,300,919.61
CRR Revenue Adequacy	-\$7,795,177.46
Revenue Adequacy Ratio	71.45%
Annual Auction Revenues	\$3,491,804.63
Monthly Auction Revenues	\$4,601,454.97
CRR Settlement Rule	\$364,026.35
Allocation to Measured Demand	\$662,108.49

Ancillary Services

IFM (Day-Ahead) Average Price


Table 6 shows the monthly IFM average ancillary service procurements and the monthly average prices. In July the monthly average procurement increased for regulation down, spinning and non-spinning reserves

Table 6: IFM (Day-Ahead) Monthly Average Ancillary Service Procurement

Average Procurred		Average Price						
	Reg Up	Reg Dn	Spinning	Non-Spinning	Reg Up	Reg Dn	Spinning	Non-Spinning
Jul-17	310	319	1037	1037	\$8.82	\$3.79	\$6.57	\$1.09
Jun-17	310	317	947	944	\$13.09	\$5.95	\$10.96	\$3.44
Percent Change	0.01%	0.61%	9.60%	9.86%	-32.64%	-36.21%	-40.02%	-68.26%

The monthly average prices increased for all four types of ancillary services in July. Figure 11 shows the daily IFM average ancillary service prices. The average prices were relatively stable in July.


Figure 11: IFM (Day-Ahead) Ancillary Service Average Price

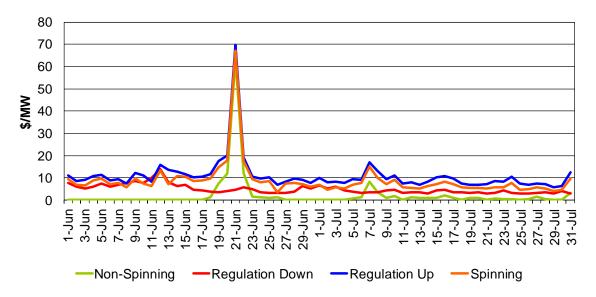

Ancillary Service Cost to Load

The monthly average cost to load decreased to \$0.43/MWh in July from \$0.85/MWh in June.

Figure 12: System (Day-Ahead and Real-Time) Average Cost to Load

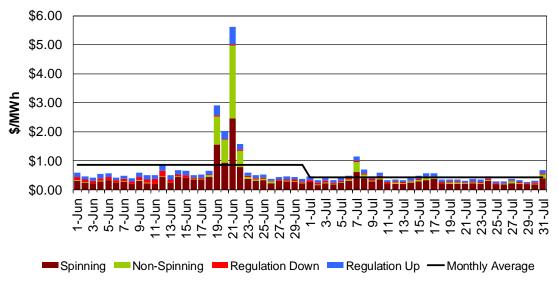

Scarcity Events

The ancillary services scarcity pricing mechanism is triggered when the ISO is not able to procure the target quantity of one or more ancillary services in the IFM and real-time market runs. There were no scarcity events in July.

Convergence Bidding

Figure 13 below shows the daily average volume of cleared virtual bids in IFM for virtual supply and virtual demand. The cleared virtual supply was well above the cleared demand in most days of July.

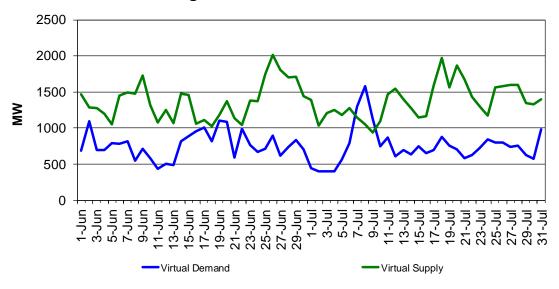


Figure 13: Cleared Virtual Bids

Convergence bidding tends to cause the day-ahead market and real-time market prices to move closer together, or "converge". Figure 14 shows the energy prices (namely the energy component of the LMP) in IFM, hour ahead scheduling process (HASP), FMM, and RTD.

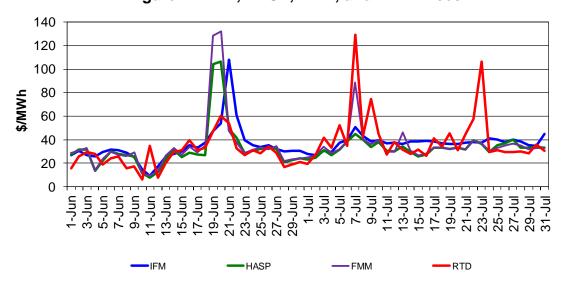


Figure 14: IFM, HASP, FMM, and RTD Prices

Figure 15 shows the profits that convergence bidders receive from convergence bidding. The total profits from convergence bidding fell to \$1.75 million in July from \$2.52 million in June.

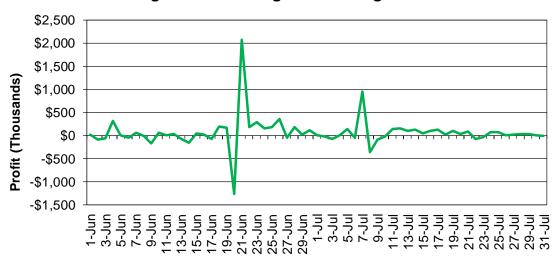


Figure 15: Convergence Bidding Profits

Renewable Generation Curtailment

Figure 16 below shows the monthly wind and solar VERs (variable energy resource) curtailment due to system wide condition or local congestion in RTD. Figure 17 shows the monthly wind and solar VERs (variable energy resource) curtailment by resource type in RTD. Economic curtailment is defined as the resource's dispatch upper limit minus its RTD schedule when the resource has an economic bid. Dispatch upper limit is the maximum level the resource can be dispatched to when various factors are take into account such as forecast, maximum economic bid, generation outage, and ramping capacity. Self-schedule curtailment is defined as the resource's self-schedule minus its RTD schedule when RTD schedule is lower than self-schedule. When a VER resource is exceptionally dispatched, then exceptional dispatch curtailment is defined as the dispatch upper limit minus the exceptional dispatch value.

As Figure 16 and Figure 17 below indicate, the renewable curtailment continued to decrease in July. The majority of the curtailments was economic.


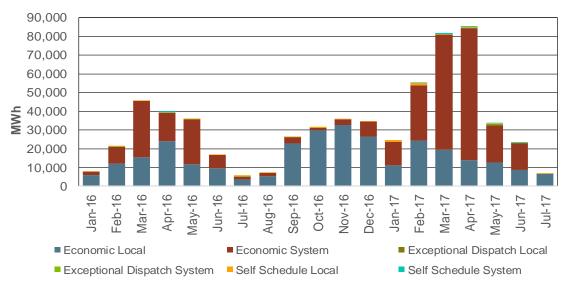


Figure 16: Renewable Curtailment by Reason



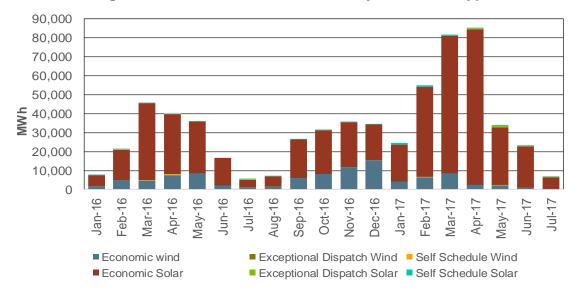

Flexible Ramping Product

On November 1, 2016 the ISO implemented two market products in the 15-minute and 5-minute markets: Flexible Ramping Up and Flexible Ramping Down uncertainty awards. These products provide additional upward and downward flexible ramping capability to account for uncertainty due to demand and renewable forecasting errors. In addition, the existing flexible ramping sufficiency test was extended to ensure feasible ramping capacity for real-time interchange schedules.

Flexible Ramping Product Payment

Figure 18 shows the flexible ramping up and down uncertainty payments. Flexible ramping up uncertainty payment edged down to \$0.82 million in July from \$0.85 Million in June. Flexible ramping down uncertainty payment dropped to \$445 in July from \$0.05 Million in June.

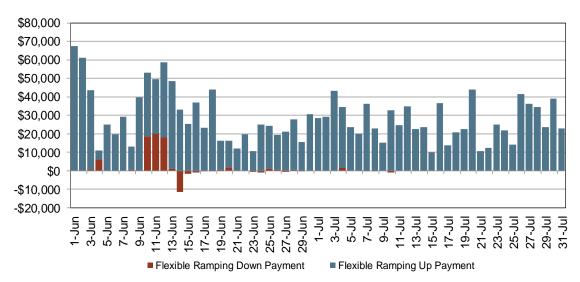


Figure 18: Flexible Ramping Up/down Uncertainty Payment

Figure 19 shows the flexible ramping forecast payment. Flexible ramping forecast payment rose to \$0.28 million this month from \$0.25 million in June.

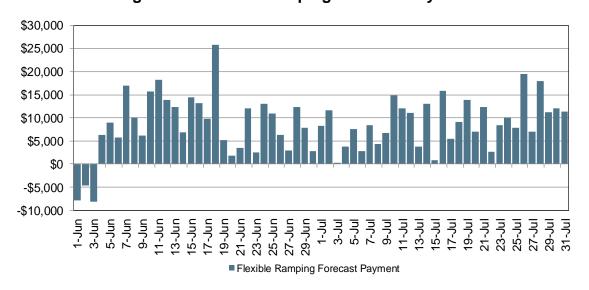


Figure 19: Flexible Ramping Forecast Payment

Indirect Market Performance Metrics Bid Cost Recovery

Figure 20 shows the daily uplift costs due to exceptional dispatch payments. The monthly uplift costs in July decreased to \$0.39 million from \$0.56 million in June.

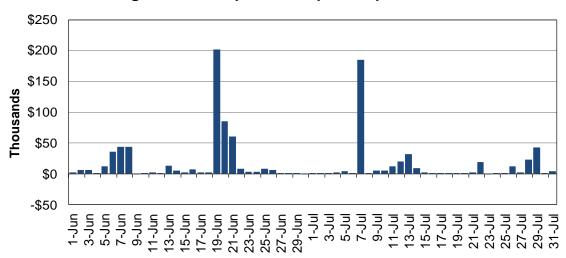


Figure 20: Exceptional Dispatch Uplift Costs

Figure 21 shows the allocation of bid cost recovery payment in the IFM, residual unit commitment (RUC) and RTM markets. The total bid cost recovery for July rose to \$11.11 million from \$8.53 million in June. Out of the total monthly bid cost recovery payment for the three markets in July, the IFM market contributed 7 percent, RTM contributed 73 percent, and RUC contributed 20 percent of the total bid cost recovery payment.

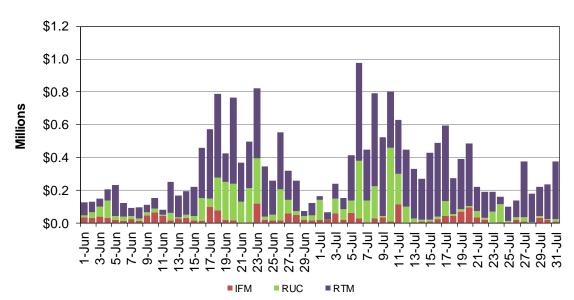


Figure 21: Bid Cost Recovery Allocation

Figure 22 and Figure 23 show the daily and monthly BCR cost by local capacity requirement area (LCR) respectively.

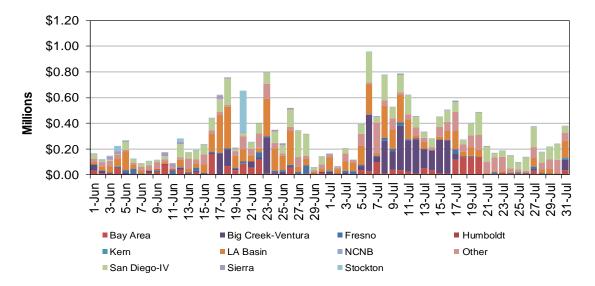


Figure 22: Bid Cost Recovery Allocation by LCR

\$3.0 \$2.5 \$2.0 \$1.5 \$1.0 \$0.5 \$0.0 -\$0.5 Bay Area LA Basin NCNB Stockton Bay Area Humboldt Big Creek-Ventura Ken Sierra Kem NCNB Other San Diego-IV Big Creek-Ventura LA Basin San Diego-IV Humboldt Jul-17 Jun-17 ■ RTM ■ IFM RUC

Figure 23: Monthly Bid Cost Recovery Allocation by LCR

Figure 24 and Figure 25 show the daily and monthly BCR cost by utility distribution company (UDC) respectively.

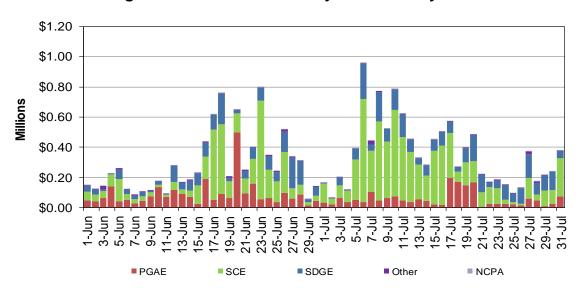


Figure 24: Bid Cost Recovery Allocation by UDC

\$7.0 \$6.0 \$5.0 \$4.0 \$3.0 \$2.0 \$1.0 \$0.0 -\$1.0 NCPA PGAE PGAE Other SCE SDGE NCPA SCE Other SDGE

Figure 25: Monthly Bid Cost Recovery Allocation by UDC

Figure 26 shows the cost related to BCR by cost type in RUC, which in July was mainly driven by minimum load cost (MLC) and start-up cost (SUC).

RUC

■ RTM

Jul-17

Jun-17

■ IFM

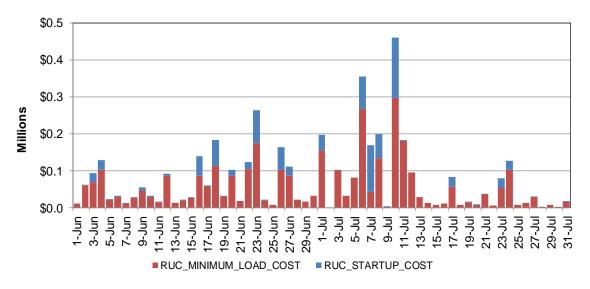


Figure 26: Cost in RUC

Figure 27 and Figure 28 show the daily and monthly cost related to BCR by type and LCR in RUC respectively.

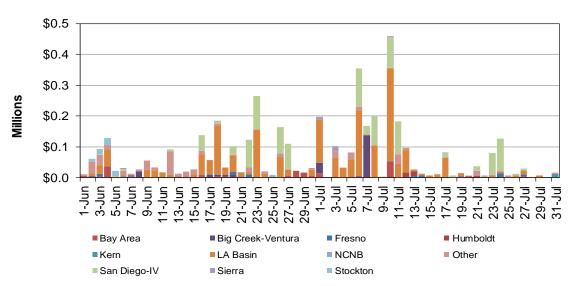


Figure 27: Cost in RUC by LCR



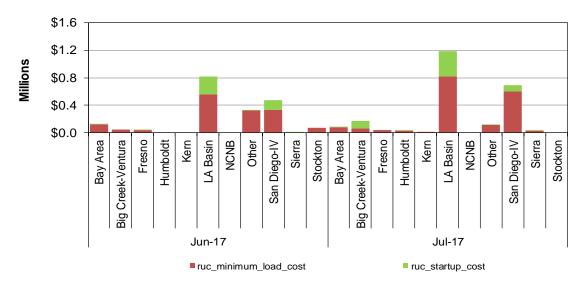


Figure 29 and Figure 30 show the daily and monthly cost related to BCR by type and UDC in RUC respectively.

Figure 29: Cost in RUC by UDC



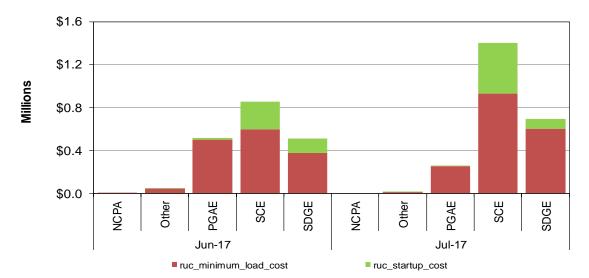


Figure 31 shows the cost related to BCR in real time by cost type. Minimum load cost and energy cost contributed mostly to the real time cost in July.

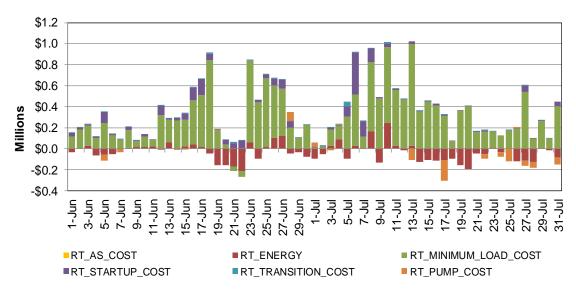


Figure 31: Cost in Real Time

Figure 32 and Figure 33 show the daily and monthly cost related to BCR by type and LCR in real time respectively.

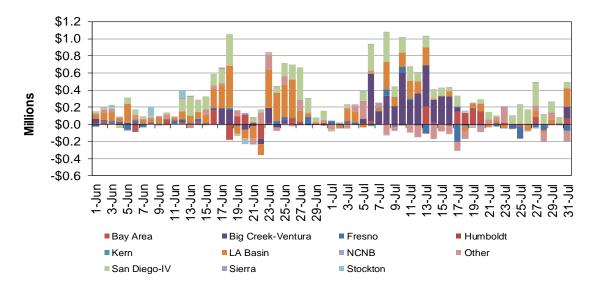


Figure 32: Cost in Real Time by LCR

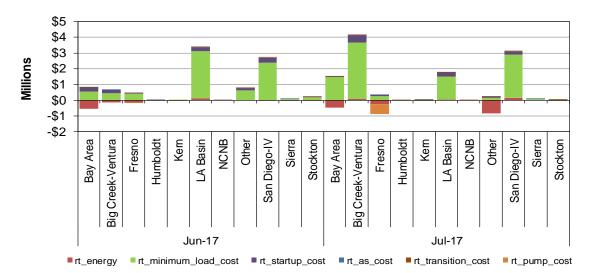


Figure 33: Monthly Cost in Real Time by LCR

Figure 34 and Figure 35 show the daily and monthly cost related to BCR by type and UDC in Real Time respectively.

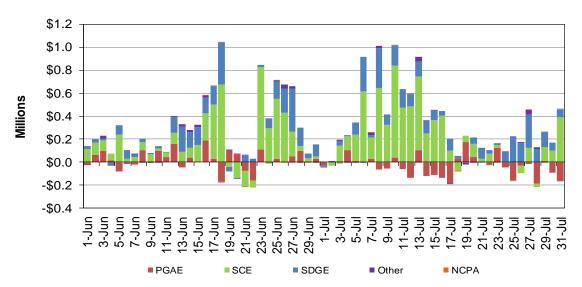


Figure 34: Cost in Real Time by UDC

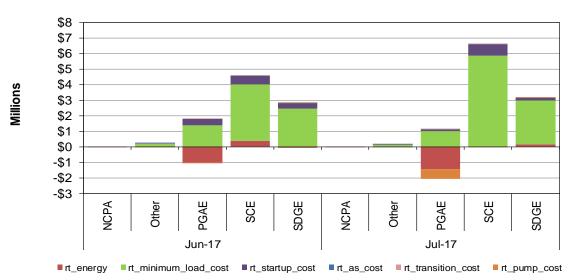


Figure 35: Monthly Cost in Real Time by UDC

Figure 36 shows the cost related to BCR in IFM by cost type. Minimum Load cost and energy cost contributed largely to the cost in IFM in July.

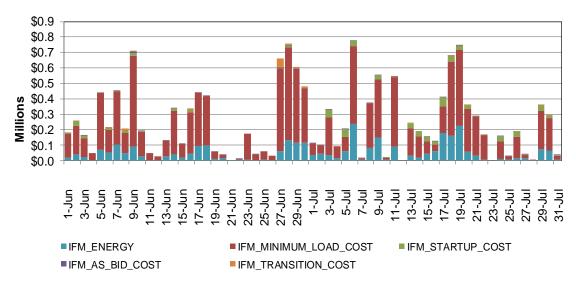


Figure 36: Cost in IFM

Figure 37 and Figure 38 show the daily and monthly cost related to BCR by type and location in IFM respectively.

Figure 37: Cost in IFM by LCR

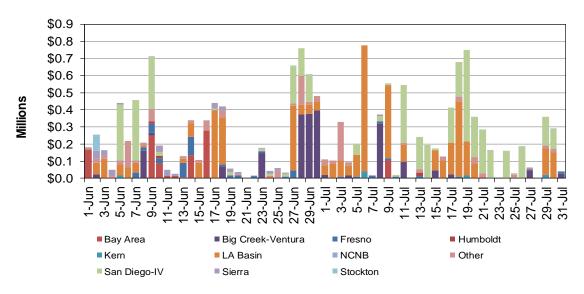


Figure 38: Monthly Cost in IFM by LCR

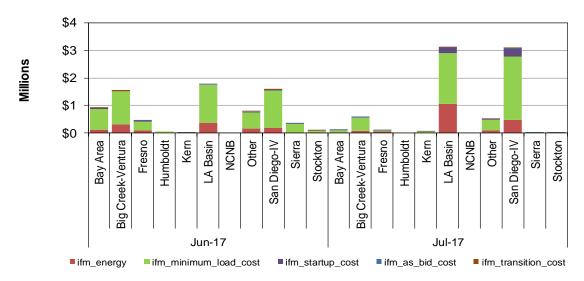


Figure 39 and Figure 40 show the daily and monthly cost related to BCR by type and UDC in IFM respectively.

\$0.9 \$0.8 \$0.7 \$0.6 \$0.5 \$0.4 \$0.3 \$0.2 \$0.1

Figure 39: Cost in IFM by UDC




SDGE

Other

■ NCPA

■ PGAE

SCE

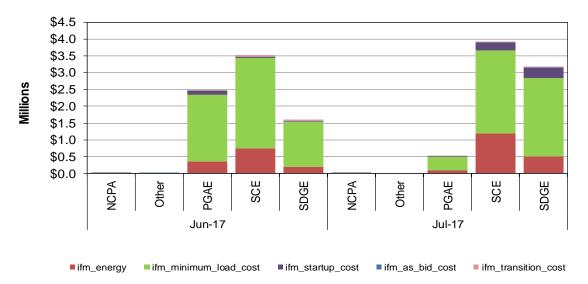

Real-time Imbalance Offset Costs

Figure 41 shows the daily real-time energy and congestion imbalance offset costs. Real-time energy offset cost dropped to \$0.08 million in July from \$4.96 million in June. Real-time congestion offset cost decreased to \$3.64 million in July from \$4.54 million in June.

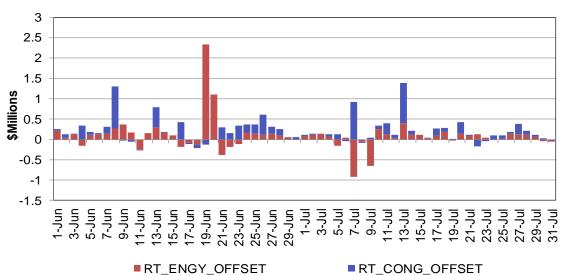


Figure 41: Real-Time Energy and Congestion Imbalance Offset

Market Software Metrics

Market performance can be confounded by software issues, which vary in severity levels with the failure of a market run being the most severe.

Market Disruption

A market disruption is an action or event that causes a failure of an ISO market, related to system operation issues or system emergencies.³ Pursuant to section 7.7.15 of the ISO tariff, the ISO can take one or more of a number of specified actions to prevent a market disruption, or to minimize the extent of a market disruption.

There were a total of 37 market disruptions in July. Table 7 lists the number of market disruptions and the number of times that the ISO removed bids (including self-schedules) in any of the following markets in this month. The ISO markets include IFM, RUC, FMM and RTD processes.

Table 7: Summary of Market Disruption

Type of CAISO Market	Market Disruption or Reportable	Removal of Bids (including Self-Schedules)
Day-Ahead		
IFM	0	0
RUC	0	0
Real-Time		
FMM Interval 1	3	0
FMM Interval 2	1	0
FMM Interval 3	1	0
FMM Interval 4	5	0
Real-Time Dispatch	27	0

Figure 42 shows the frequency of IFM, HASP (FMM interval 2), FMM (intervals 1, 3 and 4), and RTD failures. On July 12, four RTD, two FMM and one HASP disruptions occurred due to application not being running. There was one other RTD disruption on that day due to results being blocked.

³ These system operation issues or system emergencies are referred to in Sections 7.6 and 7.7, respectively, of the ISO tariff.

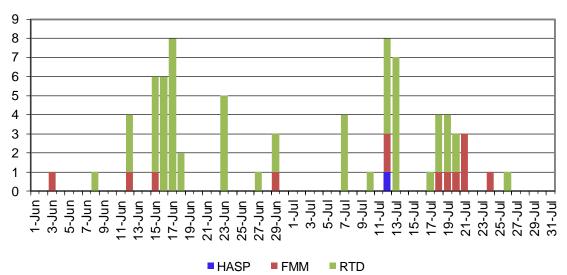


Figure 42: Frequency of Market Disruption

Manual Market Adjustment

Exceptional Dispatch

Figure 43 shows the daily volume of exceptional dispatches, broken out by market type: day-ahead, real-time incremental dispatch and real-time decremental dispatch. Generally, all day-ahead exceptional dispatches are unit commitments at the resource physical minimum. The real-time exceptional dispatches are among one of the following types: a unit commitment at physical minimum; an incremental dispatch above the day-ahead schedule and a decremental dispatch below the day-ahead schedule.

The total volume of exceptional dispatch in July increased to 94,578 MWh from 80,854 MWh in June.

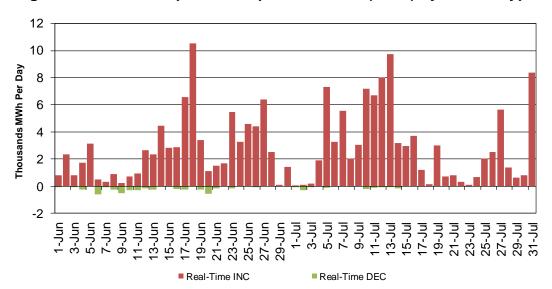


Figure 43: Total Exceptional Dispatch Volume (MWh) by Market Type

_

Figure 44 shows the volume of the exceptional dispatch broken out by reason.⁴ The majority of the exceptional dispatch volumes in July were driven by load forecast uncertainty (76 percent), planned transmission outage and constraint (9 percent), and load pull (5 percent).

⁴ For details regarding the reasons for exceptional dispatch please read the white paper at this link: http://www.caiso.com/1c89/1c89d76950e00.html.

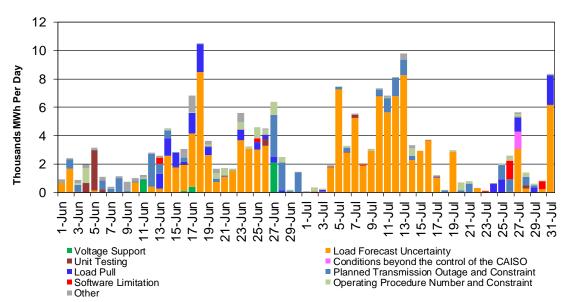


Figure 44: Total Exceptional Dispatch Volume (MWh) by Reason

Figure 45 shows the total exceptional dispatch volume as a percent of load, along with the monthly average. The monthly average percentage edged down to 0.40 percent in July from 0.42 percent in June.

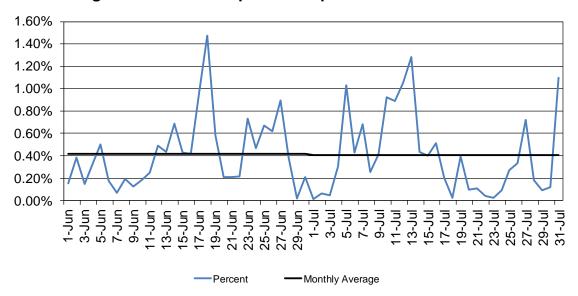


Figure 45: Total Exceptional Dispatch as Percent of Load

Energy Imbalance Market

On November 1, 2014, the California Independent System Operator Corporation (ISO) and Portland-based PacifiCorp fully activated the Energy Imbalance Market (EIM). This real-time market is the first of its kind in the West. EIM covers six western states: California, Oregon, Washington, Utah, Idaho and Wyoming.

On December 1, 2015, NV Energy, the Nevada-based utility successfully began participating in the western Energy Imbalance Market (EIM). With the addition of NV Energy, the EIM expands into Nevada, where the utility serves 2.4 million customers. The ISO real-time market is now in seven states, saving millions of dollars for consumers. The newly expanded marketplace enables the ISO and participants to incorporate thousands of megawatts of variable generating resources, such as wind and solar, into the power grid while reducing greenhouse emissions, and improving grid resiliency and reliability.

On October 1, 2016, Phoenix-based Arizona Public Service (AZPS) and Puget Sound Energy (PSEI) of Washington State successfully began full participation in the western Energy Imbalance Market. With the addition of Arizona Public Service and Puget Sound Energy, The EIM is serving over 5 million consumers in California, Washington, Oregon, Arizona, Idaho, Wyoming, Nevada and Utah.

Figure 46 shows daily simple average ELAP prices for PacifiCorp east (PACE), PacifiCorp West (PACW), NV Energy (NEVP), Arizona Public Service (AZPS) and Puget Sound Energy (PSEI) for all hours in FMM. The prices were relatively stable this month compared with June.

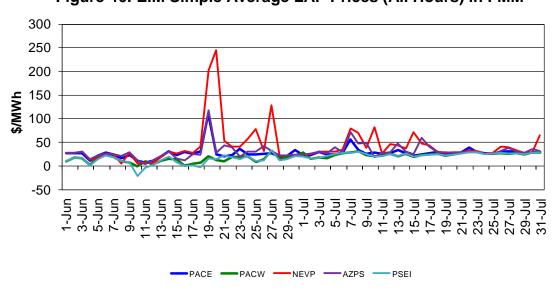


Figure 46: EIM Simple Average LAP Prices (All Hours) in FMM

Figure 47 shows daily simple average ELAP prices for PACE, PACW, NEVP, AZPS and PSEI for all hours in RTD.

Figure 47: EIM Simple Average LAP Prices (All Hours) in RTD

Figure 48 shows the daily price frequency for prices above \$250/MWh and negative prices in FMM for PACE, PACW, NEVP, AZPS and PSEI. The cumulative frequency of prices above \$250/MWh decreased to 1.07 percent in July from 1.17 percent in June. The cumulative frequency of negative prices skidded to 0.26 percent in July from 12.39 percent in June.



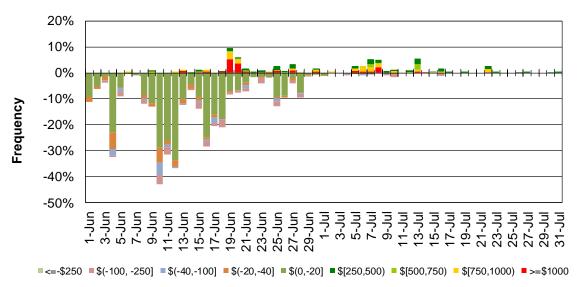


Figure 49 shows the daily price frequency for prices above \$250/MWh and negative prices in RTD for PACE, PACW, NEVP, AZPS and PSEI. The cumulative frequency of prices above \$250/MWh increased to 1.42 percent in July from to 0.88 percent in June. The cumulative frequency of negative prices dropped to 0.54 percent in July from 12.63 percent in June.

Figure 49: Daily Frequency of EIM LAP Positive Price Spikes and Negative Prices in RTD

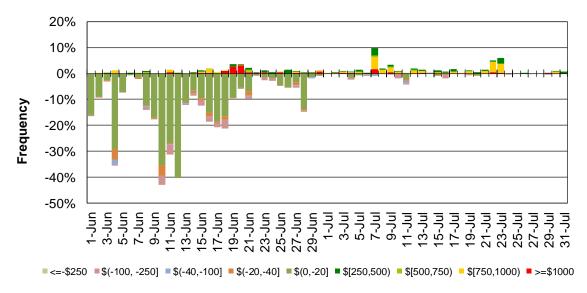


Figure 50 shows the daily volume of EIM transfer between ISO and PacifiCorp in FMM. The EIM transfer from PACW to CAISO rose in July compared with June. Figure 51 shows the daily volume of EIM transfer between PACE and PACW in FMM.

Figure 50: EIM Transfer between CAISO and PAC in FMM

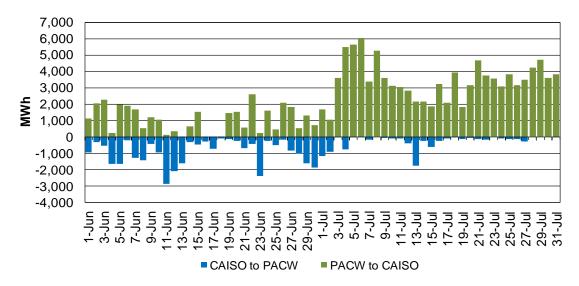


Figure 51: EIM Transfer between PACE and PACW in FMM

Figure 52 shows the daily volume of EIM transfer between CAISO and NEVP in FMM. The EIM transfer from CAISO to NEVP dropped in July compared with June. Figure 53 shows the daily volume of EIM transfer between PACE and NEVP in FMM. The EIM transfer from PACE to NEVP decreased generally in July.

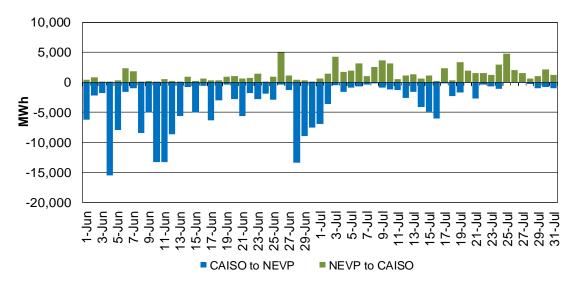


Figure 52: EIM Transfer between CAISO and NEVP in FMM

12,000 10,000 8,000 6,000 4,000 2,000 0 -2,000 -4,000 ■ NEVP to PACE ■ PACE to NEVP

Figure 53: EIM Transfer between PACE and NEVP in FMM

Figure 54 shows the daily volume of EIM transfer between ISO and AZPS in FMM. Figure 55 shows the daily volume of EIM transfer between PACE and AZPS in FMM.

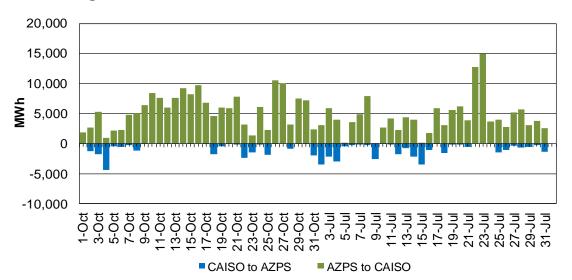


Figure 54: EIM Transfer between CAISO and AZPS in FMM

12,000 10,000 8,000 6,000 4,000 2,000 0 -2,000 -4,000 -6,000 -8,000 AZPS to PACE ■ PACE to AZPS

Figure 55: EIM Transfer between PACE and AZPS in FMM

Figure 56 shows the daily volume of EIM transfer between PACW and PSEI in FMM.

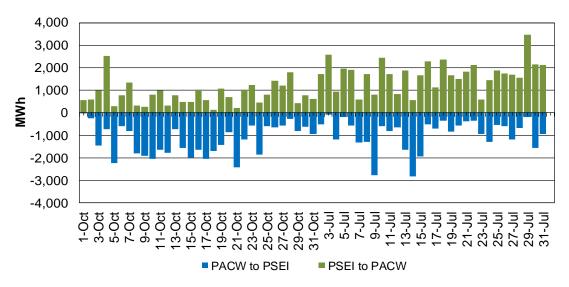


Figure 56: EIM Transfer between PACW and PSEI in FMM

Figure 57 shows the daily volume of EIM transfer between ISO and PacifiCorp in RTD. The EIM transfer from PACW to CAISO rose in July compared with June. Figure 58 shows the daily volume of EIM transfer between PACE and PACW in RTD.

8,000
4,000
2,000
-4,000
-4,000
-6,000

CAISO to PACW PACW to CAISO

Figure 57: EIM Transfer between CAISO and PAC in RTD



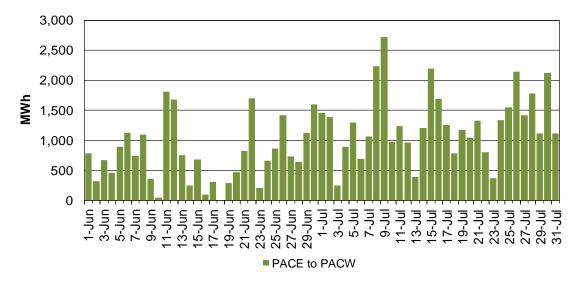


Figure 59 shows the daily EIM transfer volume between ISO and NEVP in RTD. Figure 60 shows the daily EIM transfer volume between PACE and NEVP in RTD. The EIM transfer from PACE to NEVP trended downward in July.

10,000
5,000
0
-5,000
-15,000
-20,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-25,000
-26,000
-27,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000
-28,000

Figure 59: EIM Transfer between CAISO and NEVP in RTD



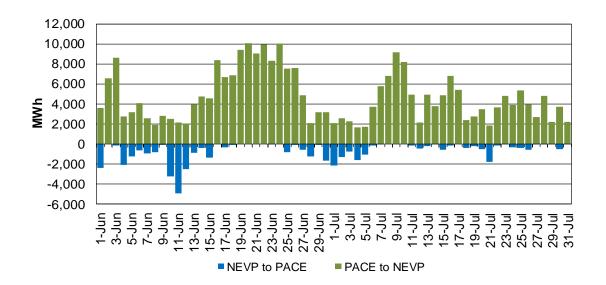


Figure 61 shows the daily volume EIM transfer between the ISO and AZPS in RTD. Figure 62 shows the daily volume EIM transfer between the PACE and AZPS in RTD.

Figure 61: EIM Transfer between CAISO and AZPS in RTD

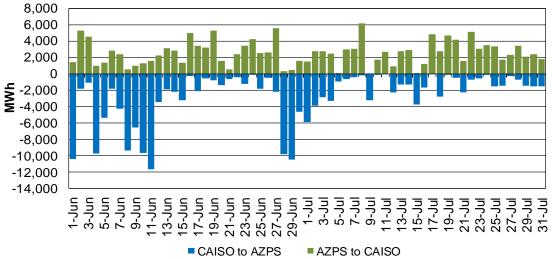


Figure 62: EIM Transfer between PACE and AZPS in RTD

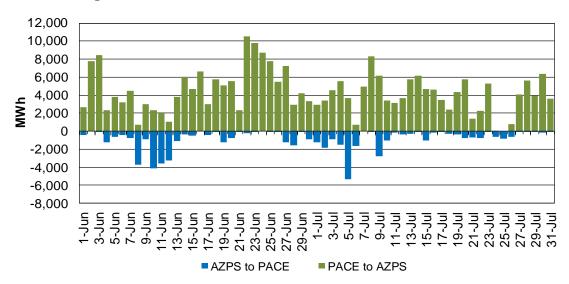


Figure 63 shows the daily volume EIM transfer between PACW and PSEI in RTD.

4,000
3,000
2,000
1,000
-1,000
-2,000
-3,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-2,000
-4,000
-2,000
-3,000
-4,000
-2,000
-3,000
-4,000
-2,000
-3,000
-4,000
-2,000
-3,000
-4,000
-2,000
-3,000
-4,000
-4,000
-2,000
-3,000
-4,000
-4,000
-2,000
-3,000
-3,000
-4,000
-4,000
-4,000
-2,000
-3,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000
-4,000

Figure 63: EIM Transfer between PACW and PSEI in RTD

Figure 64 shows daily real-time imbalance energy offset cost (RTIEO) for PACE, PACW, NEVP, AZPS and PSEI respectively. Total RTIEO was -\$6.66 million in July, decreasing from -\$2.20 million in June.

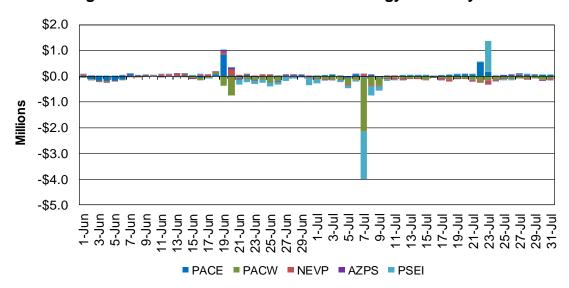


Figure 64: EIM Real-Time Imbalance Energy Offset by Area

Figure 65 shows daily real-time congestion offset cost (RTCO) for PACE, PACW, NEVP, AZPS and PSEI respectively. Total RTCO rose to -\$1.40 million in July from -\$4.68 million in June.

\$1.0 \$0.5 \$0.0 \$1.5 \$2.0 \$2.7 \$2.7 \$2.7 \$3.7 \$1.6 \$3.7 \$1.7 \$3.7 \$1.9 \$1.9 \$3.7 \$1.9 \$3.7 \$1.9 \$3.7 \$1.9 \$3.7 \$1.9 \$3.7

Figure 65: EIM Real-Time Congestion Imbalance Offset by Area

Figure 66 shows daily bid cost recovery for PACE, PACW, NEVP, AZPS and PSEI respectively. Total BCR edged down to \$0.73 million in July from \$0.74 million in June.

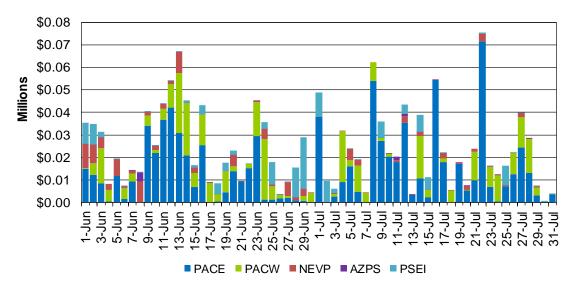


Figure 66: EIM Bid Cost Recovery by Area

Figure 67 shows the flexible ramping up uncertainty payment for PACE, PACW, NEVP, AZPS, and PSEI respectively. Total flexible ramping up uncertainty payment in July inched up to \$0.75 million from \$0.63 million in June.

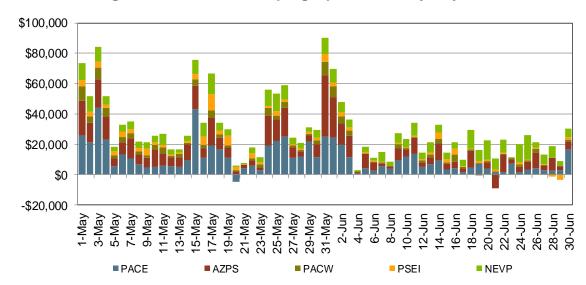


Figure 67: Flexible Ramping Up Uncertainty Payment

Figure 68 shows the flexible ramping down uncertainty payment for PACE, PACW, NEVP, AZPS, and PSEI respectively. Total flexible ramping down uncertainty payment in July decreased to -\$0.01 million from \$0.03 million in June.

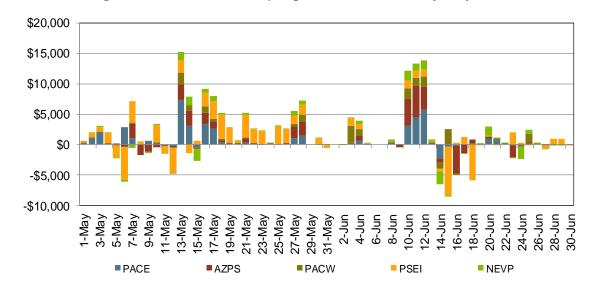


Figure 68: Flexible Ramping Down Uncertainty Payment

Figure 69 shows the flexible ramping forecast payment for PACE, PACW, NEVP, AZPS, and PSEI respectively. Total forecast payment in July increased to \$0.64 million from \$0.49 million in June.

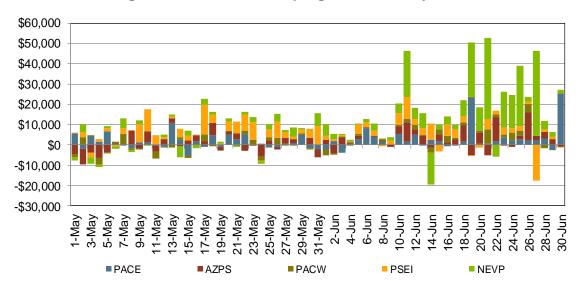


Figure 69: Flexible Ramping Forecast Payment

The ISO's Energy Imbalance Market Business Practice Manual⁵ describes the methodology for determining whether an EIM participating resource is dispatched to support transfers to serve California load. The methodology ensures that the dispatch considers the combined energy and associated marginal greenhouse gas (GHG) compliance cost based on submitted bids⁶.

In the first two months of EIM operations (November and December 2014), EIM startup issues related to processing GHG bid adder resulted in the dispatch of coal generation to support transfers into California. Once the adders were properly accounted for, beginning in July 2015, almost all of the EIM dispatches to support transfers into the ISO were from resources other than coal, as documented in Figure 70 and Table 8 below.

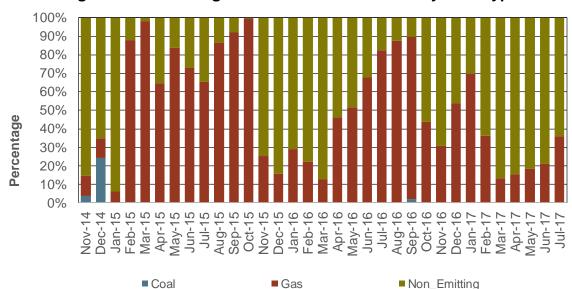


Figure 70: Percentage of EIM Transfer into ISO by Fuel Type

⁵ See the Energy Imbalance Market Business Practice Manual for a description of the methodology for making this determination, which begins on page 42 -- http://bpmcm.caiso.com/Pages/BPMDetails.aspx?BPM=Energy Imbalance Market.

⁶ A submitted bid July reflect that a resource is not available to support EIM transfers to California.

Table 8: EIM Transfer into ISO by Fuel Type

Month	Coal (%)	Gas (%)	Non-Emitting (%)	Total
Nov-14	3.66%	11.12%	85.22%	100%
Dec-14	24.18%	10.78%	65.04%	100%
Jan-15	0.07%	6.22%	93.71%	100%
Feb-15	0.32%	87.72%	11.96%	100%
Mar-15	0.48%	97.94%	1.58%	100%
Apr-15	0.12%	64.56%	35.32%	100%
May-15	0.00%	83.83%	16.17%	100%
Jun-15	0.00%	72.88%	27.12%	100%
Jul-15	0.00%	65.41%	34.59%	100%
Aug-15	0.02%	86.51%	13.48%	100%
Sep-15	0.00%	92.13%	7.87%	100%
Oct-15	0.10%	99.70%	0.20%	100%
Nov-15	0.00%	25.25%	74.75%	100%
Dec-15	0.00%	15.79%	84.21%	100%
Jan-16	0.00%	28.96%	71.04%	100%
Feb-16	0.00%	22.21%	77.79%	100%
Mar-16	0.00%	12.72%	87.28%	100%
Apr-16	0.00%	46.26%	53.74%	100%
May-16	0.00%	51.63%	48.37%	100%
Jun-16	0.00%	67.89%	32.11%	100%
Jul-16	0.00%	82.42%	17.58%	100%
Aug-16	0.00%	87.59%	12.41%	100%
Sep-16	1.98%	87.68%	10.34%	100%
Oct-16	0.00%	43.82%	56.18%	100%
Nov-16	0.00%	30.74%	69.26%	100%
Dec-16	0.00%	53.77%	46.23%	100%
Jan-17	0.00%	69.88%	30.12%	100%
Feb-17	0.00%	36.42%	63.58%	100%
Mar-17	0.00%	13.37%	86.63%	100%
Apr-17	0.00%	15.47%	84.53%	100%
May-17	0.00%	18.47%	81.53%	100%
Jun-17	0.00%	21.33%	78.67%	100%
Jul-17	0.00%	36.08%	63.92%	100%