

Wind and Solar Curtailment June 17, 2022

This report is produced daily to provide a detailed accounting of the wind and solar renewable generation that was curtailed and the reasons why¹. This report should be read in the context of the Renewables Watch report for a more complete understanding of both renewable curtailment and generation².

Wind and solar curtailments are grouped into the following categories:

- 1. Economic Local: Market dispatch of generators with economic bids to mitigate local congestion³.
- Economic System: Market dispatch of generators with economic bids to mitigate systemwide oversupply.
- 3. SelfSchCut Local: Market dispatch of self-schedules to mitigate local congestion.
- 4. SelfSchCut System: Market dispatch of self-schedules to mitigate system-wide oversupply.
- 5. ExDispatch Local: Exceptional dispatch to mitigate local congestion.
- 6. ExDispatch System: Exceptional dispatch to mitigate system-wide oversupply.

Note: Amounts smaller than 1 MW are filtered out for simplicity. Such small curtailments are occasionally observed when forecasts are lower than Pmin when market will de-commit the unit and send the 0 MW dispatch.

¹Only wind and solar resources can be reported in this manner because these resources have a forecast. Curtailment is defined as the difference between actual production and the forecast when actual production is less than the forecast.


²The Renewables Watch report provides daily actual renewable production within the ISO grid. It is available at: <u>http://www.caiso.com/green/renewableswatch.html</u>.


³Congestion occurs when available, least-cost energy cannot be delivered to some loads because transmission facilities do not have sufficient capacity to deliver the energy.


For more information on oversupply conditions, please see: <u>https://www.caiso.com/Documents/FlexibleResourcesHelpRenewables_FastFacts.pdf</u>





The following charts show the daily and 7-day wind and solar curtailment by category, if any.

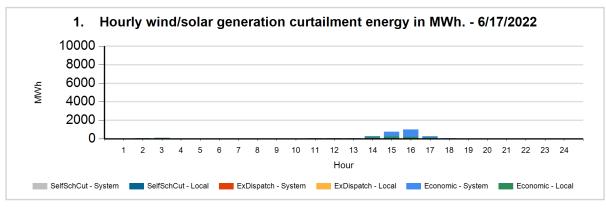

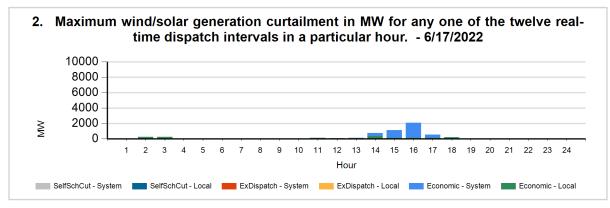

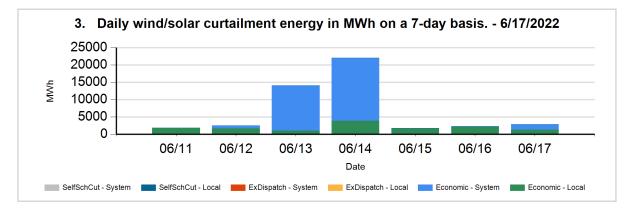




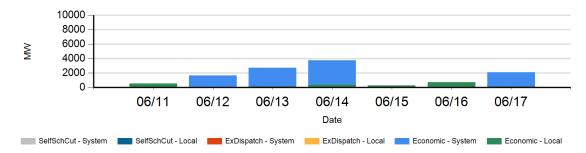




The following charts show hourly year to date wind and solar curtailment by category, if any.

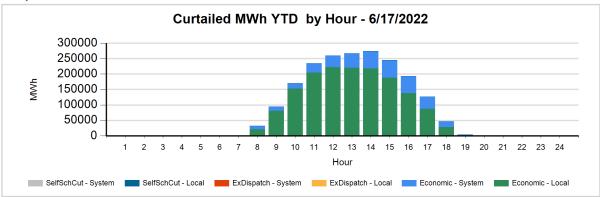

The following charts show monthly year to date wind and solar curtailment by category, if any.

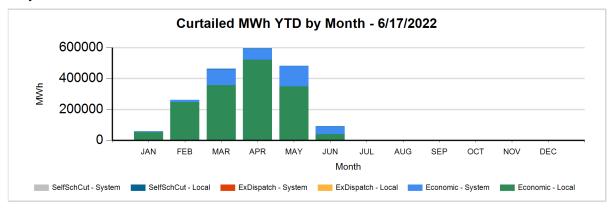

TYPE	YTD CURTAILED MWH - 6/17/2022
LocalEconomic	1,563,346
LocalSelfSchCut	5,058
SystemEconomic	382,686
TOTAL	1,951,090



Data used to produce hourly chart

DATE	HOU R	CURT TYPE	REASON	FUEL TYPE	CURTAILED MWH	CURTAILED MW
06/17	2	Economic	Local	WIND	80	248
06/17	3	Economic	Local	WIND	96	231
06/17	4	Economic	Local	WIND	13	47
06/17	7	Economic	System	SOLR	4	20
06/17	7	Economic	System	WIND	1	
06/17	8	Economic	Local	SOLR	1	10
06/17	9	Economic	Local	SOLR	1	
06/17	9	Economic	Local	WIND	14	49
06/17	9	Economic	System	SOLR	0	
06/17	10	Economic	Local	SOLR	11	38
06/17	10	Economic	System	SOLR	0	6
06/17	11	Economic	Local	SOLR	78	123
06/17	11	Economic	System	SOLR	2	
06/17	12	Economic	Local	SOLR	67	90
06/17	12	Economic	System	SOLR	2	
06/17	13	Economic	Local	SOLR	73	104
06/17	13	Economic	System	SOLR	8	29
06/17	13	Economic	System	WIND	1	
06/17	14	Economic	Local	SOLR	172	345
06/17	14	Economic	System	SOLR	98	382
06/17	14	Economic	System	WIND	5	37
06/17	14	SelfSchCut	Local	SOLR	1	
06/17	15	Economic	Local	SOLR	233	124
06/17	15	Economic	Local	WIND	8	
06/17	15	Economic	System	SOLR	494	964
06/17	15	Economic	System	WIND	36	46
06/17	16	Economic	Local	SOLR	173	106
06/17	16	Economic	Local	WIND	14	
06/17	16	Economic	System	SOLR	788	1937
06/17	16	Economic	System	WIND	24	55
06/17	17	Economic	Local	SOLR	99	82



06/17	17	Economic	Local	WIND	46	41
06/17	17	Economic	System	SOLR	111	402
06/17	17	Economic	System	WIND	2	7
06/17	18	Economic	Local	SOLR	56	188
06/17	18	Economic	Local	WIND	13	21
06/17	18	Economic	System	SOLR	0	
06/17	18	Economic	System	WIND	6	
06/17	19	Economic	Local	SOLR	13	14
06/17	19	Economic	Local	WIND	2	13
06/17	20	Economic	Local	SOLR	0	3

The information contained in this report is preliminary and subject to change without notice. No inference, decision or conclusion should be made based on the information in this report or any series of these reports. All values are hourly average unless otherwise stated. Questions about this report should be directed to Short-Term Forecasting at ShortTermForecasting@caiso.com.