

## Wind and Solar Curtailment March 18, 2017

This report is produced daily to provide a detailed accounting of the wind and solar renewable generation that was curtailed and the reasons why¹. This report should be read in the context of the Renewables Watch report for a more complete understanding of both renewable curtailment and generation².

Wind and solar curtailments are grouped into the following categories:

- 1. Economic Local: Market dispatch of generators with economic bids to mitigate local congestion<sup>3</sup>.
- Economic System: Market dispatch of generators with economic bids to mitigate systemwide oversupply⁴.
- 3. SelfSchCut Local: Market dispatch of self-schedules to mitigate local congestion.
- SelfSchCut System: Market dispatch of self-schedules to mitigate system-wide oversupply.
- 5. ExDispatch Local: Exceptional dispatch to mitigate local congestion.
- 6. ExDispatch System: Exceptional dispatch to mitigate system-wide oversupply.

Note: Amounts smaller than 1 MW are filtered out for simplicity. Such small curtailments are occasionally observed when forecasts are lower than Pmin when market will de-commit the unit and send the 0 MW dispatch.

CAISO/HZ 1 March 18, 2017

<sup>&</sup>lt;sup>1</sup>Only wind and solar resources can be reported in this manner because these resources have a forecast. Curtailment is defined as the difference between actual production and the forecast when actual production is less than the forecast.


<sup>&</sup>lt;sup>2</sup>The Renewables Watch report provides daily actual renewable production within the ISO grid. It is available at: <a href="http://www.caiso.com/green/renewableswatch.html">http://www.caiso.com/green/renewableswatch.html</a>.


<sup>&</sup>lt;sup>3</sup>Congestion occurs when available, least-cost energy cannot be delivered to some loads because transmission facilities do not have sufficient capacity to deliver the energy.


<sup>&</sup>lt;sup>4</sup>For more information on oversupply conditions, please see: https://www.caiso.com/Documents/FlexibleResourcesHelpRenewables FastFacts.pdf




The following charts show the daily and 7-day rolling wind and solar curtailment by category, if any.

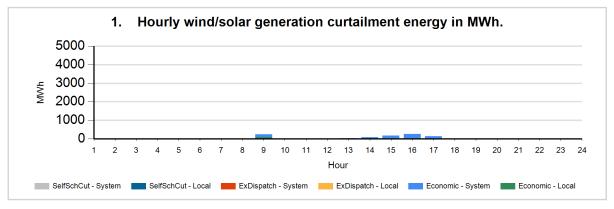

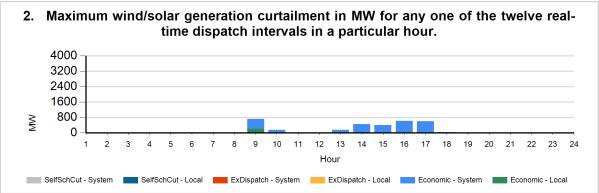

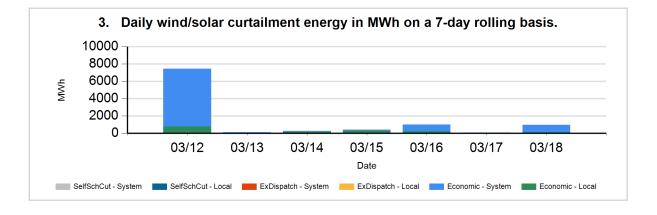

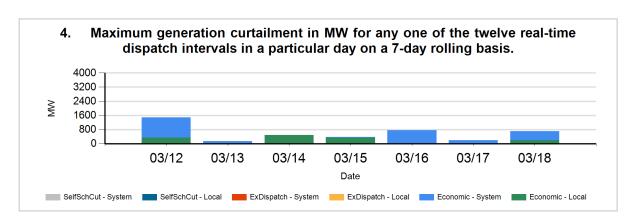

CAISO/HZ 2 March 18, 2017



Data used to produce hourly charts



URTAILED MW	CURTAILED MWH	FUEL TYPE	REASON	CURT TYPE	HOUR	DATE
	0	SOLR	Local	Economic	8	03/18
3	1	SOLR	System	Economic	8	03/18
196	73	SOLR	Local	Economic	9	03/18
8	6	WIND	Local	Economic	9	03/18
442	139	SOLR	System	Economic	9	03/18
65	23	WIND	System	Economic	9	03/18
4	7	SOLR	Local	Economic	10	03/18
7	1	WIND	Local	Economic	10	03/18
105	11	SOLR	System	Economic	10	03/18
27	2	WIND	System	Economic	10	03/18
	2	SOLR	Local	Economic	11	03/18
7	1	WIND	Local	Economic	11	03/18
15	3	SOLR	System	Economic	11	03/18
15	4	SOLR	System	Economic	12	03/18
	4	SOLR	Local	Economic	13	03/18
138	34	SOLR	System	Economic	13	03/18
9	3	WIND	System	Economic	13	03/18
9	3	SOLR	Local	Economic	14	03/18
10	1	WIND	Local	Economic	14	03/18
432	72	SOLR	System	Economic	14	03/18
4	1	WIND	System	Economic	14	03/18
	2	SOLR	Local	Economic	15	03/18
379	152	SOLR	System	Economic	15	03/18
16	16	WIND	System	Economic	15	03/18
578	217	SOLR	System	Economic	16	03/18
35	35	WIND	System	Economic	16	03/18
	3	SOLR	Local	Economic	17	03/18
535	106	SOLR	System	Economic	17	03/18
57	19	WIND	System	Economic	17	03/18
27	4	SOLR	Local	Economic	18	03/18
	1	SOLR	System	Economic	18	03/18

The information contained in this report is preliminary and subject to change without notice. No inference, decision or conclusion should be made based on the information in this report or any series of these reports. All values are hourly average unless otherwise stated. Questions about this report should be directed to Hong Zhou at hzhou@caiso.com.