



California ISO  
Shaping a Renewed Future


# Contingency Modeling Enhancements

**Third Revised Straw Proposal Discussion**

December 10, 2015

Perry Servedio

Senior Market Design & Regulatory Policy Developer

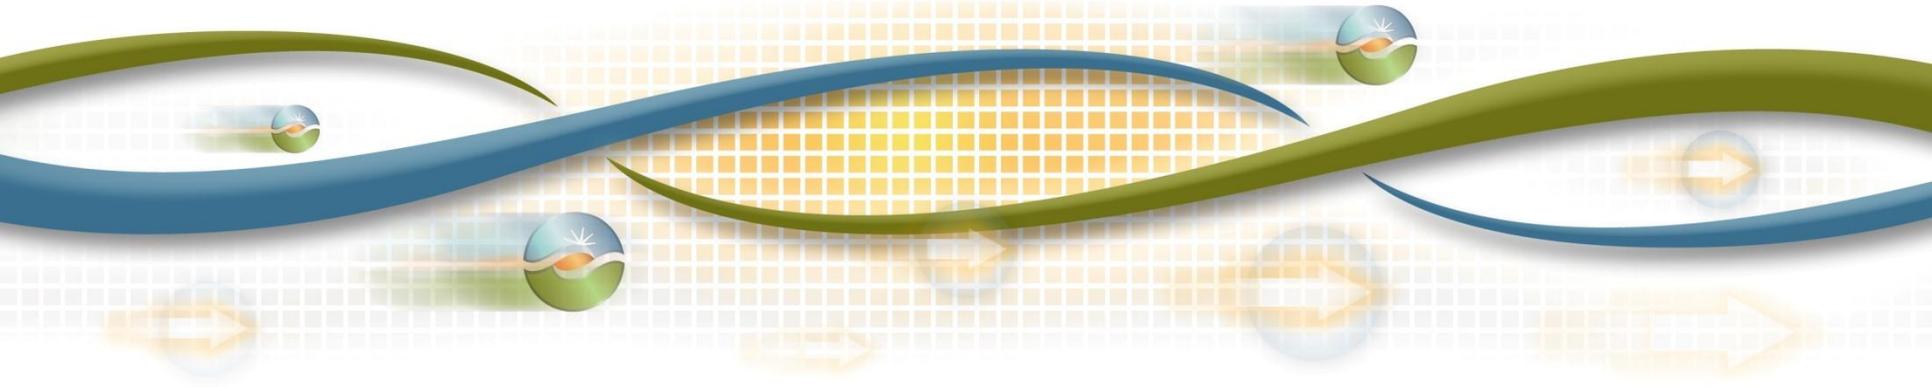


# Agenda

Time	Topic	Presenter
10:00 – 10:05	Introduction	Tom Cuccia
10:05 – 11:00	Background & Proposal	Perry Servedio
<b>Updates from second revised straw proposal</b>		
11:00 – 12:00	Congestion revenue & corrective capacity	Perry Servedio
1:00 – 2:00	CRR allocation enhancements for simultaneous feasibility	Perry Servedio
2:00 – 3:00	Settlement & no pay rules	Perry Servedio
3:00 – 3:15	Next Steps	Perry Servedio

*The meeting is scheduled to 4 p.m. in case any of the discussion items require more time*

# ISO Policy Initiative Stakeholder Process

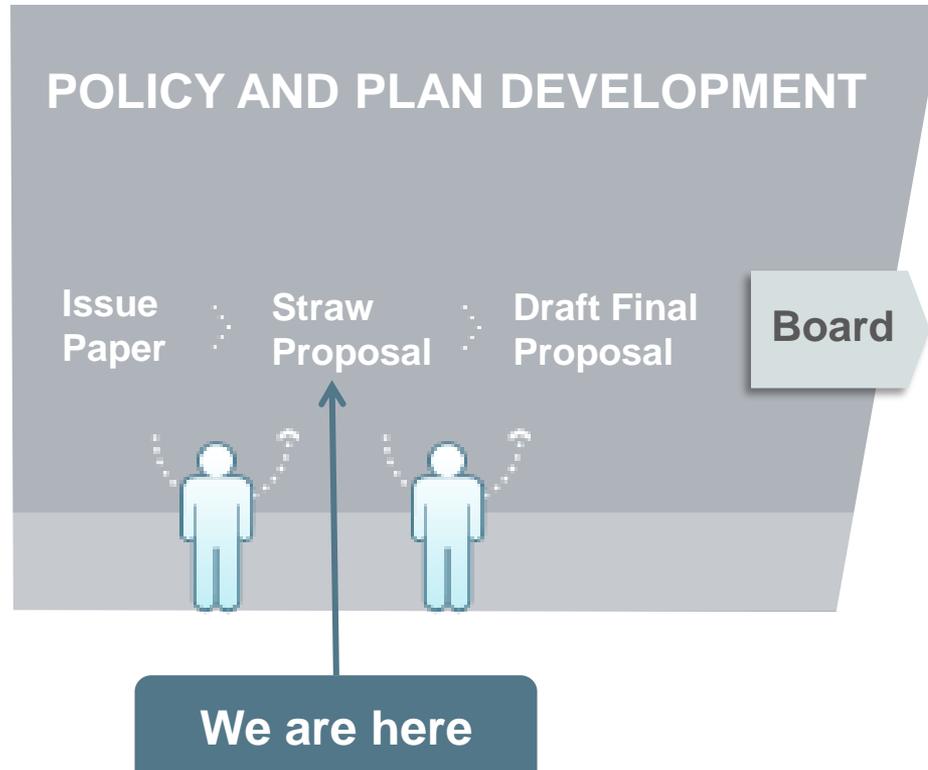

# Background

- Initiative started in early 2013
- Positions available resources so that the ISO has sufficient capability to respond to contingency events impacting critical transmission facilities and return the system to a secure state within 30 minutes.
- Enhances the LMP formulation
- Creates a Locational Marginal Capacity Price (LMCP)
- Resources are paid for reserving the capacity at the LMCP
- Stakeholders requested we build a prototype to evaluate the market impact

# Background

## Transmission feasibility


- Meet N-1 criteria
- Meet N-1-1 criteria within 30 minutes

### Today (weak preventive)

<b>Goal</b>	Achieve transmission feasible dispatch.
<b>Description</b>	<ul style="list-style-type: none"><li>• Market dispatches for N-1 security.</li><li>• ISO relies on out-of-market dispatch to achieve transmission feasibility.</li></ul>

# Background

## Today (weak preventive model)

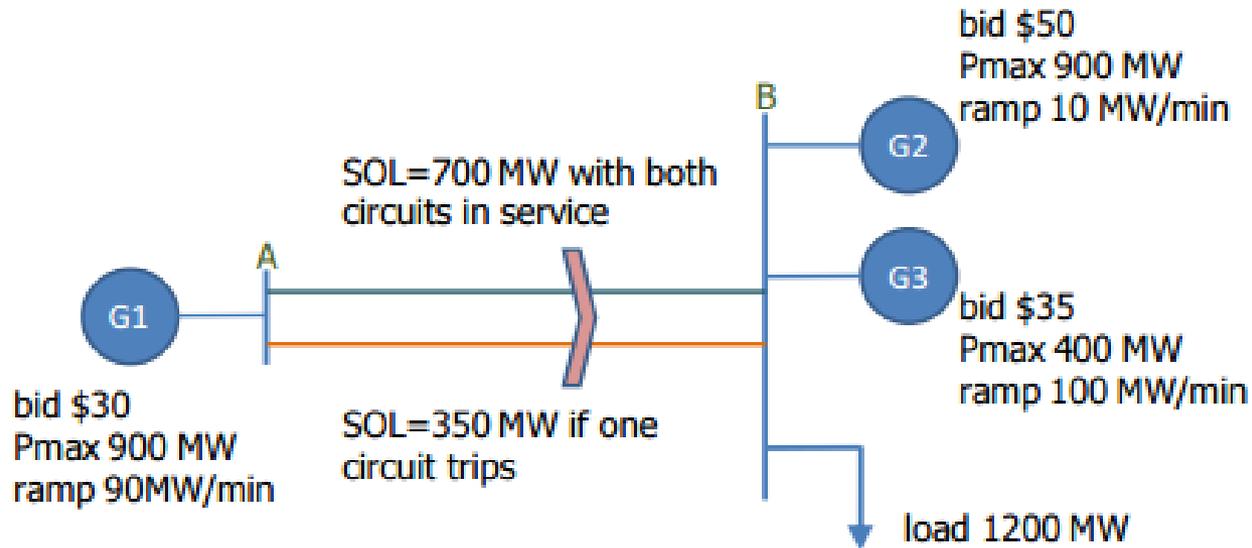

Weak-preventive model energy in base case

Generator	$P^0$	$\lambda^0$	$SF_{AB}^0$	$\mu_{AB}^0$	LMP	Bid Cost	Revenue	Profit
G1	700	\$50	1	-\$20	\$30	\$21,000	\$21,000	\$0
G2	100	\$50	0	-\$20	\$50	\$5,000	\$5,000	\$0
G3	400	\$50	0	-\$20	\$50	\$14,000	\$20,000	\$6,000

# Background

## Tomorrow

### Goal

Achieve transmission feasible dispatch without relying on exceptional dispatch/MOC.

### Option (strong preventive)

Enforce N-1-1 contingency as N-1.

- Transmission feasible.
- No longer relies on ED/MOC.
- Very restrictive.

### Option (preventive-corrective)

Preventive-corrective model with procurement of corrective capacity.

- Transmission feasible.
- No longer relies on ED/MOC.
- Maximizes use of transmission.

# What is CME?

Preventive-corrective LMP for energy dispatch at location  $i$ :

$$LMP_i = \lambda^0 + \sum_{k=0}^K \sum_{l=1}^m SF_{l,i}^k \cdot \mu_l^k + \sum_{kc=K+1}^{K+KC} \sum_{l=1}^m SF_{l,i}^{kc} \cdot \mu_l^{kc}$$


$$LMCP_i^{kc} = \lambda^{kc} + \sum_{l=1}^m SF_{l,i}^{kc} \cdot \mu_l^{kc}$$

# What is CME?

Resource paid for out-of-merit dispatch to reserve corrective capacity:


LMP = \$50

Bid = 400 MW for \$35

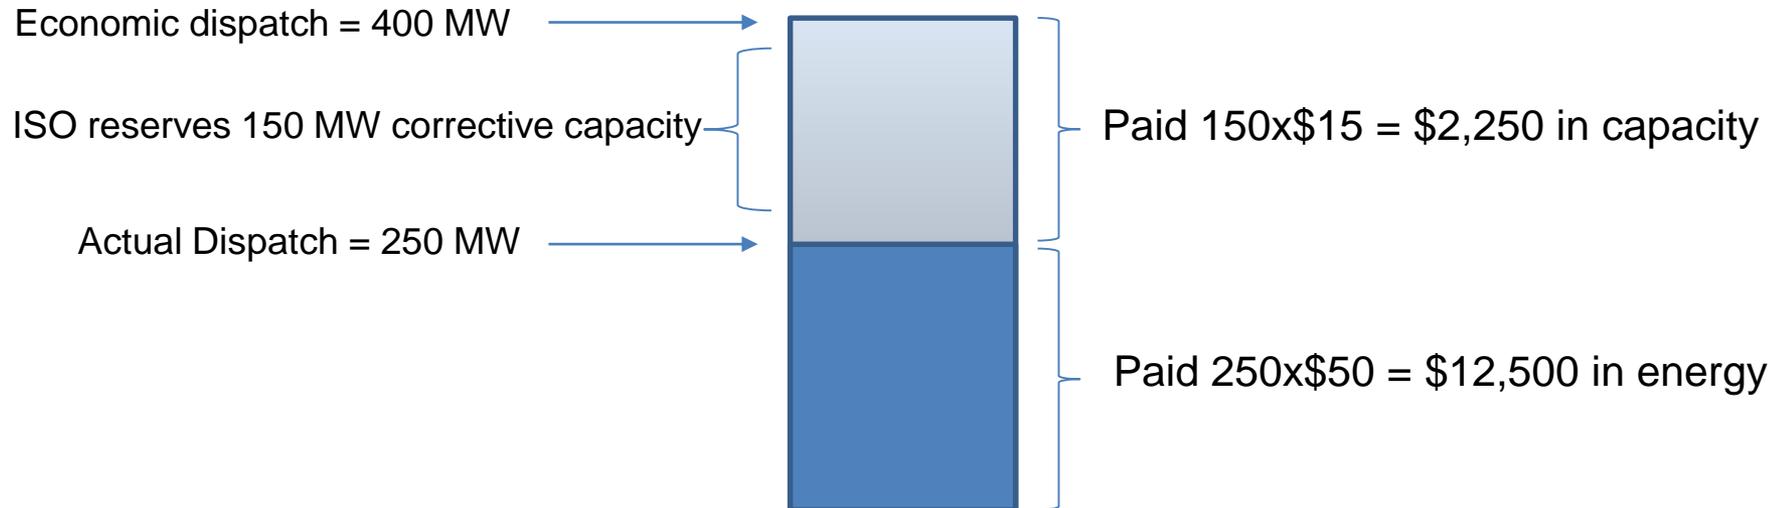

# What is CME?

## Tomorrow (preventive-corrective model)

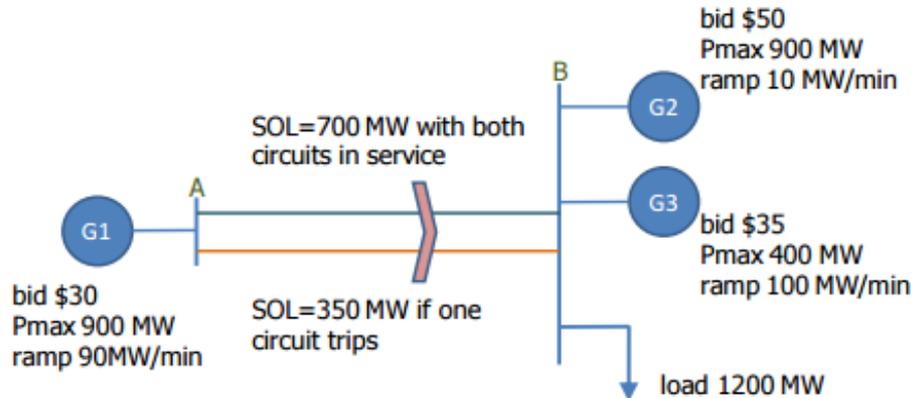

Weak-preventive model energy in base case

Generator	$P^0$	$\lambda^0$	$SF_{AB}^0$	$\mu_{AB}^0$	LMP	Bid Cost	Revenue	Profit
G1	700	\$50	1	-\$5	\$30	\$21,000	\$21,000	\$0
G2	250	\$50	0	-\$5	\$50	\$12,500	\$12,500	\$0
G3	250	\$50	0	-\$5	\$50	\$8,750	\$12,500	\$3,750

Corrective capacity in contingency kc=1

Generator	$\Delta P^1$	$\lambda^1$	$SF_{AB}^1$	$\mu_{AB}^1$	LMCP <sup>1</sup>	Bid Cost	Revenue	Profit
G1	-350	\$15	1	-\$15	\$0	\$0	\$0	\$0
G2	200	\$15	0	-\$15	\$15	\$0	\$3,000	\$3,000
G3	150	\$15	0	-\$15	\$15	\$0	\$2,250	\$2,250

# What is CME?

## Down capacity example: Today (weak preventative model)

Introduce  
slow  
ramping  
marginal  
unit at A

Bid: \$30  
Pmax: 900 MW  
Ramp: 100 MW/m

Bid: \$25  
Pmax: 900 MW  
Ramp: 10 MW/m



SOL = 700 MW with all circuits in service

SOL = 350 MW if one circuit trips



Bid: \$50  
Pmax: 900 MW  
Ramp: 10 MW/m

Bid: \$35  
Pmax: 400 MW  
Ramp: 100 MW/m

Load: 1200 MW

Weak-preventive model energy in base case


Generator	$P^0$	$\lambda^0$	$SF_{AB}^0$	$\mu_{AB}^0$	LMP	Bid Cost	Revenue	Profit
G1	0	\$50	1	-\$25	\$25	\$0	\$0	\$0
G4	700	\$50	1	-\$25	\$25	\$17,500	\$17,500	\$0
G2	100	\$50	0	-\$25	\$50	\$5,000	\$5,000	\$0
G3	400	\$50	0	-\$25	\$50	\$14,000	\$20,000	\$6,000

# What is CME?

## Down capacity example: Tomorrow (preventive-corrective model)

Bid: \$30  
Pmax: 900 MW  
Ramp: 100 MW/m

Bid: \$25  
Pmax: 900 MW  
Ramp: 10 MW/m

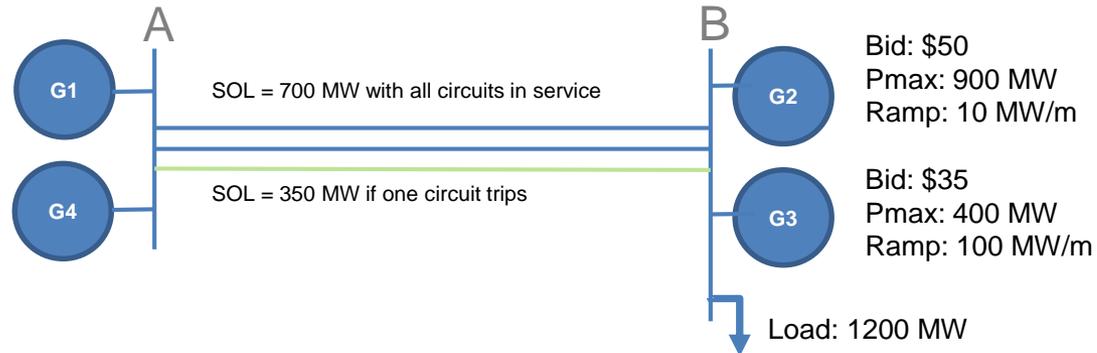

### Preventive-corrective model energy in base case

Generator	$P^0$	$\lambda^0$	$SF_{AB}^0$	$\mu_{AB}^0$	LMP	Bid Cost	Revenue	Profit
G1	150	\$50	1	\$-5	\$25	\$4,500	\$3,750	-\$750
G4	550	\$50	1	\$-5	\$25	\$13,750	\$13,750	\$0
G2	250	\$50	0	\$-5	\$50	\$12,500	\$12,500	\$0
G3	250	\$50	0	\$-5	\$50	\$8,750	\$12,500	\$3,750

### Corrective capacity in contingency kc=1

Generator	$\Delta P^1$	$\lambda^1$	$SF_{AB}^1$	$\mu_{AB}^1$	LMCP <sup>1</sup>	Bid Cost	Revenue	Profit
G1	-150	\$15	1	\$-20	-\$5	\$0	\$750	\$750
G4	-200	\$15	1	\$-20	-\$5	\$0	\$1,000	\$1,000
G2	200	\$15	0	\$-20	\$15	\$0	\$3,000	\$3,000
G3	150	\$15	0	\$-20	\$15	\$0	\$2,250	\$2,250

# Congestion Revenue & Corrective Capacity

# Congestion Revenue & Corrective Capacity

- Congestion costs on transmission paths are represented in the LMP when energy schedules cause transmission constraints to bind.
- Today, market creates a transmission infeasible dispatch
  - Any congestion shown due to N-1 constraint binding
- Operators take corrective action (ED) to restore transmission feasibility
  - Costs of ED are uplifted
- All CRRs are simultaneously feasible in the base case.
- All congestion revenues paid to CRR holders

# Congestion Revenue & Corrective Capacity

## Tomorrow

### Goal

Achieve transmission feasible dispatch without relying on exceptional dispatch/MOC.

### Option (strong preventive)

Enforce N-1-1 contingency as N-1.

- Limit: 350
- All flow-related revenue collected = congestion rent

- Transmission feasible.
- No longer relies on ED.
- Very restrictive.


### Option (preventive-corrective)

Preventive-corrective model with procurement of corrective capacity.

- Limit: 700
- CME Limit: 350
- Flow-related revenue collected = congestion rent + corrective capacity revenue

- Transmission feasible.
- No longer relies on ED.
- Maximizes use of transmission.

# Congestion Revenue & Corrective Capacity

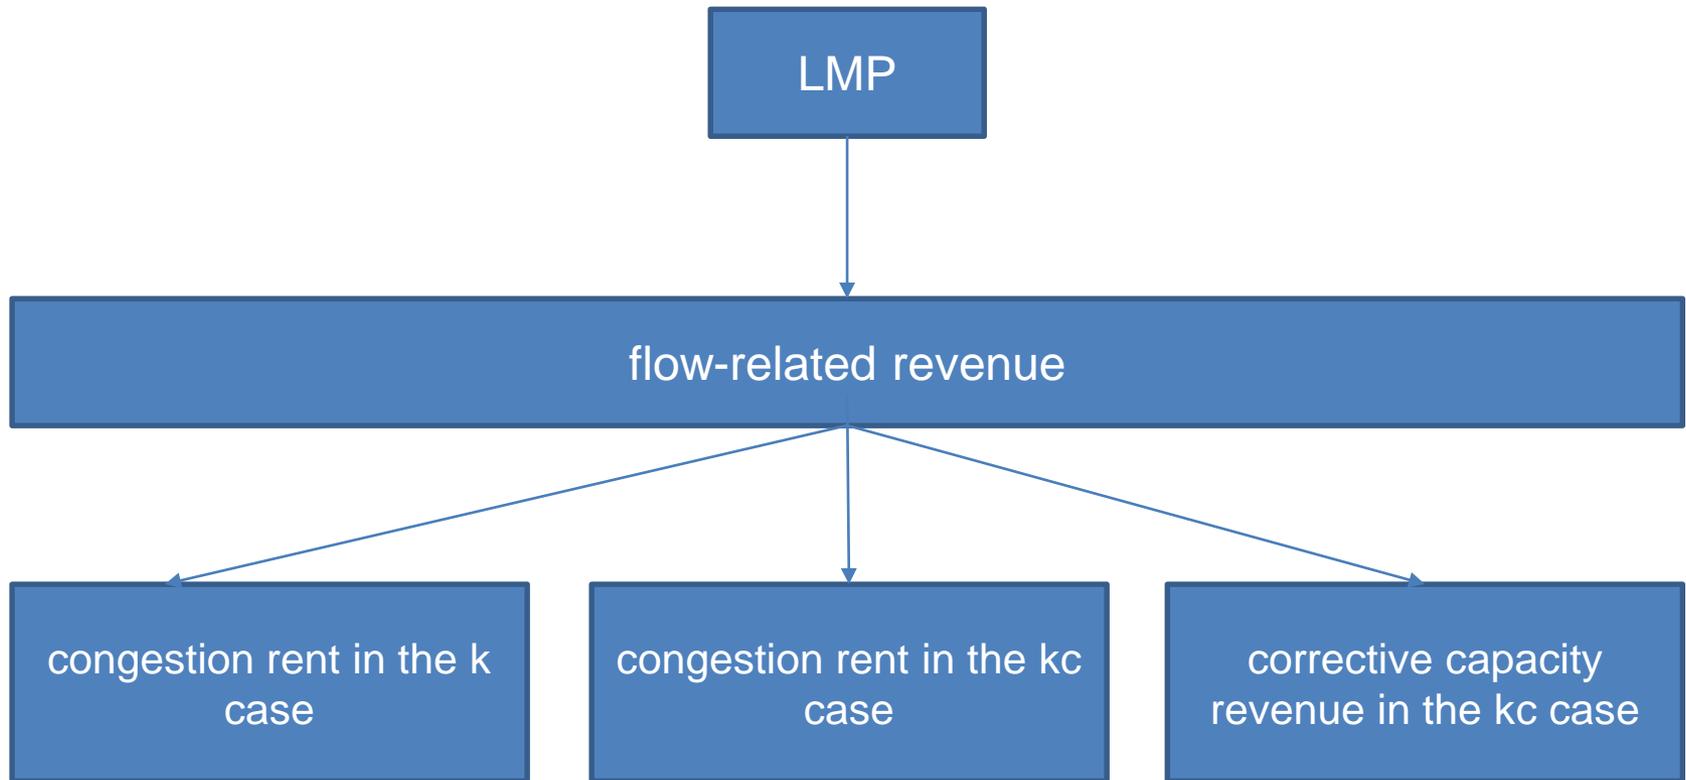

# Congestion Revenue & Corrective Capacity

LMP's resulting revenue breaks into 3 components.


LMP<sub>i</sub> flow related revenue =

$$\underbrace{\sum_{k=0}^K \sum_{l=1}^m [\mu_l^{k*} \cdot F_l^{k,\max}] + \sum_{kc=K+1}^{KC} \sum_{l=1}^m [\mu_l^{kc*} \cdot F_l^{kc,\max}]}_{\text{congestion rent collected}} - \underbrace{\sum_{kc=K+1}^{K+KC} \sum_i \left[ \left( \lambda^{kc*} + \sum_{l=1}^m SF_{l,i}^{kc} \cdot \mu_l^{kc*} \right) \cdot \Delta P_i^{kc*} \right]}_{\text{corrective capacity revenue collected}}$$



# Congestion Revenue & Corrective Capacity

## Example: isolate congestion to kc case

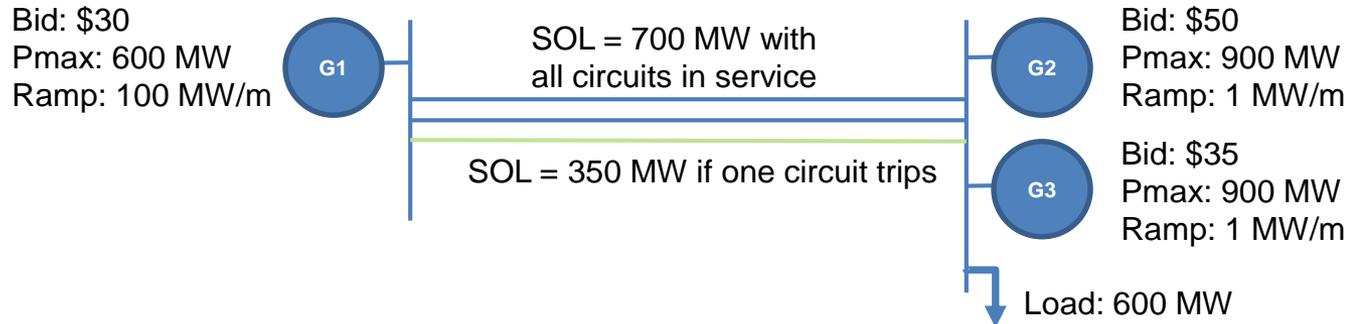

Weak-preventive model energy in base case

Generator	$P^0$	$\lambda^0$	$SF_{AB}^0$	$\mu_{AB}^0$	LMP
G1	390	\$35	1	\$0	\$30
G2	0	\$35	0	\$0	\$35
G3	210	\$35	0	\$0	\$35

Corrective capacity in contingency  $kc=1$

Generator	$\Delta P^1$	$\lambda^1$	$SF_{AB}^1$	$\mu_{AB}^1$	LMCP <sup>1</sup>
G1	-40	\$5	1	-\$5	\$0
G2	20	\$5	0	-\$5	\$5
G3	20	\$5	0	-\$5	\$5

# Congestion Revenue & Corrective Capacity

## Example: settlement

	Energy	LMP	Energy Revenue	Capacity	LMCP <sup>1</sup>	Capacity Revenues	Total Revenues
G1	390	\$30	\$11,700	-40	0	\$0	\$11,700
G2	0	\$35	\$0	20	\$5	\$100	\$100
G3	210	\$35	\$7,350	20	\$5	\$100	\$7,450
Total							\$19,250
Load	600	\$35					-\$21,000


ISO collects \$21,000

ISO pays \$19,250

Revenue adequate w/  
\$1,750 in congestion

# Congestion Revenue & Corrective Capacity

## Congestion Rent from Energy Schedules

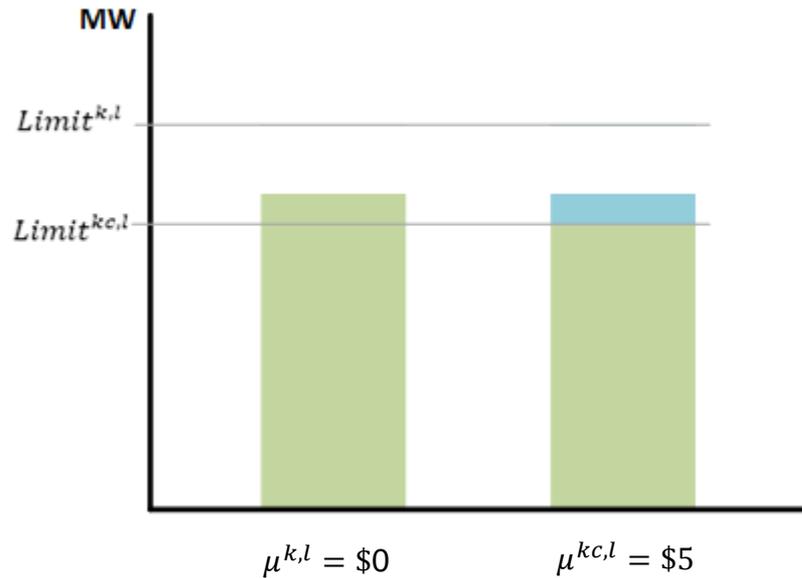

$$\begin{array}{r}
 \underbrace{\hspace{10em}} \\
 390\text{MW} * (\$0/\text{MW}) + 350\text{MW} * (\$5/\text{MW}) + 40\text{MW} * (\$5/\text{MW}) = \$1,950 \\
 \$0 \qquad \qquad \qquad + \$1,750 \qquad \qquad \qquad + \$200 \qquad \qquad \qquad = \$1,950
 \end{array}$$

# Congestion Revenue & Corrective Capacity

## Example: settlement w/ CRR

DAM Market Settlement							
	Energy	LMP	Energy Revenue	Capacity	LMCP <sup>1</sup>	Capacity Revenues	Total Revenues
G1	390	\$30	\$11,700	-40	0	\$0	\$11,700
G2	0	\$35	\$0	20	\$5	\$100	\$100
G3	210	\$35	\$7,350	20	\$5	\$100	\$7,450
Total							\$19,250
Load	600	\$35					-\$21,000
CRR Settlement							
	MW Allocated	MCC <sub>B</sub> -MCC <sub>A</sub>					Total Revenues
CRR <sub>AB</sub>	600	\$5					\$3,000

# CRR allocation enhancements for simultaneous feasibility

# CRR Allocation Enhancements

## Background

- Congestion rents collected in IFM
- Congestion rents from the corrective constraint fund the corrective capacity.
- CRR revenue inadequate because not feasible in the contingency case
- Must enhance CRR allocation to maintain revenue adequacy

# CRR Allocation Enhancements



## Considerations

- Considered allocating CRRs up to the k limit (status quo)
  - Does not maintain revenue adequacy
  - Over allocates CRRs
- Considered only allocating CRRs up to the kc limit
  - Would maintain revenue adequacy
  - Overly restrictive

# CRR Allocation Enhancements

## Background

Flows over 350 MW on the path are enabled by corrective capacity.

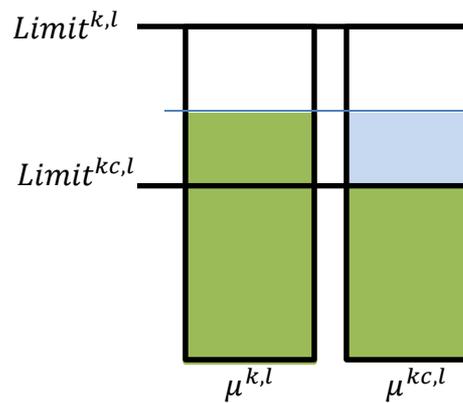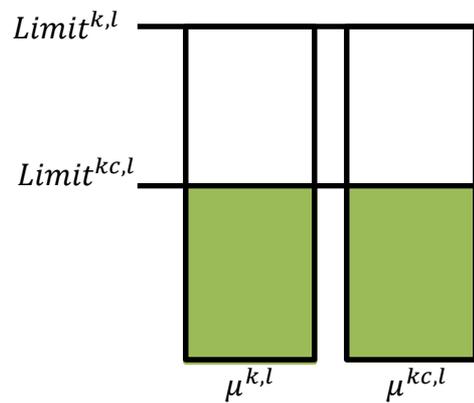

Requires corrective capacity to flow;  
Else, market will re-dispatch to reduce  
path flow to below kc limit

# CRR Allocation Enhancements Proposal

- CRR allocation/auction performed same as today
- Define new type of CRR that mimics the effects on transmission flows of procuring corrective capacity for each corrective contingency that is only used in the contingency case (CCRRs).
- After each allocation/auction, ISO proposes to automatically allocate Contingency CRRs (CCRRs) to CRR holders

# CRR Allocation Enhancements

## CCRR Allocation

- Allocate CRRs that settle against the congestion components of the LMPs

CRRs allocated as today

- Allocate CCRRs for each corrective contingency that settle against the congestion components of the LMCPs for the given corrective contingency.

CCRRs allocated based on corrective contingency cases

# CRR Allocation Enhancements

## CCRR Allocation

The SFT evaluates whether:

- the transmission flows caused by scheduling injections and withdrawals corresponding to the CRRs result in transmission flows that are feasible for the base case as well as for the N-1 contingency cases, and
- for each corrective contingency, as a post-processing step, the CRR flow will be evaluated in the post-contingency case and any overload will result in pro-rata allocation of CCRRs

# CRR Allocation Enhancements

## CCRR Allocation

If total CRR flow is over the post-contingency limit in the post-contingency case, we allocate CCRRs which represent the corrective capacity flow, enabling the feasibility of the base case CRR.

$$\alpha = \max \left\{ 0, \frac{\sum_p (SF_{l,src(p)}^{kc} - SF_{l,snk(p)}^{kc}) \cdot CRR_p - F_l^{kc,max}}{\sum_p (SF_{l,src(p)}^{kc} - SF_{l,snk(p)}^{kc}) \cdot CRR_p} \right\}$$

# CRR Allocation Enhancements

## CCRR Allocation Example

$$\text{Limit}^{k,l} = 700$$

$$\text{Limit}^{kc,l} = 350$$

Allocation						
Holder	Flow k (A->B)	CRR MW Allocation	Flow kc (A->B)	$\alpha$	CCRR MW Allocation	
SC1	800	800 A->B	800	0.50	400 B->A	
SC2	200	200 A->B	200	0.50	100 B->A	
SC3	-300	300 B->A	-300	0.50	150 A->B	
<b>Total</b>	<b>700</b>	<b>700</b>	<b>700</b>			<b>350</b>

# CRR Allocation Enhancements

## CCRR Settlement

- CRRs are settled against the congestion components of the LMPs

$$CRR \text{ Payment} = CRR MW_{AB} \times (MCC_B^k - MCC_A^k + MCC_B^{kc} - MCC_A^{kc})$$

- CCRRs are settled against the congestion components of the LMCPs for the corrective contingencies

$$CCRR \text{ Payment}_{BA} = CCRR MW_{BA} \times (MCC_A^{kc} - MCC_B^{kc})$$

# CRR Allocation Enhancements


## CCRR Settlement Example

Allocation						
Holder	Flow k (A->B)	CRR MW Allocation	Flow kc (A->B)	$\alpha$	CCRR MW Allocation	
SC1	800	800 A->B	800	0.50	400 B->A	
SC2	200	200 A->B	200	0.50	100 B->A	
SC3	-300	300 B->A	-300	0.50	150 A->B	
<b>Total</b>	<b>700</b>	<b>700</b>	<b>700</b>			<b>350</b>

Settlement			
Holder	CRR Payment	CCRR Payment	Total Payment
SC1	$(800)(\$20) = \$16,000$	$(-400)(\$15) = -\$6,000$	\$10,000
SC2	$(200)(\$20) = \$4,000$	$(-100)(\$15) = -\$1,500$	\$2,500
SC3	$(-300)(\$20) = -\$6,000$	$(150)(\$15) = \$2,250$	(\$3,750)
<b>Total</b>	<b>\$14,000</b>	<b>(\$5,250)</b>	<b>\$8,750</b>

# CRR Allocation Enhancements

## Example: isolate congestion to kc case

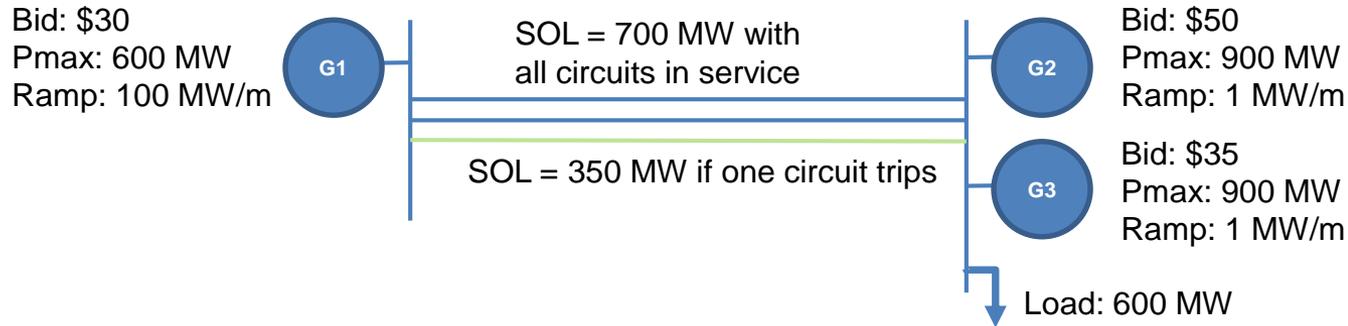

**Weak-preventive model energy in base case**

Generator	$P^0$	$\lambda^0$	$SF_{AB}^0$	$\mu_{AB}^0$	LMP
G1	390	\$35	1	\$0	\$30
G2	0	\$35	0	\$0	\$35
G3	210	\$35	0	\$0	\$35

**Corrective capacity in contingency kc=1**

Generator	$\Delta P^1$	$\lambda^1$	$SF_{AB}^1$	$\mu_{AB}^1$	LMCP <sup>1</sup>
G1	-40	\$5	1	-\$5	\$0
G2	20	\$5	0	-\$5	\$5
G3	20	\$5	0	-\$5	\$5

# CRR Allocation Enhancements

## Example: settlement w/ CRR & CCRR

DAM Market Settlement							
	Energy	LMP	Energy Revenue	Capacity	LMCP <sup>1</sup>	Capacity Revenues	Total Revenues
G1	390	\$30	\$11,700	-40	0	\$0	\$11,700
G2	0	\$35	\$0	20	\$5	\$100	\$100
G3	210	\$35	\$7,350	20	\$5	\$100	\$7,450
Total							\$19,250
Load	600	\$35					-\$21,000
CRR Settlement							
	MW Allocated	$MCC_B^k - MCC_A^k + MCC_B^{kc} - MCC_A^{kc}$	$MCC_A^{kc} - MCC_B^{kc}$				Total Revenues
CRR <sub>AB</sub>	600	\$5					\$3,000
CCRR <sub>BA</sub>	250				-\$5		-\$1,250

# CRR Allocation Enhancements

Extend example showing ownership interests

**What if you owned G1 and the load at node B?**

## **BigCorp**

- Owns 600 MW G1 at node A.
- Owns 600 MW of load at node B.
- Is allocated 600 MW of CRR from A to B.

How does this settle?

Does BigCorp pay for corrective capacity more than once?

# CRR Allocation Enhancements

## Extend example showing ownership interests

DAM Market Settlement							
	Energy	LMP	Energy Revenue	Capacity	LMCP <sup>1</sup>	Capacity Revenues	Total Revenues
G1	390	\$30	\$11,700	-40	0	\$0	\$11,700
G2	0	\$35	\$0	20	\$5	\$100	\$100
G3	210	\$35	\$7,350	20	\$5	\$100	\$7,450
Load	600	\$35					-\$21,000

CRR Settlement				
	MW Allocated	$MCC_B^k - MCC_A^k + MCC_B^{kc} - MCC_A^{kc}$	$MCC_A^{kc} - MCC_B^{kc}$	Total Revenues
CRR <sub>AB</sub>	600	\$5		\$3,000
CCRR <sub>BA</sub>	250		-\$5	-\$1,250

BigCorp outflows = \$21,000 for load

BigCorp in-flows = \$11,700 for G1

**-\$9,300**

CRR adjustments (in-flows) = \$1,750

**-\$7,550 ← net outflows; who receives this money?**

# CRR Allocation Enhancements

Extend example showing ownership interests

BigCorp pays out net \$7,550

G2 receives \$100 for corrective capacity

G3 receives \$7,350 for energy

G3 receives \$100 for corrective capacity

Total = \$7,550

BigCorp pays for energy at the node and corrective capacity at the node.

# Corrective Capacity Settlement & No Pay Rules

# Corrective Capacity Settlement & No Pay Rules Settlement


- Day-ahead market settled
- Fifteen minute market re-optimized (buy backs or more procurement)
- Five minute market re-optimized (buy backs or more procurement)

Awarded corrective capacity MW x LMCP

# Corrective Capacity Settlement & No Pay Rules

## Services procured


- Corrective capacity can overlap A/S
- Corrective capacity can be independent from A/S
- Corrective capacity does not overlap FRP

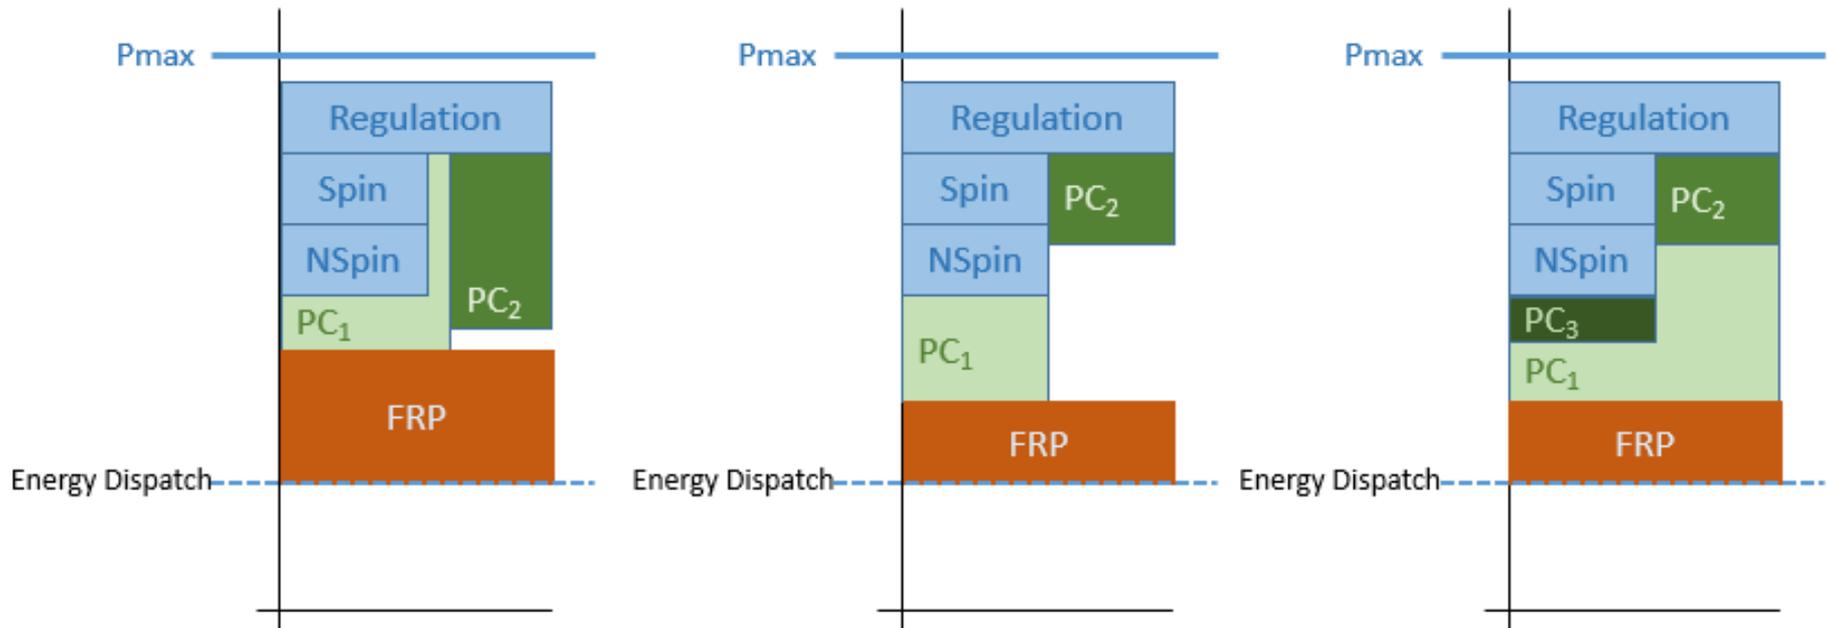

# Corrective Capacity Settlement & No Pay Rules

## No Pay


- If corrective capacity is unavailable because it is converted to Energy without Dispatch Instructions from CAISO, the Scheduling Coordinator shall pay back the unavailable capacity at the RTD LMCP.
- Uninstructed Deviations in real-time may cause corrective capacity to be unavailable.

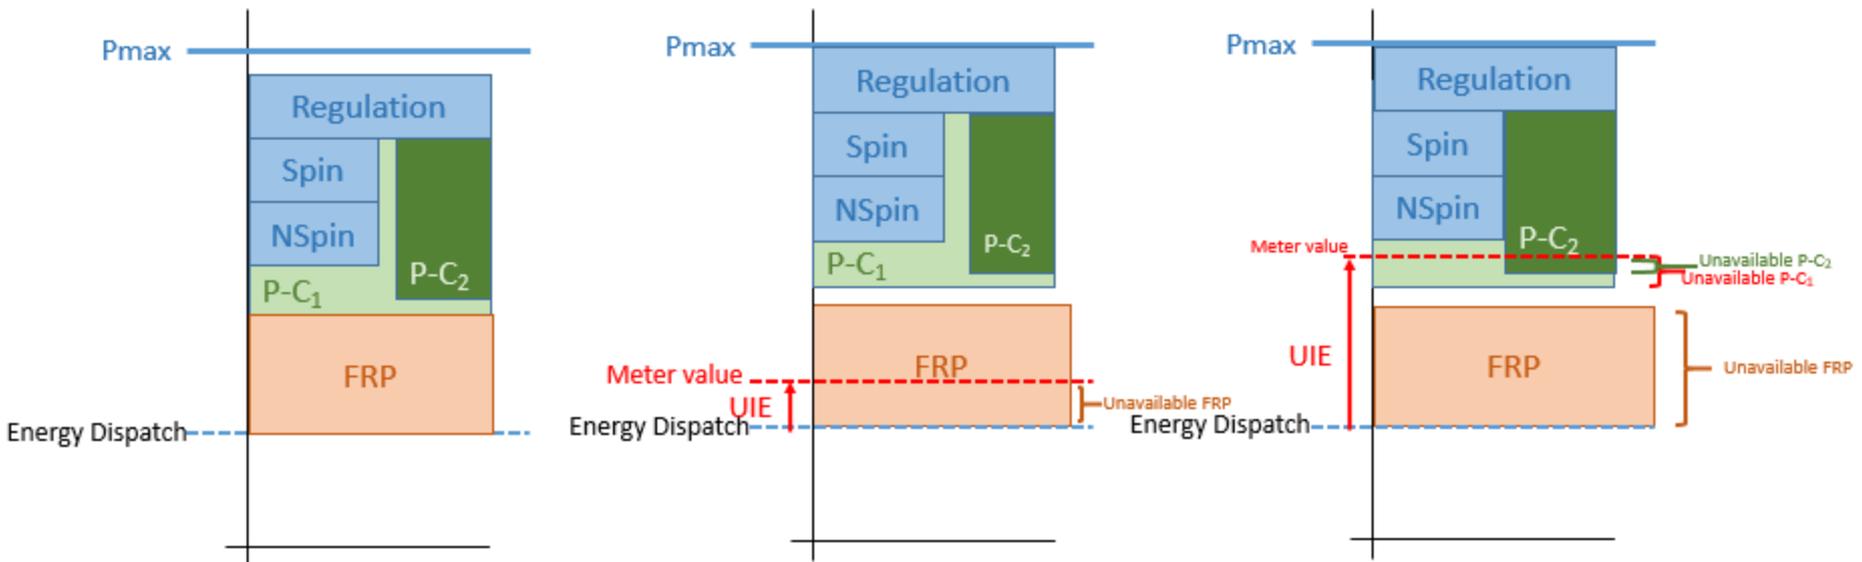

# Corrective Capacity Settlement & No Pay Rules

## Corrective capacity deployment

- Automatically dispatched for real-time needs per re-optimization
- Operator can exceptionally dispatch for any reason
- If corrective capacity overlaps A/S, will be dispatched via RTCD

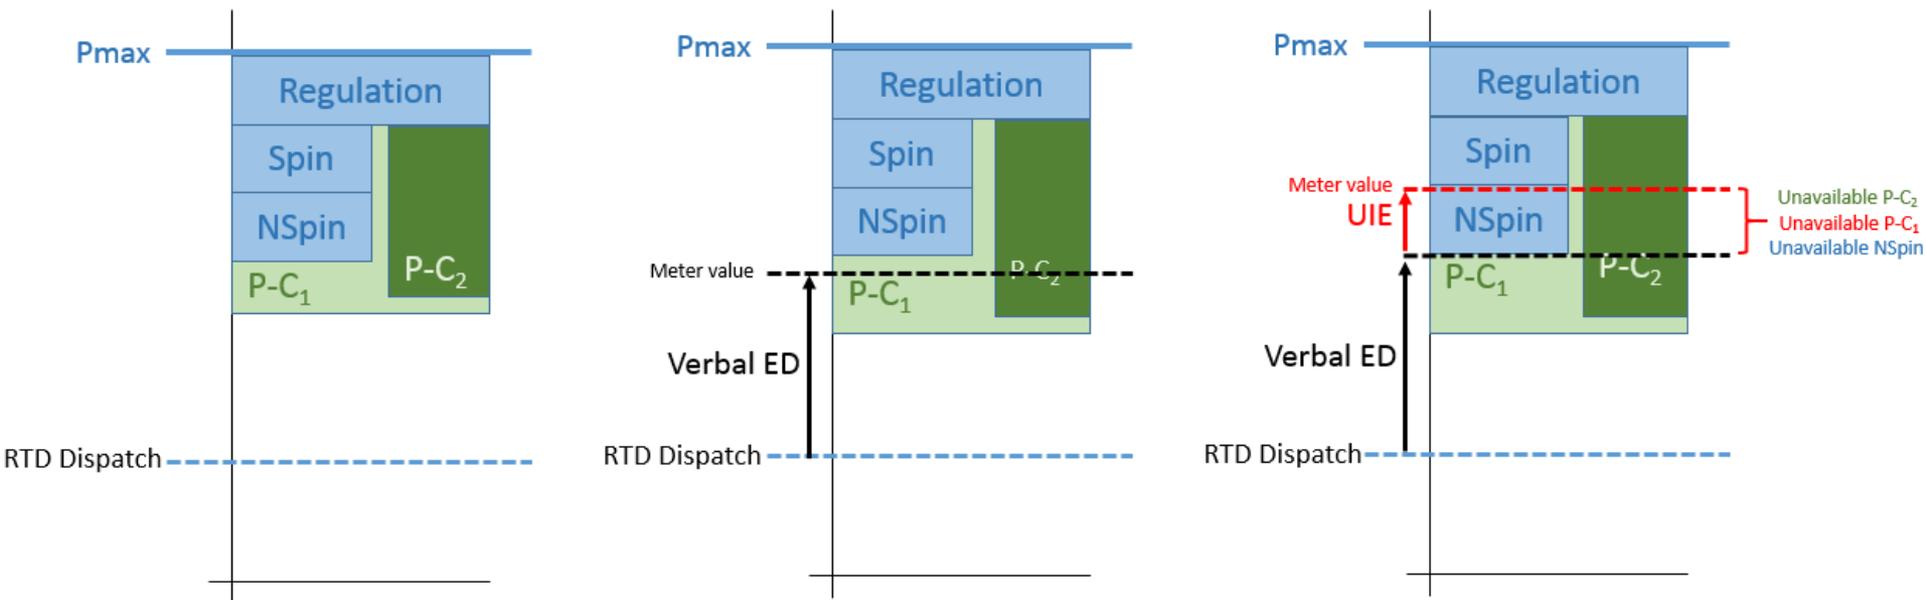

# Next Steps

# Next Steps

Item	Date
Third revised straw proposal	11/20/2015
Stakeholder Meeting	12/10/2015
Stakeholder comments due	12/22/2015
Prototype results	TBD
Draft final proposal	1/13/2016
Stakeholder call	1/20/2016
Stakeholder comments due	2/3/2016
Board meeting	3/24/2016-3/26/2016

Please submit comments to [initiativecomments@caiso.com](mailto:initiativecomments@caiso.com)

# Questions