




Business Requirements Specification

Day-Ahead Market Enhancements


Document Version: 1.7

Current Version Date: 2/11/2026

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

Revision History


Date	Version	Description
7/25/2023	1.0	Initial Document Release.
12/22/2023	1.1	Updated for the following <ul style="list-style-type: none"> • Clarified, corrected typos and cleaned up the document. • Moved some requirements from DAME BRS to EDAM BRS and vice versa. • Updated business requirement to match filed Tariff and/or clarified policy. <ul style="list-style-type: none"> ○ Restored back RCU/RCD bid caps to \$250. ○ Set MSS-specific annual RUC participation flag to always Opt-In. ○ Netted RCU/RCD Overlapping RA Capacity from RUC BCR calculations. ○ Updated for not assessing RAAIM to IR and RC awards for generic and Flex RA. ○ Extended the DA and Base Schedule Forecast Movement to virtual supply and demand resources. ○ Extended the FMM deviation settlements to virtual supply and demand resources. ○ Accounted for virtual FM in allocation of residual Forecasted Movement Settlements. ○ Made the LSE-Resource Pair True-Up flag on LSE-Resource Pair instead of LSE-only and updated its logic and submission system from Master File to CIRA. ○ Set UEL to 0 for System Resources, if e-tag validation fails. ○ Required that resources with RCU Award that submitted a DA Energy Bid to export outside the EDAM Area must provide a decremental RT Energy Bid to dispatch down the export schedule in the FMM. ○ Updated for not mitigating RCU Bids that are submitted on behalf of imports from outside the EDAM Area. ○ Published IRU/IRD and RCU/RCD Overlapping RA Capacity in CMRI reports. ○ Changed calculation of ramp rate segment for IRU and IRD to correspond to DAES instead of DAES+IRU and DAES-IRD. ○ Removed the requirement of intertie congestion components being included in RCU/RCD marginal prices. ○ Updated AS SOC formulation constraints formulation. ○ Accounted for Imbalance Reserve Surplus in market optimization, Settlements and reporting. ○ Allowed bid daily min energy limit positive or negative in SIBR, consistent with market. ○ Expand Imbalance Reserve Requirement input model to cover Trading Day+1, +2 for market and reporting. ○ Added formulas for Certified Capacity for IRU and IRD. ○ Replaced Proxy RCU Flag with Proxy RCU MW, as applicable.

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Date	Version	Description
		<ul style="list-style-type: none"> ○ Marked all days as Weekdays Day Type for BARC's IR quantile regression model. ○ Updated formulation of: IRx BAA Average Price, IRx BAA Derived Price, Tier-2 IRx BAA Allocation Cost for Settlements.
4/25/2024	1.2	<p>Updated for the following:</p> <ul style="list-style-type: none"> ▫ Clarified, corrected typos and cleaned up the document. ▫ Updated business requirement to per feedback from CAISO SMEs and market participants. <ul style="list-style-type: none"> ● DAME-BRQ-01160 <ul style="list-style-type: none"> ○ Added to define Surplus zones in a BAA. ● DAME-BRQ-01180 <ul style="list-style-type: none"> ○ Deleted and moved to Internal ISO System (DAME-BRQ-02005) ● DAME-BRQ-01200 <ul style="list-style-type: none"> ○ Added for EDAM participation Flag in MF. ● DAME-BRQ-02010 <ul style="list-style-type: none"> ○ Updated to move the setting of sampling scheme parameters to separate BRQ (DAME-BRQ-02011) ● DAME-BRQ-02011 <ul style="list-style-type: none"> ○ Added for the moved functionality of setting the sampling scheme parameters (moved from DAME-BRQ-02010). ○ Marked this BRQ for Production-Track implementation (ahead of DAME Go-Live date) ● DAME-BRQ-02005 <ul style="list-style-type: none"> ○ Moved from MF (DAME-BRQ-01180). ● DAME-BRQ-02040 <ul style="list-style-type: none"> ○ Updated to remove storing uncertainty. ● DAME-BRQ-02060, DAME-BRQ-02070, DAME-BRQ-02090, DAME-BRQ-02100, DAME-BRQ-02110, DAME-BRQ-02120, DAME-BRQ-02130, DAME-BRQ-02140, DAME-BRQ-02150, DAME-BRQ-02310, DAME-BRQ-02320, DAME-BRQ-02340, DAME-BRQ-04140, DAME-BRQ-10280, DAME-BRQ-10300, DAME-BRQ-10320, DAME-BRQ-10340, DAME-BRQ-10360, DAME-BRQ-11420 <ul style="list-style-type: none"> ○ Updated to remove D+2 calculation, broadcast and consume for ISO-Internal System, DAM, OASIS, Internal ISO System (for IRR Thresholds, IRR Input Polynomials, IRR Uncertainty Histograms, IR




Date	Version	Description
		<p>Forecasts, IR Demand Curves and only keep IRR, IRS and RC Awards).</p> <ul style="list-style-type: none"> • DAME-BRQ-02300, DAME-BRQ-02310, DAME-BRQ-02320, DAME-BRQ-03070, DAME-BRQ-04080, DAME-BRQ-04090, DAME-BRQ-04134, DAME-BRQ-05002 <ul style="list-style-type: none"> ○ Updated to add “/MWh” for “\$55, \$247, \$250, \$150, \$300, \$0” to align with Tariff Compliance Filing. • DAME-BRQ-04030 <ul style="list-style-type: none"> ○ Updated the note about extension of RCU/RCD bid for VERs to clarify it is in RUC. • DAME-BRQ-04134A, DAME-BRQ-04135, DAME-BRQ-04136, DAME-BRQ-04137 <ul style="list-style-type: none"> ○ Added to model multiple IR zones in a BAA in the Market • DAME-BRQ-04150 <ul style="list-style-type: none"> ○ Updated to split calculations of IRUR/IRDR for D+2 and D+3 to a separate BRQ (DAME-BRQ-04155). • DAME-BRQ-04155 <ul style="list-style-type: none"> ○ Added for the calculations of IRUR/IRDR for D+2 and D+3 as a separate BRQ (split from DAME-BRQ-04150). • DAME-BRQ-10260, DAME-BRQ-11420 <ul style="list-style-type: none"> ○ Updated to add D+3. • DAME-BRQ-04331, DAME-BRQ-04331A <ul style="list-style-type: none"> ○ Updated to correct ASSOC formulas to replace $SOC_{i,t-1}$ index with $SOC_{i,t}$. • DAME-BRQ-04334, DAME-BRQ-04337, DAME-BRQ-06075 <ul style="list-style-type: none"> ○ Deleted from this BRS and moved to ESE3 project’s BRS. • DAME-BRQ-04454 <ul style="list-style-type: none"> ○ Updated to clarify access of IR surplus zones and their associated Apnodes from MF. ○ Updated to clarify that IRU/IRD Surplus is on Apnode associated with each IR surplus zone and aggregated on BAA level on Imbalance Demand Hub Apnode. • DAME-BRQ-05000 <ul style="list-style-type: none"> ○ Updated to apply insertion logic to non-VERs and replaced UEL with VER forecast with lower of energy bid range and RCU Certified Capacity.

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Date	Version	Description
		<ul style="list-style-type: none"> ○ Updated to add extension logic for non-VERs. ● DAME-BRQ-05005 <ul style="list-style-type: none"> ○ Updated to remove first two bullets regarding extension/insertion of RCU bids to Forecast output and change the system from SIBR to RUC. ● DAME-BRQ-05090 <ul style="list-style-type: none"> ○ Updated to clarify the 2nd bullet to apply to online physical resources. ● DAME-BRQ-05130 <ul style="list-style-type: none"> ○ Updated to clarify resource types applicability. ● DAME-BRQ-05144 <ul style="list-style-type: none"> ○ Updated to remove the reference to DAME-BRQ-04334 ● DAME-BRQ-06065 <ul style="list-style-type: none"> ○ Deleted. ● DAME-BRQ-07860, DAME-MSIM-15020 <ul style="list-style-type: none"> ○ Updated to add IR Surplus Zone associated Apnodes to Imbalance Hub Demand Apnode. ● DAME-BRQ-09160 <ul style="list-style-type: none"> ○ Updated logic/formula that calculates IRx BAA Average Price, and IRx BAA Derived Price. ○ Updated to add logic formula for IRx BAA Allocation Cost and replaced several terms with the defined IRx BAA Allocation Cost for clarity (contents moved and modified from DAME-BRQ-09530). ○ Updated to add formula for IRX Surplus Adjustment. ○ Updated Tier-2 IRx BAA Allocation Cost to remove “max (0)” to allow positive and negative values. ● DAME-BRQ-09180 <ul style="list-style-type: none"> ○ Updated logic/formula that calculates RCx BAA Average Price, and RCx BAA Derived Price. ○ Updated to add logic formula for RCx BAA Allocation Cost and replaced several terms with the defined RCx BAA Allocation Cost for clarity. ○ Updated Tier 2 to remove the max (0,). ● DAME-BRQ-09380

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Date	Version	Description
		<ul style="list-style-type: none"> ○ Updated to replace RA showing with monthly Generic and Flex (across all categories) RA showing in the pro-rata allocation. • DAME-BRQ-09530 <ul style="list-style-type: none"> ○ Deleted and moved the contents to DAME-BRQ-09160. • DAME-BRQ-09535 <ul style="list-style-type: none"> ○ Deleted as it is duplicate of contents within DAME-BRQ-09160. • DAME-BRQ-09540 <ul style="list-style-type: none"> ○ Updated logic to use separate MCC prices for IRx Requirement and Surplus. • DAME-BRQ-09610 <ul style="list-style-type: none"> ○ Added for Apply HASP Reversal to CAISO BAA IFM Intertie Schedule. • DAME-BRQ-10160, DAME-BRQ-11420 <ul style="list-style-type: none"> ○ Updated to clarify processing of nodal IRUMP/IRDMP prices for Apnodes associated with IR surplus zones. • DAME-BRQ-10160, DAME-BRQ-10180, DAME-BRQ-10200, DAME-BRQ-10220, DAME-BRQ-10260 <ul style="list-style-type: none"> ○ Split OASIS reports (one BRQ for each OASIS report). • DAME-BRQ-10160A, DAME-BRQ-10160B, DAME-BRQ-10180A, DAME-BRQ-10180B, DAME-BRQ-10200A, DAME-BRQ-10200B, DAME-BRQ-10200C, DAME-BRQ-10220A, DAME-BRQ-10260A <ul style="list-style-type: none"> ○ Added for Split OASIS BRQs into separate BRQs (one BRQ for each OASIS report). • DAME-BRQ-10260, DAME-BRQ-11420 <ul style="list-style-type: none"> ○ Updated to add publishing of IRUS/IRDS and associated Apnode on IR Surplus Zone level within each BAA. • DAME-BRQ-10380 <ul style="list-style-type: none"> ○ Deleted as OASIS report that publish aggregated BAA Forecasted Movement Data by resource category. • DAME-BRQ-10700 <ul style="list-style-type: none"> ○ Clarified publishing by IFM-MPM and RUC-MPM. • DAME-BRQ-10730 <ul style="list-style-type: none"> ○ Added to publish REN (aka RUC schedules) to Forecasted Generation report (existing). • DAME-BRQ-10810

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

Date	Version	Description
		<ul style="list-style-type: none"> ○ Added for CMRI to publish nodal by SC DA Schedule Virtual Forecasted Movement. ● DAME-BRQ-10880 <ul style="list-style-type: none"> ○ Added for MPP publishing Shift Factors (SF) for IRU/IRD. ● DAME-BRQ-11420 <ul style="list-style-type: none"> ○ Updated to add publishing of monthly Generic RA Showing for each mapped LSE and monthly Flex (for all categories) RA Showing for each mapped LSE. ○ Updated to delete publishing Deployment Scenario Deliverability Inclusion Constraints Flag due RCU/RCD Awards since these flags does not apply to RCU/RCD. ○ Updated to add nodal by SC DA Schedule Virtual Forecasted Movement. ○ Updated to remove aggregated BAA Forecasted Movement Data by resource category. ● DAME-MSIM-15020 <ul style="list-style-type: none"> ○ Updated to remove OASIS IFM Forecasted Movement. ○ Updated to add CMRI DA Schedule Virtual Forecasted Movement Data. ○ Updated OASIS, CMRI and MPP publishing lists.
8/2/2024	1.3	<p>Updated business requirement to per feedback from CAISO SMEs and market participants.</p> <ul style="list-style-type: none"> ● DAME-BRQ-01220 <ul style="list-style-type: none"> ○ Added for GMC rate updates. ● DAME-BRQ-03070 <ul style="list-style-type: none"> ○ Updated to add a clarifying note that NDAB for IRD/RCD should be consistent with those of IRU/RCU, respectively. ● DAME-BRQ-03090 <ul style="list-style-type: none"> ○ Added for calculations update of Variable-Cost-based DAM and RTM DEBs to use updated GMC rates. ● DAME-BRQ-07600 <ul style="list-style-type: none"> ○ Updated to revise formulas for IRx award 5-min ramp capable portion to account for DA Schedule Forecasted Movement. ● DAME-BRQ-09250

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Date	Version	Description
		<ul style="list-style-type: none"> ○ Added for GMC Charge Code updates. ● DAME-BRQ-10160B, DAME-BRQ-10200B, DAME-BRQ-10200C, DAME-BRQ-10220, DAME-BRQ-10220A ○ Updated to remove OASIS publishing corrected IFM-MPM or RUC-MPM nodal prices, shadow prices and competitive paths data.
12/23/2024	1.4	<p>Updated business requirement to per feedback from CAISO SMEs and market participants.</p> <ul style="list-style-type: none"> ● General cleanups throughout the document. ● DAME-BRQ-01135 <ul style="list-style-type: none"> ○ Added Process BRQ to toggle MF RUC Participation Flag for LESRs to Yes. ● DAME-BRQ-04080 <ul style="list-style-type: none"> ○ Clarified to replace “registered quantities from MF” with “registered IR Certified Capacity quantities from MF”. ● DAME-BRQ-04130 <ul style="list-style-type: none"> ○ Deleted (penalty price for IR.) ● DAME-BRQ-04132 <ul style="list-style-type: none"> ○ Updated to remove displaying (internal to ISO) IRU/IRD demand price curve. ● DAME-BRQ-04135 <ul style="list-style-type: none"> ○ Updated the 4th bullet to match the formulation to limit the IRU/IRD surplus to IRU/IRD requirements on BAA level instead of surplus zone. ● DAME-BRQ-04200 <ul style="list-style-type: none"> ○ Updated to correct verbiage about LDF to use SYS LFZ (renormalized with respect to current topology). ● DAME-BRQ-04390, DAME-BRQ-04400 <ul style="list-style-type: none"> ○ Updated to move resource SP-Tie IRU/IRD marginal price (IRUMP/IRDMP) in DAM to separate BRQ (DAME-BRQ-04395 / DAME-BRQ-04405, respectively) and revise shadow prices adjustments for the calculations of nodal SP-Tie IRU/IRD marginal price (IRUMP/IRDMP) in IFM, IFM-MPM. ○ Clarified to account for import/export direction for IRUMP/IRDMP SP-Tie prices ● DAME-BRQ-04395, DAME-BRQ-04405

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Date	Version	Description
		<ul style="list-style-type: none"> ○ Added for resource SP-Tie IRU/IRD marginal price (IRUMP/IRDMP), including shadow prices adjustments (moved from DAME-BRQ-04390 / DAME-BRQ-04400, respectively) in IFM, IFM-MPM. ○ Clarified to account for import/export direction for IRUMP/IRDMP SP-Tie prices ● DAME-BRQ-05002 <ul style="list-style-type: none"> ○ Corrected to remove duplicate wording. ● DAME-BRQ-05030 <ul style="list-style-type: none"> ○ Updated to remove use of unmitigated bids for RUC 48 and 72 hours as RUC will only run for 24 hours ahead now. ● DAME-BRQ-05160 <ul style="list-style-type: none"> ○ Clarified to replace REN with RCU. ● DAME-BRQ-05170 <ul style="list-style-type: none"> ○ Clarified to replace REN with RCD. ● DAME-BRQ-05180, DAME-BRQ-05182 <ul style="list-style-type: none"> ○ Updated to move resource SP-Tie RCU/RCD marginal price (RCUMP/RCDMP) in DAM to separate BRQ (DAME-BRQ-05181/ DAME-BRQ-05183, respectively) and revise shadow prices adjustments for the calculations of nodal SP-Tie RCU/RCD marginal price (RCUMP/RCDMP) in RUC, RUC-MPM. ○ Clarified to account for import/export direction for RCUMP/RCDMP SP-Tie prices ● DAME-BRQ-05181, DAME-BRQ-05183 <ul style="list-style-type: none"> ○ Added for resource SP-Tie RCU/RCD marginal price (RCUMP/RCDMP), including shadow prices adjustments (moved from DAME-BRQ-05180/ DAME-BRQ-05182, respectively) in RUC, RUC-MPM. ○ Clarified to account for import/export direction for RCUMP/RCDMP SP-Tie prices ● DAME-BRQ-06100 <ul style="list-style-type: none"> ○ Added to revise shadow prices adjustments for the calculations of nodal SP-Tie FRU/FRD marginal price (FRUMP/FRDMP) in RTM. ○ Clarified to account for import/export direction for FRUMP/FRDMP SP-Tie prices ● DAME-BRQ-06120



Date	Version	Description
		<ul style="list-style-type: none"> ○ Added to include shadow prices adjustments for the calculations of resource SP-Tie FRU/FRD marginal price (FRUMP/FRDMP) in RTM (existing). ● DAME-BRQ-07265 <ul style="list-style-type: none"> ○ Updated to add details for the calculation of monthly RA Showing Capacity. ● DAME-BRQ-10160, DAME-BRQ-10160B <ul style="list-style-type: none"> ○ Clarified the price breakdown for nodal IRUMP/IRDMP to be (total, capacity, congestion but no loss) ○ Clarified the price breakdown for nodal RCUMP/RCDMP to be (total, capacity, congestion and loss) ○ Updated to exclude sub-components of MCC prices (by BAA) for nodal RCUMP/RCDMP ● DAME-BRQ-10160A <ul style="list-style-type: none"> ○ Clarified the price breakdown for nodal IRUMP/IRDMP to be (total, capacity, congestion but no loss) ○ Clarified to account for import/export direction for IRUMP/IRDMP SP-Tie prices. ○ Clarified the price breakdown for nodal RCUMP/RCDMP to be (total, capacity, congestion and loss) ○ Updated to exclude sub-components of MCC prices (by BAA) for nodal RCUMP/RCDMP ○ Clarified to account for import/export direction for RCUMP/RCDMP SP-Tie prices ● DAME-BRQ-10160AA <ul style="list-style-type: none"> ○ Added for OASIS to publish RTM Flexible Ramp Scheduling Point/Tie Nodal Prices by Direction (Import/Export). ○ Clarified to account for import/export direction for FRUMP/FRDMP SP-Tie prices ● DAME-BRQ-10740 <ul style="list-style-type: none"> ○ Clarified the price breakdown for resource IRUMP/IRDMP to be (total, capacity, congestion but no loss) ○ Clarified the price breakdown for resource RCUMP/RCDMP to be (total, capacity, congestion and loss)

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Date	Version	Description
		<ul style="list-style-type: none"> ○ Updated to exclude sub-components of MCC prices (by BAA) for resource RCUMP/RCDMP ● DAME-BRQ-11420 <ul style="list-style-type: none"> ○ Clarified the price breakdown for nodal and resource IRUMP/IRDMP to be (total, capacity, congestion but no loss). ○ Clarified the price breakdown for nodal and resource RCUMP/RCDMP to be (total, capacity, congestion and loss). ○ Updated to include sub-components of MCC prices (by BAA) for resource IRUMP/IRDMP and RCUMP/RCDMP. ○ Clarified to account for import/export direction for IRUMP/IRDMP, RCUMP/RCDMP SP-Tie prices. ○ Updated to publish FRUMP/FRDMP SP-Ties by direction.
4/7/2025	1.5	<p>Updated business requirement to per feedback from CAISO SMEs and market participants.</p> <ul style="list-style-type: none"> ● General cleanups throughout the document. ● DAME-BRQ-02011 <ul style="list-style-type: none"> ○ Updated to replace 90 days with 75 days. ● DAME-BRQ-04065 <ul style="list-style-type: none"> ○ Added for RCU bid coverage for entire economic bid range for all physical supply resources. ● DAME-BRQ-04510, DAME-BRQ-04515 <ul style="list-style-type: none"> ○ Added for Market Priority Types functionality, including CRN for IFM. ● DAME-BRQ-05000 <ul style="list-style-type: none"> ○ Updated to correct the BRQ title to match its contents. ● DAME-BRQ-05002 <ul style="list-style-type: none"> ○ Updated insertion/extension bid price for Proxy RCU Bid for exports for RUC. ● DAME-BRQ-05003 <ul style="list-style-type: none"> ○ Added to consider Proxy RCU and RCU when SIBR receives a Proxy RCU on the exports. ● DAME-BRQ-06100 <ul style="list-style-type: none"> ○ Updated to correct BRQ title to remove broadcast. ● DAME-BRQ-06150, DAME-BRQ-06170

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

Date	Version	Description
		<ul style="list-style-type: none"> ○ Added for Market Priority Types functionality, including CRN for RTM. ● DAME-BRQ-10380 <ul style="list-style-type: none"> ○ Added for OASIS to publish existing hourly aggregated data for Base scenarios (Energy product). ○ And to publish new hourly aggregated data for IRU and IRD product for IRU, IRD deployment scenarios. ● DAME-BRQ-10735, DAME-BRQ-10737 <ul style="list-style-type: none"> ○ Added for Market Priority Types functionality, including CRN for CMRI. ● DAME-BRQ-10830 <ul style="list-style-type: none"> ○ Added for CMRI to publish existing hourly data for Base scenarios (Energy product). ○ And to publish new hourly data for IRU and IRD product for IRU, IRD deployment scenarios. ● DAME-BRQ-10940 <ul style="list-style-type: none"> ○ Added for Market Priority Types functionality, including CRN for ADS. ● DAME-BRQ-11420 <ul style="list-style-type: none"> ○ Updated for Market Priority Types functionality for Data sent to FERC. ● DAME-MSIM-15020 <ul style="list-style-type: none"> ○ Updated for Market Priority Types functionality for Market Sim scenario guidelines. ○ Updated for checking CRR Revenue Adjustments.
9/3/2025	1.6	<p>Updated business requirement to per feedback from CAISO SMEs and market participants.</p> <ul style="list-style-type: none"> ● General cleanups throughout the document. ● Section 4.1 (Business Practice Manual (BPM)) <ul style="list-style-type: none"> ○ Updated to correct Reliability Requirements BPM impact to Yes. ● DAME-BRQ-04060 <ul style="list-style-type: none"> ○ Updated to add a bullet point for RCU bid insertion applies to RAAIM hours only for RA import resources unless the resource bids for energy outside these hours. ● DAME-BRQ-04332 <ul style="list-style-type: none"> ○ Corrected to add envelope constraints formulation for IFM.



Date	Version	Description
		<ul style="list-style-type: none"> ○ Updated RUC envelope constraints formulation to account for Ancillary Services (Regulation Up/Down, Spinning Reserve, and Non-Spinning Reserve). ○ Updated envelope constraints formulation to make commodity attenuation factors for IRU/IRD and RCU/RCD hourly. ○ Updated to add a note that all commodity attenuation factors shall be configurable. ○ Updated to add a reference to DAME-BRQ-05144 in the notes. ● DAME-BRQ-05144 <ul style="list-style-type: none"> ○ Updated requirements for RUC to match those in DAME-BRQ-04332. ○ Updated to add a reference to DAME-BRQ-04332 in the notes. ● DAME-BRQ-06150, DAME-BRQ-06170 <ul style="list-style-type: none"> ○ Updated to clarify the requirements to be extending existing HASP market priority types functionality to FMM and RTD. ● DAME-BRQ-09160 <ul style="list-style-type: none"> ○ Updated to correct typo in Tier-1 IRD Allocation Quantity formula for Generation to replace MaxExCap with MinExCap. ● DAME-BRQ-09160, DAME-BRQ-09180 <ul style="list-style-type: none"> ○ Updated to clarify the logic of IR and RC cost allocations. ● DAME-BRQ-09320 <ul style="list-style-type: none"> ○ Updated to add notes about resource-specific FMM FRUMP/FRDMP. ● DAME-BRQ-09340 <ul style="list-style-type: none"> ○ Updated to split the first bullet into two: one for physical resources and another for virtual supply/demand and clarified the logic for the latter. ● DAME-BRQ-09580 <ul style="list-style-type: none"> ○ Updated to replace “net of” to “along with” in regard to BAA Energy congestion revenue distribution. ● DAME-BRQ-10180 <ul style="list-style-type: none"> ○ Deleted since the Imbalance Reserve Capacity data is already covered in the Aggregate Awards OASIS publishing (DAME-BRQ-10240), and the Imbalance Reserve price data is covered in the Nodal Prices OASIS publishing (DAME-BRQ-10160). ● DAME-BRQ-10180A

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Date	Version	Description
		<ul style="list-style-type: none"> ○ Deleted since the nomogram data is covered in Nomogram/Branch Shadow Price OASIS publishing (DAME-BRQ-10200), and the Intertie Constraint data is covered in the Interties Shadow Price OASIS publishing (DAME-BRQ-10200A). ● DAME-BRQ-10180B <ul style="list-style-type: none"> ○ Updated to include RUC Binding Constraints and shadow prices data.
2/11/2026	1.7	<p>Updated business requirement to per feedback from CAISO SMEs and market participants.</p> <ul style="list-style-type: none"> ● General cleanups throughout the document. ● DAME-BRQ-01160 <ul style="list-style-type: none"> ○ Updated to add Anode to the IR Surplus Zone definition in Maste File (MF). ● DAME-BRQ-04030 <ul style="list-style-type: none"> ○ Clarified that RMR resources RCU bid MW quantity will be additionally limited by their RMR capacities. ● DAME-BRQ-04060, DAME-BRQ-04065 <ul style="list-style-type: none"> ○ Clarified the cap of RCU bid insertion/extension to be consistent with the filed Tariff. ○ Clarified that RMR resources RCU bid MW quantity insertion/extension will be additionally limited by their RMR capacities. ● DAME-BRQ-04080 <ul style="list-style-type: none"> ○ Clarified the cap of IRU/IRD bid validation to be consistent with the filed Tariff. ● DAME-BRQ-04090 <ul style="list-style-type: none"> ○ Clarified the cap of RCU/RCD bid validation to be consistent with the filed Tariff. ○ Clarified that RMR resources RCU/RCD bid MW quantity will be additionally limited by their RMR capacities. ● DAME-BRQ-04080 <ul style="list-style-type: none"> ○ Clarified the cap of IRU/IRD bid validation to be consistent with the filed Tariff. ● DAME-BRQ-04090 <ul style="list-style-type: none"> ○ Clarified the cap of RCU/RCD bid validation to be consistent with the filed Tariff.



Date	Version	Description
		<ul style="list-style-type: none"> ○ Clarified that RMR resources RCU/RCD bid MW quantity will be additionally limited by their RMR capacities. ● DAME-BRQ-04137 <ul style="list-style-type: none"> ○ Updated to replace Apnode with Anode for Surplus Zone Shift Factor. ● DAME-BRQ-04453A <ul style="list-style-type: none"> ○ Added for the moved IFM access of Apnode for each BAA Imbalance Demand Hub and IR Surplus Zone from MF from DAME-BRQ-04454, and added Anode to the access. ● DAME-BRQ-04454 <ul style="list-style-type: none"> ○ Updated to move IFM access of Anode and Apnode for each BAA Imbalance Demand Hub and IR Surplus Zone from MF to DAME-BRQ-04453A. ● DAME-BRQ-05000 <ul style="list-style-type: none"> ○ Clarified the cap of RCU bid insertion/extension to be consistent with the filed Tariff. ○ Clarified that RMR resources RCU bid MW quantity insertion/extension will be additionally limited by their RMR capacities. ● DAME-BRQ-07265 <ul style="list-style-type: none"> ○ Updated to clarify the logic for calculating 15-min IRU/IRD/RCU/RCD Overlapping RA Capacity for MSG resources. ○ Updated to replace monthly with daily for generic and flex RA showings that are used for the calculation related to IRU/IRD and RCU/RCD overlapping RA capacity. ○ Updated to add a bullet that the RA overlapping capacity slicing by final DA energy bid segments applies to IRU/IRD but not RCU/RCD. ○ Updated to add a clarification note that RA Capacity is relative to FMM Min Ex Cap for NGRs and absolute value for non-NGRs. ● DAME-BRQ-07270 <ul style="list-style-type: none"> ○ Updated to Updated to replace monthly with time-block for the note about RA Showings and mapping data. ○ Updated LOC calculations to make it positive only. ○ Updated to split calculation of 15-min IRD LOC to be positive difference between final DA energy bid price and DA Energy LMP for the amount of 15-min resource IRD Overlapping RA capacity.



Date	Version	Description
		<ul style="list-style-type: none"> ○ Update to emphasize exclusion of Energy Self Schedule from LOC calculations. ● DAME-BRQ-07610 <ul style="list-style-type: none"> ○ Updated to clarify that for MSG resources, the calculation will be calculated for each MSG config then translated to MSG plant level. ● DAME-BRQ-07615 <ul style="list-style-type: none"> ○ Updated to clarify that for MSG resources, the calculations will be performed on MSG plant level. ● DAME-BRQ-09160 <ul style="list-style-type: none"> ○ Updated to remove the “minus sum of IRx No Pay Quantity over all resources within the BAA” from the IRx BAA Average Price formulation to be consistent with the Tariff. ○ Updated to correct the sign of IRx BAA Surplus Adjustment in the IRx BAA Allocation Cost formulation from “+” to “-“. ○ Updated to change formulation of Tier-1 IRx and RCx BAA Allocation Prices to ensure they are not negative (capped at 0, by adding “Max (0, ”). ● DAME-BRQ-09180 <ul style="list-style-type: none"> ○ Updated to remove the “minus sum of RCx No Pay Quantity” from the RCx BAA Average Price formulation to be consistent with the Tariff. ○ Updated to change formulation of Tier-1 IRx and RCx BAA Allocation Prices to ensure they are not negative (capped at 0, by adding “Max (0, ”). ● DAME-BRQ-09380 <ul style="list-style-type: none"> ○ Updated to replace monthly with daily for generic and flex RA showings that are used for the allocation of the IR and RC overlapping RA capacity amount. ○ Updated to cap at 0 the Hourly IRx and RCx Overlapping RA Capacity Amount to guard against LSE SC being charged. ● DAME-BRQ-10350 <ul style="list-style-type: none"> ○ Added for OASISI to publish FRU/FRD input data for demand, wind, solar forecasts for RTPD binding interval. ● DAME-BRQ-10780 <ul style="list-style-type: none"> ○ Updated to clarify the publishing of 15-min IRU/IRD LOC and IRU/IRD & RCU/RCD overlapping RA capacity in CMRI is accessed by each resource’s associated SC of LSE ID. ● DAME-BRQ-11420

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

Date	Version	Description
		<ul style="list-style-type: none"> ○ Updated to replace monthly with time-block for RA to LSE mappings data and generic and flex RA showings for data published to FERC. ● DAME-BRQ-13018 <ul style="list-style-type: none"> ○ Added for CIRA to display SC of LSE ID to all suppliers, LSE and CAISO users via UI.

Disclaimer and Understanding

All information contained in this draft Business Requirements Specification (BRS) as provided by the California Independent System Operator Corporation (ISO) is prepared for discussion and information purposes only. The draft BRS is provided “as is” without representation or warranty of any kind, including, without limitation, a representation or warranty as to accuracy, completeness, or appropriateness for any particular purpose. The draft BRS shall be revised as the development and review of the business requirements progresses. The ISO assumes no responsibility for the consequences of any errors or omissions. The ISO may revise or withdraw all or part of this information at any time at its discretion without notice.




 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

Table of Contents

1	Introduction	20
1.1	Purpose	20
1.2	Conventions.....	20
1.3	Scope.....	20
1.4	Acronym and Terms Definitions	21
2	Intellectual Property Ownership	22
2.1	Checklist.....	22
3	Details of Business Need/Problem	23
3.1	Description.....	23
4	Business Impacts	24
4.1	Business Practice Manual (BPM).....	24
4.2	Other.....	25
5	Business Requirements	26
5.1	Business Process: Resource Management (Master File).....	26
5.1.1	<i>Business Requirements</i>	26
5.2	Business Process: Manage the Balancing Authority Requirements Calculator.....	33
5.2.1	<i>Business Requirements</i>	33
5.3	Business Process: Calculate & Monitor Energy Costs & Indices.....	46
5.3.1	<i>Business Requirements</i>	46
5.4	Business Process: Manage DAM – IFM	50
5.4.1	<i>Business Requirements</i>	50
5.5	Business Process: Manage DAM – RUC.....	79
5.5.1	<i>Business Requirements</i>	79
5.6	Business Process: Manage RTM	92
5.6.1	<i>Business Requirements</i>	92
5.7	Business Process: Manage Market Quality System.....	95
5.7.1	<i>Business Requirements</i>	95
5.8	Business Process: Manage Market Billing and Settlements.....	103
5.8.1	<i>Business Requirements</i>	103
5.9	Business Process: Manage Market Reporting	120
5.9.1	<i>Business Requirements</i>	121

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.10	Business Process: Manage FERC Reporting	134
5.10.1	<i>Business Requirements</i>	134
5.11	Business Process: Manage Resource Adequacy Requirements (CIRA)	138
5.11.1	<i>Business Requirements</i>	138
5.12	Business Process: <Market/Business Simulation>	141
5.12.1	<i>Business Requirements</i>	141
6	Appendices	146
6.1	Appendix-A – Acronym Definition	146
6.2	Appendix-B: Formulas, Calculation Details, and Examples	164
6.2.1	<i>Eligibility Tables</i>	164
6.2.2	<i>Bidding Obligation</i>	169

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

1 Introduction

1.1 Purpose

The purpose of this document is to capture and record a description of what the Users and Business Stakeholders of the project wish to obtain, by providing high level business requirements. This document establishes the basis for the agreement between the initiators and implementers of the project. The information in this document serves as input to determine the scope of projects and all Business Process Modeling and System Requirements Specifications efforts.

Business requirements are what must be delivered to provide value for the Users and Business Stakeholders. Systems, software, and processes are the ways (how) to deliver, satisfy or meet the business requirements (what).

The objective of this initiative is to enhance the California ISO's (CAISO's) day-ahead market by: (BOG: May 2023, In production: Fall 2026)

- Introducing an imbalance reserve (IRU/IRD) product to provide flexible capacity to account for real-time ramping needs that are greater than accounted for in hourly day-ahead market schedules and to account for real-time net load uncertainty;
- Enhancing the residual unit commitment process to also ensure there is sufficient downward dispatch capability (RCU/RCD) in the event real-time load is less than scheduled in the integrated forward market.

The CAISO proposes to preserve the sequential integrated forward market and residual unit commitment process (IFM, RUC)


1.2 Conventions

- None

1.3 Scope

High level Impact analysis:

- **MF:** Define and consume IRU/IRD and RCU/RCD related data.
- **Market products IRU/IRD, RCU/RCD:** Suppliers will provide price and quantity bids for capacity availability in both the upward and downward direction that the market will use to award both imbalance reserves (IRU/IRD, 15-minute ramp dispatchable in IFM) and reliability capacity (RCU/RCD, hourly dispatchable in RUC). Set resource eligibility of IRU/IRD, RCU/RCD in MF.


 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

- **IRU/IRD requirement:** An imbalance reserves up and down product to the integrated forward market with a requirement based on historical uncertainty between the day-ahead and real-time markets using quantile regression (Internal ISO System, DAM)
- **ISO Internal System:** Setting IR/RC DAB for Calculated and Negotiate Rate Ranking Option.
- **Co-optimization IRU/IRD** products with energy and ancillary services to schedule resources (MPM, IFM, SIBR)
 - Set up IRU/IRD procurement constraints
 - Apply market power mitigation to IRU in the same manner for energy
 - An imbalance reserve award will obligate a supplier to provide economic energy bids in the real-time market (RTM, SIBR)
 - Ensure imbalance reserves are deliverable using IRU/IRD deployment scenario.
 - Modeling these transmission constraints including IRU/IRD, using same DF as energy of the resource, no incremental transmission losses, have MP for IRU/IRD (MPM,IFM)
 - Publish IRU/IRD (CMRI, OASIS)
- **Optimize RCU/RCD** products in RUC with energy, IRU/IRD and ancillary services award/schedule from IFM (RUC)
 - Apply market power mitigation to RCU
 - RCU/RCD will obligate to provide economic energy bids in the real-time market (RTM, SIBR)
 - Modeling transmission constraints that have MP for RCU/RCD (MPM/RUC)
 - Publish RCU/RCD (CMRI, OASIS)
- Enhance the residual unit commitment (RUC) process to establish the binding configuration for multi-stage generating (MSG) resources. (RUC, CMRI)
- RTM run with IRU/IRD, RCU/RCD awards must offer obligation and price bid cap.

- **Settlement for IRU/IRD, RCU/RCD payment, cost allocation, Unavailability No Pay, BCR and GMC**
 - Resources awarded IRU/IRD, RCU/RCD will be paid a day-ahead payment at the marginal price for the relevant product.
 - Ramping provided by imbalance reserve awards and forecasted movement in the day-ahead market will be settled against forecasted movement and flexible ramping product in the real-time market.
 - Resource economic limit not support IRU/IRD, exclude 5 minute uncertainty, subject to No Pay,
 - Resource economic limit not support RCU/RCD subject to No Pay
 - The market will recover the costs of these products through a cost allocation that collects payments from entities based on their contribution to the need to procure the product.
 - BCR: IRU/IRD for DAM BCR, RCU/RCD for RTM BCR
 - GMC: GMC market service charge apply to IRU/IRD, RCU/RCD
- **CMRI/OASIS:** report IRU/IRD, RCU/RCD
- **FODD:** Publish IRU/IRD, RCU/RCD related data to FERC

1.4 Acronym and Terms Definitions

Refer to **Appendix-A – Acronym Definition**


 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

2 Intellectual Property Ownership

Intellectual Property covers a broad array of information and materials, including written works, computer programs, software, business manuals, processes, symbols, logos and other work products. Determining ownership of Intellectual Property is very important in preserving the rights of the California ISO, and helps to avoid Intellectual Property infringement issues. In considering the business requirements or service requirements to be performed, the business owner of the project must determine Intellectual Property Ownership.

2.1 Checklist


All information in this document is the Intellectual Property (copyright, trademark, patent, and/or trade secret) of the California ISO.

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

3 Details of Business Need/Problem

3.1 Description


Business Opportunity/Problem Statement:	
What:	<p>The objective of this initiative is to enhance the California ISO's (CAISO's) day-ahead market by:</p> <ul style="list-style-type: none"> * Introducing an imbalance reserve (IRU/IRD) product to provide flexible capacity to account for real-time ramping needs * Enhancing the residual unit commitment process to also ensure there is sufficient downward dispatch capability (RCU/RCD) * Enhancing the day-ahead market to maximize benefits of greater West-wide diversity in the day-ahead optimization for Western Energy Imbalance Market participants
When:	<p>Fall 2026</p>
Why do we have this opportunity/problem:	<p>Imbalance reserves will ensure the day-ahead market schedules sufficient real-time dispatch capability to meet net load imbalances and ramping needs that materialize between the day-ahead and real-time markets. These imbalances have increased in recent years because of increasing amounts of weather- dependent supply and load resources on the CAISO grid.</p>
Who does this opportunity/problem impact:	<ul style="list-style-type: none"> • Real-Time Operations • Market Performance and Advanced Analytics • STF • Market Services • Market Participants • Customer Service • Policy • Legal

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

4 Business Impacts


4.1 Business Practice Manual (BPM)

BPM	Description of Impact(s)
Definitions and Acronyms	Yes
Market Instruments	Yes
Market Operations	Yes
Reliability Requirements	Yes
Settlements and Billing	Yes

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

4.2 Other

Impact	Description (optional)
Market Simulation	Yes
Market Participant Impact	Yes
External Bid Publication	Yes
User Acceptance Testing (UAT)	Yes
Operational Procedures	Yes
Customer Readiness Impact	
1. External Communication Needed	Yes
2. External Onboarding and Maintenance	No
• External Training	Yes
• External Computer Based Training	Yes
Policy Initiative	Yes

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5 Business Requirements

The sections below describe the Business processes and the associated business requirements involved in the project. These may represent high-level functional, non-functional, reporting, and/or infrastructure requirements. These business requirements directly relate to the high-level scope items determined for the project.

5.1 Business Process: Resource Management (Master File)


- Define Resource IRU and IRD eligibility
- Define Resource RCU and RCD eligibility
- Define and Consume IR and RC DAB Ranking Options
- Set MSS-Specific Annual RUC Participation Flag to Always Opt-In
- Set RUC Participation Flag for LESRs to Y
- Define Imbalance demand Hub Anode and Apnode
- Define IR Surplus Zones and associated Anodes and Apnodes
- Define EDAM BAA Participation and Date
- Update GMC rates

5.1.1 Business Requirements

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-01000	<p>Define Imbalance Reserve Up (IRU) and Imbalance Reserve Down (IRD) eligibility for the resource in DAM:</p> <ul style="list-style-type: none"> • Define resource and intertie eligibility for Imbalance reserve product (IR): <ul style="list-style-type: none"> ○ Separate flag for upper (IRU), down (IRD) for all upper eligible registered resources ○ Certified Capacity (MW) for IRU and IRD (IRU_{max}, IRD_{max}), calculated by System based on 30-minute ramp, capped by Pmax/Pmin, using the below formulas. ○ For NGR, the IRU eligibility and Certified Capacity are limited to positive (discharging) range, and the IRD eligibility and Certified 	Core	Master File RDT




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>Capacity are limited to the negative (charging) range.</p> <ul style="list-style-type: none"> Pass the IRU, IRD flags and Certified Capacity MW to the downstream systems <p>Formulas:</p> <ul style="list-style-type: none"> For IRU: <ul style="list-style-type: none"> If $SUT \leq 15'$: <ul style="list-style-type: none"> $IRU_{max} = \text{Max}\{ \text{Min}[(P_{min} + [(15' - SUT) * RR]), P_{max}], \text{Min}[(30' * RR), (P_{max} - P_{min})] \}$ If $SUT > 15'$: <ul style="list-style-type: none"> $IRU_{max} = \text{Min}\{ (30' * RR), (P_{max} - P_{min}) \}$ For IRD: <ul style="list-style-type: none"> $IRD_{max} = \text{Min}\{ (30' * RR), (P_{max} - P_{min}) \}$ Where RR is highest value among operational ramp rate segments in MW/min. <p>Note:</p> <p>Resource provide the capacity product must register in MF</p> <p>The IRU/IRD eligibility flags and corresponding <i>Certified Capacity</i> MW quantities should be added to GRDT as read-only.</p> <p>Note:</p> <ul style="list-style-type: none"> Refer to Resource Eligibility Table in Appendix-B: Formulas, Calculation Details, and Examples 		
DAME-BRQ-01010	<p>Define Reliability Capacity Up (RCU) and Reliability Capacity Down (RCD) eligibility:</p> <ul style="list-style-type: none"> Define physical market resource eligibility for Reliability Capacity (RC): <ul style="list-style-type: none"> Separate flag for upper (RCU), down (RCD) Certified Capacity (MW) for RCU and RCD (RCU_{max}, RCD_{max}), calculated based on 60-minute ramp, capped by Pmax/Pmin, using the below formulas. 	Core	Master File RDT

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ For NGR, the RCU eligibility and Certified Capacity are limited to positive (discharging) range, and the RCD eligibility and Certified Capacity are limited to the negative (charging) range ● Pass the RCU, RCD flags and Certified Capacity MW to the downstream systems <p>Formulas:</p> <ul style="list-style-type: none"> ● For RCU: <ul style="list-style-type: none"> ○ If $SUT \leq 60'$: <ul style="list-style-type: none"> ▪ $RCU_{max} = \text{Max}\{ \text{Min}[(P_{min} + [(60' - SUT) * RR]), P_{max}] , \text{Min}[(60' * RR) , (P_{max} - P_{min})] \}$ ○ If $SUT > 60'$: <ul style="list-style-type: none"> ▪ $RCU_{max} = \text{Min}\{ (60' * RR), (P_{max} - P_{min}) \}$ ● For RCD: <ul style="list-style-type: none"> ○ $RCD_{max} = \text{Min}\{ (60' * RR) , (P_{max} - P_{min}) \}$ ● Where RR is highest value among operational ramp rate segments in MW/min. <p>Note: The RCU/RCD eligibility flags and corresponding Certified Capacity MW quantities should be added to GRDT as read-only</p> <p>Note:</p> <ul style="list-style-type: none"> ● Resources/MSG configurations will only get awarded RCU or RCD, not both. ● Long Start Units are eligible to participate in RUC and bid for RCU/RCD. ● Refer to Resource Eligibility Table in Appendix-B: Formulas, Calculation Details, and Examples 		




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-01040	<p>Define IR and RC DAB Ranking Options</p> <ul style="list-style-type: none"> • System shall define the following <u>separate</u> resource-specific fields, for all resources, including NGRs: <ul style="list-style-type: none"> ○ IRU DAB Options Ranking ○ IRD DAB Options Ranking ○ RCU DAB Options Ranking ○ RCD DAB Options Ranking • Supported possible numeric rankings are for: <ul style="list-style-type: none"> ○ Null (for IR/RC non-eligible resources) ○ (1 or 2) Calculated (for IR/RC eligible resources) ○ (1 or 2) Negotiated Rate (for IR/RC eligible resources) 	Core	<ul style="list-style-type: none"> • MF
DAME-BRQ-01060	<p>Consume IR and RC DAB Ranking Options from Resources' SCs</p> <ul style="list-style-type: none"> • System shall consume the following <u>separate</u> resource-specific fields from resources' SCs, respectively, for all resources, including NGRs: <ul style="list-style-type: none"> ○ IRU DAB Options Ranking ○ IRD DAB Options Ranking ○ RCU DAB Options Ranking ○ RCD DAB Options Ranking • Supported possible numeric rankings are for: <ul style="list-style-type: none"> ○ Null (for IR/RC non-eligible resources) ○ (1 or 2) Calculated (for IR/RC eligible resources) ○ (1 or 2) Negotiated Rate (for IR/RC eligible resources) <p>Notes</p> <ul style="list-style-type: none"> • If Negotiated Rate Option is ranked as 1, but no Negotiated Rate process was in place, CAISO will revert to the next ranking option, which is the Calculated option. • For the first year from Go-Live, the Negotiated Rate option for IRU/IRD and RCU/RCD will not be supported, until CAISO gains more operational experience with associated bid and costs. • Rankings should be consistent across up and down products; i.e. if Calculated is ranked 1 for IRU, it should also be ranked 1 for IRD. 	Core	<ul style="list-style-type: none"> • MF • RDT
DAME-BRQ-01080	<p>Default IR and RC DAB Ranking Options</p> <p>System shall use the following default numeric values for resource-specific IRU/IRD and RCU/RCD DAB Options Ranking, for all resources, including NGRs:</p>	Core	<ul style="list-style-type: none"> • MF


 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> Null (for non-eligible resources) (1) Calculated (for eligible resources) (2) Negotiated Rate (for eligible resources) 		
DAME-BRQ-01130	<p>Set MSS-Specific Annual RUC Participation Flag to Always Opt-In</p> <ul style="list-style-type: none"> MSS-specific Annual RUC participation flag shall be set to always Opt-In, regardless of their MSS election type, starting from Tariff activation date. This annual flag setting shall override the previous annual flag setting for the remainder of the year. <p>Notes</p> <ul style="list-style-type: none"> For this project, Tariff activation date is same as Go-Live date. 	Core	<ul style="list-style-type: none"> MF
DAME-BRQ-01135	<p>Set RUC Participation Flag for LESRs to Yes</p> <ul style="list-style-type: none"> RUC participation flag for LESRs shall be set to Yes, starting from Tariff activation date. This participation flag setting shall override the previous flag setting for the remainder of the year. <p>Notes</p> <ul style="list-style-type: none"> For this project, Tariff activation date is same as Go-Live date. 	Process	<ul style="list-style-type: none"> MF
DAME-BRQ-01150	<p>Define Imbalance Demand Hub for each BAA</p> <ul style="list-style-type: none"> Define Anode for the BAA Imbalance demand Hub, include load nodes, solar resource Cnodes and Wind resource Cnodes. The Anode associated APnode shall have type same as LAP. Define default Distribution factors for Imbalance Demand Hub, normalize the default LDF and Solar and Wind resource GDF based on Pmax. 	Core	<ul style="list-style-type: none"> MF
DAME-BRQ-01160	<p>Define IR surplus zones for an EDAM BAA, consistent with FRP surplus zones for the same BAA</p>	Core	<ul style="list-style-type: none"> MF

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • The IR/FRP Surplus Zones shall be used in the market to distribute IR Surplus variables in DAM and distribute FRP surplus variables in RTM. • Each surplus zone shall have its associated Anode and Apnode. 		
DAME-BRQ-01200	<p>Define EDAM BAA Participation and Date</p> <ul style="list-style-type: none"> • Define BAA with EDAM participation flag • Define activate date <p>Note: EDAM participation requirement also in EDAM-BRQ-02020 that link to the EDAM Tariff section.</p>	Core	<ul style="list-style-type: none"> • MF
DAME-BRQ-01220	<p>Update GMC Rates Effective January 1, 2026</p> <ul style="list-style-type: none"> • The following GMC rate shall be terminated: <ul style="list-style-type: none"> ○ System Operations (SYSOPR) • The following GMC rates shall be created: <ul style="list-style-type: none"> ○ System Operations Real-Time Dispatch (SYSOPRTD) <ul style="list-style-type: none"> ▪ Applies to EDAM, CAISO BAA. ○ System Operations Balancing Authority Area Services (SYSOPBAA) <ul style="list-style-type: none"> ▪ Applies to CAISO BAA. • The following existing GMC rate shall be updated: <ul style="list-style-type: none"> ○ WEIM System Operations (ESYSOPR) GMC rate shall be set equal to System Operations Real-Time Dispatch (SYSOPRTD) GMC rate. <ul style="list-style-type: none"> ▪ WEIM System Operations (ESYSOPR) GMC rate is already defined in MF. ▪ The only change is re-setting its value. ▪ This GMC rate will apply to WEIM-only BAAs. <p>Note</p> <ul style="list-style-type: none"> • For more <i>details</i> regarding the GMC rate, see the new Cost of Service Initiative. 	Core	<ul style="list-style-type: none"> • MF

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


5.2 Business Process: Manage the Balancing Authority Requirements Calculator

For IRU/IRD requirement forecast parameters estimation use quantile regression model:


- Mark all days as Weekdays Day Type for IR Quantile Regression Model
- Calculate (DA-RTPD) forecast up/down extreme variation
- Calculate the second-order polynomial coefficients of the High/Low Percentile quadratic quantile regression for uncertainty of demand, solar, wind and MOSAIC
- Calculate High/Low Percentile forecast uncertainty histogram for Load, wind, Solar, net load *and maximum boundary for IRU/IRD*
- Calculate IRU/IRD demand price curve

5.2.1 Business Requirements


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-02000	<p>General statement:</p> <p>Extend FRP requirements forecast quantile regression model to Imbalance Reserve requirement forecast and demand price curve</p> <p>The system stores the historical data and estimate the parameters of the statistic forecast model.</p>	Process	Internal ISO System
DAME-BRQ-02005	<p>Mark all days as Weekdays Day Type for BARC's IR Quantile Regression Model</p> <p>Day Types calendar that are used by BARC for IR quantile regression model calculations shall mark all days starting from Go-Live date as one type (Weekday).</p>	Process	Internal ISO System
DAME-BRQ-02010	<p>Set the configurable parameters for the quantile regression for IR</p> <p>The system shall have a set of system-wide configurable initialization parameters (separate set for FRP and IR) for Imbalance Requirement (IR) :</p> <ul style="list-style-type: none"> ○ the High Percentile, initially set to 97.5% (0.975) 	Core	Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ the Low Percentile, initially set to 2.5% (0.025) ○ for the High Percentile Threshold, initially set to 99% (0.99) ○ the Low Percentile Threshold, initially set to 1% (0.01) 		
DAME-BRQ-02011 (Production-Track)	<p>Set Configurable Sampling Scheme Parameters for the Quantile Regression for IR</p> <p>The system shall have a set of system-wide configurable sampling scheme parameters (separate set for FRP and IR) for Imbalance Requirement (IR) :</p> <ul style="list-style-type: none"> ○ Data Retention Period, initially set to 365 days ○ Configurable parameter to select Sampling Scheme: <ul style="list-style-type: none"> ○ Rolling sampling (current) ○ Symmetrical sampling (backward/forward) for matching day and month (default option) ○ Set configurable sample days (if Symmetrical sampling option is selected, default this parameter to 75 days backward and 75 days forward) <p>Note</p> <ul style="list-style-type: none"> ○ This BRQ will be implemented in production track ahead of the DAME Go-Live. 	Core	Internal ISO System
DAME-BRQ-02012	<p>Access EDAM BAAs</p> <ul style="list-style-type: none"> ● Access DAM BAA definition from MF ● Access the EDAM_AREA definition from MF 	Core	Internal ISO System (from MF)
DAME-BRQ-02020	<p>Consume and store the trading day DAM forecast data of demand(d) /solar(s)/wind(w) for each BAA and aggregate for the entire DAM area</p>	Core	Internal ISO System (from IFM)

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>At the end of each DAM, the system shall consume the following data for each Trading Hour in the previous Trading Day for each BAA in the DAM Area:</p> <ul style="list-style-type: none"> • DAM binding total demand forecast(d) • DAM binding total solar forecast(s) for each 60min interval • DAM binding total wind forecast(w) for each 60min interval <p>The system shall store this hourly forecast for demand/solar/wind for the Data Retention Period by BAA, Trading Day, Day Type, Trading Hour and market DAM.</p> <p>Notes</p> <ul style="list-style-type: none"> • lowercase (d, s, w) is for independent forecast data • uppercase (D,S,W) is the dependent uncertainty data • Refer to DAME-BRQ-02010 for data retention business requirement. 		
DAME-BRQ-02030	<p>Consume and store the demand(d)/solar(s)/wind(w) trading day RTPD forecast data</p> <p>At the end of each Trading Day, the system shall consume the following data for each Trading Hour in that Trading Day for each BAA in the DAM area:</p> <ul style="list-style-type: none"> • FMM binding demand forecast for each 15 min interval • FMM binding solar forecast for each 15 min interval • FMM binding wind forecast for each 15 min interval <p>The system shall store this information for the Data Retention Period by Trading Day, Day Type, Trading Hour, and DAM/FMM Trading Interval.</p>	Existing System Functionality	Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-02040	<p>Calculate uncertainty as hourly maximum and minimum differences (two samples) between RTPD and DAM for the demand/solar/wind binding forecasts</p> <p>After each Trading Day, the system shall calculate the uncertainty for each 60min period of each Trading Hour in that Trading Day, for each BAA in the DAM Area, for the entire DAM Area:</p> <ul style="list-style-type: none"> • the algebraic difference between the <i>maximum/minimum demand</i> forecast of the four binding 15 minute RTPD intervals in that 60min period and the corresponding DAM hourly forecast in that 60min period • the algebraic difference between the <i>maximum/minimum solar</i> forecast of the four binding 15 minute RTPD intervals in that 60min period and the corresponding DAM hourly forecast in that 60min period • the algebraic difference between the <i>maximum/minimum wind</i> forecast of the four binding 15 minute RTPD intervals in that 60min period and the corresponding DAM hourly forecast in that 60min period • The system shall calculate hourly maximum and minimum difference values of demand, solar and wind for the Data Retention Period by Trading Day, Day Type, Trading Hour of DAM horizon. 	Core	Internal ISO System
DAME-BRQ-02050	<p>Manage rolling day of retention period for DAM</p> <p>The system shall roll the Data Retention Period at the end of each Trading Day by one Trading Day, deleting the data for the first Trading Day in the Data Retention Period.</p>	Core	Internal ISO System
DAME-BRQ-02060	<p>Retrieve the total maximum capacity of solar/wind for each BAA and aggregate for the entire DAM area</p> <p>After rolling the Data Retention Period, the system shall</p>	Existing	Internal ISO System (from MF)

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> Retrieve the maximum capacity of VER resources by solar/wind at any given Trading Day (D+1) for each BAA and then aggregate for the entire DAM Area. Store this information for the Data Retention Period by Trading Day and Day Type. 		
DAME-BRQ-02070	<p>Adjust solar/wind forecast and uncertainty for each day in retention period:</p> <p>After rolling the Data Retention Period, For each trading day in the Data Retention Period for the Day Type of the next Trading Day (D+1), for each BAA and DAM Area system shall calculate</p> <ul style="list-style-type: none"> The solar/wind capacity factor as the ratio of the total solar/wind capacity in the next Trading Day (D+1) over the total solar/wind capacity in the Trading Day in the Data Retention Period. Adjust the solar/wind forecast and uncertainty data by multiplying the data with the solar/wind capacity factor of the Trading Day (D+1) in the Data Retention Period. 	Core	Internal ISO System
DAME-BRQ-02080	<p>Calculate and store net demand uncertainty as maximum/minimum net demand difference between RTPD and DAM for retention period</p> <p>After rolling the Data Retention Period, For each Trading Hour in each Trading Day in the Data Retention Period for the Day Type of the next Trading Day (D+1), for each BAA and the DAM Area</p> <ul style="list-style-type: none"> Calculate the net demand forecast (nd) as the demand forecast minus the adjusted solar forecast minus the adjusted wind forecast for each hour in DAM and each binding 15 minute intervals in RTPD Calculate the hourly net demand forecast uncertainty (ND) as the algebraic difference between the <i>maximum/minimum</i> net demand forecast of the 4 	Core	Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	binding RTPD intervals and DAM in the corresponding hour (two samples).		
DAME-BRQ-02090	<p>Calculate and store the Hourly High/lower percentile of histogram(H) for uncertainty of Demand(D) /Solar(S) /Wind(W) /Net demand(ND)</p> <p>After rolling the Data Retention Period, for each Trading Hour in the Data Retention Period for the Day Type of the next Trading Day (D+1), for each BAA and DAM Area</p> <p>Calculate and store:</p> <ul style="list-style-type: none"> the High/Low Percentile demand forecast uncertainty histogram ($D_{60}^{H97.5}$) / ($D_{60}^{H2.5}$) the High/Low Percentile adjusted solar forecast uncertainty histogram ($S_{60}^{H97.5}$) / ($S_{60}^{H2.5}$) the High/Low Percentile adjusted wind forecast uncertainty histogram ($W_{60}^{H97.5}$) / ($W_{60}^{H2.5}$) the High/Low Percentile net demand forecast uncertainty histogram ($ND_{60}^{H97.5}$) / ($ND_{60}^{H2.5}$) 	Core	Internal ISO System
DAME-BRQ-02100	<p>Calculate and store the hourly second-order polynomial coefficients of the High /Low Percentile quadratic quantile regression for uncertainty of Demand(D)/Solar(S)/Wind(W)</p> <p>After rolling the Data Retention Period, for each Trading Hour in the Data Retention Period for the Day Type of the next Trading Day (D+1), for each BAA and DAM Area</p> <p>Calculate and store the second-order polynomial coefficients of the High/low Percentile quadratic quantile regression of uncertainty of forecast of:</p> <ul style="list-style-type: none"> Demand: <p>($A_{60}^{D97.5}, B_{60}^{D97.5}, C_{60}^{D97.5}$) / ($A_{60}^{D2.5}, B_{60}^{D2.5}, C_{60}^{D2.5}$) through regression</p> $D_{60}^{P97.5}(d) \equiv A_{60}^{D97.5} d^2 + B_{60}^{D97.5} d + C_{60}^{D97.5}$ $D_{60}^{P2.5}(d) \equiv A_{60}^{D2.5} d^2 + B_{60}^{D2.5} d + C_{60}^{D2.5}$	Core	Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • Solar: $(A_{60}^{S97.5}, B_{60}^{S97.5}, C_{60}^{S97.5}) / (A_{60}^{S2.5}, B_{60}^{S2.5}, C_{60}^{S2.5})$ through regression $S_{60}^{P97.5}(s) \equiv A_{60}^{S97.5} s^2 + B_{60}^{S97.5} s + C_{60}^{S97.5}$ $S_{60}^{P2.5}(s) \equiv A_{60}^{S2.5} s^2 + B_{60}^{S2.5} s + C_{60}^{S2.5}$ • Wind: $(A_{60}^{W97.5}, B_{60}^{W97.5}, C_{60}^{W97.5}) / (A_{60}^{W2.5}, B_{60}^{W2.5}, C_{60}^{W2.5})$ through regression $W_{60}^{P97.5}(w) \equiv A_{60}^{W97.5} w^2 + B_{60}^{W97.5} w + C_{60}^{W97.5}$ $W_{60}^{P2.5}(w) \equiv A_{60}^{W2.5} w^2 + B_{60}^{W2.5} w + C_{60}^{W2.5}$ <p><i>Note:</i> lowercase (<i>d, s, w</i>) is for independent variables for forecasts uppercase (<i>D, S, W</i>) is the dependent variables for calculated uncertainty data, difference between DAM and RTPD to estimate <i>A, B, C</i>, use historical forecast and uncertainty data (historical uncertainty data will have 2 samples for each hour with max/min)</p> <p><i>2 samples of uncertainty will be used in both high/low percentile regression, meaning same sample set for High/low percentile parameter estimation.</i></p>		
DAME-BRQ-02110	<p>Construct input of mosaic for high/low percentile mosaic regression</p> <p>After rolling the Data Retention Period, for each Trading Hour in the Data Retention Period for the Day Type of the next Trading Day (D+1), for each BAA and DAM Area</p> <p>Based on Histogram and quadratic Quantile Regression estimates uncertainty of load, wind, and solar</p> <p><i>Calculate:</i></p>	Core	Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ <i>Input (m=uncertainty of net load) for High percentile mosaic regression:</i> $m_{60}^{P97.5}(nd, d, s, w)$ $\equiv ND_{60}^{H97.5} - (D_{60}^{H97.5} - S_{60}^{H2.5} - W_{60}^{H2.5})$ $+ (D_{60}^{P97.5}(d) - S_{60}^{P2.5}(s) - W_{60}^{P2.5}(w))$ <ul style="list-style-type: none"> ○ <i>Input (m) for Low percentile mosaic regression:</i> $m_{60}^{P2.5}(nd, d, s, w)$ $\equiv ND_{60}^{H2.5} - (D_{60}^{H2.5} - S_{60}^{H97.5} - W_{60}^{H97.5})$ $+ (D_{60}^{P2.5}(d) - S_{60}^{P97.5}(s) - W_{60}^{P97.5}(w))$ <p>Note: There will be 2 samples of variable m created for each hour.</p>		
DAME-BRQ-02120	<p>Calculate and store the hourly second-order polynomial coefficients of the High /Low Percentile quadratic quantile regression for mosaic (M)</p> <p>After rolling the Data Retention Period, for each Trading Hour in the Data Retention Period for the Day Type of the next Trading Day (D+1), for each BAA and DAM Area</p> <p>Calculate and store the second-order polynomial coefficients of the High/low Percentile quadratic quantile regression of uncertainty of forecast of:</p> <ul style="list-style-type: none"> • Mosaic (Net Demand): $(A_{60}^{M97.5}, B_{60}^{M97.5}, C_{60}^{M97.5}) / (A_{60}^{M2.5}, B_{60}^{M2.5}, C_{60}^{M2.5}) \text{ through regression}$ $M_{60}^{P97.5}(m) \equiv A_{60}^{M97.5} m^2 + B_{60}^{M97.5} m + C_{60}^{M97.5}$ $M_{60}^{P2.5}(m) \equiv A_{60}^{M2.5} m^2 + B_{60}^{M2.5} m + C_{60}^{M2.5}$ <p>Note: In Quantile regression for Mosaic</p> <ul style="list-style-type: none"> • m include $m_{60}^{P97.5}$ and $m_{60}^{P2.5}$ for each hour calculated for historical data according to BRQ1110 	Core	Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> <i>M include calculation of Net Load uncertainty max/min for historical data according to BRQ1080</i> <i>2 samples of m and 2 samples of M will be used in both high/low percentile regression for parameter A,B,C estimation for M</i> 		
DAME-BRQ-02130	<p>Calculate High/low percentile threshold for uncertainty of net demand (ND)</p> <p>After rolling the Data Retention Period, the system shall calculate and store the hourly High/low Percentile Threshold net demand forecast uncertainty histogram (ND_{60}^{H99}) / (ND_{60}^{H1}) for each Trading Hour in the Data Retention Period for the Day Type of the next Trading Day (D+1), for each BAA and DAM Area.</p>	Core	Internal ISO System
DAME-BRQ-02140	<p>By 6:00am of DAM each Trading Day, the system shall broadcast the following hourly data</p> <p>For each Trading Hour in the next Trading Day for the Day Type of that Trading Day (D+1), for each BAA and DAM Area:</p> <ul style="list-style-type: none"> the High/low Percentile hourly forecast uncertainty histogram for: net demand: ($ND_{60}^{H97.5}$) / ($ND_{60}^{H2.5}$) demand: ($D_{60}^{H97.5}$) / ($D_{60}^{H2.5}$) adjusted solar: ($S_{60}^{H97.5}$) / ($S_{60}^{H2.5}$) adjusted wind: ($W_{60}^{H97.5}$) / ($W_{60}^{H2.5}$) the second-order polynomial coefficients of the High/low Percentile quadratic quantile regression of hourly forecast uncertainty <ul style="list-style-type: none"> demand: ($A_{60}^{D97.5}, B_{60}^{D97.5}, C_{60}^{D97.5}$) / ($A_{60}^{D2.5}, B_{60}^{D2.5}, C_{60}^{D2.5}$) Solar: ($A_{60}^{S97.5}, B_{60}^{S97.5}, C_{60}^{S97.5}$) / ($A_{60}^{S2.5}, B_{60}^{S2.5}, C_{60}^{S2.5}$) Wind: ($A_{60}^{W97.5}, B_{60}^{W97.5}, C_{60}^{W97.5}$) / ($A_{60}^{W2.5}, B_{60}^{W2.5}, C_{60}^{W2.5}$) Mosaic (net load) ($A_{60}^{M97.5}, B_{60}^{M97.5}, C_{60}^{M97.5}$) / ($A_{60}^{M2.5}, B_{60}^{M2.5}, C_{60}^{M2.5}$) 	Core	Internal ISO System




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> the hourly High/low Percentile Threshold forecast uncertainty histogram <ul style="list-style-type: none"> net demand $(ND_{60}^{H99}) / (ND_{60}^{H1})$ <p>Note: Market DAM will consume data to forecast the IRU and IRD requirements (IRUR/IRD). CMRI or OASIS will report the data</p>		
DAME-BRQ-02150	<p>Set, Store and broadcast IRU/IRD Requirement Threshold</p> <ul style="list-style-type: none"> Set and store configurable threshold to allow settings of the max/min IRU/IRD requirement for each BAA and DAM_AREA. If the threshold value is not provided, then 9999/0 is assumed. Broadcast max/min IRU/IRD requirement thresholds for the next Trade Day (D+1) $(IRUR_{60}^{max}) / (IRUR_{60}^{min}); IRDR_{60}^{max} / (IRDR_{60}^{min})$ <p>for each BAA and DAM area</p> <p>Note:</p> <ul style="list-style-type: none"> The threshold value will be used by DAM to cap the IRU/IRD requirement. The threshold values should be positive. 	Core	Internal ISO System
DAME-BRQ-02300	<p>Set configurable IRU and IRD price cap for the DAM</p> <p>Set configurable parameters for capping IRU and IRD demand curve respectively apply to every BAA. These parameters are subject to be scaled just like other penalty prices. Default parameters for</p> <ul style="list-style-type: none"> IRU price cap is \$55/MWh IRD price cap is \$55/MWh 	Core	Internal ISO System
DAME-BRQ-02310	<p>Consume DAM hourly forecast for demand, solar and wind for each BAA after 9 am</p>	Core	Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	Consume the hourly demand, solar and wind forecast for DAM time horizon, aggregated for each BAA for next Trade Day (D+1).		(from IFM [Pre-DAM])
DAME-BRQ-02320	<p>Calculate hourly demand price curve for IRU and IRD for each BAA using latest forecast following the completion of [IFM pre-DAM] run, with avoidance cost of \$247/MWh for IRU and -\$150/MWh for IRD, and an administration cap of \$55/MWh for both IRU/IRD</p> <p>At 10 am, calculate hourly demand price curve for IRU/IRD by BAA for next Trade Day (D+1), based on the latest hourly forecast data:</p> <p style="padding-left: 40px;">Monotonically decreasing stepwise price curve with N segments.</p> <p style="padding-left: 40px;">Equidistant percentile selection from P_0 to $P_N^{(-)}$ (0.025) and from P_0 to $P_N^{(+)}$ (0.975):</p> $\left\{ P_n^{(-)} = P_{n-1}^{(-)} - \frac{P_0 - P_N^{(-)}}{N}, n = 1, 2, \dots, N \right\} \text{ and } \left\{ P_n^{(+)} = P_{n-1}^{(+)} + \frac{P_N^{(+)} - P_0}{N}, n = 1, 2, \dots, N \right\}, \text{ where } P_0 = P_0^{(-)} = P_0^{(+)}$ <p style="padding-left: 40px;">The price curve quantities are the quantiles of the selected percentiles:</p> $Q(P_0 = P_0^{(-)} = P_0^{(+)}) \equiv 0, \{Q(P_n^{(-)}), n = 1, 2, \dots, N\}, \text{ and } \{Q(P_n^{(+)}) , n = 1, 2, \dots, N\}.$ <p style="padding-left: 40px;">These can be determined from the MOSAIC polynomial evaluation grid via linear interpolation.</p> <p style="padding-left: 40px;">The price curve segment prices are the products of the probability of uncertainty materializing beyond the start of each segment and the relevant energy price cap:</p> $\left\{ P_n^{(-)} ENPF, n = 0, 1, \dots, N - 1 \right\} \text{ and } \left\{ (1 - P_n^{(+)}) ENPC, n = 0, 1, \dots, N - 1 \right\}, \text{ where } ENPF \text{ is the}$	Core	Internal ISO System



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>avoidance cost floor (-\$150/MWh) and <i>ENPC</i> is the avoidance cost ceiling [\$247/MWh for IRU and - \$150/MWh for IRD]).</p> <ul style="list-style-type: none"> For IRU demand price curve for each hour interval for each BAA in the EDAM Area: $\left\{ Q \left(P_n^{(+)} \right), \left(1 - P_n^{(+)} \right) ENPC, \right\}$ $\left\{ \begin{array}{l} n = 0, 1, 2, \dots, N - 1 \end{array} \right\}$ <p>Where:</p> <p><i>N</i> is the Price Curve Segment Count</p> <p><i>ENPC</i> is the avoidance cost ceiling</p> <p><i>P</i>₀ is the percentile with zero quantile</p> <p><i>P</i>_{<i>N</i>}⁺ is the high percentile</p> $Q \left(P_n^{(+)} \right) = A_{60}^{MP_n^+} \left(M_{60}^{PP_n^+} \right)^2 + B_{60}^{MP_n^+} M_{60}^{PP_n^+} + C_{60}^{MP_n^+}$ <p>Where: $M_{60}^{PP_n^+} \equiv ND_{60}^{HP_n^+} - \left(D_{60}^{HP_n^+} - S_{60}^{H(1-P_n^+)} - W_{60}^{H(1-P_n^+)} \right) + \left(D_{60}^{PP_n^+}(d) - S_{60}^{P(1-P_n^+)}(s) - W_{60}^{P(1-P_n^+)}(w) \right)$</p> For IRD demand price curve for each hour interval for each BAA in the EDAM Area: $\left\{ Q \left(P_n^{(-)} \right), P_n^{(-)} ENPF, \right\}$ $\left\{ \begin{array}{l} n = 0, 1, 2, \dots, N - 1 \end{array} \right\}$ <p>Where:</p> <p>ENPF is the avoidance cost floor</p> <p><i>P</i>₀ is the percentile with zero quantile</p> <p><i>P</i>_{<i>N</i>}⁽⁻⁾ is the low percentile</p> 		

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> no steps of the demand curve will exceed the administrative ceiling of \$55/MWh for the imbalance reserve product <p>Note</p> <p style="margin-left: 40px;"><i>d – latest demand forecast for each BAA</i></p> <p style="margin-left: 40px;"><i>w – latest wind forecast for each BAA</i></p> <p style="margin-left: 40px;"><i>s – latest solar forecast for each BAA</i></p>		
DAME-BRQ-02340	<p>Broadcast IRU and IRD demand price curve before 10 am</p> <p>Broadcast demand price curve for</p> <ul style="list-style-type: none"> IRU each hour each EDAM BAA for the DAM horizon (D+1) before 10 am $\left\{ Q \left(P_n^{(+)} \right), \left(1 - P_n^{(+)} \right) ENPC, \right\}$ <p style="margin-left: 40px;"><i>n = 0, 1, 2, ..., N - 1</i></p> <ul style="list-style-type: none"> IRD each hour each EDAM BAA for the DAM horizon before 10 am $\left\{ Q \left(P_n^{(-)} \right), P_n^{(-)} ENPF, \right\}$ <p style="margin-left: 40px;"><i>n = 0, 1, 2, ..., N - 1</i></p>	Core	Internal ISO System


 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.3 Business Process: Calculate & Monitor Energy Costs & Indices


- Setting IR/RC DAB for Calculated Ranking Option
- Negotiated Rate IR/RC DAB (NDAB)
- Process for Establishing an NDAB for IRU or RCU
- Setting IR/RC DAB for Negotiated Option (NDAB)
- Replace SYSOPR GMC Rate with (SYSOPRTD+SYSOPBAA) GMC Rate in the Calculation of Variable-Cost-Based DAM and RTM DEBs

5.3.1 Business Requirements


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted										
DAME-BRQ-03040	<p>Setting IR/RC DAB for Calculated Ranking Option</p> <ul style="list-style-type: none"> • For resources (including NGRs) that have market product DAB Options Ranking set to “Calculated” as first option, System shall automatically set the DAB for these resources for that market product to a configurable values (initially set as below): <table border="1" style="margin-left: 40px;"> <thead> <tr> <th style="text-align: center;">Market Product</th> <th style="text-align: center;">DAB</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">IRU</td> <td style="text-align: center;">\$55/MWh</td> </tr> <tr> <td style="text-align: center;">IRD</td> <td style="text-align: center;">\$55/MWh</td> </tr> <tr> <td style="text-align: center;">RCU</td> <td style="text-align: center;">\$55/MWh</td> </tr> <tr> <td style="text-align: center;">RCD</td> <td style="text-align: center;">\$55/MWh</td> </tr> </tbody> </table> <ul style="list-style-type: none"> • There shall be separate DAB for IRU, IRD, RCU and RCD. • The IRU/IRD and RCU/RCD DAB shall have single segment. • The x-axis of all DABs shall be set to the entire Registered MW Capacity of the eligible resource, specifically calculated as: <ul style="list-style-type: none"> ○ Registered Max Capacity (Pmax) minus Registered Min Capacity (Pmin). 	Market Product	DAB	IRU	\$55/MWh	IRD	\$55/MWh	RCU	\$55/MWh	RCD	\$55/MWh	Core	<ul style="list-style-type: none"> • Internal ISO System
Market Product	DAB												
IRU	\$55/MWh												
IRD	\$55/MWh												
RCU	\$55/MWh												
RCD	\$55/MWh												

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> The IRU/IRD and RCU/RCD DAB shall be resource-specific daily granularity. The DAB value shall be applied to all the EDAM resources, include CASIO and EDAM BAAs. <p>Note:</p> <ul style="list-style-type: none"> The resource-specific daily DAB for IRU and RCU market products are needed for market power mitigation of IRU and RCU bids, respectively, as well as IRU and RCU bid insertion/creation in SIBR, respectively. The resource-specific daily DAB for IRD and RCD market products are needed for IRD and RCD bid insertion/creation in SIBR, respectively. Registered Pmin is negative for NGRs. 		
DAME-BRQ-03060	<p>Negotiated Rate IR/RC DAB (NDAB)</p> <p>System shall process IRU, IRD, RCU, and RCD DAB if all the following conditions are met:</p> <ul style="list-style-type: none"> Their resources elect Negotiated Rate DAB (NDAB) (for IRU, IRD, RCU, and RCD, respectively) as rank "1" If the requested Negotiated Rate DAB (NDAB) is greater than the corresponding Calculated DAB (currently defaulted at \$55/MWh) (business process). <p>Notes</p> <ul style="list-style-type: none"> Resources' SCs shall be responsible of negotiating the IRU/IRD and RCU/RCD NDAB if that option is applicable and will initiate the negotiation process. The ability for an SC to negotiate for an NDAB is suspended until CAISO issues a market notice it has gained the required operational experience about IR and RC NDAB. If CAISO does not issue market notice, the suspension period will end after 18 months from Tariff activation date (Go-Live date). 	Core	<ul style="list-style-type: none"> Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-03070	<p>Process for Establishing an NDAB for IRU or RCU</p> <p>The following process shall be adhered to for establishing NDAB for IRU or RCU:</p> <ul style="list-style-type: none"> • SC submits proposed NDAB along with supporting documentation via CIDI. • CAISO will provide written response within 10 business days of the SC's submitted application. • If CAISO accepts the SC-proposed NDAB, it will be effective within 11 business days of the date of acceptance until: <ul style="list-style-type: none"> ○ FERC modifies NDAB ○ CAISO and SC mutually agree to modify NDAB. ○ NDAB expires, get terminated, or modified by FERC order. • If CAISO rejected the SC-proposed NDAB, CAISO and SC will negotiate agreeable NDAB within 60 days negotiation period and it will become effective within 11 business days of the date of acceptance. If no agreement by end of 60 days, SC can file proposed NDAB with FERC and the DAB for IRU and RCU will be set to \$55/MWh until negotiation between SC and FERC is completed. • CAISO may require renegotiation the NDAB if the negotiated values become outdated, or erroneous, or if the SC has changed and may request the SC to provide more information. • CAISO shall make informational filing with FERC for any NDAB no later than 7 days after the end of the month in which CAISO approved the NDAB. <p>Notes</p> <ul style="list-style-type: none"> • The negotiated values will apply to the downward products (IRD and RCD) but will need to be consistent with whatever was negotiated for the upward products (IRU and RCU, respectively). 	Business Process	<ul style="list-style-type: none"> • Internal ISO System • CIDI
DAME-BRQ-03080	<p>Setting IR/RC DAB for Negotiated Option (NDAB)</p> <p>For resources (including NGRs) that have market product DAB Options Ranking set to "Negotiated" as first option, System shall</p>	Core	<ul style="list-style-type: none"> • Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>automatically set the NDAB for these resources based on the value or formulation that was negotiated with the SC.</p> <ul style="list-style-type: none"> • There shall be separate NDAB for IRU, IRD, RCU and RCD. • The IRU/IRD and RCU/RCD NDAB shall have single segment. • The IRU/IRD and RCU/RCD NDAB shall be resource-specific daily granularity. 		
DAME- BRQ-03090	<p>Replace SYSOPR GMC Rate with (SYSOPRTD+SYSOPBAA) GMC Rate in the Calculation of Variable-Cost-Based DAM and RTM DEBs</p> <p>Effective January 1, 2026</p> <ul style="list-style-type: none"> • System shall replace System Operations (SYSOPR) GMC rate with the sum of System Operations Real-Time Dispatch (SYSOPRTD) GMC rate and System Operations Balancing Authority Area Services (SYSOPBAA) in the calculations of Variable Cost-based DAM and RTM DEBs for CAISO BAA resources. 	Core	<ul style="list-style-type: none"> • Internal ISO System


 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.4 Business Process: Manage DAM – IFM

- Setup the configurable set of transmission constraints activate in IRU/IRD deployment scenarios
- Set up the configurable parameter for specify the IRU/IRD deployment scenarios percentage of contribution towards the transmission constraint
- Accept and validate IRU/IRD bids, MOO apply to Flex RA
- Accept and validate RCU/RCD bids, MOO apply to RA
- Consume hourly Histogram and second-order polynomial coefficients for IRU/IRD
- Calculate/broadcast 6&9 am hourly IRU/IRD requirements (IRUR/IRDR)
- Set IRU demand price curve
- Distribute IRUR/IRDR to load and VER nodes
- Include IRU/IRD deployment scenarios, use same SF as case cases
- Apply LMPM for energy bid by Including IRU and IRD deployment scenario in DCPA counter flow calculation and Energy LMP calculation
- Apply LMPM for IRU bid by including IRU deployment scenario in DCPA counter flow calculation and IRU nodal price calculation
- Procure IRU/IRD through co-optimization with energy and AS
- Calculate LMP for energy and IRU/IRD

5.4.1 Business Requirements


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-04004	<p>Specify the set of transmission constraints for IRU/IRD deployment scenarios</p> <ul style="list-style-type: none"> • Setup the configurable set of transmission constraints activate in IRU or IRD deployment scenarios <ul style="list-style-type: none"> ○ By individual constraint: enable or disable the constraints in IRU/IRD deployment scenarios, provide ability to group the constraints ○ The changes should persistent , default is to enforce all critical constraints ○ A constraint can't be activated for deployment scenarios only; if the constraint is not activated in base scenario, the activation in deployment scenario won't be in effect. • Build Operator display for control the activate transmission constraint in deployment scenarios 	Core	DAM

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> The same set of constraints in deployment scenarios apply to all the IFM passes, in MPM, GHG pass, IFM 		
DAME-BRQ-04005	<p>Specify configurable IRU and IRD deployment factors (DIRU/DIRD) configure portion of power flow related the IRU and IRD deployment scenarios</p> <ul style="list-style-type: none"> Set up the configurable deployment factors between 0 to 1 for specify the IRU/IRD deployment scenarios percentage of contribution on power flow towards the transmission constraint. Default value is 1 <p>Note:</p> <ul style="list-style-type: none"> The deployment factors (DIRU/DIRD) will affect IR MCC, consider the deployment factor in MPM, CRR 1B The product of DIRU/DIRD and shift factor should be higher than Shift Factor tolerance 	Core	DAM
DAME-BRQ-04008	<p>Allow eligible resource to submit one-segment bid for Imbalance Reserve upward and downward: IRU, IRD</p> <ul style="list-style-type: none"> Access MF defined resource eligibility for IR, each flag for each corresponding product: IRU, IRD, Access MF defined resource Certified Capacity MW for IRU and IRD Access MF defined BAA-Specific EDAM Participation Flag. Allow the eligible resource, include intertie resource, with resource ID defined in MF to submit one-segment bid of the IRU and/or IRD for the resource associated eligible flag Transaction ID (not pre-registered in MF) are not allowed to bid for IRU/IRD Not allow the following resource types to bid for IRU/IRD. <ul style="list-style-type: none"> The non-participating load Virtual supply/demand Hourly block import/export 60-minute PDR 60-minute RDRR <p>Note:</p> <ul style="list-style-type: none"> Refer to Resource Eligibility Table in Appendix-B: Formulas, Calculation Details, and Examples 	Core	SIBR (from MF)



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-04010	<p>Set up configurable value for ramp intervals eligible for IRU/IRD , initial 30 minute</p> <ul style="list-style-type: none"> System shall allow the market engineer to configure the ramp intervals eligible for IRU/IRD, initial value is 30 minute. System shall use the latest configured the ramp interval in DAM. 	Core	DAM
DAME-BRQ-04020	<p>Allow eligible resource to submit one-segment bid for Reliability Capacity (RC) upward and downward: RCU, RCD</p> <ul style="list-style-type: none"> Access MF defined resource eligibility in RUC each flag for each corresponding product: RCU, RCD. Access MF defined resource Certified Capacity MW for RCU and RCD. Allow the resource with resource ID defined, include inertia resource in MF to submit one-segment bid of the RCU and/or RCD product that is associated eligible flag Not allow 15 minute and 60 minute dispatch-able inertia import/export resources with transaction ID (not pre-registered in MF) to bid for RCU/RCD Not allow the following resource type to bid for RCU/RCD. <ul style="list-style-type: none"> The non-participating load Virtual supply/demand <p>Note:</p> <ul style="list-style-type: none"> Refer to Resource Eligibility Table in Appendix-B: Formulas, Calculation Details, and Examples 	Core	SIBR (from MF)
DAME-BRQ-04030	<p>Allow eligible VER to bid for IRU, IRD, RCU, RCD</p> <ul style="list-style-type: none"> Allow VERs with relevant IR and RC eligibility flags to bid IRU and/or IRD same as other resources Allow VERs with eligible flags to bid RCU and RCD, <ul style="list-style-type: none"> VER can bid any price for RCU/RCD, same as other resource If VER is RA, RA resource SIBR rule apply <p>Notes</p>	Core	SIBR

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • Restrict all VERs upper economic limit in IFM/RUC to their VER forecast • Extending the RCU/RCD bid in RUC up to VER forecast • In settlement remove VERs from RCU/RCD cost allocation. • RMR resources shall be treated as generating resources, except the RCU bid MW quantity shall additionally be limited by their RMR capacities. 		
DAME-BRQ-04031	<p>Apply VER bid obligation for RCU up to certified capacity</p> <ul style="list-style-type: none"> • Inserting a RCU bid using DAB for VERs up to their certified RCU capacity if they do not bid • Extending a submitted RCU bid for VERs up to their certified RCU capacity if bid not cover the applicable capacity. 	Core	SIBR
DAME-BRQ-04040	<p>Enforce Flex RA resource Must Offer Obligation (MOO) for Energy</p> <ul style="list-style-type: none"> • Only allow Flex RA to submit self-schedule energy at Pmin • For Flex RA capacity, MOO and bid insertion for energy: <ul style="list-style-type: none"> ○ resource shall submit both economic energy bids for full flex RA capacity in DAM ○ Insert DEB for energy for the flex RA capacity without economic bids ○ Extend the last bid segment for energy if the economic bids not cover the full flex RA capacity <p>Note: Any resources that are awarded IRU/IRD shall be subject to MOO in RTM.</p>	Core	SIBR (from CIRA)
DAME-BRQ-04060	<p>All RA resources have MOO for RCU, optional for RCD and allow non-zero bid</p> <ul style="list-style-type: none"> • RA resources (Generic and Flex) will be able to bid non-zero prices for reliability capacity RCU/RCD. <ul style="list-style-type: none"> ○ Note: This shall also apply to NGRs without REM too. • For all RA capacity, MOO and bid insertion for RCU apply up to RCU bid MW quantity of the lower of: <ul style="list-style-type: none"> ○ (1) Its RCU Certified Capacity, and 	Core	SIBR




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ (2) For non-NGRs: Its upper economic limit of its energy bid in DAM. For NGRs: The difference between its upper and lower economic limit of its energy bid in DAM. • Resource can optional bid for RCD. • If RA capacity has no economic RCU bids, system shall insert RCU DABs for RCU with RCU bid MW quantity of the lower of: <ul style="list-style-type: none"> ○ (1) Its RCU Certified Capacity, and ○ (2) For non-NGRs: Its upper economic limit of its energy bid in DAM. For NGRs: The difference between its upper and lower economic limit of its energy bid in DAM. • Note: RMR resources shall be treated as generating resources, except the RCU bid MW quantity insertion or extension shall additionally be limited by their RMR capacities. • If RA capacity has no energy bids or self-schedule insert default energy bid (DEB) (existing). <ul style="list-style-type: none"> ○ For import RA resources, the RCU bid insertion rules applies to RAAIM hours only. However, if the resource bids for energy for hours outside RAAIM hours, the RCU bid insertion shall cover these hours too. 		
DAME-BRQ-04065	<p>RCU Bids Coverage for All Physical Supply Resources</p> <p>For all other physical supply resources (except RA resources, VERs and PT exports) that submit economic energy bids:</p> <ul style="list-style-type: none"> • If a resource did not submit RCU bid, System shall insert RCU bid at RCU DAB price with RCU bid MW quantity of the lower of: <ul style="list-style-type: none"> ○ (1) Its RCU Certified Capacity, and ○ (2) For non-NGRs: Its upper economic limit of its energy bid in DAM. For NGRs: The difference between its upper and lower economic limit of its energy bid in DAM. • If a resource submitted RCU bid with RCU bid MW quantity that did not cover the lower of: <ul style="list-style-type: none"> ○ (1) Its RCU Certified Capacity, and 	Core	SIBR




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ (2) For non-NGRs: Its upper economic limit of its energy bid in DAM. <p>For NGRs: The difference between its upper and lower economic limit of its energy bid in DAM.</p> <p>then, System shall extend RCU bid MW quantity up to that latter limit at submitted RCU bid price.</p> <p>Notes</p> <ul style="list-style-type: none"> • This shall also apply to NGRs without REM too. • RMR resources shall be treated as generating resources, except the RCU bid MW quantity insertion or extension shall additionally be limited by their RMR capacities. • Refer to DAME-BRQ-04040, DAME-BRQ-04060, DAME-BRQ-05000 for corresponding requirement related to RA resources. • Refer to DAME-BRQ-04031 for corresponding requirement related to VERs. • Refer to DAME-BRQ-04070 for corresponding requirement related to PT exports. • Refer to EDAM-BRQ-11210 for corresponding EDAM BRQ. 		
DAME-BRQ-04070	<p>Supporting supply resource bid for RCU for PT-Export</p> <p>Incorporate Summer readiness 2021 rule for supporting the PT-export for RCU</p> <ul style="list-style-type: none"> • Non-RA supply resources designated to support a PT export shall bid for RCU to the quantity being used to support the PT export, resource is allowed to bid non-zero prices • If the supporting supply resource has no RCU bid, system shall insert DAB to cover the range that supports sum of PT-exports associate with the supporting resource 	Core	SIBR
DAME-BRQ-04072	<p>Supporting supply resource submit positive or negative bid component for Daily Minimum Energy Limit</p> <p>System shall support supply resource submittal of positive or negative bid component for Daily Minimum Energy Limit.</p>	Core	SIBR
DAME-BRQ-04080	<p>Accept and validate IRU/IRD bid</p> <ul style="list-style-type: none"> • Market participants will submit separate IR bids for IRU, IRD • IRU/IRD bids shall be a single segment (\$/MWh) of capacity products. IRU/IRD bids can have different hourly bids. • IRU/IRD bids shall have energy bids cover the entire IRU/IRD range 	Core	SIBR




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> The IRU, IRD bids will subject to corresponding IRU, IRD bid price configurable Caps \$55/MWh as default , floor \$0/MWh as default The IRU/IRD bid MW quantity must be greater than zero and will be capped by the lower of: <ul style="list-style-type: none"> (1) Its IRU/IRD Certified Capacity from MF, and (2) The difference between its upper and lower economic limit of its energy bid in DAM. Modify the Raw Bids and Clean Bids include market product type IRU and IRD 		
DAME-BRQ-04090	<p>Accept and validate RCU/RCD capacity bids</p> <ul style="list-style-type: none"> Market participants will submit separate bids for RCU, RCD A single segment (\$/MWh) for capacity products RCU, RCD. RCU/RCD bids can have different hourly bids. Energy bids shall be required to cover for RCU/RCD bids range (except for VER, since they don't have to bid En for RCU). RCU/RCD will subject bid cap \$250/MWh, floor \$0/MWh The RCU/RCD bid MW quantity must be greater than zero and will be capped by the lower of: <ul style="list-style-type: none"> (1) Its RCU/RCD Certified Capacity from MF, and (2) For non-NGRs: Its upper economic limit of its energy bid in DAM. <p>For NGRs: The difference between its upper and lower economic limit of its energy bid in DAM.</p> Modify the Raw Bids and Clean Bids replace market product RUC with RCU and RCD <p>Notes</p> <ul style="list-style-type: none"> In SIBR, no forecast is consumed in current design, so the VER forecast limit will be enforced in IFM and RUC. Reliability capacity up and down bid prices will be capped at \$250/MWh. RMR resources shall be treated as generating resources, except the RCU/RCD bid MW quantity shall additionally be limited by their RMR capacities. 	Core	SIBR

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

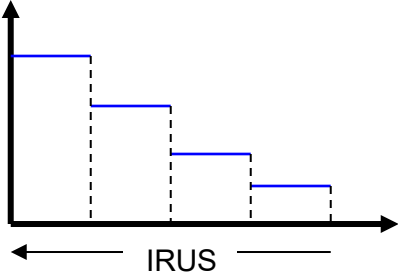ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-04131	<p>IRU/IRD Requirements (IRUR/IRDR) subjects to demand price curve</p> <ul style="list-style-type: none"> Apply the demand price curve to the relax variable for the IRU/IRD Requirement (IRUR/IRDR). <p>Note: no calculation change for demand price curve for ISO and other EDAM BAAs</p>	Core	DAM
DAME-BRQ-04132	<p>Consume IRU/IRD demand price curve</p> <p>At 10 am, the system shall consume the IRU and IRD demand price curves $\{Q_k, P_k, k = 1, 2, \dots, n\}$ for each hour interval of the DAM market horizon for each BAA in the EDAM Area.</p> <p>Note:</p> <p>Same as FRU, the IRU demand price curve has increasing positive quantities (an <u>ascending</u> ordering shall be performed on the quantities to ensure the MW quantities monotonically increasing) and decreasing positive prices:</p> <div style="text-align: center;">  </div> <p>Same as FRD, the IRD demand price curve has decreasing negative quantities (a <u>descending</u> ordering shall be performed on the quantities to ensure the MW quantities monotonically decreasing) and decreasing positive prices</p>	Core	DAM (from Internal ISO System)

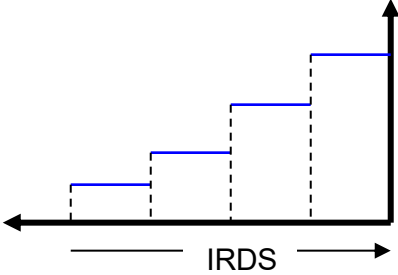

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
			
DAME-BRQ-04134	<p>Apply IRU/ IRD demand price curve on IRU/IRD surplus variables in optimization to procure IRU/IRD</p> <ul style="list-style-type: none"> Cover the IRUR/IRDR range: system shall extend or prune the end of the IRU/IRD demand price curve for each BAA in the EDAM Area to match the corresponding IRU/IRD Requirement (IRUR/IRDR) distributed to that BAA: $Q_n = IRUR \text{ for IRU}$ $Q_n = -IRDR \text{ for IRD}$ Transform demand price curve to monotonic increase price curve for surplus variables for IRU/IDR for each hour each BAA <ul style="list-style-type: none"> Flip the monotonically decreasing IRU demand price curve form the monotonically increasing price curve for the IRU surplus that varies from zero to <i>IRUR</i>. All Q_i capped by Q_n. Offset the IRD demand price curve by $+IRDR$ to form the monotonically increasing price curve for the IRD surplus that varies from zero to <i>IRDR</i>. All Q_i shall be capped by Q_n Limit from above all segments of the IRU/IRD price curve by the IRU/IRD configurable cap price \$55/MWh. 	Core	DAM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-04134A	<p>Apply IRU/IRD demand price curve to IRU/IRD surplus in proportion to IRUR/IRDR in that surplus zone</p> <p>The system shall allocate the IRU/IRD demand price curve for each interval of the market horizon for each BAA in the EDAM Area to the IRUS/IRDS of Surplus Zones of that BAA in proportion to the distributed IRU/IRD requirement in that zone.</p> $\sum_{t=1}^N \sum_{j \in EIM} IRUSP_{j,t} \sum_{z \in Z_j} IRUS_{z,j,t} + \sum_{t=1}^N \sum_{j \in EIM} IRDSP_{j,t} \sum_{z \in Z_j} IRDS_{z,j,t}$	Core	DAM
DAME-BRQ-04135	<p>BAA IRU/IRD Procurement constraints include IRU/IRD surplus in the BAA IR surplus zones</p> <ul style="list-style-type: none"> The system shall retrieve all defined IR Surplus Zones and their BAA association from Master File BAA IRU/IRD procurement constraints include multiple IRUS/IRDS for multiple IR surplus zones in the BAA $\sum_{i \in BAA_j} IRU_{i,t} + \sum_{z \in Z_j} IRUS_{z,j,t} = IRUR_{j,t}$ $0 \leq IRUS_{z,j,t}, \forall z \in Z_j$ $\sum_{i \in BAA_j} IRD_{i,t} + \sum_{z \in Z_j} IRDS_{z,j,t} = IRDR_{j,t}$ $0 \leq IRDS_{z,j,t}, \forall z \in Z_j$ <ul style="list-style-type: none"> The system shall distribute the IRU/IRD surplus in each interval of the market horizon in the IRU/IRD deployment scenario as negative load to the load and VER nodes in the respective IR Surplus Zone with the same distribution factors used for distributing the IRU/IRD requirement in that zone. $IRUS_{i,z,j,t} = \frac{\Delta L_{i,t}^{(u)}}{\sum_{i \in S_z} \Delta L_{i,t}^{(u)}} IRUS_{z,j,t}, \forall i \in S_z, \forall z \in Z_j$ $IRDS_{i,z,j,t} = \frac{\Delta L_{i,t}^{(d)}}{\sum_{i \in S_z} \Delta L_{i,t}^{(d)}} IRDS_{z,j,t}, \forall i \in S_z, \forall z \in Z_j$	Core	DAM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> The total IRU/IRD surplus in each BAA in the EDAM Area shall be limited to the IRU/IRD requirement, respectively, in that BAA. $\sum_{z \in Z_j} IRUS_{z,j,t} \leq \widehat{IRUR}_{j,t} \equiv \sum_{z \in Z_j} \sum_{i \in S_z} \Delta L_{i,t}^{(u)}$ $\sum_{z \in Z_j} IRDS_{z,j,t} \leq \widehat{IRDR}_{j,t} \equiv - \sum_{z \in Z_j} \sum_{i \in S_z} \Delta L_{i,t}^{(d)}$		
DAME-BRQ-04136	<p>Transmission Constraints with IR surplus zones Include the IRUS/IRDS nodal contribution on constraint, using IRUS nodal shift factor for the IR surplus zone</p> $\widehat{LFL}_{m,t} \leq \tilde{F}_{m,t} + \sum_i (\Delta EN_{i,t} + DFIRU IRU_{i,t} + \Delta VS_{i,t} - \Delta VD_{i,t} - \Delta L_{i,t}) SF_{i,m,t}$ $+ DFIRU \left(\sum_{j \in EDAM} \sum_{z \in Z_j} IRUS_{z,j,t} SF_{z,j,m,t}^{(u)} - IRUR_t SF_{m,t}^{(u)} \right) \leq \widehat{UFL}_{m,t}$ $\widehat{LFL}_{m,t} \leq \tilde{F}_{m,t} + \sum_i (\Delta EN_{i,t} - DFIRD IRU_{i,t} + \Delta VS_{i,t} - \Delta VD_{i,t} - \Delta L_{i,t}) SF_{i,m,t}$ $- DFIRD \left(\sum_{j \in EDAM} \sum_{z \in Z_j} IRDS_{z,j,t} SF_{z,j,m,t}^{(d)} - IRDR_t SF_{m,t}^{(d)} \right) \leq \widehat{UFL}_{m,t}$	Core	DAM
DAME-BRQ-04137	<p>Include the Anode of surplus zones shift factors in shift factor set in each market pass System shall include the Anode of surplus zones shift factors in shift factor set in each market pass.</p>	Core	DAM
DAME-BRQ-04140	<p>Consume Histogram and the second-order polynomial coefficients for DAM hourly (60min) IRU and IRD for each Trading Hour of the next Trading Day (D+1), for each BAA and DAM Area:</p> <ul style="list-style-type: none"> the High/low Percentile hourly forecast uncertainty histogram for: net demand: $(ND_{60}^{H97.5}) / (ND_{60}^{H2.5})$ demand: $(D_{60}^{H97.5}) / (D_{60}^{H2.5})$ adjusted solar: $(S_{60}^{H97.5}) / (S_{60}^{H2.5})$ adjusted wind: $(W_{60}^{H97.5}) / (W_{60}^{H2.5})$ the second-order polynomial coefficients of the High/low Percentile quadratic quantile regression of hourly forecast uncertainty 	Core	DAM [pre-DAM close] (from Internal ISO System)



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ demand: $(A_{60}^{D97.5}, B_{60}^{D97.5}, C_{60}^{D97.5}) / (A_{60}^{D2.5}, B_{60}^{D2.5}, C_{60}^{D2.5})$ ○ Solar: $(A_{60}^{S97.5}, B_{60}^{S97.5}, C_{60}^{S97.5}) / (A_{60}^{S2.5}, B_{60}^{S2.5}, C_{60}^{S2.5})$ ○ Wind: $(A_{60}^{W97.5}, B_{60}^{W97.5}, C_{60}^{W97.5}) / (A_{60}^{W2.5}, B_{60}^{W2.5}, C_{60}^{W2.5})$ ○ Mosaic (net load) $(A_{60}^{M97.5}, B_{60}^{M97.5}, C_{60}^{M97.5}) / (A_{60}^{M2.5}, B_{60}^{M2.5}, C_{60}^{M2.5})$ • the hourly High/low Percentile Threshold forecast uncertainty histogram <ul style="list-style-type: none"> ○ net demand $(ND_{60}^{H99}) / (ND_{60}^{H1})$ • Threshold value of IRU and IRD requirements $(IRUR_{60}^{max}) / (IRUR_{60}^{min}); IRDR_{60}^{max} / (IRDR_{60}^{min})$ <p>Note: General rule: For IRU, using P97.5 for load, P2.5 for solar and wind, for IRD, using P2.5 for load P97.5 for solar and wind</p>		
DAME-BRQ-04150	<p>Calculate the hourly IRU/IRD requirements (IRUR/IRDR) every time [IFM pre-DAM] runs for D+1</p> <p>For each Trading Hour of the next Trading Day (D+1) of the day type, for each BAA and DAM Area</p> <p>use the corresponding parameters from D+1 to calculate:</p> <ul style="list-style-type: none"> • Imbalance reserve upper requirement (IRUR): $IRUR_{60} = A_{60}^{M97.5} (M_{60}^{P97.5})^2 + B_{60}^{M97.5} M_{60}^{P97.5} + C_{60}^{M97.5}$ <p>Where:</p> $M_{60}^{P97.5}(nd, d, s, w) \equiv ND_{60}^{H97.5} - (D_{60}^{H97.5} - S_{60}^{H2.5} - W_{60}^{H2.5}) + (D_{60}^{P97.5}(d) - S_{60}^{P2.5}(s) - W_{60}^{P2.5}(w))$ $D_{60}^{P97.5}(d) \equiv A_{60}^{D97.5} d^2 + B_{60}^{D97.5} d + C_{60}^{D97.5}$ $S_{60}^{P2.5}(s) \equiv A_{60}^{S2.5} s^2 + B_{60}^{S2.5} s + C_{60}^{S2.5}$ $W_{60}^{P2.5}(w) \equiv A_{60}^{W2.5} w^2 + B_{60}^{W2.5} w + C_{60}^{W2.5}$ • Imbalance reserve down requirement (IRDR): 	Core	IFM [pre-DAM close]



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	$IRDR_{60} = A_{60}^{M2.5} (M_{60}^{P2.5})^2 + B_{60}^{M2.5} M_{60}^{P2.5} + C_{60}^{M2.5}$ <p>Where:</p> $M_{60}^{P2.5}(nd, d, s, w) \equiv ND_{60}^{H2.5} - (D_{60}^{H2.5} - S_{60}^{H97.5} - W_{60}^{H97.5}) + (D_{60}^{P2.5}(d) - S_{60}^{P97.5}(s) - W_{60}^{P97.5}(w))$ $D_{60}^{P2.5}(d) \equiv A_{60}^{D2.5} d^2 + B_{60}^{D2.5} d + C_{60}^{D2.5}$ $S_{60}^{P97.5}(s) \equiv A_{60}^{S97.5} s^2 + B_{60}^{S97.5} s + C_{60}^{S97.5}$ $W_{60}^{P97.5}(w) \equiv A_{60}^{W97.5} w^2 + B_{60}^{W97.5} w + C_{60}^{W97.5}$ <p>Notes</p> <ul style="list-style-type: none"> • <i>d</i> – latest demand forecast for each BAA and DAM Area • <i>w</i> – latest wind forecast for each BAA and DAM Area • <i>s</i> – latest solar forecast for each BAA and DAM Area • There shall be no dependency between DAME and EDAM; the IRU/IRD Requirements (IRUR/IRDR) shall be calculated even if EDAM RSE is not yet available. 		
DAME-BRQ-04155	<p>Calculate the hourly IRU/IRD requirements (IRUR/IRDR) for D+2 and D+3</p> <p>For each Trading Hour of the next Trading Days (D+2 and D+3) of the day type, for each BAA and DAM Area</p> <p>use the corresponding parameters from D+1 to calculate:</p> <ul style="list-style-type: none"> • Imbalance reserve upper requirement (IRUR): • Imbalance reserve down requirement (IRDR): <p>Notes</p> <ul style="list-style-type: none"> • IRUR/IRDR shall be calculated for D+2 and D+3 using same formulation as the ones used for D+1 (refer to DAME-BRQ-04150). • There shall be no dependency between DAME and EDAM; the IRU/IRD Requirements (IRUR/IRDR) shall be calculated even if EDAM RSE is not yet available. 	Core	IFM [pre-DAM close]
DAME-BRQ-04160	<p>The system shall bound the hourly IRU/IRD Requirements (IRUR/IRDR)</p> <p>for each Trading Hour of the next Trading Day, for each BAA and DAM Area</p>	Core	IFM [IFM pre-DAM close]




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	$IRUR_{60} = \max\left(\begin{matrix} IRUR_{60}^{min}, ND_{60}^{H1}, \\ \min((ND_{60}^{H99}, IRUR_{60}, IRUR_{60}^{max})) \end{matrix}\right)$ $IRDR_{60} = \min\left(\begin{matrix} -1 * IRDR_{60}^{min}, ND_{60}^{H99}, \\ \max((ND_{60}^{H1}, IRDR_{60}, -1 * IRDR_{60}^{max})) \end{matrix}\right)$		
DAME-BRQ-04180	<p>The system shall calculate the IRU requirement allocation factors to demand, solar, and wind for each hour of the trading day for ISO BAA:</p> <ul style="list-style-type: none"> $IRUDF_{60}(d,s,w) \equiv \frac{ D_{60}^{P97.5}(d) }{ D_{60}^{P97.5}(d) + S_{60}^{P2.5}(s) + W_{60}^{P2.5}(w) }$ $IRUSF_{60}(d,s,w) \equiv \frac{ S_{60}^{P2.5}(s) }{ D_{60}^{P97.5}(d) + S_{60}^{P2.5}(s) + W_{60}^{P2.5}(w) }$ $IRUWF_{60}(d,s,w) \equiv \frac{ W_{60}^{P2.5}(w) }{ D_{60}^{P97.5}(d) + S_{60}^{P2.5}(s) + W_{60}^{P2.5}(w) }$ 	Core	DAM
DAME-BRQ-04190	<p>The system shall calculate the IRD requirement allocation factors to demand, solar, and wind for each hour of the trading day for ISO BAA,</p> <ul style="list-style-type: none"> $IRDDF_{60}(d,s,w) \equiv \frac{ D_{60}^{P2.5}(d) }{ D_{60}^{P2.5}(d) + S_{60}^{P97.5}(s) + W_{60}^{P97.5}(w) }$ $IRDSF_{60}(d,s,w) \equiv \frac{ S_{60}^{P97.5}(s) }{ D_{60}^{P2.5}(d) + S_{60}^{P97.5}(s) + W_{60}^{P97.5}(w) }$ $IRDWF_{60}(d,s,w) \equiv \frac{ W_{60}^{P97.5}(w) }{ D_{60}^{P2.5}(d) + S_{60}^{P97.5}(s) + W_{60}^{P97.5}(w) }$ 	Core	DAM
DAME-BRQ-04200	<p>The system shall distribute the IRU/IRD Requirement (IRUR/IRDR) allocated to demand nodes, superimposed on the load schedule</p> <p>For each hour of the trading day in the IR deployment scenario, with distribution factors (LDF) for SYS LFZ (renormalized with respect to current topology).</p> <ul style="list-style-type: none"> Allocate IRU as positive load to the load nodes: $\Delta L_{i,t}^{(u)} = (LDF_{i,t} * IRUR_{60} * IRUDF_{60}(d,s,w))$ 	Core	DAM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> Allocate IRD as negative load to the load nodes: $\Delta L_{i,t}^{(d)} = (-LDF_{i,t} * IRDR_{60} * IRDDF_{60}(d,s,w))$ 		
DAME-BRQ-04210	<p>Calculate solar and wind distribution Factors of each VER nodes proportion to the forecasts:</p> <p>Solar Resource distribution factor:</p> $SDF_{i,t} = \frac{FS_{i,t}}{\sum_i FS_{i,t}}$ <p>Wind Resource distribution factor:</p> $WDF_{i,t} = \frac{FW_{i,t}}{\sum_i FW_{i,t}}$	Core	DAM
DAME-BRQ-04220	<p>Distribute the IRU/IRD Requirement (IRUR/IRDR) to VER nodes, superimposed on the VER schedule</p> <ul style="list-style-type: none"> Distribute IRU as positive load to the Solar and wind VER nodes: $\Delta L_{i,t}^{(u)} = (SDF_{i,t} * IRUR_{60} * IRUSF_{60}(d,s,w))$ $\Delta L_{i,t}^{(u)} = (WDF_{i,t} * IRUR_{60} * IRUWF_{60}(d,s,w))$ Distribute IRD as negative load to the solar and wind VER nodes: $\Delta L_{i,t}^{(d)} = (-SDF_{i,t} * IRDR_{60} * IRDSF_{60}(d,s,w))$ $\Delta L_{i,t}^{(d)} = (-WDF_{i,t} * IRDR_{60} * IRDWF_{60}(d,s,w))$ 	Core	DAM
DAME-BRQ-04230	<p>IRU/IRD additional deployment scenarios use same topology as base case and base with contingencies in NA, apply DIRU/DIRD on the specified set of transmission constraints</p> <ul style="list-style-type: none"> No additional AC power flow runs for IRU/IRD deployment scenarios, instead use same base cases and contingencies cases shift factors set to calculate the transmission constraints for IRU, and for IRD deployment scenarios for each intervals (DAME-BRQ-04310) Apply the DIRU/DIRD contribution of IRU/IRD deployment scenarios (parameter defined in DAME-BRQ-04005) in the transmission constraints Only enforce the set transmission constraints (specified in DAME-BRQ-04004) in IRU/IRD deployment scenarios 	Core	DAM




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-04232	<p>Identify the critical constraints for IRU/IRD deployment scenarios</p> <p>Determine the critical set in the deployment scenarios superimposing the linear IR flows from UC</p> <p>Note</p> <ul style="list-style-type: none"> Refer to DAME-BRQ-06070 for RTM. 	Core	DAM
DAME-BRQ-04235	<p>Calculate Shift Factors for base case and base case with contingencies</p> <p>Calculate Shift factor based on AC power flow runs:</p> <ul style="list-style-type: none"> Shift Factor $SF_{i,m,t}$ for the node i on transmission m and hour t of base case Shift Factor $SF_{i,m,t}^{(k)}$ for N-1 preventive transmission contingencies Shift Factor $SF_{i,m,t}^{(g)}$ for GCARM generation/transmission contingencies Adjusted Shift Factor $SF_{i,m,t}^{r(g)}$ for GCARM generation/transmission contingencies with post-contingency correction Store the calculated the shift factors. <p>Note: The same Shift factors will apply to the base scenario, IRU/IRD deployment scenarios in IFM, and RUC RCU/RCD procurement</p>	Core	DAM
DAME-BRQ-04240	<p>Apply LMPM for energy bid by Including IRU and IRD deployment scenario in DCPA counter flow calculation and Energy LMP calculation</p> <ul style="list-style-type: none"> For IRU deployment scenario: To calculate counter flow for the binding transmission constraint from the resource shall be the product of negative shift factor and energy schedule plus IRU award For IRD deployment scenario: To calculate counter flow for the binding transmission constraint from the resource shall be the product of negative shift factor and energy schedule minus IRD award; no mitigation for IRD bid, but still should be considered for En bid mitigation 	Core	IFM-MPM

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • To calculate the Energy competitive LMP for each node, <ul style="list-style-type: none"> ○ Calculate LMP's congest cost MCC that include energy, IRU deployment scenario and IRD deployment scenario ○ Break the LMP congestion cost MCC into two components: non-competitive component (based on DCPA uncompetitive paths that include IRU/IRD deployment scenarios in the counter-flow) and a competitive component. ○ Calculate the nodal competitive LMP that exclude the non-competitive MCC. • Apply the LMPM for the applicable resource's energy bid mitigate it to the higher of the default energy bid (DEB) and its competitive LMP 		
DAME-BRQ-04250	<p>Apply LMPM for IRU bid by including IRU deployment scenario in DCPA counter flow calculation and IRU nodal price calculation</p> <ul style="list-style-type: none"> • Build Activation switch for turn on/off of IR LMPM function • In DCPA process, the counter flow calculation, to determine the uncompetitive paths: • For IRU deployment scenario: same uncompetitive paths as in DCPA with IRU deployment for energy LMPM • To calculate the IRU competitive nodal price for each node, <ul style="list-style-type: none"> ○ Calculate IRU nodal price congest cost MCC that include energy, IRU deployment scenario ○ Break the IRU nodal price congestion cost MCC into two components: non-competitive component (based on DCPA uncompetitive paths that include IRU deployment scenarios in the counter-flow) and a competitive component. ○ Calculate the nodal competitive IRU price that exclude the non-competitive MCC. • Apply the existing LMPM for the applicable resource's IRU bid mitigate it to greater of (its nodal competitive IRU price and IRU DAB) if it below submitted bid. 	Core	IFM-MPM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	Note: LMPM applies to IRU only, not for IRD.		
DAME-BRQ-04260	<p>System shall procure IRU/IRD through co-optimization with energy and AS</p> <p>Objective function:</p> <ul style="list-style-type: none"> • Include IRU/IRD bid costs in Objective function. • IRU can be provided by offline 15min-start units • IRD can only be provided by online resources • MSG configuration in transition cannot provide IRU/IRD 	Core	IFM, IFM-MPM
DAME-BRQ-04280	<p>Procurement constraints for IRU/IRD in co-optimization energy, AS and IR</p> <ul style="list-style-type: none"> • Keep power balance constraint unchanged, include losses • Keep ancillary services procurement constraints unchanged • Add IRU/IRD procurement constraints to meet IRU/IRD Requirements (IRUR/IRDR) for each hour for each BAA and for EDAM area in DAM. 	Core	IFM, IFM-MPM
DAME-BRQ-04290	<p>Capacity constraints for IRU/IRD in co-optimization energy, AS and IR</p> <ul style="list-style-type: none"> • Include IRU/IRD upper/lower bound constraints for each resource by certified quantities. • Include IRU/IRD with energy and AS in resource upper/lower bound capacity constraint • Include IRU/IRD with AS capacity awards in resource upper/lower bound adjusted economic limit constraint <p>For VER:</p> <ul style="list-style-type: none"> • VER for IRU/IRD, UOL/UEL limited by VER forecast 	Core	IFM, IFM-MPM
DAME-BRQ-04300	<p>Ramp capability constraints for IRU/IRD in co-optimization energy, AS and IR</p> <ul style="list-style-type: none"> • Include IRU/IRD with energy and AS in resource ramp capability constraint • The ramp capability constraint for offline start up at beginning of the hour to support IRU and upward AS • The ramp capability constraint for the resource shut down at the end of hour to support IRD and downward AS • Use dynamic ramp capability on IRU/IRD awards. 	Core	IFM, IFM-MPM

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ For resource remain on-line, AS and IRU/IRD Capacity awards and day ahead energy schedule changes across hours share the resource dynamic ramp capability, use granularity adjustment factor 2 converts 30-min IRU/IRD awards to the hourly. ○ For resource start up use configurable granularity adjustment factor (defaulted to 2) for IRU ○ For resource shut down use configurable granularity adjustment factor (defaulted to 2) for IRD. (same factor as the one used for IRU) <p>Note: With the adjustment factor, there is no need to develop 15min dynamic ramp for IRU/IRD</p>		
DAME-BRQ-04310	<p>Transmission constraints in co-optimization energy, AS and IRU/IRD</p> <p>From base case</p> <ul style="list-style-type: none"> • Enforce transmission constraints for energy and virtual energy base case, the incremental energy injections are multiplied by the corresponding shift factors $SF_{i,m,t}$ for the relevant network constraint to account for changes in the active power flow from the AC power flow solution <p>From base case with contingencies</p> <ul style="list-style-type: none"> • Enforce transmission constraints for energy and virtual energy base case with N-1 transmission contingencies using shift factor $SF_{i,m,t}^{(k)}$ • Enforce transmission constraints for energy and virtual energy base case with GCARM generation/transmission contingencies using adjusted shift factor $SF_{i,m,t}^{(g)}$ <p>From IRU/IRD deployment scenarios</p> <ul style="list-style-type: none"> • Enforce additional transmission constraints that add IRU deployment scenario in upper active power limits • Enforce additional transmission constraints that add IRD deployment scenario in lower active power limits • The shift factors in the IRU/IRD deployment scenarios are the same as the ones in the base scenario $SF_{i,m,t}$. <p>From IRU/IRD deployment scenarios with contingencies</p>	Core	IFM, IFM-MPM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> Enforce transmission constraints in IRU/IRD deployment scenarios with contingencies: The shift factors in the IRU/IRD deployment scenarios with N-1 transmission contingencies using shift factor $SF_{i,m,t}^{(k)}$ The shift factors in the IRU/IRD deployment scenarios with GCARM generation/transmission contingencies using adjusted shift factor $SF_{i,m,t}^{(g)}$ <p>Note:</p> <ul style="list-style-type: none"> Critical transmission constraints will be different in general for Base scenario, with/without contingencies and IRU/IRD deployment scenarios, with/without contingencies. ACPF will determine CCS in IRU/IRD deployment scenarios by evaluating power flow with deployment of IRU/IRD awards with relevant deployment factor 		
DAME-BRQ-04320	<p>Scheduling Limit constraints in co-optimization energy, AS and IR</p> <ul style="list-style-type: none"> Include IRU in ITC/ISL upper limit (import) constraints for energy plus upward AS (EA type) Include IRU in ITC/ISL upper limit constraints for upward AS without energy (AS type) Include IRD in ITC/ISL lower limit (export) constraints for energy plus downward AS (EA type) Include IRD in ITC/ISL lower limit constraints for downward AS without energy (AS type) <p>Notes</p> <ul style="list-style-type: none"> Import and export Netting is allow for the energy, not allowed between energy and capacity (AS,IR). AS Type: AS Only EA Type: Energy + AS 	Core	IFM, IFM-MPM
DAME-BRQ-04330	<p>Energy limit, Gas-burn, pump and other constraints in co-optimization energy, AS and IR</p> <ul style="list-style-type: none"> Gas-Burn Nomogram: Add IRU, in addition to Energy, in the Gas-Burn nomograms 	Core	IFM, IFM-MPM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> Daily Energy limit: Add IRU, in addition to Energy, in the Daily Energy limit constraint Pump-storage Hydro (PSH): Add IRU, in addition to Energy, in the PSH positive limit (generating mode) constraint; minus IRD, in addition to Energy, in the PSH negative limit (pumping mode) constraint. 		
DAME-BRQ-04331	<p>Include IRU/IRD in storage resource ASSOC constraint</p> <p>Include IRU in the ASSOC constraint that SOC be able to discharge to support minimum SOC plus upward AS and IRU;</p> <p>Include IRD, in the ASSOC constraint that SOC be able to charge to support downward AS and IRD with charge efficiency that not exceed the maximum SOC.</p> <p>Notes</p> $SOC_{i,t} - RU_{i,t} - SR_{i,t} - NR_{i,t} - \frac{IRU_{i,t} + IRU_{i,t+1}}{2} \geq \underline{SOC}_{i,t}$ $SOC_{i,t} + \eta_i \left(RD_{i,t} + \frac{IRD_{i,t} + IRD_{i,t+1}}{2} \right) \leq \overline{SOC}_{i,t}$ <p style="text-align: center;">$, \forall i \in S_{LESR} \wedge t = 1, 2, \dots, T$</p> <ul style="list-style-type: none"> ASSOC constraints of LESR shall be consistent with Energy Storage Enhancements initiative, model attenuation and coverage factor to have SOC to support AS, and IRU/IRD provided by storage resource. 	Core	IFM, IFM-MPM
DAME-BRQ-04331A	<p>Include IRU/IRD and RCU/RCD in storage resource ASSOC constraint</p> <p>Include IRU and RCU in the ASSOC constraint that SOC be able to discharge to support minimum SOC plus upward AS and IRU/RCU;</p> <p>Include IRD and RCD in the ASSOC constraint that SOC be able to charge to support downward AS and IRD/RCD with charge efficiency that not exceed the maximum SOC.</p> <p>Notes</p> $SOC_{i,t} - RU_{i,t} - SR_{i,t} - NR_{i,t} - \frac{IRU_{i,t} + IRU_{i,t+1}}{2} - \frac{RCU_{i,t} + RCU_{i,t+1}}{2} \geq \underline{SOC}_{i,t}$ $SOC_{i,t} + \eta_i \left(RD_{i,t} + \frac{IRD_{i,t} + IRD_{i,t+1}}{2} + \frac{RCD_{i,t} + RCD_{i,t+1}}{2} \right) \leq \overline{SOC}_{i,t}$	Core	RUC

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	$\forall i \in S_{LESR} \wedge t = 1, 2, \dots, T$ <ul style="list-style-type: none"> ASSOC constraints of LESR shall be consistent with Energy Storage Enhancements initiative, model attenuation and coverage factor to have SOC to support AS, IRU/IRD, and RCU/RCD provided by storage resource. 		
DAME-BRQ-04332	<p>Include attenuation from capacity IR/RC awards in SOC envelop constraint in MPM, IFM, RUC</p> <ul style="list-style-type: none"> Set hourly configurable parameters by BAA for attenuation factors for IR and RC capacity awards to storage resource in DAM <ul style="list-style-type: none"> System shall allow user to setup configurable parameters for attenuation factors for DAM and RTM, apply to all the storage resource SOC envelop constraints Attenuation factor shall be defined for Imbalance reserve and Reliability Reserve: <ul style="list-style-type: none"> IRU IRD RCU RCD Each Attenuation factor must be between 0 to 1, The day-ahead market will generate an upper and lower bound, or envelope, for state of charge <ul style="list-style-type: none"> The envelope could constrain operation for storage resources The initial upper and lower bounds will be set to the initial day-ahead state of charge The initial multiplier attached to the imbalance reserves in the envelope equation will be 0.85 $ \left. \begin{aligned} SOC_{i,t}^{(u)} &= \left(\frac{SOC_{i,t-1}^{(u)} - EN_{i,t}^{(+)} - \eta_i EN_{i,t}^{(-)} - ARU_t RU_{i,t} - ASR_t SR_{i,t}^{-}}{ANR_t NR_{i,t} - \frac{AIRU_t IRU_{i,t} + AIRU_{t+1} IRU_{i,t+1}}{2}} \right) \geq \underline{SOC}_{i,t} \\ IFM: \quad SOC_{i,t}^{(l)} &= \left(\frac{SOC_{i,t-1}^{(l)} - EN_{i,t}^{(+)} - \eta_i EN_{i,t}^{(-)} + \eta_i ARD_t RD_{i,t} +}{\eta_i \frac{AIRD_t IRD_{i,t} + AIRD_{t+1} IRD_{i,t+1}}{2}} \right) \leq \overline{SOC}_{i,t} \end{aligned} \right\} $ $\forall i \in S_{LESR} \wedge t = 1, 2, \dots, T$	Core	DAM




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	$ \begin{aligned} &SOC_{it}^{(w)} = \left(\frac{SOC_{i,t-1}^{(w)} - EN_{it}^{(w)} - \eta_i EN_{it}^{(w)} - ARU_{it} - ASR_{it} - SR_{it}}{ANR_{it} + NR_{it} - \frac{AIRU_{it} + IRU_{it+1} + AIRU_{it+1}}{2} - \frac{ARCU_{it} + RCU_{it} + ARCU_{it+1} + RCU_{it+1}}{2}} \right) \geq \underline{SOC}_{it} \\ &RUC: \\ &SOC_{it}^{(d)} = \left(\frac{SOC_{i,t-1}^{(d)} - EN_{it}^{(d)} - \eta_i EN_{it}^{(d)} + \eta_i ARD_{it} + RD_{it} + \frac{ARD_{it} + RCD_{it} + ARCD_{it+1} + RCD_{it+1}}{2}}{\eta_i \frac{AIRD_{it} + IRD_{it+1} + AIRD_{it+1} + IRD_{it+1}}{2} + \eta_i \frac{ARCD_{it} + RCD_{it} + ARCD_{it+1} + RCD_{it+1}}{2}} \right) \leq \overline{SOC}_{it} \\ &\forall i \in S_{ESR} \wedge t = 1, 2, \dots, T \end{aligned} $ <p>Where</p> $IRU_{i,T+1} = IRD_{i,T+1} = RCU_{i,T+1} = RCD_{i,T+1} = 0$ <p>Notes</p> <ul style="list-style-type: none"> The attenuation factors shall be configurable parameters and can be set to 0 to disable the commodity in the envelope constraints. Also refer to DAME-BRQ-05144 		
DAME-BRQ-04350	<p>Calculate hourly locational marginal price (LMP) for energy in DAM include IRU/IRD deployment scenarios on congestion, for nodal and resource</p> <p>Energy locational marginal price LMP for each hour in IFM:</p> <ul style="list-style-type: none"> Shadow price of PBC/ Loss Penalty Factor (LPF) of res/node (existing) (minus) Marginal Congestion cost components (MCC) of base case using shift factor $SF_{i,m,t}$ (minus) MCC components of base case with N-1 preventive transmission contingency using shift factor $SF_{i,m,t}^{(k)}$ (minus) MCC components of base case with GCARM generation/transmission contingency using adjusted shift factor $SF_{i,m,t}^{(g)}$ (minus) MCC components of deployment case of IRU, using DIRU* shift factor $SF_{i,m,t}^{(u)}$ (minus) MCC components of IRU deployment case with N-1 preventive transmission contingency using DIRU* shift factor $SF_{i,m,t}^{(k,u)}$ 	Core	IFM, IFM-MPM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> (minus) MCC components of IRU deployment case with GCARM generation/ transmission contingency using DIRD*adjusted shift factor $SF_{i,m,t}^{(g,d)}$ (minus) MCC components of deployment case of IRD, using DIRD* shift factor $SF_{i,m,t}^{(d)}$ (minus) MCC components of IRD deployment case with N-1 preventive transmission contingency using DIRD*shift factor $SF_{i,m,t}^{(k,d)}$ (minus) MCC components of IRD deployment case with GCARM generation/ transmission contingency using DIRD*adjusted shift factor $SF_{i,m,t}^{(g,d)}$ The intertie congestion components shall be included in LMP for energy Gas nomogram shadow prices shall be reflected in resource prices only, not the Pnode/APnode IRUMP. <p>Note: MCC is the sum of all congestion costs, each calculated as product of shift factor and shadow price of the binding network constraint</p>		
DAME-BRQ-04360	<p>Calculate hourly SP-Tie LMP for energy in DAM include IRU/IRD deployment scenarios on congestion as normal nodal LMP plus shadow price of ITC/ISL, for nodal and resource</p> <ul style="list-style-type: none"> The SP nodal price of energy minus the shadow prices of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie Location 	Core	IFM, IFM-MPM
DAME-BRQ-04370	<p>Calculate hourly nodal IRU marginal price (IRUMP) in DAM for all nodal and resource</p> <ul style="list-style-type: none"> Shadow price of IRU procurement constraint (no loss component) (minus) MCC components of deployment case of IRU, using shift factor $SF_{i,m,t}$ (minus) MCC components of IRU deployment case with N-1 preventive transmission contingency using shift factor $SF_{i,m,t}^{(k)}$ (minus) MCC components of IRU deployment case with GCARM generation/ transmission contingency using adjusted shift factor $SF_{i,m,t}^{(g)}$ Gas nomogram shadow prices shall be reflected in resource prices only, not the Pnode/APnode IRUMP. 	Core	IFM, IFM-MPM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>Note</p> <ul style="list-style-type: none"> IRUMP/IRDMP will be calculated for all the pnodes and resources, similar as for Energy LMP. 		
DAME-BRQ-04380	<p>Calculate hourly nodal IRD marginal price (IRDMP) in DAM for node and resource</p> <ul style="list-style-type: none"> Shadow price of IRD procurement constraint (no loss component) (plus) MCC components of deployment case of IRD, using shift factor $SF_{i,m,t}$ (plus) MCC components of IRD deployment case with N-1 preventive transmission contingency using shift factor $SF_{i,m,t}^{(k)}$ (plus) MCC components of IRD deployment case with GCARM generation/ transmission contingency using adjusted shift factor $SF_{i,m,t}^{(g)}$ The intertie congestion components shall be included in IRDMP 	Core	IFM, IFM-MPM
DAME-BRQ-04390	<p>Calculate Hourly SP-Tie IRU Marginal Price (IRUMP) in DAM for Nodal by Direction (Import & Export)</p> <p>For Import direction</p> <ul style="list-style-type: none"> SP nodal price of IRU (plus) the shadow prices for import direction of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-TIE location of IRU <p>For Export direction</p> <ul style="list-style-type: none"> SP nodal prices of IRU (minus) the shadow prices for export direction of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-TIE location of IRU. 	Core	IFM, IFM-MPM
DAME-BRQ-04395	<p>Calculate Hourly SP-Tie IRU Marginal Price (IRUMP) in DAM for Resource</p> <ul style="list-style-type: none"> SP nodal price of IRU 	Core	IFM, IFM-MPM

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> (plus) the shadow prices of import direction of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie Location of IRU for import resources and TG (minus) the shadow prices of export direction of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie Location of IRU for export resources. 		
DAME-BRQ-04400	<p>Calculate Hourly SP-Tie IRD Marginal Price (IRDMP) in DAM for Nodal by Direction (Import & Export) For import direction</p> <ul style="list-style-type: none"> SP nodal price IRD (minus) the shadow prices of export direction of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie location of IRD <p>For export direction</p> <ul style="list-style-type: none"> SP nodal price IRD (plus) the shadow prices of import direction of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie location of IRD. 	Core	IFM, IFM-MPM
DAME-BRQ-04405	<p>Calculate Hourly SP-Tie IRD Marginal Price (IRDMP) in DAM for Resource</p> <ul style="list-style-type: none"> SP nodal price IRD (plus) the shadow prices of the import directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie Location of IRD for export resources (minus) the shadow prices of the export directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie Location of IRD for import resources and TG. 	Core	IFM, IFM-MPM
DAME-BRQ-04451	<p>Calculate weight of distribution of IRUR/IRDR in the BAA For each load/Solar/Wind (d/s/w) distribution Weight factors for IRU/IRD, using (D/S/W) Distribution factor*(D/S/W) Allocation Factor</p> $w_{i,t}^u(d) = (LDF_{i,t} * IRUDF_{60}(d,s,w))$ $w_{i,t}^u(s) = (SDF_{i,t} * IRUSF_{60}(d,s,w))$	Core	IFM, IFM-MPM, RUC




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	$w_{i,t}^u(w) = (WDF_{i,t} * IRUWF_{60}(d,s,w))$ $w_{i,t}^d(d) = (LDF_{i,t} * IRDDF_{60}(d,s,w))$ $w_{i,t}^d(s) = (SDF_{i,t} * IRDSF_{60}(d,s,w))$ $w_{i,t}^d(w) = (WDF_{i,t} * IRDWF_{60}(d,s,w))$		
DAME-BRQ-04452	<p>Calculate BAA Imbalance Upward/Downward deployment Shift Factors Imbalance demand reference point (Anode)</p> <p>Calculate BAA market footprint aggregated Imbalance demand Shift Factor $SF_{m,t}^{(u)}/SF_{m,t}^{(d)}$ for base case and $SF_{m,t}^{(k,u)}/SF_{m,t}^{(k,d)}$ $SF_{m,t}^{(g,u)}/SF_{m,t}^{(g,d)}$ for contingency case (that reference point of market footprint distributed load) as sum of product of nodal weight and nodal shift factor. Calculate adjusted shift factor $SF_{m,t}^{(g,u)}/SF_{m,t}^{(g,d)}$ for GCARM with post contingency correction</p> <p>Note: Same Reference point is used to calculate SF for balance demand anode of each EDAM BAAs.</p>	Core	IFM, IFM-MPM, RUC
DAME-BRQ-04453	<p>Include IRU/IRD awards, requirement and surplus contribution in transmission constraint</p> <p>Include IRU/IRD awards, IRU/IRD Requirements (IRUR/IRDR) and IRU/IRD Surplus (IRUS/IRDS) contribution on transmission constraint</p> $\left. \begin{aligned} \overline{LFL}_{m,t} &\leq \tilde{F}_{m,t} + \sum_i (\Delta EN_{i,t} + DFIRU IRU_{i,t} + \Delta VS_{i,t} - \Delta VD_{i,t} - \Delta L_{i,t}) SF_{i,m,t} + \\ &\quad DFIRU (IRUS_t - IRUR_t) SF_{m,t}^{(u)} \leq \overline{UFL}_{m,t} \\ \overline{LFL}_{m,t} &\leq \tilde{F}_{m,t} + \sum_i (\Delta EN_{i,t} - DFIRD IRD_{i,t} + \Delta VS_{i,t} - \Delta VD_{i,t} - \Delta L_{i,t}) SF_{i,m,t} - \\ &\quad DFIRD (IRDS_t - IRDR_t) SF_{m,t}^{(d)} \leq \overline{UFL}_{m,t} \end{aligned} \right\}$ <p>$\forall m \wedge t = 1, 2, \dots, T$</p>	Core	IFM, IFM-MPM, RUC



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	$\forall k, m \wedge t = 1, 2, \dots, T$ $\left. \begin{aligned} \widetilde{LFL}_{m,t}^{(g)} &\leq \widetilde{F}_{m,t}^{(g)} + \sum_i (\Delta EN_{i,t} + DFIRU IRU_{i,t} + \Delta VS_{i,t} - \Delta VD_{i,t} - \Delta L_{i,t}) SF_{i,m,t}^{(g)} + \\ &\quad DFIRU (IRUS_t - IRUR_t) SF_{i,m,t}^{(g,u)} \leq \overline{UFL}_{m,t}^{(g)} \\ \widetilde{LFL}_{m,t}^{(g)} &\leq \widetilde{F}_{m,t}^{(g)} + \sum_i (\Delta EN_{i,t} - DFIRD IRD_{i,t} + \Delta VS_{i,t} - \Delta VD_{i,t} - \Delta L_{i,t}) SF_{i,m,t}^{(g)} - \\ &\quad DFIRD (IRDS_t - IRDR_t) SF_{i,m,t}^{(g,d)} \leq \overline{UFL}_{m,t}^{(g)} \end{aligned} \right\}$ $\forall g, m \wedge t = 1, 2, \dots, T$		
DAME-BRQ-04453A	<p>Access Anode and Apnode for each BAA Imbalance Demand Hub and IR Surplus Zone from MF</p> <ul style="list-style-type: none"> Access Associated Imbalance Demand Hub Anode and Apnode of each BAA from MF. Access associated IR surplus zones of each BAA and their associated Anodes and Apnodes from MF 	Core	IFM
DAME-BRQ-04454	<p>Calculate hourly IRU/IRD Surplus variable and IRU/IRD marginal price of Surplus Apnode, price breakdown by BAA</p> <ul style="list-style-type: none"> The hourly IRU/IRD surplus variable values are optimally calculated through IFM co-optimization Energy, AS and IRU/IRD with demand curve. Calculate the BAA aggregated hourly IRU/IRD Marginal prices of IRU/IRD surplus as a IRU/IRD Locational Marginal Prices and the price components at location (Apnode) associated with the BAA Imbalance Demand Hub (same method as for DLAP) per PIME logic <ul style="list-style-type: none"> The IRU/IRD surplus is defined on each Apnode associated with corresponding surplus zone and are aggregated on BAA level to be on the same Imbalance Demand Hub Apnode of each BAA (DAME-BRQ-01150) The Shift factor of IRU/IRD APnode is defined in (DAME-BRQ-04452) The IRUMP/IRDMP locational price is defined in DAME-BRQ-04370, DAME-BRQ-04380 Calculate the BAA aggregated hourly IRU/IRD price MCC components using the shift factor of Imbalance Demand anode of the BAA 	Core	IFM

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-04510	<p>Roll Over DAECON into DALPT Resource-Specific Market Priority Types for Export Resources</p> <p>For broadcasting purposes-only, System shall roll over DAECON into DALPT resource-specific market priority type for export resources.</p> <p>Notes</p> <ul style="list-style-type: none"> An export resource ID can be associated with more than one market priority types with a MW corresponding to each market priority type. 	Core	IFM
DAME-BRQ-04515	<p>Roll Over DAECON into PT Resource-Specific Market Priority Types for Non-Export Resources</p> <p>For broadcasting purposes-only, System shall roll over DAECON into PT resource-specific market priority type for non-export resources.</p> <p>Notes</p> <ul style="list-style-type: none"> An export resource ID can be associated with more than one market priority types with a MW corresponding to each market priority type. 	Core	IFM

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.5 Business Process: Manage DAM – RUC


- MOO for RA in RUC, VER to the forecast
- Define notion $REN=EN+RCU-RCD$
- Build RUC-MPM, apply LMPM for RCU
- Apply mitigated RUC bids for 24 hours, un-mitigated bids for 48 hour RUC or 72 hour RUC
- Procure RCU/RCD through optimization
- Fixed EN, AS and IRU/IRD IFM awards
- Model MSG transition in RUC
- RUC-NA use REN as injection, no IRU/IRD deployment scenarios
- Calculate LMP for RCU/RCD

5.5.1 Business Requirements

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-05000	<p>Consume RCU/RCD MF Data in RUC, insert/extend RCU bids for RA non-VER resources</p> <ul style="list-style-type: none"> • Consume MF defined physical market resource eligibility for Reliability Capacity (RC): Separate flag for upper (RCU), down (RCD) • Consume MF defined Certified quantity (MW) for RCU and RCD • Consume MF defined BAA-Specific EDAM Participation Flag. • Accept resource RCU/RCD bids through SIBR. • For non-VERs, if an RA resource did not bid in for RCU product, SIBR shall insert DAB bids for RCU with RCU bid MW quantity up to the lower of: <ul style="list-style-type: none"> ○ (1) Its RCU Certified Capacity, and ○ (2) For non-NGRs: Its upper economic limit of its energy bid in DAM. <p style="margin-left: 40px;">For NGRs: The difference between its upper and lower economic limit of its energy bid in DAM.</p> • For non-VERs, if an RA resource bid in for RCU product with RCU bid MW quantity that is lower than the lower of: <ul style="list-style-type: none"> ○ (1) Its RCU Certified Capacity, and ○ (2) For non-NGRs: Its upper economic limit of its energy bid in DAM. 	Core	SIBR (from MF)



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>For NGRs: The difference between its upper and lower economic limit of its energy bid in DAM.</p> <p>Then, SIBR shall extend that bid up to that latter limit at the submitted RCU bid price.</p> <ul style="list-style-type: none"> • Note: For VERs, refer to DAME-BRQ-04031. <p>Notes</p> <ul style="list-style-type: none"> • RMR resources shall be treated as generating resources, except the RCU bid MW quantity insertion or extension shall additionally be limited by their RMR capacities. 		
DAME-BRQ-05001	<p>Keep IFM Energy, AS, IRU/IRD Fixed in RUC</p> <p>Keep the resource day-ahead market IFM awards/self-schedules for energy (EN), Ancillary Services (AS), Imbalance Reserves (IRU, IRD) at fixed value in RUC.</p>	Core	RUC
DAME-BRQ-05002	<p>Create Proxy RCU Bid for Exports with IFM LPT and/or Economic Energy Schedules with No RCU Clean Bid or Not Enough RCU Clean Bid</p> <ul style="list-style-type: none"> • If exports cleared IFM with LPT and/or economic energy schedules and do not have RCU clean bids, in the RUC schedule run, System shall create proxy RCU bids for them that covers their cleared IFM energy schedules with a bid price higher than the RCU DAB price (configurable) and lower than the RUC PBC penalty in the scheduling run and at DAB bid price in the pricing run). The proxy RCU award due to proxy penalty bids will be fixed in pricing run. • If exports cleared IFM with LPT and/or economic energy schedules and have RCU clean bids that does not cover all energy bid range, (not <i>enough</i> RCU clean bids), in the RUC schedule run, System shall create proxy RCU bids for them (extending their RCU clean bids) to cover their cleared IFM energy schedules with a bid price higher than 	Core	RUC

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>the RCU DAB price (configurable) and lower than the RUC PBC penalty in the scheduling run for the extended portion and using the RCU bid price for the clean bid portion. The proxy RCU award due to proxy penalty bids will be fixed in pricing run.</p> <ul style="list-style-type: none"> System shall create a resource-specific hourly flag to indicate the creation of such proxy bids and their proxy RCU awards if market awarded them. The proxy RUC bids shall not apply to PT export, and wheeling export. System shall exclude Proxy RCU bids from setting RCUMP. <p>Notes</p> <ul style="list-style-type: none"> The Proxy Awards can co-exist for same resource and hour with RCU Awards. This bid insertion is a mechanism to indicate the cleared IFM LPT and/or economic schedules for these exports are subject to Curtailment in RTM, if they are awarded RCU awards in RUC. Since these exports have their created RCU bids at the penalty prices, they will only be awarded RCU awards if there is no available physical supply capacity in the RUC above energy schedules to meet both the demand forecast and the economic and LPT exports that cleared the IFM. The SCs for these exports will be obligated to submit energy bids for the RCU capacity, similar to the MOO for RCU awards. These created proxy RCU bids and proxy RCU awards will not be paid at the relevant marginal RCUMP in Settlements, while the clean RCU bids and RCU awards will be paid the relevant marginal RCUMP in Settlements. Proxy RCU bids shall be excluded from final bid set. For extended RCU bids, the proxy portion is omitted and the clean bid portion is included in the final bid set. In the scheduling run for RUC, the proxy RCU price will be indexed in the price range of the RCU DAB price plus a configurable value and the RUC PBC penalty in the scheduling run to maintain the same merit order when proxy RCU is awarded (DAECON first followed by DALPT), two separate configurable values shall be available, one for DAECON and one for DALPT. In the pricing run for RUC, the proxy RCU awards will be fixed and the price discovery feature will be used to produce a \$250/MWh price (excluding marginal losses and congestion). Where \$250/MWh is RCU Bid Price Cap. 		




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-05003	<p>Consider Proxy RCU and RCU when SIBR Receives a Proxy RCU on the Exports</p> <ul style="list-style-type: none"> System shall ensure that there is an energy bid curve with a bid range equal to the sum of the RCU award MW and the Proxy RCU MW. System shall have a validation rule to prohibit a Total Self-Schedule from being greater than the IFM Schedule minus the sum of the RCU Award and the Proxy RCU MW, if any. 	Core	SIBR
DAME-BRQ-05005	<p>Adjust VER RCU/RCD Bid Down If Forecast Output Less than Bid MW Value</p> <p>Adjust the clean RCU/RCD VER bid down as necessary if the forecast output is less than the max MW value of the bid.</p>	Core	RUC
DAME-BRQ-05010	<p>Define the notion of Reliability Energy REN</p> <p>In the RUC,</p> <ul style="list-style-type: none"> Set the notion of REN as resource reliability energy schedules that RCU/RCD awards are related to the day-ahead energy schedules fixed EN $REN_{i,t} \equiv EN_{i,t} + RCU_{i,t} - RCD_{i,t}$ <p>Note</p> <ul style="list-style-type: none"> REN is another alternative terminology of RUC Schedule. 	Information-Only	RUC
DAME-BRQ-05020	<p>Build RUC-MPM pass, perform market power mitigation for RCU</p> <ul style="list-style-type: none"> Build Activation switch for turn on/off of RUC-MPM If RUC-MPM is off, skip RUC-MPM pass <p>Note:</p> <p>With RUC-MPM is on:</p> <ul style="list-style-type: none"> Add market power mitigation pass in RUC (DAME-BRQ-05021, DAME-BRQ-05025) Run RUC optimization with SIBR submitted bids in RUC-MPM path. 	Core	RUC -MPM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-05021	<p>Build RUC- DCPA Use same process as IFM MPM for energy, except use REN in place of energy EN, in the counter-flow calculation to identify the non-competitive binding constraints use</p> $REN_{i,t} \equiv EN_{i,t} + RCU_{i,t} - RCD_{i,t}$ <p>Notes</p> <ul style="list-style-type: none"> REN is another alternative terminology of RUC Schedule. 	Core	RUC -MPM
DAME-BRQ-05025	<p>Build RUC- LMPM:</p> <ul style="list-style-type: none"> The shadow price of REN PBC of each BAA is used in price formation/decomposition in LMP for RCU. Calculate competitive LMP for RCU that excludes non-competitive path congestion prices, in the same manner as IFM-MPM for energy (no change to reference point for calculate LMP) Mitigation: If the non-competitive constraint congestion component of a RCU supply bid is greater than Mitigation Threshold Price (default value 0.02), the resource RCU bid will be mitigated to greater of (RCU competitive LMP and RCU DAB) if it is lower than the unmitigated bid. RCD bids shall not be mitigated. RCU Bids submitted on behalf of imports from outside the EDAM Area shall not be mitigated. <p>Notes</p> <ul style="list-style-type: none"> REN is another alternative terminology of RUC Schedule. 	Core	RUC-MPM
DAME-BRQ-05030	<p>Apply mitigated RCU bids for trading day hours only</p> <ul style="list-style-type: none"> Use mitigated bids for RCU in RUC optimization for Trading day hours (24 hours). 	Core	RUC
DAME-BRQ-05050	<p>Procure RCU/RCD through optimization in RUC</p> <p>Objective function:</p> <ul style="list-style-type: none"> Include resource RCU and RCD bid cost in OBJ function of RUC, and corresponding start-up cost and minimum load cost. 	Core	RUC

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • No de-commitment: Resources that are committed in IFM are modeled as must run in RUC, kept online, no de-commitment. The resource dispatch level in RUC is determined by REN optimization. • RCU and RCD are zero when the resource is offline, except for RCU that can be provided by offline resources that can start within 60min ($SUT \leq 60min$), which the optimization will determine the resource commitment based on the min load cost, start-up cost and energy bid. • For the MSG committed in IFM, model MSG transition cost • RUC shall not issue infeasible MSG transition due to RC Awards from an IFM MSG configuration. • System Resources (SRs) and Non-Generator Resources (NGRs) have no discontinuities or inter-temporal constraints and are always modeled as online. <p>Notes</p> <ul style="list-style-type: none"> • Refer to <i>Error! Reference source not found.</i> in <i>Error! Reference source not found.</i> • Fixed IFM schedules for EN, AS, IRU/IRD are not be optimized in RUC. • REN is another alternative terminology of RUC Schedule. • RC Awards can be either RCU or RCD but not both for a given resource and hour. • For a trading hour: <ul style="list-style-type: none"> ○ If CAISO forecast of BAA Demand > IFM Cleared Physical Supply, then RCU Target = Mismatch quantity and RCD Target = 0. ○ Else If CAISO forecast of BAA Demand < IFM Cleared Physical Supply, then RCU Target = 0 and RCD Target = Mismatch quantity. ○ Else If CAISO forecast of BAA Demand = IFM Cleared Physical Supply, then RCU Target = 0 and RCD Target = 0. 		
DAME- BRQ- 05060	Allow MSG transition in RUC <ul style="list-style-type: none"> • Keep online for the MSG is committed in IFM 	Core	RUC

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> Allow all feasible transitions modeled. The resource dispatch level and stage are determined by REN, can be at different stage, different MW from IFM RUC shall not issue infeasible MSG transition due to RC Awards from an IFM MSG configuration. <p>Note: MSG may be transitioned to a lower configuration but not shut down in RUC. Lower configuration MLC shall be set to 0 for both CISO and EDAM BAAs in the objective function.</p> <p>The compromise with Ops was that RUC will not shut down any resource, including MSG, if scheduled by IFM. Regular resources can be assigned RCD down to Pmin, and MSGs down to the Pmin of lowest configuration. The rationale is that the operator may still ED a resource up if it is online, but not if it is shut down. In any case, the IFM schedule is the DA schedule (and that is why RUC does not shut down); The difference between the RUC schedule and the IFM schedule is RCU or RCD.</p> <p>Note</p> <ul style="list-style-type: none"> REN is another alternative terminology of RUC Schedule. 		
DAME-BRQ-05070	<p>Procurement REN balance constraints in RUC</p> <ul style="list-style-type: none"> Reliability energy (REN) Power Balance Constraint (PBC) is for the REN to balance the demand forecast (D) include losses. $\sum_i REN_{i,t} = D_t,$ <p style="text-align: center;">$t = 1, 2, \dots, T.$</p> <ul style="list-style-type: none"> Ancillary Service awards are fixed in RUC at IFM solution IRU/IRD awards are fixed in RUC at IFM solution <p>Note</p> <ul style="list-style-type: none"> REN is another alternative terminology of RUC Schedule. 	Core	RUC
DAME-BRQ-05080	<p>RCU/RCD Capacity upper/lower bound constraints in RUC</p> <ul style="list-style-type: none"> The RCU/RCD upper/lower bound constraints by certified the RCU/RCD capacities 	Core	RUC




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> An energy bid is required for reliability energy schedules and RCU/RCD awards 		
DAME-BRQ-05090	<p>Resource Capacity constraint for RCU/RCD in RUC</p> <ul style="list-style-type: none"> For online physical resource, the REN is limited by capacity between the physical resource UCL minus upward AS and IRU awards, and LCL plus the downward AS and IRD For online physical resource, the REN is limited by economic limit between the adjusted LEL + IRD and adjusted UEL-IRU For offline physical resource the upward capacity awards NR + IRU +RCU is limited by capacity UCL, RCU+IRU is limited by economic limit adjusted UEL <p>For VER,</p> <ul style="list-style-type: none"> the capacity and economic limit are limited by the VER forecast <p>Notes</p> <ul style="list-style-type: none"> Adjusted LEL = max(LCL, LEL) ensure the resource must bid IFM Adjusted UEL=min(UCL,UEL) REN is another alternative terminology of RUC Schedule. 	Core	RUC
DAME-BRQ-05100	<p>Ramp capability constraints for REN in RUC</p> <ul style="list-style-type: none"> Include REN, AS and IRU/IRD in resource ramp capability constraint The ramp capability constraint for offline start up at beginning of the hour to support REN and upward AS, IRU The ramp capability constraint for the resource shut down at the end of hour to support REN, IRD and downward AS Use same granularity adjustment factors as in IFM <p>Note</p> <ul style="list-style-type: none"> REN is another alternative terminology of RUC Schedule. 	Core	RUC
DAME-BRQ-05110	<p>RUC-NA use REN as injection, no IRU/IRD deployment scenarios:</p> <ul style="list-style-type: none"> Use REN as nodal injection in RUC-NA. Not include IRU/IRD deployment scenarios in RUC-NA power flow. 	Core	RUC



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> The demand forecast is distributed to the load nodes using LDF <p>Notes</p> <ul style="list-style-type: none"> Treat IRU/IRD the similar manner as AS. Not include in power flow and transmission constraints, but include in the resource capacity constraint. REN is another alternative terminology of RUC Schedule. 		
DAME-BRQ-05120	<p>Network constraints in RUC using same network topology and transmission limits as IFM</p> <ul style="list-style-type: none"> Enforce critical transmission constraints from NA power flow by REN injection for <ul style="list-style-type: none"> base case, using same topology in IFM base case (shift factor set $SF_{i,m,t}$) base case with contingencies of N-1 transmission using same topology in IFM base case with contingencies (shift factor set $SF_{i,m,t}^{(k)}$) base case with contingencies of GCARM generation/transmission using same topology in IFM base case with contingencies of GCARM (shift factor set $SF_{i,m,t}^{(g)}$) Use the same transmission limits as used in IFM <p>Notes</p> <ul style="list-style-type: none"> The shift factors in the RUC base case are the same as the ones in the IFM base case because the transmission network is the same; however, the set of critical constraints is different in general. REN is another alternative terminology of RUC Schedule. 	Core	RUC
DAME-BRQ-05130	<p>Scheduling Limit constraints in RUC</p> <ul style="list-style-type: none"> Include RCU from import resources and RCD from export resources in ITC/ISL upper limit (import) constraints for energy plus upward AS and IRU/IRD Include RCU from import resources and RCD from export resources in ITC/ISL upper limit constraints for upward AS and IRU/IRD without energy Include RCU from export resources and RCD from import resources in ITC/ISL lower limit (export) constraints for energy plus downward AS plus IRD/IRU 	Core	RUC




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> Include RCU from export resources and RCD from import resources in ITC/ISL lower limit constraints for downward AS and IRD/IRU without energy <p>Note</p> <ul style="list-style-type: none"> The ITC/ISL constraints allow netting of import and export energy schedules, but they prevent netting among energy schedules and ancillary services or RCU/RCD/IRU/IRD awards. 		
DAME-BRQ-05140	<p>Energy limit, Gas-burn, pump and other constraints in RUC</p> <ul style="list-style-type: none"> <i>Gas-Burn Nomogram</i>: Add RCU/RCD, in addition to En+IRU, in the Gas-Burn nomograms <i>Daily Energy limit</i>: include En, RCU and IRU in the Daily Energy limit constraint Pump-storage Hydro (PSH): En+ IRU+RCU, in the PSH upper limit constraint; En-IRD-RCD, in the PSH lower limit constraint; 	Core	RUC
DAME-BRQ-05144	<p>Model State of Charge (SOC) constraints envelop and limits of LESR:</p> <p>Use RCU/RCD for energy charge/discharge SOC balance constraint, SOC limit constraint, attenuation factors and coverage factor apply to the AS and IR capacity awards (same as DAME-BRQ-04331, DAME-BRQ-04332)</p> <p>Envelop constraint include RCU/RCD</p> $SOC_{i,t}^{(e)} = \left(\begin{array}{l} ANR_t NR_{i,t} - \frac{SOC_{i,t-1}^{(e)} - EN_{i,t}^{(+)} - \eta_i EN_{i,t}^{(-)} - ARU_t RU_{i,t} - ASR_t SR_{i,t} -}{AIRU_t IRU_{i,t} + AIRU_{t+1} IRU_{i,t+1} - \frac{ARCU_t RCU_{i,t} + ARCU_{t+1} RCU_{i,t+1}}{2}} \geq \underline{SOC}_{i,t} \\ \frac{SOC_{i,t-1}^{(d)} - EN_{i,t}^{(+)} - \eta_i EN_{i,t}^{(-)} + \eta_i ARD_t RD_{i,t} +}{AIRD_t IRD_{i,t} + AIRD_{t+1} IRD_{i,t+1} + \eta_i \frac{ARCD_t RCD_{i,t} + ARCD_{t+1} RCD_{i,t+1}}{2}} \leq \overline{SOC}_{i,t} \end{array} \right)$ <p>$\forall i \in S_{LESR} \wedge t = 1, 2, \dots, T$</p> <p>SOC limit include RCU/RCD:</p> $SOC_{i,t} - RU_{i,t} - SR_{i,t} - NR_{i,t} - IRU_{i,t} - RCU_{i,t} \geq \underline{SOC}_{i,t}$ $SOC_{i,t} + \eta_i (RD_{i,t} + IRD_{i,t} + RCD_{i,t}) \leq \overline{SOC}_{i,t}$ <p>Notes</p>	Core	RUC

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> The attenuation factors shall be configurable parameters and can be set to 0 to disable the commodity in the envelope constraints. Also refer to DAME-BRQ-04332 		
DAME-BRQ-05160	<p>Calculate hourly nodal RCU marginal price (RCUMP) and price breakdowns and sub-components of MCC prices in RUC for nodal and resource</p> <ul style="list-style-type: none"> Shadow price of RCU balance constraint / Loss Penalty Factor (LPF) of res/node (minus) MCC components of RCU, using shift factor $SF_{i,m,t}$ (minus) MCC components of RCU with N-1 preventive transmission contingency using shift factor $SF_{i,m,t}^{(k)}$ (minus) MCC components of RCU with GCARM generation/ transmission contingency using adjusted shift factor $SF_{i,m,t}^{(g)}$ <p>Notes</p> <ul style="list-style-type: none"> For RCUMP and RCDMP, the sign is opposite for each component of price formation, represent the RCU RCD opposite direction impact on price. Loss factor in area control feature need apply REN is another alternative terminology of RUC Schedule. 	Core	RUC
DAME-BRQ-05170	<p>Calculate hourly nodal RCD marginal price (RCDMP) and breakdowns and sub- components of MCC prices in RUC for node and resource</p> <ul style="list-style-type: none"> (minus) Shadow price of RCD balance constraint / Loss Penalty Factor (LPF) of res/node (plus) MCC components of RCD, using shift factor $SF_{i,m,t}$ (plus) MCC components of RCD with N-1 preventive transmission contingency using shift factor $SF_{i,m,t}^{(k)}$ (plus) MCC components of RCD with GCARM generation/ transmission contingency using adjusted shift factor $SF_{i,m,t}^{(g)}$ <p>Notes</p>	Core	RUC



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-05180	<ul style="list-style-type: none"> REN is another alternative terminology of RUC Schedule. <p>Calculate Hourly SP-Tie RCU Marginal Price (RCUMP) in DAM for Nodal by Import/Export Direction (Import/Export)</p> <p>For import direction:</p> <ul style="list-style-type: none"> SP nodal price of RCU (plus) the shadow prices of import directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie location of RCU <p>For export direction:</p> <ul style="list-style-type: none"> SP nodal prices of RCU (minus) the shadow prices of export directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie location of RCU. 	Core	RUC
DAME-BRQ-05181	<p>Calculate Hourly SP-Tie RCU Marginal Price (RCUMP) in DAM for Resource</p> <ul style="list-style-type: none"> SP nodal price of RCU (plus) the shadow prices of import directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie Location of RCU for import resources and tie-gen (TG) (minus) the shadow prices of export directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie location of RCU for export resources. 	Core	RUC
DAME-BRQ-05182	<p>Calculate Hourly SP-Tie RCD Marginal Price (RCDMP) in DAM for Nodal by Direction (Import/Export)</p> <p>For Import direction:</p> <ul style="list-style-type: none"> SP nodal price RCD (minus) the shadow prices of export directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie location of RCD <p>For Export direction</p> <ul style="list-style-type: none"> SP nodal prices of RCD 	Core	RUC

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • (plus) the shadow prices of import directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie location of RCD. 		
DAME-BRQ-05183	<p>Calculate Hourly SP-Tie RCD Marginal Price (RCDMP) in DAM for Resource</p> <ul style="list-style-type: none"> • SP nodal price RCD • (minus) the shadow prices of export directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie location of RCD for import resources and tie gen (TG) • (plus) the shadow prices of import directions of all binding Intertie Scheduling Limits (ISLs) and Inter-Tie Constraints (ITCs) associated with that SP-Tie Location of RCD for export resources. 	Core	RUC

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.6 Business Process: Manage RTM


- MOO for Resource have DAM IRU/IRD, RCU/RCD awards
- MOO for RA resource that no DAM EN/AS/IR/RC awards
- Use IFM schedule for MSG reference stage to calculate min load
- Set UEL to 0 if IRU and/or RCU eTagging Validation Fails for System Resources
- Identify the critical constraints for FRU/FRD deployment scenarios
- Add configurable parameters coverage factor for AS and FRP capacity awards to storage resource opposite dispatch energy bids in RTM

5.6.1 Business Requirements


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-06010	<p>Enforce must offer obligation in RTM for the resources with IRU/IRD, RCU/RCD DAM awards:</p> <ul style="list-style-type: none"> • Resources that are awarded reliability capacity (RCU/RCD), or imbalance reserve awards (IRU/IRD) in the day-ahead market will have real-time market bidding obligations. • Resources must bid economically energy bid the full range of their reliability capacity and imbalance reserve awards in the real-time market. • Real-time must offer obligations apply in the hours that a resource has a reliability capacity or imbalance reserve award. • The resources that do not submit the bids will have economic energy bids inserted for them at their Default Energy Bid (DEB) for the full range of RC and IR awards. • Resources receiving a RCU Award for which their SC has submitted a DA Energy Bid to export outside the EDAM Area must provide a decremental RT Energy Bid to dispatch down the export schedule in the FMM if needed. 	Core	SIBR <i>For RTM</i>
DAME-BRQ-06020	<p>Maintain the CAISO BAA resource adequacy real-time must-offer obligation</p> <p>System shall maintain the CAISO BAA RA RT MOO.</p>	Core	SIBR <i>For RTM</i>
DAME-BRQ-06060	<p>Use IFM schedule for MSG reference stage to calculate MLC</p>	Core	RTM



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>In RTM, use IFM schedule as MSG reference stage to calculate MLC.</p> <p>Note: The difference between the RUC schedule and the IFM schedule is RCU or RCD, RUC stage will not be used as reference stage for MSG.</p>		
DAME-BRQ-06070	<p>Identify the critical constraints for FRU/FRD deployment scenarios</p> <p>Determine the critical set in the deployment scenarios superimposing the linear FR flows from UC</p> <p>Note</p> <ul style="list-style-type: none"> Refer to DAME-BRQ-04232 for DAM. 	Core	RTM
DAME-BRQ-06100	<p>Calculate SP-Tie FRU/FRD Marginal Price (FRUMP/FRDMP) in RTM for Nodal by Direction (Import/Export)</p> <p>For import direction FRU</p> <ul style="list-style-type: none"> SP nodal price of FRU (plus) the shadow prices of import directions for Inter-Tie Scheduling Limits (ISLs) or Inter-Tie Constraint (ITCs) associated with that SP-Tie location of FRU <p>For export direction FRU</p> <ul style="list-style-type: none"> SP nodal price of FRU (minus) the shadow prices of export directions for Inter-Tie Scheduling Limits (ISLs) or Inter-Tie Constraint (ITCs) associated with that SP-Tie location of FRU <p>For import direction FRD</p> <ul style="list-style-type: none"> SP nodal price of FRD (minus) the shadow prices of export directions for Inter-Tie Scheduling Limits (ISLs) or Inter-Tie Constraint (ITCs) associated with that SP-Tie location of FRD <p>For export direction FRD</p> <ul style="list-style-type: none"> SP nodal price of FRD 	Core	RTM

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> (plus) the shadow prices of import directions for Inter-Tie Scheduling Limits (ISLs) or Inter-Tie Constraint (ITCs) associated with that SP-Tie location of FRU. 		
DAME-BRQ-06120	<p>Include ITC/ISL Shadow Prices from SP-Tie FRU/FRD Marginal Price (FRUMP/FRDMP) in RTM for Resource</p> <ul style="list-style-type: none"> SP nodal price of FRU 	Existing	RTM
DAME-BRQ-06150	<p>Extend Existing HASP Market Priority Types Functionality for Export Resources to FMM and RTD</p> <p>System shall extend the existing HASP market priority types functionality for export resources to FMM and RTD markets.</p>	Core	RTM
DAME-BRQ-06170	<p>Extend Existing HASP Market Priority Types Functionality for Non-Export Resources to FMM and RTD</p> <p>System shall extend the existing HASP market priority types functionality for non-export resources to FMM and RTD markets.</p>	Core	RTM

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.7 Business Process: Manage Market Quality System

- Calculate 15-min IRU/IRD and RCU/RCD Overlapping RA Capacity
- Calculate 15-min IRU/IRD LOC for Overlapping RA Capacity
- Calculate DA/Base Schedule Forecasted Movement Data
- Resource IRU/IRD Award 5-min Ramp Capable Portion Calculation
- FMM Ex-Post Capacity Calculation
- FMM Ex-Post IR/RC Capacity Allocations
- Update Commitment Cost Determination Logic to Account for RC
- Use IFM MSG Configuration as Reference for RT MLC Calculations
- Account for IRU/IRD in CRR1B Logic

5.7.1 Business Requirements


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-07265	<p>Calculate 15-min IRU/IRD and RCU/RCD Overlapping RA Capacity</p> <p>On daily basis, and after all RTM markets run for a trade day, and after everytime corrections occurred on any of the data used in the calculations, System shall have the capability to calculate 15-min resource-specific IRU/IRD and RCU/RCD Overlapping RA Capacity, as sliced by final DA energy bid segments and as total, using latest available data for RA-resources only:</p> <ul style="list-style-type: none"> • For non-MSG resources, 15-min IRU/IRD and RCU/RCD Overlapping RA Capacity are calculated as the overlapped capacity between RA Capacity and corresponding IRU/IRD and RCU/RCD awards, as sliced by final DA energy bid segments and as a total, accounting for any Pmax derates and/or Pmin re-rates that occur in FMM. • For MSG resources, 15-min IRU/IRD/RCU/RCD Overlapping RA Capacity are calculated on the MSG plant level, where. <ul style="list-style-type: none"> ○ RA Capacity shall be on MSG plant level. ○ IRU/IRD awards, final DA energy bid segments, any FMM Pmax derates and/or FMM Pmin re-rates shall be on the MSG plant level. 	Core	<ul style="list-style-type: none"> • Internal ISO System




	<ul style="list-style-type: none"> ○ For same MSG resource and hour, <ul style="list-style-type: none"> ▪ If the upward/downward 15-min Overlapped RA Capacity is on same IFM MSG configuration, the slicing of that upward/downward 15-min Overlapping RA Capacity against the final DA energy bid segments will be aligned on the same IFM MSG configuration. ▪ Otherwise, if the upward/downward 15-min Overlapped RA Capacity is on a different MSG configuration from the IFM MSG configuration, the slicing of that upward/downward 15-min Overlapping RA Capacity against the final DA energy bid segments will be unaligned to different MSG configurations, and the following logic shall be applied for the slicing of the upward/downward 15-min Overlapped RA Capacity: <ul style="list-style-type: none"> • For the upward 15-min Overlapped RA Capacity (in a higher MSG configuration, relative to the IFM MSG configuration) with overlapping of the final DA energy bid segments between the two MSG configurations, use the higher of the overlapped final DA energy bid prices among both configurations. • For the upward 15-min Overlapped RA Capacity (in a higher MSG configuration, relative to the IFM MSG configuration) without any final DA energy bid segments in both MSG configurations, bridge it with the higher of the final DA energy bid price at the UEL_{DAM} of the lower MSG configuration and the final DA energy bid price at the LEL_{DAM} of the higher MSG configuration. • For the downward 15-min Overlapped RA Capacity (in a lower MSG configuration, relative to the IFM MSG configuration) with overlapping of the final DA energy bid segments between the two MSG configurations, use the lower of the overlapped final 		
--	--	--	--




	<p>DA energy bid prices among both configurations.</p> <ul style="list-style-type: none"> • For the downward 15-min Overlapped RA Capacity (in a lower MSG configuration, relative to the IFM MSG configuration) without any final DA energy bid segments in both MSG configurations, bridge it with the lower of the final DA energy bid price at the LEL_{DAM} of the higher MSG configuration and the final DA energy bid price at the UEL_{DAM} of the lower MSG configuration. <ul style="list-style-type: none"> • Where <ul style="list-style-type: none"> ○ RA Capacity is the most restrictive between RA Showing and Daily RA Capacity. ○ RA Showing is calculated as the higher of RA Generic Showing Capacity and RA Flex Showing Capacity for that RA resource and trade day, where: <ul style="list-style-type: none"> ▪ RA Generic Showing Capacity for each RA resource is calculated as the Summation of all RA Generic Showing Capacity across all LSEs that are associated with that RA resource and trade day within the time-block. ▪ RA Flex Showing Capacity for each RA resource is calculated as the Summation of all RA Flex Showing Capacity across all Flex categories and across all LSEs that are associated with that RA resource and trade day within the time-block. ▪ Note: RA Showing for a time-block does not account for the RA substitution. ○ Daily RA capacity accounts for RA resources substitution and accounts for both Generic RA capacity and Flex RA Capacity. ○ The RA Overlapping capacity slicing, by final DA energy bid segments, is only required for IRU/IRD to be used for LOC calculations, but not for RCU/RCD. 		
	Notes		

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

	<ul style="list-style-type: none"> The time-block will be the entire month window for all resource types with the exception of interties, where the time-block can be any time frame window within the month. The Generic, Flex and total RA Showings are values for a trade day within the corresponding time-block. For non-NGRs, RA Capacity is an absolute value (relative to 0 MW). For NGRs, RA Capacity is relative to FMM Min Ex-Post Capacities ($MinExCap_{FMM}$). No substitutions will be accounted for in the time-block RA showing and mapping data. Substitution will be included in the daily RA capacity and identification data. 		
DAME- BRQ-07270	<p>Calculate 15-min IRU/IRD LOC for Overlapping RA Capacity</p> <p>On daily basis, and after all RTM markets run for a trade day, and after everytime corrections occurred on any of the data used in LOC calculations, System shall have the capability to calculate 15-min resource-specific IRU/IRD Lost Opportunity Cost (LOC) for each IRU/IRD Overlapping RA Capacity, sliced by final DA energy bid segments (excluding energy self schedule), using latest available data for RA-resources only, include internal RA resources and intertie RA resources:</p> <ul style="list-style-type: none"> 15-min IRU LOC is calculated as the positive difference between DA Energy LMP and final DA energy bid price for the amount of 15-min resource IRU Overlapping RA capacity (excluding energy self schedule), and converted into 15-min granularity, where: <ul style="list-style-type: none"> Mathematically: <ul style="list-style-type: none"> 15-min IRU LOC = $(\frac{1}{4}) * \text{Max} \{ 0, [\text{Sum over all corresponding DA energy bid segment } i \text{ of } \{ (15\text{-min resource IRU Overlapping RA Capacity, sliced by final DA energy bid segment } i \text{ [excluding energy self schedule]}) * (\text{hourly DA Energy LMP} - \text{hourly DA Final Energy Bid Price for bid segment } i) \}] \}$ 15-min IRD LOC is calculated as the positive difference between final DA energy bid price and DA Energy LMP for the amount of 15-min resource IRD Overlapping RA capacity (excluding energy self schedule), and converted into 15-min granularity, where: <ul style="list-style-type: none"> Mathematically: 	Core	<ul style="list-style-type: none"> Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


	<ul style="list-style-type: none"> ▪ 15-min IRD LOC = $(\frac{1}{4}) * \text{Max} \{ 0, [\text{Sum over all corresponding DA energy bid segment } i \text{ of } \{ (15\text{-min resource IRD Overlapping RA Capacity, sliced by final DA energy bid segment } i \text{ [excluding energy self schedule]}) * (\text{hourly DA Final Energy Bid Price for bid segment } i - \text{hourly DA Energy LMP}) \}] \}$ <p>Notes</p> <ul style="list-style-type: none"> • No substitutions will be accounted for in the time-block RA showing and mapping data. • Substitution will be included in the daily RA capacity and identification data. 		
DAME-BRQ-07320	<p>Calculate DA/Base Schedule Forecasted Movement Data</p> <p>Using similar calculation calendar as FMM and RTD Forecasted Movement, and for every trade hour (h) of each trade day, System shall calculate resource-specific hourly DA/Base Schedule Forecasted Movement as:</p> <ul style="list-style-type: none"> • For CAISO and EDAM BAA resources (including virtual supply and demand resources): <ul style="list-style-type: none"> ○ DA Schedule Forecasted Movement (h) = $DAES_{DAM,h} - DAES_{DAM,h-1}$ • For WEIM-only BAA-only (non-EDAM) resources: <ul style="list-style-type: none"> ○ Base Schedule Forecasted Movement (h) = $BS_h - BS_{h-1}$ <p>Notes</p> <ul style="list-style-type: none"> • For Virtual Awards, the Forecasted Movement is the algebraic difference of the Virtual Award between consecutive hours. • For the calculation of the DA/Base Schedule Forecasted Movement for first hour of the day, results from the previous day last hour will be used. • Movement shall be calculated for all hours when there is a non-zero DAES/Base Schedule for at least one hour in the day, or there is a non-zero DAES/Base Schedule in the last hour of the previous day. • This FM calculation shall run in the same run as existing FMM/RTD Forecasted Movement calculation run. 	Core	<ul style="list-style-type: none"> • Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


DAME- BRQ-07600	<p>Resource IRU/IRD Award 5-min Ramp Capable Portion Calculation</p> <p>System shall automatically calculate IRU/IRD award 5-min ramp capable portion ($IRU5_{DAM}$, $IRD5_{DAM}$) on resource-specific hourly basis for hour h as follows:</p> <ul style="list-style-type: none"> Determine DAM upward and downward ramp rate segments (RRU_{DAM} and RRD_{DAM} in MW/min, respectively) that corresponds to $DAES_{DAM}$. $IRU5_{DAM} = \min (IRU_{DAM}, \max\{0, ([RRU_{DAM} * 5'] - \max [0, (DASFM/12)])\})$ $IRD5_{DAM} = \min (IRD_{DAM}, \max\{0, ([RRD_{DAM} * 5'] + \min [0, (DASFM/12)])\})$ Where DASFM is Day Ahead Schedule Forecasted Movement @h ($DAES_h - DAES_{h-1}$) 	Core	<ul style="list-style-type: none"> Internal ISO System
DAME- BRQ-07610	<p>FMM Ex-Post Capacity Calculation</p> <ul style="list-style-type: none"> System shall automatically calculate FMM Ex-Post Capacities ($MinExCap_{FMM}$, $MaxExCap_{FMM}$) on resource-specific 15-minute basis by utilizing FMM bid data and data that are available in FMM run, and using similar formulation as the ones used for the calculation of RTD Ex-Post Capacities ($MinExCap$, $MaxExCap$). For MSG resources, the FMM Ex-Post Capacities shall be calculated first for each MSG configuration, then the plant level FMM Ex-Post Capacities shall be calculated as follows: <ul style="list-style-type: none"> Plant-level FMM Min Ex Post Capacity is the minimum of FMM Min Ex Post Capacity among all MSG configurations. Plant-level FMM Max Ex Post Capacity is the maximum of FMM Max Ex Post Capacity among all MSG configurations. 	Core	<ul style="list-style-type: none"> Internal ISO System
DAME- BRQ-07615	<p>FMM Ex-Post IR/RC Capacity Allocations</p> <ul style="list-style-type: none"> System shall automatically calculate FMM Ex-Post IRU/IRD and RCU/RCD capacity allocations on resource-specific 15-minute basis: <ul style="list-style-type: none"> $IRUC_{FMM}$ Imbalance Reserve Up allocated capacity range (FMM). $IRDC_{FMM}$ Imbalance Reserve Down allocated capacity range (FMM). $RCUC_{FMM}$ Reliability Capacity Up allocated capacity range (FMM). $RCDC_{FMM}$ Reliability Capacity Down allocated capacity range (FMM). 	Core	<ul style="list-style-type: none"> Internal ISO System



	<ul style="list-style-type: none"> For MSG resources, the FMM Ex-Post IRU/IRD and RCU/RCD capacity allocations shall be performed on plant level. 		
DAME-BRQ-07620	<p>Update Commitment Cost Determination Logic to Account for RC</p> <ul style="list-style-type: none"> System shall be updated to use RCU Awards instead of RUC Awards in commitment cost determination logic, starting from Go-Live date going forward. System shall account for RCD Awards in commitment cost determination logic, as applicable to commitment to downward MSG commitments in RUC due to RCD Awards. 	Core	<ul style="list-style-type: none"> Internal ISO System
DAME-BRQ-07630	<p>Use IFM MSG Configuration as Reference for RT MLC Calculations</p> <p>System shall use IFM MSG configuration as reference for RT MLC calculations.</p>	Core	<ul style="list-style-type: none"> Internal ISO System
DAME-BRQ-07860	<p>Account for IRU/IRD in CRR1B Logic</p> <p>System shall update CRR1B logic to account for IRU/IRD, by utilizing Shift Factors for IRU/IRD, IRU/IRD Deployment Factor (DIRU/DIRD), and IRU/IRD Resource Awards, for all upward/downward deployment scenarios, as follows:</p> <ul style="list-style-type: none"> Calculate Hourly IRU/IRD flow by constraint and constraint case, considering IRU/IRD deployment factors. Update calculations of hourly Constraint Flow Difference (Market flow vs CRR flow) to account for IRU/IRD. Update calculations of hourly portion of CRR-settled flow by constraint and constraint case. Calculations shall include IRU/IRD deployment scenarios constraints, IRUR/IRD and IRUS/IRDS and their Associated Imbalance Demand Hub/IR Surplus Zone Apnode for each BAA. 	Core	<ul style="list-style-type: none"> Internal ISO System
DAME-BRQ-07875	<p>Include Virtual Bids impact on IRU/IRD deployment scenario binding constraints in CRR clawback for ISO BAA</p> <p>For the day-ahead constraint-entity-specific CRR revenues for ISO BAA:</p> <ul style="list-style-type: none"> Consume IFM binding constraint information by deployment scenarios Calculate the impact from all virtual bids and implicit virtuals at CAISO BA ties for the flow impact on each constraint in CAISO, include IRU/IRD deployment constraint <ul style="list-style-type: none"> Shift factors to be used for deployment scenarios are the same as the shift factors for the base scenarios for the same constraint 	Core	<ul style="list-style-type: none"> Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

	<ul style="list-style-type: none"> • Expand the comparison of the magnitude of the flow impact between IFM and FMM CRR congestion impacted the constraint to cover deployment scenarios <ul style="list-style-type: none"> ○ Base/IRU/IRD deployment scenarios in IFM shall be compared with base scenario in FMM for the same constraint • If the difference is more than the 10% flow impact threshold, clawback the corresponding CRR revenue • Expand reporting the CRR payment adjustment by deployment scenarios. • Note: moved from EDAM-BRQ-06012 		
--	---	--	--

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.8 Business Process: Manage Market Billing and Settlements

- IFM IR & RUC RC Payments
- IFM IR & RUC Cost Allocation
- IR DA & RC RT BCR Settlements
- Inclusion of IR & RC in GMC Settlements
- Update GMC Charge Codes
- IRU/IRD & RCU/RCD Unavailability No-Pay Charges
- IR and RC Unavailability No-Pay Charges Priority
- Do not assess RAAIM to IR and RC awards for generic and Flex RA
- IR – FRP RTM Ramp Deviation Settlements
- FMM Forecasted Movement Deviation Settlements
- Accounting for Virtuals in Allocation of Residual Forecasted Movement Settlements
- Settlements of Overlapping RA Capacity for True-Up Settlements Mechanism
- Apply CRR 1B Methodology for CAISO BAA
- Calculate BAA IRU/IRD and Energy Congestion Revenues
- Distribute BAA IRU/IRD Congestion Revenues for CAISO and EDAM BAAs
- Apply HASP Reversal to CAISO BAA IFM Intertie Schedule

5.8.1 Business Requirements

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME -BRQ- 09140	IFM IR & RUC RC Payments System shall be updated for the following: <ul style="list-style-type: none"> • All eligible resources (including MSS resources) that have been awarded hourly IFM IRU/IRD shall be paid hourly IFM IRUMP/IRDMP prices, respectively. • All eligible resources (including CAISO RA resources and MSS resources) that have been awarded hourly RUC RCU (but excluding resources with proxy RCU awards) shall be paid hourly RUC RCUMP prices, respectively. • All eligible resources (including CAISO RA resources and MSS resources) that have been awarded hourly RUC RCD shall be paid hourly RUC RCDMP prices, respectively 	Core	<ul style="list-style-type: none"> • Settlements




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted									
	<p>Notes</p> <ul style="list-style-type: none"> This shall apply to MSS resources that have been awarded IR, regardless of the MSS operator's selection of Net or Gross settlement. 											
DAME-BRQ-09160	<p>IFM IR Cost Allocation</p> <ul style="list-style-type: none"> System shall be updated to allocate IFM IRx costs in two Tiers, where x = U, D. Tier-1 IRx Cost Allocation, for each individual component, and on hourly basis: <ul style="list-style-type: none"> Tier-1 IFM IRx Allocation Cost = Tier-1 IRx Allocation Quantity * Tier-1 IRx BAA Allocation Price. Tier-1 IRx Allocation Quantity shall be calculated as follows: <table border="1" data-bbox="264 1119 1159 1894"> <thead> <tr> <th data-bbox="264 1119 477 1205">Component Type</th> <th data-bbox="477 1119 824 1205">Tier-1 IRU Allocation Quantity</th> <th data-bbox="824 1119 1159 1205">Tier-1 IRD Allocation Quantity</th> </tr> </thead> <tbody> <tr> <td data-bbox="264 1205 477 1671">Generation (including ESR)</td> <td data-bbox="477 1205 824 1671"> $\max(0, [DAES_{DAM} - MaxExCap_{FMM}])$ as affected by de-rates and reduction in VER forecast between DAM and RTM (if applicable) excluding valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules. Implementation Note: The IFM valid and balanced quantity is reflected in both the $DAES_{DAM}$ and $MaxExCap_{FMM}$ quantities. </td> <td data-bbox="824 1205 1159 1671"> $\max(0, [MinExCap_{FMM} - DAES_{DAM}])$ as affected by rerates or self-schedules (if applicable) excluding valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules. Implementation Note: The IFM valid and balanced quantity is reflected in both the $DAES_{DAM}$ and $MinExCap_{FMM}$ quantities. </td> </tr> <tr> <td data-bbox="264 1671 477 1894">Import</td> <td data-bbox="477 1671 824 1894"> $\max(0, [DAES_{DAM} - MaxExCap_{FMM}])$ as affected by e-Tag transmission profile) </td> <td data-bbox="824 1671 1159 1894"> $\max(0, [SS_{FMM} - DAES_{DAM}])$ where SS_{FMM} excludes sum of valid and balanced IFM ETC self-schedule and IFM TOR self-schedules plus valid and balanced ETC Self-Schedules or TOR Self- </td> </tr> </tbody> </table>	Component Type	Tier-1 IRU Allocation Quantity	Tier-1 IRD Allocation Quantity	Generation (including ESR)	$\max(0, [DAES_{DAM} - MaxExCap_{FMM}])$ as affected by de-rates and reduction in VER forecast between DAM and RTM (if applicable) excluding valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules. Implementation Note: The IFM valid and balanced quantity is reflected in both the $DAES_{DAM}$ and $MaxExCap_{FMM}$ quantities.	$\max(0, [MinExCap_{FMM} - DAES_{DAM}])$ as affected by rerates or self-schedules (if applicable) excluding valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules. Implementation Note: The IFM valid and balanced quantity is reflected in both the $DAES_{DAM}$ and $MinExCap_{FMM}$ quantities.	Import	$\max(0, [DAES_{DAM} - MaxExCap_{FMM}])$ as affected by e-Tag transmission profile)	$\max(0, [SS_{FMM} - DAES_{DAM}])$ where SS_{FMM} excludes sum of valid and balanced IFM ETC self-schedule and IFM TOR self-schedules plus valid and balanced ETC Self-Schedules or TOR Self-	Core	<ul style="list-style-type: none"> Settlements
Component Type	Tier-1 IRU Allocation Quantity	Tier-1 IRD Allocation Quantity										
Generation (including ESR)	$\max(0, [DAES_{DAM} - MaxExCap_{FMM}])$ as affected by de-rates and reduction in VER forecast between DAM and RTM (if applicable) excluding valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules. Implementation Note: The IFM valid and balanced quantity is reflected in both the $DAES_{DAM}$ and $MaxExCap_{FMM}$ quantities.	$\max(0, [MinExCap_{FMM} - DAES_{DAM}])$ as affected by rerates or self-schedules (if applicable) excluding valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules. Implementation Note: The IFM valid and balanced quantity is reflected in both the $DAES_{DAM}$ and $MinExCap_{FMM}$ quantities.										
Import	$\max(0, [DAES_{DAM} - MaxExCap_{FMM}])$ as affected by e-Tag transmission profile)	$\max(0, [SS_{FMM} - DAES_{DAM}])$ where SS_{FMM} excludes sum of valid and balanced IFM ETC self-schedule and IFM TOR self-schedules plus valid and balanced ETC Self-Schedules or TOR Self-										




ID#	Business Feature			Requirement Type	Potential Application(s) Impacted
		<p>excluding valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules.</p> <p>Implementation Note: The IFM valid and balanced quantities is reflected in both the $DAES_{DAM}$ and $MaxExCap_{FMM}$ quantities.</p>	<p>Schedules after the Day-Ahead Market. $DAES_{DAM}$ should only reflect valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules.</p> <p>Implementation Note: This can be accomplished by the valid and balanced ETC and TOR self-schedule quantities subject to RTM Congestion Credit from the $[SS_{FMM} - DAES_{DAM}]$ quantity.</p>		
	Load	<p>ABS (Negative UIE)</p> <p>excluding UIE associated with the difference between metered demand valid and Balanced ETC self-schedule and TOR self-schedules less valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules.</p> <p>Implementation Note: This can be accomplished by the valid and balanced ETC and TOR self-schedule quantities subject to RTM Congestion Credit from the UIE quantity for Load.</p>	<p>Positive UIE</p> <p>excluding UIE associated with the difference between metered demand valid and Balanced ETC self-schedule and TOR self-schedules less valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules.</p> <p>Implementation Note: This can be accomplished by the valid and balanced ETC and TOR self-schedule quantities subject to RTM Congestion Credit from the UIE quantity for load.</p>		
	Export	<p>$\max(0, [SS_{FMM} - DAES_{DAM}])$</p> <p>where SS_{FMM} excludes sum of valid and balanced</p> <p>valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules plus valid and balanced ETC Self-Schedules or TOR Self-Schedules after the Day-Ahead Market. $DAES_{DAM}$ should only reflect valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules.</p>	<p>$\max(0, [DAES_{DAM} - eTag \text{ transmission profile}])$</p> <p>excluding valid and Balanced IFM ETC self-schedule and IFM TOR self-schedules.</p> <p>Implementation Note: The IFM valid and balanced quantities is reflected in the $DAES_{DAM}$ and eTag transmission profile.</p>		



ID#	Business Feature			Requirement Type	Potential Application(s) Impacted
		<p>Implementation Note: This can be accomplished by the valid and balanced ETC and TOR self-schedule quantities subject to RTM Congestion Credit from the $[SS_{FMM} - DAES_{DAM}]$ quantity.</p>			
	MSS (on Load Following)	<p>MSS operator's net portfolio uninstructed deviations excluding UIE associated with the difference between valid and Balanced ETC self-schedule and TOR self-schedules associated with metered demand less valid and Balanced IFM ETC load self-schedule and IFM TOR load self-schedules.</p> <p>Implementation Note: This can be accomplished by the valid and balanced ETC and TOR self-schedule quantities subject to RTM Congestion Credit from the UIE quantity for Load.</p>	<p>MSS operator's net portfolio uninstructed deviations excluding UIE associated with the difference between valid and Balanced ETC self-schedule and TOR self-schedules associated with metered demand less valid and Balanced IFM ETC load self-schedule and IFM TOR load self-schedules.</p> <p>Implementation Note: This can be accomplished by the valid and balanced ETC and TOR self-schedule quantities subject to RTM Congestion Credit from the UIE quantity for Load.</p>		
	MSS (NOT on Load Following, regardless of their Net versus Gross selection)	Same as non-MSS resources	Same as non-MSS resources		
	<ul style="list-style-type: none"> ○ For each BAA, and on hourly basis, Tier-1 IRx BAA Allocation Price shall be calculated as follows: <ul style="list-style-type: none"> ▪ $\text{Max} \{ 0, \text{Min} (\text{IRx BAA Average Price}, \text{IRx BAA Derived Price}) \}$ ▪ where <ul style="list-style-type: none"> • $\text{IRx BAA Average Price} = \text{IRx BAA Allocation Cost} / (\text{IRxR} \text{ minus sum of IRxS over all surplus zones within the BAA})$ 				

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • IRx BAA Derived Price = IRx BAA Allocation Cost / Sum of Tier-1 IRx Allocation Quantity across BAA. • Where IRx BAA Allocation Cost = Max {0, [IRx BAA Requirement Cost - IRx BAA Surplus Adjustment]} + IRx BAA No Pay Revenue • IRx BAA Requirement Cost = IRxR * IRxRMP • IRx BAA Surplus Adjustment = sum of (IRxS * IRxSMP) over all IR Surplus zones in BAA • IRx BAA No Pay Revenue = -1 * Sum over all resources within a BAA of (IRx No Pay Charge) • IRxRMP = IRX BAA Requirement Price = IRxMP Associated Imbalance Demand Hub Apnode of the BAA • IRxSMP = IRX Surplus Marginal Price = IRxMP at Associated Apnode of the IR Surplus Zone • Tier-2 IRx Cost Allocation, for each BAA, and on hourly basis: <ul style="list-style-type: none"> ○ System shall calculate Tier-2 IRx BAA Allocation Cost as the remainder (left over) of unallocated IRx costs from Tier-1, as follows: <ul style="list-style-type: none"> ▪ Tier-2 IRx BAA Allocation Cost = IRx BAA Allocation Cost – Sum of Tier-1 IRx Cost Allocation across BAA ○ System shall allocate Tier-2 IRx BAA Allocation Cost proportional to Metered Demand within each BAA, excluding metered Demand associated valid and Balanced ETC self-schedule and TOR self-schedules, except for: ○ If a BAA is Gen-only (does not have metered demand), Tier-2 IRx BAA Allocation Cost shall be directly allocated to the Entity of the BAA. • Treatment of MSS 		

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ If MSS operator has elected to load follow to manage its own load variability, it shall get IRx Tier-1 and IRx Tier-2 cost allocations based on the MSS operator’s net portfolio uninstructed deviations. <ul style="list-style-type: none"> ▪ Note: Load Following is an MSS Annual Election. For the MSS that has elected to Load Follow, the generation and load resource shall be excluded from the Generation Bucket and Load Bucket, and instead be calculated as a separate bill determinant at the MSS portfolio level based upon Net Deviation of the portfolio (Net of Generation UIE and Load UIE). The Net UIE shall determine if that MSS Bubble receives an IRU or IRD allocation for any given interval. ○ Otherwise, for both IRx Tier-1 and IRx Tier 2 cost allocations, MSS resources shall be settled in a similar manner as non-MSS resources, regardless of their Net versus Gross selection. <ul style="list-style-type: none"> ● Treatment of ETC, and TOR <ul style="list-style-type: none"> ○ System shall exclude the ETC and TOR self-schedules from IR Tier-1 and IR Tier-2 allocations up to the valid and balanced portion of ETC and TOR self-schedules. ○ In contrast, System shall consider quantities above the valid and balanced portion of the ETC or TOR self-schedules in IRx Tier-1 and IRx Tier-2 cost allocations. <p>Notes</p> <ul style="list-style-type: none"> ● This cost allocation does not apply to EIM BAAs. ● Tier-1 IRx Cost Allocation to Generation and Import/Export component types applies to all generation resources, regardless whether they are awarded IRx or not. ● ESRs (using either the NGR model or the proposed ESR mode) will be considered under the “Generation” component type of the Tier-1 IRx cost allocations. ● For each BAA, if the IRx obligation is higher than the IRx awards, all of the IRx cost will be allocated to IRx Tier-1, otherwise, IRx cost will be split between Tier-1 and Tier-2. 		



ID#	Business Feature	Requirement Type	Potential Application(s) Impacted									
DAME -BRQ- 09180	<p>RUC RC Cost Allocation</p> <ul style="list-style-type: none"> System shall be updated to allocate RUC RCx costs in two Tiers, where x = U, D. Tier-1 RCx Cost Allocation, for each individual component, and on hourly basis: <ul style="list-style-type: none"> Tier-1 RUC RCx Allocation Cost = Tier-1 RCx Allocation Quantity * Tier-1 RCx BAA Allocation Price. Tier-1 RCx Allocation Quantity shall be calculated as follows: <table border="1" data-bbox="264 915 1159 1705"> <thead> <tr> <th data-bbox="264 915 456 1010">Component Type</th> <th data-bbox="456 915 792 1010">Tier-1 RCU Allocation Quantity</th> <th data-bbox="792 915 1159 1010">Tier-1 RCD Allocation Quantity</th> </tr> </thead> <tbody> <tr> <td data-bbox="264 1010 456 1213">Virtual Bids</td> <td data-bbox="456 1010 792 1213"> max (0 , SC Net Virtual Supply Awards). Applies only if the BAA has total net virtual supply. </td> <td data-bbox="792 1010 1159 1213"> max (0 , SC Net Virtual Demand Awards). Applies only if the BAA has total net virtual demand. </td> </tr> <tr> <td data-bbox="264 1213 456 1705">Load</td> <td data-bbox="456 1213 792 1705"> ABS (Net Negative Metered Demand) excluding metered Demand associated with valid and balanced ETC self-Schedules and TOR Self-schedules. i.e. Under-Scheduled Load See note below about Net Negative Metered Demand exclusions. </td> <td data-bbox="792 1213 1159 1705"> Net Positive Metered Demand excluding metered Demand associated with valid and balanced ETC self-Schedules and TOR Self-schedules. i.e. Over-Scheduled Load See note below about Net Positive Metered Demand exclusions. </td> </tr> </tbody> </table> For each BAA, Tier-1 RCx BAA Allocation Price shall be calculated as follows: <ul style="list-style-type: none"> Max { 0 , Min (RCx BAA Average Price , RCx BAA Derived Price) } 	Component Type	Tier-1 RCU Allocation Quantity	Tier-1 RCD Allocation Quantity	Virtual Bids	max (0 , SC Net Virtual Supply Awards). Applies only if the BAA has total net virtual supply.	max (0 , SC Net Virtual Demand Awards). Applies only if the BAA has total net virtual demand.	Load	ABS (Net Negative Metered Demand) excluding metered Demand associated with valid and balanced ETC self-Schedules and TOR Self-schedules. i.e. Under-Scheduled Load See note below about Net Negative Metered Demand exclusions.	Net Positive Metered Demand excluding metered Demand associated with valid and balanced ETC self-Schedules and TOR Self-schedules. i.e. Over-Scheduled Load See note below about Net Positive Metered Demand exclusions.	Core	<ul style="list-style-type: none"> Settlements
Component Type	Tier-1 RCU Allocation Quantity	Tier-1 RCD Allocation Quantity										
Virtual Bids	max (0 , SC Net Virtual Supply Awards). Applies only if the BAA has total net virtual supply.	max (0 , SC Net Virtual Demand Awards). Applies only if the BAA has total net virtual demand.										
Load	ABS (Net Negative Metered Demand) excluding metered Demand associated with valid and balanced ETC self-Schedules and TOR Self-schedules. i.e. Under-Scheduled Load See note below about Net Negative Metered Demand exclusions.	Net Positive Metered Demand excluding metered Demand associated with valid and balanced ETC self-Schedules and TOR Self-schedules. i.e. Over-Scheduled Load See note below about Net Positive Metered Demand exclusions.										




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ▪ where <ul style="list-style-type: none"> • RCx BAA Average Price = RCx BAA Allocation Cost / Sum of (RCx Awards) over all resources within the BAA. • RCx BAA Derived Price = RCx BAA Allocation Cost / Sum of Tier-1 RCx Allocation Quantity across BAA. • Where RCx BAA Allocation Cost = Sum of (RCx Payments minus RCx No Pay Charge) over all resources within the BAA • Tier-2 RCx Cost Allocation, for each BAA, and on hourly basis: <ul style="list-style-type: none"> ○ System shall calculate Tier-2 RCx BAA Allocation Cost as the remainder (left over) of unallocated RCx costs from Tier-1, as follows: <ul style="list-style-type: none"> ▪ Tier-2 RCx BAA Allocation Cost = RCx BAA Allocation Cost – Sum of Tier-1 RCx Cost Allocation across BAA ○ System shall allocate Tier-2 RCx BAA Allocation Cost proportional to Metered Demand within each BAA, excluding metered Demand associated with valid and balanced ETC self-Schedules and TOR Self-schedules. ○ If a BAA is Gen-only (does not have metered demand), Tier-2 RCx BAA Allocation Cost shall be directly allocated to the Entity of the BAA. • Treatment of MSS <ul style="list-style-type: none"> ○ If MSS operator has elected to load follow to manage its own load variability, it shall NOT get RCx Tier-1 nor RCx Tier-2 cost allocations. <ul style="list-style-type: none"> ▪ Note: Because an MSS Operator that has elected to Load Follow is required to provide sufficient resources in DAM to follow its Load within the MSS Deviation Band, the MSS Bubble which has elected to Load Follow shall not receive a RCU/RCD allocation. ○ Otherwise, for both RCx Tier-1 and RCx Tier 2 cost allocations, MSS resources shall be settled in a similar 		

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>manner as non-MSS resources, regardless of their Net versus Gross selection.</p> <ul style="list-style-type: none"> • Treatment of ETC, and TOR <ul style="list-style-type: none"> ○ System shall exclude the ETC and TOR self-schedules from RCx Tier-1 and RCx Tier-2 allocations up to the metered Demand associated valid and balanced portion of ETC and TOR self-schedules. ○ In contrast, System shall consider quantities above the metered Demand associated valid and balanced portion of the ETC or TOR self-schedules in RCx Tier-1 and RCx Tier-2 cost allocations. <p>Notes</p> <ul style="list-style-type: none"> • This cost allocation does not apply to EIM BAAs. • For Tier-1 RCU (RCD, respectively) cost allocations to Load component type, the net negative (positive) metered demand will exclude net negative (positive) demand associated with balanced ETC/TOR rights, negative (positive) deviation for Participating Load (PL) resulting from a market dispatch. • For each BAA, If the RCx obligation is higher than the RCx awards, all of the RCx cost will be allocated to RCx Tier-1, otherwise, RCx cost will be split between Tier-1 and Tier-2, where x = U, D. 		
DAME -BRQ- 09200	<p>IR DA BCR Settlements</p> <p>System shall be updated for the following:</p> <ul style="list-style-type: none"> • Revenue and bid costs for IRU/IRD awards (after netting No-Pay) shall be included in the calculation of DA BCR. • Mathematically, for each resource, for each hour: <ul style="list-style-type: none"> ○ IR Revenues = ([IFM IRU Awards – IRU No-Pay Quantity] * IFM IRUMP) + ([IFM IRD Awards – IRD No-Pay Quantity] * IFM IRDMP) ○ IR Bid Costs = ([IFM IRU Awards – IRU No-Pay Quantity] * IFM IRU Bid Price) + ([IFM IRD Awards – IRD No-Pay Quantity] * IFM IRD Bid Price) <p>Notes</p> <ul style="list-style-type: none"> • Resources committed in IFM, including resources that are scheduled for IRU/IRD, shall be eligible to get DA BCR. 	Core	<ul style="list-style-type: none"> • Settlements




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> Accounting Commitment Costs in DA BCR will remain intact as existing. 		
DAME-BRQ-09220	<p>RC RT BCR Settlements</p> <p>System shall be updated for the following:</p> <ul style="list-style-type: none"> Revenue and bid costs for RCU awards (but excluding resources with proxy RCU awards) (after netting No-Pay and RCU/RCD Overlapping RA Capacity, regardless of their LSE-RA Resource Pair True-Up Flags) shall be included in the calculation of RT BCR. Revenue and bid costs for RCD awards (after netting No-Pay) shall be included in the calculation of RT BCR. Mathematically, for each resource, for each hour: <ul style="list-style-type: none"> RC Revenues = {Max (0, [RUC RCU Awards – Hourly RCU Overlapping RA Capacity Quantity – RCU No-Pay Quantity]) * RUC RCUMP} + {Max (0, [RUC RCD Awards – Hourly RCD Overlapping RA Capacity Quantity – RCD No-Pay Quantity]) * RUC RCDMP} RC Bid Costs = {Max (0, [RUC RCU Awards – Hourly RCU Overlapping RA Capacity Quantity – RCU No-Pay Quantity]) * RUC RCU Bid Price} + {Max (0, [RUC RCD Awards – Hourly RCD Overlapping RA Capacity Quantity – RCD No-Pay Quantity]) * RUC RCD Bid Price} RUC BCR costs shall be allocated, in alignment with RCU cost allocation, to net virtual supply and under scheduled load. <p>Notes</p> <ul style="list-style-type: none"> Resources committed in RUC, including resources that are scheduled for RCU/RCD, shall be eligible to get RT BCR. A resource can be awarded either RCU or RCD awards, but not both, for the same hour. Accounting Commitment Costs in RT BCR will remain intact as existing. 	Core	<ul style="list-style-type: none"> Settlements
DAME-BRQ-09240	<p>Inclusion of IR & RC in GMC Settlements</p> <p>System shall be updated for the following:</p> <ul style="list-style-type: none"> GMC Bid Transaction Fee shall be applied for IRU/IRD and RCU/RCD bid segments. GMC Market Services Charge shall be applied for IRU/IRD and RCU/RCD awards (but excluding proxy RCU awards). <p>Notes</p>	Core	<ul style="list-style-type: none"> Settlements

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • Eligible resources will include these GMC costs in their IR and RC bids. • Final RCU bids will not contain any proxy RCU bids. • Coordination/synchronization may be needed with GMC initiative. 		
DAME -BRQ- 09250	<p>Update GMC Charge Codes Effective January 1, 2026</p> <ul style="list-style-type: none"> • The following GMC charge code shall be terminated: <ul style="list-style-type: none"> ○ System Operations • The following GMC charge code shall be created: <ul style="list-style-type: none"> ○ System Operations Real-Time Dispatch. <ul style="list-style-type: none"> ▪ Represents the fees for real-time dispatch services for EDAM, and CAISO BAA. ▪ Applies to metered flows in MWh of supply and demand ▪ Applies to EDAM, CAISO BAA ○ System Operations Balancing Authority Area Services <ul style="list-style-type: none"> ▪ Represents the costs to support services within the CAISO BAA such as transmission planning, summer readiness, and planning coordinator. ▪ Applies to CAISO BAA metered flows in MWh of supply and demand. <p>Note</p> <ul style="list-style-type: none"> • No change to WEIM-only BAA Settlements. • For more details regarding the GMC charge codes, see the new Cost of Service Initiative. 	Core	<ul style="list-style-type: none"> • Settlements
DAME -BRQ- 09260	<p>IRU/IRD Unavailability No-Pay Charges</p> <p>System shall be updated for the following:</p> <ul style="list-style-type: none"> • Resources with an FMM Ex-post capacity range that does not support ($DAES_{DAM} + [IRU_{DAM} - IRU5_{DAM}]$) will be charged the resource-specific IRU No-Pay Penalty Price of Max (FMM FRUMP, IRUMP) for the undelivered MW quantity after accounting for DA Spinning Reserve award, and DA Non-Spinning Reserve award, in that respective order. • Resources with an FMM Ex-post capacity range that does not support ($DAES_{DAM} - [IRD_{DAM} - IRD5_{DAM}]$) will be charged the resource-specific IRD No-Pay Penalty Price of Max (FMM FRDMP, IRDMP) for the undelivered MW quantity. 	Core	<ul style="list-style-type: none"> • Settlements

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME -BRQ- 09280	<p>RCU/RCD Unavailability No-Pay Charges</p> <p>System shall be updated for the following:</p> <ul style="list-style-type: none"> Resources with an FMM Ex-post capacity range that does not support ($DAES_{DAM} + RCU_{DAM}$) (but excluding proxy RCU awards) will be charged the 5-minute resource-specific RCUMP for the undelivered MW quantity after accounting for DA Spinning Reserve award, DA Non-Spinning Reserve award, and IRU award, in that respective order. Exception is for VERs, where RCU No-Pay Penalty Price shall be the RCUMP. Resources with an FMM Ex-post capacity range that does not support ($DAES_{DAM} - RCD_{DAM}$) will be charged the 5-minute resource-specific RCDMP for the undelivered MW quantity after accounting for IRD award. 	Core	<ul style="list-style-type: none"> Settlements
DAME -BRQ- 09300	<p>IR and RC Unavailability No-Pay Charges Priority</p> <p>System shall be updated for the following:</p> <ul style="list-style-type: none"> Resources that have been awarded both a RC and IR and are not available, or only bid a portion of their combined award, shall have the unavailability charge applied first to RC and then to IR. 	Core	<ul style="list-style-type: none"> Settlements
DAME -BRQ- 09310	<p>Do not Assess RAAIM to IR and RC Awards for Generic and Flex RA</p> <p>System shall continue to assess RAAIM penalty for Energy and AS bids.</p> <p>Notes</p> <ul style="list-style-type: none"> CAISO's availability assessment shall not consider local and system (generic) nor Flex RA resource's compliance with any IR and RC bidding obligations it holds. Implementation There will not be impact to exiting RAAIM functionality. 	Existing	<ul style="list-style-type: none"> Settlements
DAME -BRQ- 09320	<p>IR – FRP RTM Ramp Deviation Settlements</p> <p>System shall be updated for the following:</p> <ul style="list-style-type: none"> Resources that have been awarded both IRU (IRD) in IFM and FRU (FRD) in FMM shall be charged (paid) for the deviation between the FMM FRU (FRD) award and the 5-min ramp capable portion of the IRU (IRD) award [$IRU5_{DAM}$ ($IRD5_{DAM}$) from MQS] at the FMM FRUMP (FRDMP), respectively. <p>Notes</p>	Core	<ul style="list-style-type: none"> Settlements

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> The FRUMP/FRDMP should be based upon the resource type. If resource is an import, apply the SP-TIE import price. If an export, apply the SP-TIE export price. For any special generation resource linked to an SP-Tie, apply the SP-Tie import price. For other resources, associate the undirected non-SP-Tie nodal price based on the resource to node association. Deviation settlements between FMM FRU (FRD) and RTD FRU (FRD), respectively, is existing functionality. 		
DAME -BRQ- 09340	<p>FMM Forecasted Movement Deviation Settlements</p> <p>System shall be updated for the following:</p> <ul style="list-style-type: none"> For CAISO and EDAM BAAs, resources that have upward (downward) deviation in Forecasted Movement in FMM relative to DAM is paid (charged) net difference between FMM FRUMP and FMM FRDMP, respectively. Virtual supply and virtual demand awards is paid (charged), when the value is positive (negative), the product of the virtual Forecasted Movement quantity and the difference between the FMM FRUMP and FMM FRDMP. For WEIM-only BAAs, resources that have upward (downward) deviation in Forecasted Movement in FMM relative to Base Schedule Forecasted Movement is paid (charged) net difference between FMM FRUMP and FMM FRDMP, respectively. <p>Notes</p> <ul style="list-style-type: none"> DA/Base Schedule Forecasted Movement is not settled. It is used to determine the deviation settlement of FMM Forecasted Movement Deviation only. DA/Base Schedule Forecasted Movement settlement is embedded in Day Ahead Energy settlement already or in the bi-lateral market settlement. Forecasted Movement Deviation settlements between FMM and RTD is existing functionality. If the 5-minute ramp capability that is awarded in IFM (as either energy movement or an IR award) is available and awarded in FMM (as either forecasted movement or a FRP award), there should be No net deviation settlement in FMM. 	Core	<ul style="list-style-type: none"> Settlements

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> If the 5-minute ramp capability that is awarded in FMM is available and awarded in RTD (as either forecasted movement or a FRP award), there should be No net deviation settlement in RTD. If the 5-minute ramp capability of a resource is awarded between forecasted movement and uncertainty awards the same across markets, from IFM to FMM to RTD, there are no net payments or charges due to deviations in RTM. The only exceptions are when a resource reaches their Pmin or Pmax at a different time than in the preceding market, there is a ramp rate de-rate, or the resource's ramp capability is not fully used. 		
DAME -BRQ- 09350	<p>Accounting for Virtuals in Allocation of Residual Forecasted Movement Settlements</p> <p>System shall be updated for the following for each 5-min interval:</p> <ul style="list-style-type: none"> For BAAs (CAISO BAA, EDAM BAAs and WEIM-only BAAs), the summation of FMM resource-specific FM and FMM virtual FM and RTD resource-specific FM shall be allocated to Meter Demand of the BAA or Passed Group as determined by WEIM RSE flexible ramp assessment. <p>Notes</p> <ul style="list-style-type: none"> Allocation methodology is existing but adding virtual award FM costs/revenues. 	Core	<ul style="list-style-type: none"> Settlements
DAME -BRQ- 09380	<p>Settlements of Overlapping RA Capacity for LSE-RA Resource True-Up Settlements Mechanism</p> <p>If an RA resource is mapped to one or more LSEs that have their LSE-RA Resource Pair True-Up Flag set to Opt-In for a trading day,</p> <ul style="list-style-type: none"> System shall calculate the Settlements Amount for that RA Resource and each hour as: <ul style="list-style-type: none"> Hourly IRx Overlapping RA Capacity Quantity <ul style="list-style-type: none"> Sum over all 15-min within the hour (15-min IRx Overlapping RA Capacity / 4) Hourly IRx LOC for Overlapping RA Capacity <ul style="list-style-type: none"> Sum over all 15-min within the hour (15-min IRx LOC for Overlapping RA Capacity) Hourly IRx Overlapping RA Capacity Amount 	Core	<ul style="list-style-type: none"> Settlements




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> <ul style="list-style-type: none"> <ul style="list-style-type: none"> ▪ $\text{Max} \{ 0, [(\text{Hourly IRx Overlapping RA Capacity Quantity} * \text{Hourly IRxMP}) - \text{Hourly IRx LOC for Overlapping RA Capacity}] \}$ ○ Hourly RCx Overlapping RA Capacity Quantity <ul style="list-style-type: none"> ▪ Sum over all 15-min within the hour (15-min RCx Overlapping RA Capacity / 4) ○ Hourly RCx Overlapping RA Capacity Amount <ul style="list-style-type: none"> ▪ $\text{Max} \{ 0, [\text{Hourly RCx Overlapping RA Capacity} * \text{Hourly RCxMP}] \}$ ○ Where $x = \{U, D\}$ • System shall allocate the hourly IRx and RCx Overlapping RA Capacity Amount for that RA resource to the LSEs associated with it pro-rata to their Generic and Flex (across all categories) RA Showings for LSEs that have Opted-In LSE-RA Resource Pair True-Up Flag for each trade day, resulting in: <ul style="list-style-type: none"> ○ Hourly IRx Overlapping RA Capacity LSE Amount ○ Hourly RCx Overlapping RA Capacity LSE Amount • SCs of LSEs that have their LSE-RA Resource Pair True-Up Flag opted-in shall be paid Hourly IRx Overlapping RA Capacity LSE Amount and RCx Overlapping RA Capacity LSE Amount for all RA resources that are associated with them. • SCs of resources shall be charged the Hourly IRx Overlapping RA Capacity LSE Amount and RCx Overlapping RA Capacity LSE Amount for all LSEs that are associated with it. <p>Note</p> <ul style="list-style-type: none"> • The time-block will be the entire month window for all resource types with the exception of interties, where the time-block can be any time frame window within the month. • The Generic, Flex and total RA Showings are values for a trade day within the corresponding time-block. 		
DAME-BRQ-09520	<p>Apply CRR 1B Methodology for CAISO BAA</p> <p>For CAISO BAA: System shall apply CRR 1B methodology per existing Tariff</p>	Core	• Settlements
DAME-BRQ-09540	<p>Calculate BAA IRU/IRD Congestion Revenue</p> <p>For CAISO and EDAM BAAs:</p> <ul style="list-style-type: none"> • System shall calculate BAA IRU/IRD Congestion Revenue as the sum over all resources within that BAA of the product of (IRU/IRD Awards and the sub-components of MCC prices of IRUMP/IRDMP [by BAA]) netted against the BAA-level (product of IRUR/IRD and the sub- 	Core	• Settlements

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>components of MCC prices of IRURMP/IRDRMP (for corresponding BAA) at the associated Imbalance Demand Hub Apnode minus product of Sum of IRUS/IRDS over the IR surplus zones within the BAA and the sub-components of MCC prices of IRUSMP/IRDSMP of the associated IR surplus zone Apnode, respectively.</p> <ul style="list-style-type: none"> • Mathematically, for each BAA, for each hour: <ul style="list-style-type: none"> ○ IRx Congestion Revenue = Sum over all resources for that BAA (IRx Award * IRxMP MCC by BAA) – Max {0, [IRx BAA Requirement Congestion Amount – IRx Surplus Congestion Amount]} ○ Where <ul style="list-style-type: none"> ▪ IRx BAA Requirement Congestion Amount = IRxR * IRxRMP MCC by BAA ▪ IRx Surplus Congestion Amount = Sum over all IR Surplus Zones within the BAA (IRxS * IRxSMP MCC by BAA) ▪ Where x = {U, D} <p>Notes</p> <ul style="list-style-type: none"> • Based upon payload failures and fill logic, any IRx imbalance will be settled through neutrality charge code (rounding). 		
DAME -BRQ- 09560	<p>Calculate BAA Energy Congestion Revenues For CAISO and EDAM BAAs:</p> <ul style="list-style-type: none"> • System shall calculate BAA Energy congestion revenues as product of DA Energy Awards and congestion sub-components MCC of Energy LMP (for corresponding BAA). 	Existing System Functionality	<ul style="list-style-type: none"> • Settlements
DAME -BRQ- 09580	<p>Distribute BAA IRU/IRD Congestion Revenues for CAISO BAA For CAISO BAA:</p> <ul style="list-style-type: none"> • System shall distribute the BAA IRU/IRD congestion revenues along with BAA Energy congestion revenues through the existing CRR Balancing Account. 	Core	<ul style="list-style-type: none"> • Settlements
DAME -BRQ- 09600	<p>Distribute BAA IRU/IRD Congestion Revenues for EDAM BAAs For EDAM BAA:</p> <ul style="list-style-type: none"> • System shall return the BAA IRU/IRD congestion revenues, along with BAA Energy congestion revenues, to EDAM BAAs through BAA Congestion Offset Account, for distribution to its participants according to their OATT processes. <p>Notes</p> <ul style="list-style-type: none"> • Congestion contributions to transmission constraints in an EDAM BAA from resources in other EDAM BAAs contribute to the congestion offset of the EDAM BAA where the congestion occurs. 	Core	<ul style="list-style-type: none"> • Settlements

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME -BRQ- 09610	Apply HASP Reversal to CAISO BAA IFM Intertie Schedule For CAISO BAA: <ul style="list-style-type: none"> • For intertie schedules that are awarded energy and/or RCU/RCD schedules in DAM and subsequently have incremental/decremental FMM schedule change in the RTM and did not submit energy profile tag prior to HASP, System shall apply revised Settlements HASP reversal rule on them by using IFM Energy plus RCU Award minus RCD Award instead of the current logic of using the minimum of IFM Energy Award and RUC Energy Schedule. 	Core	<ul style="list-style-type: none"> • Settlements

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


5.9 Business Process: Manage Market Reporting

OASIS

- Publish IR/RC Bid-Related Data
- Publish IFM IR and RUC RC Nodal Prices
- Publish IFM IR and RUC Binding Constraints Shadow Prices
- Publish IFM IR and RUC RC Nomogram/Branch and Interties Shadow Prices
- Publish IFM IR and RUC RC MPM Intertie Constraint Competitive Path
- Publish IFM IR and RUC RC MPM Nomogram/Branch Competitive Path
- Publish IFM IR and RUC RC Aggregate Awards
- Publish IRU/IRD Requirements (IRUR/IRDR), IRU/IRD Surplus (IRUS/IRDS) and their Associated Imbalance Demand Hub/IR surplus zones Apnode for each BAA
- Publish IRU/IRD Requirement Thresholds
- Publish IRU/IRD Requirements Input Polynomials
- Publish IRU/IRD Requirements Uncertainty Histograms
- Publish IRU/IRD Forecasts
- Publish FRU/FRD Forecasts for RTPD Binding Intervals
- Publish IRU/IRD Demand Curves
- Publish CRR Aggregated Revenue Adjustments Data for IRU/IRD Deployment Scenarios
- Publish Payment and No-Payments of IR/RC-Charge Code Settlements Amounts Data

CMRI

- Publish IR and RC DAB Curves
- Publish IFM IRU and RUC RCU Mitigated Bids
- Publish IFM IR and RUC RC Resource Awards
- Publish IFM IR and RUC RC Resource Prices
- Publish IFM IR and RUC RC LSE Resource Awards
- Publish IFM & RUC Resource-Specific Market Priority Types Results
- Publish RTM Resource-Specific Market Priority Types Results
- Publish 15-min IRU/IRD LOC for Overlapping RA Capacity
- Publish Resource-Specific DA/Base Schedule Forecasted Movement Data

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

- Publish Nodal, by SC DA Schedule Virtual Forecasted Movement Data
- Publish CRR Revenue Adjustments Details for IRU/IRD Deployment Scenarios

MPP


- Publish Shift Factors Data for IR Deployment Scenarios from IFM

ADS

- Publish RTM Resource-Specific Market Priority Types Results for HASP Exports

5.9.1 Business Requirements

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-10140	<p>Publish IR/RC Bid-Related Data Upon data receipt, System shall report the following IR/RC bid-related data (original and corrected):</p> <ul style="list-style-type: none"> • Resource-Specific Hourly Data <ul style="list-style-type: none"> ○ IRU/IRD Clean Bids ○ RCU/RCD Clean Bids 	Core	• OASIS
DAME-BRQ-10160	<p>Publish IFM IR and RUC RC Nodal Prices Upon data receipt, System shall report the following IFM IR and RUC RC market results data (original and corrected):</p> <ul style="list-style-type: none"> • Nodal Hourly Data <ul style="list-style-type: none"> ○ IFM IRUMP/IRDMP Nodal Prices and their price breakdown (total, capacity, congestion but no loss), but shall exclude the sub-components of their MCC prices (by BAA), and include prices for Imbalance Demand Hub Apnodes as well as Apnodes associated with IR surplus zones. ○ RUC RCUMP/RCDMP Nodal Prices and their price breakdown (total, capacity, congestion and loss), but excluding sub-components of MCC prices (by BAA). 	Core	• OASIS
DAME-BRQ-10160A	<p>Publish IFM IR and RUC RC Scheduling Point/Tie Combination Nodal Prices</p>	Core	• OASIS

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>Upon data receipt, System shall report the following IFM IR and RUC RC market results data (original and corrected) for Scheduling Points/Tie Combinations by direction (import/export):</p> <ul style="list-style-type: none"> • Nodal Hourly Data <ul style="list-style-type: none"> ○ IFM IRUMP/IRDMP Nodal Prices and their price breakdown (total, capacity, congestion but no loss), but shall exclude the sub-components of their MCC prices (by BAA), and include prices for Imbalance Demand Hub Apnodes as well as Apnodes associated with IR surplus zones. ○ RUC RCUMP/RCDMP Nodal Prices and their price breakdown (total, capacity, congestion and loss), but excluding sub-components of MCC prices (by BAA). 		
DAME-BRQ-10160AA	<p>Publish RTM Flexible Ramp Scheduling Point/Tie Nodal Prices by Direction (Import/Export)</p> <p>Upon data receipt, System shall report the following RTM FR market results data (original and corrected) for Scheduling Points/Tie Combinations by direction (import/export):</p> <ul style="list-style-type: none"> • Nodal 15-min & 5-min Data <ul style="list-style-type: none"> ○ FRUMP/FRDMP Nodal Prices but excluding their price breakdown, and sub-components of MCC prices (by BAA). 	Core	<ul style="list-style-type: none"> • OASIS
DAME-BRQ-10160B	<p>Publish IFM-MPM IR and RUC-MPM RC Nodal Prices</p> <p>Upon data receipt, System shall report the following IFM-MPM IR and RUC-MPM RC market results data (original):</p> <ul style="list-style-type: none"> • Nodal Hourly Data <ul style="list-style-type: none"> ○ IFM-MPM IRUMP/IRDMP Nodal Prices and their price breakdown (total, capacity, congestion but no loss), but shall exclude the sub-components of their MCC prices (by BAA), and include prices for Imbalance Demand Hub Apnodes as well as Apnodes associated with IR surplus zones. ○ RUC-MPM RCUMP/RCDMP Nodal Prices and their price breakdown (total, capacity, congestion and loss), but excluding sub-components of MCC prices (by BAA). 	Core	<ul style="list-style-type: none"> • OASIS




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-10180B	<p>Publish IFM IR and RUC Binding Scheduling Constraints Shadow Prices</p> <p>Upon data receipt, System shall report the following IFM IR and RUC market results data (original and corrected):</p> <ul style="list-style-type: none"> • Scheduling Constraints Hourly Data <ul style="list-style-type: none"> ○ Binding Constraint due to IFM IRU/IRD. ○ IFM IRU/IRD Constraint Shadow Prices ○ Binding Constraint due to RUC. ○ RUC Constraint Shadow Prices 	Core	• OASIS
DAME-BRQ-10200	<p>Publish IFM IR and RUC RC Nomogram/Branch Shadow Prices</p> <p>Upon data receipt, System shall report the following IFM IR and RUC RC market results data (original and corrected):</p> <ul style="list-style-type: none"> • Network Constraints Hourly Data <ul style="list-style-type: none"> ○ IFM IRU/IRD Nomogram/Branch Shadow Prices ○ RUC RCU/RCD Nomogram/Branch Shadow Prices 	Core	• OASIS
DAME-BRQ-10200A	<p>Publish IFM IR and RUC RC Interties Shadow Prices</p> <p>Upon data receipt, System shall report the following IFM IR and RUC RC market results data (original and corrected):</p> <ul style="list-style-type: none"> • Network Constraints Hourly Data <ul style="list-style-type: none"> ○ IFM IRU/IRD Intertie Shadow Prices ○ RUC RCU/RCD Intertie Shadow Prices 	Core	• OASIS
DAME-BRQ-10200B	<p>Publish IFM-MPM IR and RUC-MPM RC Nomogram/Branch Shadow Prices</p> <p>Upon data receipt, System shall report the following IFM-MPM IR and RUC-MPM RC market results data (original):</p> <ul style="list-style-type: none"> • Network Constraints Hourly Data <ul style="list-style-type: none"> ○ IFM-MPM IRU/IRD Nomogram/Branch Shadow Prices ○ RUC-MPM RCU/RCD Nomogram/Branch Shadow Prices 	Core	• OASIS




ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-10200C	<p>Publish IFM-MPM IR and RUC-MPM RC Interties Shadow Prices</p> <p>Upon data receipt, System shall report the following IFM-MPM IR and RUC-MPM RC market results data (original):</p> <ul style="list-style-type: none"> • Network Constraints Hourly Data <ul style="list-style-type: none"> ○ IFM-MPM IRU/IRD Intertie Shadow Prices ○ RUC-MPM RCU/RCD Intertie Shadow Prices 	Core	• OASIS
DAME-BRQ-10220	<p>Publish IFM-MPM IR and RUC-MPM RC MPM Nomogram/Branch Competitive Path</p> <p>Upon data receipt, System shall report the following IFM-MPM IR and RUC-MPM RC market results data (original):</p> <ul style="list-style-type: none"> • Competitive Path Hourly Data <ul style="list-style-type: none"> ○ MPM Nomogram/Branch Competitive Path 	Core	• OASIS
DAME-BRQ-10220A	<p>Publish IFM-MPM IR and RUC-MPM RC MPM Intertie Constraint Competitive Path</p> <p>Upon data receipt, System shall report the following IFM-MPM IR and RUC-MPM RC market results data (original):</p> <ul style="list-style-type: none"> • Competitive Path Hourly Data <ul style="list-style-type: none"> ○ MPM Intertie Constraint Competitive Path 	Core	• OASIS
DAME-BRQ-10240	<p>Publish IFM IR and RUC RC Aggregate Awards</p> <p>Upon data receipt, System shall report the following IFM IR and RUC RC market results data (original and corrected):</p> <ul style="list-style-type: none"> • BAA Hourly Data <ul style="list-style-type: none"> ○ IFM IRU/IRD Awards ○ RUC RCU/RCD Awards (including proxy RCU awards) 	Core	• OASIS
DAME-BRQ-10260	<p>Publish IRU/IRD Requirements</p> <p>Upon data receipt, System shall report the following data for next Trade Days (binding: D+1 as well as advisory: D+2 and D+3) (original and corrected data):</p> <ul style="list-style-type: none"> • BAA Hourly Data <ul style="list-style-type: none"> ○ IRU/IRD Requirements (IRUR/IRDR) 	Core	• OASIS

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ IRU/IRD Surplus (IRUS/IRDS) ○ Associated Imbalance Demand Hub Apnode <p>Notes</p> <ul style="list-style-type: none"> • The published IRUR/IRDR are the ones that are adjusted to account for diversity benefit. • D+2 advisory data will be published at different time by 6 pm everyday. • D+3 advisory data will be published at different time by 6+ pm everyday. 		
DAME-BRQ-10260A	<p>Publish IRU/IRD Surplus</p> <p>Upon data receipt, System shall report the following data for next Trade Days (binding: D+1 as well as advisory: D+2 and D+3) (original and corrected data):</p> <ul style="list-style-type: none"> • IR Surplus Zone Hourly Data (within each BAA) <ul style="list-style-type: none"> ○ IRU/IRD Surplus (IRUS/IRDS) ○ Associated IR Surplus Zone Apnode <p>Notes</p> <ul style="list-style-type: none"> • D+2 advisory data will be published at different time by 6 pm everyday. • D+3 advisory data will be published at different time by 6+ pm everyday. 	Core	• OASIS
DAME-BRQ-10280	<p>Publish IRU/IRD Requirement Thresholds</p> <p>Upon data receipt, System shall report the following data for next Trade Day (D+1) (original data only, no data corrections):</p> <ul style="list-style-type: none"> • BAA Hourly Data <ul style="list-style-type: none"> ○ IRU/IRD Requirement Thresholds 	Core	• OASIS
DAME-BRQ-10300	<p>Publish IRU/IRD Requirements Input Polynomials</p> <p>Upon data receipt, System shall report the following data for next Trade Day (D+1) (original data only, no data corrections):</p> <ul style="list-style-type: none"> • BAA Hourly Data <ul style="list-style-type: none"> ○ IRU/IRD Requirements Input Polynomials 	Core	• OASIS

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-10320	Publish IRU/IRD Requirements Uncertainty Histograms Upon data receipt, System shall report the following data for next Trade Day (D+1) (original data only, no data corrections): <ul style="list-style-type: none"> • BAA Hourly Data <ul style="list-style-type: none"> ○ IRU/IRD Requirements Uncertainty Histograms 	Core	• OASIS
DAME-BRQ-10340	Publish IRU/IRD Input Data for Demand, Wind, Solar Forecasts Upon data receipt, System shall report the following data for next Trade Das (D+1) (original data only, no data corrections): <ul style="list-style-type: none"> • BAA Hourly Data <ul style="list-style-type: none"> ○ IRU/IRD Forecasts 	Core	• OASIS
DAME-BRQ-10350	Publish FRU/FRD Input Data for Demand, Wind, Solar Forecasts for RTPD Binding Interval Upon data receipt, System shall report the following data for RTPD binding intervals (original data only, no PCA corrections): <ul style="list-style-type: none"> • BAA 15-min Data (for RTPD binding intervals) <ul style="list-style-type: none"> ○ FRU/FRD Forecasts 	Core	• OASIS
DAME-BRQ-10360	Publish IRU/IRD Demand Curves Upon data receipt, System shall report the following data for next Trade Day (D+1) (original data only, no data corrections): <ul style="list-style-type: none"> • BAA Hourly Data <ul style="list-style-type: none"> ○ IRU/IRD Demand Curves 	Core	• OASIS
DAME-BRQ-10380	Publish CRR Aggregated Revenue Adjustments Data for IRU/IRD Deployment Scenarios Upon data receipt, System shall report the following data (original and corrected): <ul style="list-style-type: none"> • Hourly Data <ul style="list-style-type: none"> ○ Product ○ Constraint Case ○ Transmission Constraint ID ○ CRR Offset Revenue ○ CRR Clawback Revenue ○ CRR Circular Scheduling Revenue ○ CRR Notional Revenue ○ Directional Indicator ○ IFM Net Flow 	Core	• OASIS

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-10400	<p>Publish Payment and No-Payments of IR/RC-Charge Code Settlements Amounts Data Upon data receipt, System shall report the following payment and no-payments of IR/RC charge code Settlements amounts (original and corrected):</p> <ul style="list-style-type: none"> • Resource-Specific Monthly Data and Zonal-Specific Daily Data <ul style="list-style-type: none"> ○ CC-6800 – DA RUC Availability Settlement <ul style="list-style-type: none"> ▪ (or tentative replacement: CC-6xxxx – DA RUC Reliability Capacity Up Settlement) ○ CC-06824 – No Pay Residual Unit Commitment (RUC) Settlement <ul style="list-style-type: none"> ▪ (or tentative replacement: CC-6xxxx – No Pay Residual Unit Commitment (RUC) Reliability Capacity Up Settlement) ○ CC-6xxx (tentative) – No Pay Residual Unit Commitment (RUC) Reliability Capacity Down Settlement ○ CC-6xxx (tentative) – DA Imbalance Reserve Up Settlement ○ CC-6xxx (tentative) – No Pay DA Imbalance Reserve Up Settlement ○ CC-6xxx (tentative) – DA Imbalance Reserve Down Settlement ○ CC-6xxx (tentative) – No Pay DA Imbalance Reserve Down Settlement 	Core	• OASIS
DAME-BRQ-10680	<p>Publish IR and RC DAB Curves Upon data receipt, System shall report the following data:</p> <ul style="list-style-type: none"> • Resource-specific Daily <ul style="list-style-type: none"> ○ DAB Curves (MW , Bid Price) ○ Market Product Type: <ul style="list-style-type: none"> ▪ IRU ▪ IRD ▪ RCU ▪ RCD 	Core	• CMRI
DAME-BRQ-10700	<p>Publish IFM-MPM IRU and RUC RCU-MPM Mitigated Bids Upon data receipt, System shall report the following IFM IR and RUC RC market results data (original and corrected):</p> <ul style="list-style-type: none"> • Resource-Specific Hourly Data <ul style="list-style-type: none"> ○ IRU Mitigated Bids ○ RCU Mitigated Bids 	Core	• CMRI

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-10720	<p>Publish IFM IR and RUC RC Resource Awards</p> <p>Upon data receipt, System shall report the following IFM IR and RUC RC market results data (original and corrected):</p> <ul style="list-style-type: none"> • Resource-Specific Hourly Data <ul style="list-style-type: none"> ○ IFM IRU/IRD Resource Awards (Market and Cleared) ○ RUC RCU/RCD Resource Awards (Market, Proxy and Cleared) ○ Retire RUC Awards as it is replaced with RCU Awards. <p>Notes</p> <ul style="list-style-type: none"> • The Proxy RCU Awards can co-exist for same resource and hour with RCU Awards. • Award MW: Represents market award MW corresponding to the submitted bid (after mitigation, if any) for a specific market product (IRU, IRD, RCU, or RCD). • Proxy RCU MW: Represents the proxy RCU Award MW corresponding to the inserted/extends proxy bid. • Cleared MW: Represents the total cleared capacity MW (Award MW + Proxy MW [if applicable]) for a specific market product (IRU, IRD, RCU, or RCD). • Proxy MW should be zero for non-export resources. • Proxy MW should be zero for IRU, IRD and RCD market products. • No self-schedule MW is applicable to IRU/IRD or RCU/RCD market products. 	Core	• CMRI
DAME-BRQ-10730	<p>Publish REN</p> <p>System shall continue to publish REN.</p> <p>Notes</p>	Existing	• CMRI

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • The following existing CMRI reports will be used without any modifications. <ul style="list-style-type: none"> ○ Reliability Coordination <ul style="list-style-type: none"> ▪ Forecasted Generation 		
DAME-BRQ-10735	<p>Publish IFM & RUC Resource-Specific Market Priority Types Results</p> <p>Upon data receipt, System shall report the following resource-specific market priority types for all resources (original and corrected):</p> <ul style="list-style-type: none"> • All Resource-specific market priority types and their associated MW data, including but not limited to: <ul style="list-style-type: none"> ○ ETC (including CRN ID and Type) ○ TOR (including CRN ID and Type) ○ OATT1 (including CRN ID Type) ○ OATT2 (including CRN ID Type) ○ DAPT ○ DALPT (this includes rolled-over DAECOM) • The existing reporting functionality for export resources shall be extended to all resources. • The existing reporting functionality shall be extended for OATT1 and OATT2. <p>Notes</p> <ul style="list-style-type: none"> • A resource ID can be associated with more than one market priority types with a MW corresponding to each market priority type. • There is an existing CMRI report for RUC export resources. • OATT1 and OATT2 are new functionalities that are applicable to EDAM BAAs only. 	Core	• CMRI
DAME-BRQ-10737	<p>Publish RTM Resource-Specific Market Priority Types Results</p> <p>Upon data receipt, System shall report the following resource-specific market priority types for all resources (original and corrected):</p> <ul style="list-style-type: none"> • All Resource-specific market priority types and their associated MW data for binding 15-min and 5-min intervals, including but not limited to: <ul style="list-style-type: none"> ○ ETC (including CRN ID and Type) ○ TOR (including CRN ID and Type) 	Core	• CMRI

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ OATT1 (including CRN ID Type) ○ OATT2 (including CRN ID Type) ○ DAPT ○ DALPT (this includes rolled-over DAECON) ○ RTPT ○ RTLPT ○ RTECON (RT economic exports that clear HASP) <ul style="list-style-type: none"> • The existing reporting functionality for export resources shall be extended to all resources. • The existing HASP reporting functionality shall be extended to FMM and RTD markets. • The existing functionality shall be extended for OATT1 and OATT2. <p>Notes</p> <ul style="list-style-type: none"> • A resource ID can be associated with more than one market priority types with a MW corresponding to each market priority type. • There is an existing CMRI report for HASP export resources. • OATT1 and OATT2 are new functionalities that are applicable to EDAM BAAs only. 		
DAME-BRQ-10740	<p>Publish IFM IR and RUC RC Resource Prices</p> <p>Upon data receipt, System shall report the following IFM IR and RUC RC market results data (original and corrected):</p> <ul style="list-style-type: none"> • Resource-Specific Hourly Data <ul style="list-style-type: none"> ○ IFM IRUMP/IRDMP Resource Prices and their price breakdown (total, capacity, congestion but no loss), but shall exclude the sub-components of their MCC prices (by BAA). ○ RUC RCUMP/RCDMP Resource Prices and their price breakdown (total, capacity, congestion and loss), but excluding sub-components of MCC prices (by BAA). 	Core	<ul style="list-style-type: none"> • CMRI
DAME-BRQ-10780	<p>Publish 15-min IRU/IRD LOC and IRU/IRD & RCU/RCD Overlapping RA Capacity</p>	Core	<ul style="list-style-type: none"> • CMRI

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>Upon data receipt, System shall report the following data (original and corrected) and shall be accessed by each resource's SC and by each resource's associated SC of LSE ID:</p> <ul style="list-style-type: none"> • RA-Resource-Specific 15-min <ul style="list-style-type: none"> ○ IRU/IRD LOC for Overlapping RA Capacity ○ IRU/IRD Overlapping RA Capacity ○ RCU/RCD Overlapping RA Capacity 		
DAME-BRQ-10800	<p>Publish DA/Base Schedule Forecasted Movement Data Upon data receipt, System shall report the following data (original and corrected) and shall be accessed by each resource's SC:</p> <ul style="list-style-type: none"> • Resource-Specific Hourly <ul style="list-style-type: none"> ○ DA Schedule Forecasted Movement (for CAISO and EDAM BAAs) ○ Base Schedule Forecasted Movement (for WEIM BAAs) 	Core	• CMRI
DAME-BRQ-10810	<p>Publish DA Schedule Virtual Forecasted Movement Data Upon data receipt, System shall report the following data (original and corrected) and shall be accessed by each node's SC:</p> <ul style="list-style-type: none"> • Nodal, by SC, Hourly <ul style="list-style-type: none"> ○ DA Schedule Virtual Forecasted Movement (for CAISO and EDAM BAAs) 	Core	• CMRI
DAME-BRQ-10830	<p>Publish CRR Revenue Adjustments Details for IRU/IRD Deployment Scenarios Upon data receipt, System shall report the following data (original and corrected):</p> <ul style="list-style-type: none"> • Hourly Data <ul style="list-style-type: none"> ○ Product ○ CRR ID ○ CRR Type ○ CRR Hedge Type ○ CRR Award MW ○ SC ID ○ Constraint Case ○ Transmission Constraint ID ○ CRR Offset Revenue ○ CRR Clawback Revenue ○ CRR Circular Scheduling Revenue ○ CRR Notional Revenue 	Core	• CMRI

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ Derate Factor 		
DAME-BRQ-10880	<p>Publish Shift Factors for IRU/IRD Deployment Scenarios</p> <p>Upon data receipt, System shall report the following IFM market results data:</p> <ul style="list-style-type: none"> ● Shift Factor Hourly Data <ul style="list-style-type: none"> ○ Shift Factor for IRU/IRD deployment scenarios (including Imbalance demand Anode) 	Core	● MPP
DAME-BRQ-10940	<p>Publish RTM Resource-Specific Market Priority Types Results for HASP Exports</p> <p>System shall continue to publish the following resource-specific market priority types for all export resources:</p> <ul style="list-style-type: none"> ● All Resource-specific market priority types and their associated MW data for all resources, including but not limited to: <ul style="list-style-type: none"> ○ ETC (including CRN ID and Type) ○ TOR (including CRN ID and Type) ○ OATT1 (including CRN ID Type) ○ OATT2 (including CRN ID Type) ○ DAPT ○ DALPT (this includes rolled-over DAECON) ○ RTPT ○ RTLPT ○ RTECON (RT economic) ○ PT (this is applicable to non-export resources, and includes rolled-over DAECON) ● The existing publishing functionality for export resources shall stay the same and shall not be extended to all resources. ● The existing HASP publishing functionality shall stay the same and shall not be extended to publish data from FMM and RTD markets. ● The existing publishing functionality shall be extended for OATT1 and OATT2. <p>Notes</p> <ul style="list-style-type: none"> ● A resource ID can be associated with more than one market priority types with a MW corresponding to each market priority type. 	Core	● ADS

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> • OATT1 and OATT2 are new functionalities that are applicable to EDAM BAAs only. • Refer to existing RSEE2-BRQ-08040 in RSEE2 project. 		


 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.10 Business Process: Manage FERC Reporting


- Publish Market Data FERC
- Publish Settlements Data FERC

5.10.1 Business Requirements


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-11420	<p>Publish Market Data to FERC System shall have the capability to automatically publish the following data to FERC:</p> <ul style="list-style-type: none"> • System Parameters Daily Data <ul style="list-style-type: none"> ○ IRU/IRD Deployment Factor (DIRU/DIRD) • Resource-Specific Data <ul style="list-style-type: none"> ○ IR Eligibility Flag ○ RC Eligibility Flag • RA-Resource-Specific Time-Block Data <ul style="list-style-type: none"> ○ Mapping between RA Resources and LSEs ○ RA Resources RA Showing Capacity ○ RA Resources Generic RA Showing Capacity for each mapped LSE ○ RA Resources Flex RA Showing Capacity (for all categories) for each mapped LSE ○ LSE-Resource Pair True-Up Flag (Opt- In/Out) • RA-Resource-Specific Daily Data <ul style="list-style-type: none"> ○ RA Resources Identification ○ RA Resources Generic RA Capacity ○ RA Resources Flex RA Capacity • Resource-Specific Daily Data <ul style="list-style-type: none"> ○ DAB Curves (Capacity MW , Bid Price) for: <ul style="list-style-type: none"> ▪ IRU ▪ IRD 	Core	<ul style="list-style-type: none"> • Internal ISO System

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ▪ RCU ▪ RCD • Resource-Specific Hourly Data <ul style="list-style-type: none"> ○ IRU/IRD and RCU/RCD Clean Bids ○ IRU/IRD and RCU/RCD Final Bids (including mitigation flags) ○ IRU/IRD and RCU/RCD Resource Awards ○ Retire RUC Awards (from go-live) as it is replaced with RCU Awards. ○ Proxy RCU MW ○ IRUMP/IRDMP Resource Prices and their price breakdown (total, capacity, congestion but no loss), including sub-components of MCC prices (by BAA). ○ RCUMP/RCDMP Resource Prices and their price breakdown (total, capacity, congestion and loss), including sub-components of MCC prices (by BAA). ○ DA Schedule Forecasted Movement (for CAISO and EDAM BAAs) ○ Base Schedule Forecasted Movement (for EIM BAAs) ○ IFM and RUC Energy Schedules and breakdown by market priority type (including CRN ID and Type) for all resources. • RA-Resource-Specific 15-min <ul style="list-style-type: none"> ○ IRU/IRD LOC for Overlapping RA Capacity ○ IRU/IRD Overlapping RA Capacity ○ RCU/RCD Overlapping RA Capacity • Nodal Hourly Data <ul style="list-style-type: none"> ○ IRUMP/IRDMP Nodal Prices and their price breakdown (total, capacity, congestion but no loss), including sub-components of MCC prices (by BAA), including prices for Imbalance 		

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<p>Demand Hub Apnodes as well as Apnodes associated with IR surplus zones.</p> <ul style="list-style-type: none"> ○ RCUMP/RCDMP Nodal Prices and their price breakdown (total, capacity, congestion and loss), including sub-components of MCC prices (by BAA). ● Nodal, by SC, Hourly Data <ul style="list-style-type: none"> ○ DA Schedule Virtual Forecasted Movement (for CAISO and EDAM BAAs) ● Network Constraints Hourly Data <ul style="list-style-type: none"> ○ Binding Constraint due to IRU/IRD and RUC. ○ IRU/IRD and RUC Constraint Shadow Prices ● Network Constraints Daily Data <ul style="list-style-type: none"> ○ Deployment Scenario Deliverability Constraints Activation Flag for IRU/IRD Awards (separate activation flags for IRU and IRD) ● BAA Hourly Data [for next Trading Days (D+1 as well as D+2 and D+3)] <ul style="list-style-type: none"> ○ IRU/IRD Requirements (IRUR/IRDR) (adjusted for diversity benefit) ○ IRU/IRD Surplus (IRUS/IRDS) ○ Associated Imbalance Demand Hub Apnode ● BAA Hourly Data [for next Trading Day (D+1)] <ul style="list-style-type: none"> ○ IRU/IRD Requirement Thresholds ○ IRU/IRD Requirements Input Polynomials ○ IRU/IRD Requirements Uncertainty Histograms ○ IRU/IRD Forecasts ○ IRU/IRD Demand Curves ● IR Surplus Zone Hourly Data (within each BAA) <ul style="list-style-type: none"> ○ IRU/IRD Surplus (IRUS/IRDS) ○ Associated IR Surplus Zone Apnode ● Nodal 15-min & 5-min Data 		

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	<ul style="list-style-type: none"> ○ FRUMP/FRDMP Nodal Prices but excluding their price breakdown, and sub-components of MCC prices (by BAA). ● Resource-Specific Hourly, 15-min & 5-min Data <ul style="list-style-type: none"> ○ RTM Energy Schedules broken down by market priority type (including CRN ID and Type) for all resources. <p>Notes</p> <ul style="list-style-type: none"> ● The time-block will be the entire month window for all resource types with the exception of interties, where the time-block can be any time frame window within the month. ● The Proxy RCU Awards can co-exist for same resource and hour with RCU Awards. ● The IRU/IRD, RCU/RCD and FRU/FRD SP-Tie prices are published by direction (import/export). 		
DAME-BRQ-11440	<p>Publish Settlements Data to FERC System shall have the capability to automatically publish the following data to FERC:</p> <ul style="list-style-type: none"> ● IRU/IRD and RCU/RCD Settlements Charge Codes <ul style="list-style-type: none"> ○ Payments ○ No-Pay Charges ○ Cost Allocations ○ BCR ○ GMC ○ IR – FRP Ramp Deviation 	Core	● Internal ISO System


 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.11 Business Process: Manage Resource Adequacy Requirements (CIRA)


- Define LSE-RA Resource True-Up Flag
- Consume LSE-Resource Pair True-Up Flag from LSE' SCs
- Consume LSE-Resource Pair True-Up Flag from Resource's SC
- Set and Display Effective LSE-Resource Pair True-Up Flag
- LSE-Resource Pair True-Up Flag Election Change Rules
- Set LSE-RA Resource Pair True-Up Flag
- Broadcast LSE-RA Resource Pair True-Up Flag
- Broadcast Monthly RA Resources Identification and Mappings
- Broadcast Daily RA Resources Identification and Mappings

5.11.1 Business Requirements


ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-13005	<p>Define LSE-Resource Pair True-Up Flag</p> <ul style="list-style-type: none"> • System shall define the following LSE-resource pair specific fields: <ul style="list-style-type: none"> ○ LSE-Resource Pair True-Up Flag • Supported possible values are: <ul style="list-style-type: none"> ○ Opt-In ○ Opt-Out • Default values for first implementation shall be set to: <ul style="list-style-type: none"> ○ Opt-Out • The same resource may be part of multiple LSE SCs. • The same LSE SC may be paired with multiple resources. <p>Notes</p> <ul style="list-style-type: none"> • This flag is used for LSE-RA Resource True-Up settlements to compensate LSEs for IRU/IRD and RCU/RCD awards that overlap with RA capacity with IRU/IRD awards for transitional three years period starting from Tariff activation date. 	Core	• CIRA

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
DAME-BRQ-13010	<p>Consume LSE-Resource Pair True-Up Flag from LSE' SCs</p> <p>At any time, System shall automatically consume the following LSE-resource pair specific fields from LSE' SCs:</p> <ul style="list-style-type: none"> LSE-Resource Pair True-Up Flag (Submitted by LSE's SC) 	Core	• CIRA
DAME-BRQ-13012	<p>Consume LSE-Resource Pair True-Up Flag from Resource's SC</p> <p>At any time, System shall consume the following LSE resource pairs specific fields from resource's SC:</p> <ul style="list-style-type: none"> LSE-Resource Pair True-Up Flag (Submitted by resource's SC) 	Core	• CIRA
DAME-BRQ-13013	<p>Set and Display Effective LSE-Resource Pair True-Up Flag</p> <p>Upon receipt of any data change,</p> <ul style="list-style-type: none"> If the LSE-Resource Pair True-Up Flag submitted by resource's SC matches the corresponding flag submitted by LSE's SC, System shall use the matched flag; otherwise, the effective flag shall be set to Opt-Out for that LSE-Resource pair. System shall display the Effective LSE-Resource Pair True-Up Flag to both resource's SC and LSE's SC. 	Core	• CIRA
DAME-BRQ-13015	<p>LSE-Resource Pair True-Up Flag Election Change Rules</p> <ul style="list-style-type: none"> If an LSE's SC and resource's SC mutually change their Opt-in/Opt-out election for LSE-resource pair within 60-days of Tariff activation date, System shall apply that election retroactively starting from the Tariff activation date. If an LSE's SC and resource's SC mutually change their Opt-in/Opt-out election for LSE-resource pair more than 60-days of Tariff activation date, System shall apply that election starting with the first Trading Day of the month after the month in which they completed the election process. Display this flag to LSE's and resource's SC. After 3-years from Tariff activation date, System shall set this flag to always Opt-Out for all LSE-RA resource pairs. 	Core	• CIRA

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

ID#	Business Feature	Requirement Type	Potential Application(s) Impacted
	Note <ul style="list-style-type: none"> For this project, Tariff activation date is same as Go-Live date. 		
DAME-BRQ-13017	Set LSE-RA Resource Pair True-Up Flag For all RA resources-LSE pairs, System shall have the capability to automatically perform the following: <ul style="list-style-type: none"> If LSE-Resource Pair True-Up Flag exists (not NULL), set LSE-RA Resource Pair True-Up Flag to be equal to LSE-Resource Pair True-Up Flag. Otherwise (LSE-Resource Pair True-Up Flag does not exist (NULL), set LSE-RA Resource Pair True-Up Flag to Opt-Out. 	Core	<ul style="list-style-type: none"> CIRA
DAME-BRQ-13018	Display SC of LSE ID to All Supplier, LSE and CAISO Users System shall display SC of LSE ID to all Supplier, LSE and CAISO users via UI.	Core	<ul style="list-style-type: none"> CIRA

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

5.12 Business Process: <Market/Business Simulation>


This section shall provide a basis for the development of the Market/Business Simulation Scenarios. These requirements will provide guidance on the market participant impacts, inputs into the Scenarios, endpoints to the Scenarios and reasons for potential Scenarios. The guidance on market participant impacts shall be gathered from the requirements that impact rules, interfaces, applications/reports, new system processes, new/modified data models, and new user roles. The source and sink systems shall be determined through the development of the system context diagram and the web service requirements. The *Reason for the Potential Scenario* column will be to offer guidance regarding what potential scenarios, and their context, may be needed for this project. This section applies to all policy development projects, market enhancements, technology enhancements, operation enhancements, Western Energy Imbalance Market (WEIM) implementations, and Reliability Coordination (RC) service implementations.

In the Reason for Potential Scenario column, select one or more of the following reasons:

1. **Rule Impacts:** Generalized changes in market rules, bidding rules, settlements rules, market design changes, or other business rules.
2. **Interface changes:** Changes that impact templates (e.g., the Resource Adequacy (RA) supply plan), user interface (UI), and application programming interface (API) (e.g., retrievals of new shadow settlement data).
3. **New application/report:** Changes that cause addition/modification of market software or reports, especially when market data input is required by the market participant.
4. **New system process:** Modification of data flow in systems, especially if the new process requires the market participant to demonstrate proficiency prior to production.
5. **New/Modified model data:** Addition or substantial modification of model data as a market solution or export provided by the ISO.
6. **New user role:** The addition or modification of access permissions for a user role applied to specific business units within a WEIM entity or market participant organization (e.g., Load Serving Entity (LSE) as a Local Regulatory Authority (LRA) role). Scenarios are beneficial for market participants taking on a new function or process within their organization.

5.12.1 Business Requirements

ID#	Guidance on Market Participant Impacts	Source System	Sink System	Reason for Potential Scenario
DAME-MSIM-15020	ISO SCs Submit IRU/IRD & RCU/RCD Bids	<ul style="list-style-type: none"> • SIBR 	<ul style="list-style-type: none"> • CMRI • OASIS • MPP 	1. Rule Impacts 2. Interface changes

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Guidance on Market Participant Impacts	Source System	Sink System	Reason for Potential Scenario
	<ul style="list-style-type: none"> • Set up a scenario where SCs for resources within CAISO BAA submit bid combinations, including IRU/IRD and RCU/RCD bids. • Run DAM (IFM and RUC). • Run RTM • Run Settlements • Follow the results in sink systems to verify market results: <ul style="list-style-type: none"> ○ OASIS <ul style="list-style-type: none"> ▪ IR/RC Bid-Related Data ▪ IFM IR and RUC RC Nodal Prices ▪ IFM-MPM IR and RUC-MPM RC Nodal Prices ▪ IFM IR and RUC Binding Constraints Shadow Prices ▪ IFM IR and RUC RC Nomogram/Branch and Interties Shadow Prices ▪ IFM-MPM IR and RUC-MPM RC Nomogram/Branch and Interties Shadow Prices ▪ IFM-MPM IR and RUC-MPM RC MPM Nomogram/Branch and Intertie Constraint Competitive Path ▪ IFM IR and RUC RC Aggregate Awards ▪ IRU/IRD Requirements (IRUR/IRDR) ▪ IRU/IRD Surplus (IRUS/IRDS) ▪ Associated Imbalance Demand Hub/IR Surplus Zone Apnode ▪ IRU/IRD Requirement Thresholds ▪ IRU/IRD Requirements Input Polynomials 		<ul style="list-style-type: none"> • ADS • MRI-S 	3. new application /report 4. New system process




ID#	Guidance on Market Participant Impacts	Source System	Sink System	Reason for Potential Scenario
	<ul style="list-style-type: none"> ▪ IRU/IRD Requirements Uncertainty Histograms ▪ IRU/IRD Forecasts ▪ IRU/IRD Demand Curves ▪ CRR Aggregated Revenue Adjustment Data ▪ Payment and No-Payments of IR/RC-Charge Code Settlements Amounts Data ○ CMRI <ul style="list-style-type: none"> ▪ IR and RC DAB Curves ▪ IFM-MPM IRU and RUC-MPM RCU Mitigated Bids ▪ IFM IR and RUC RC Resource Awards ▪ IFM IR and RUC RC Resource Prices ▪ IFM IR and RUC RC LSE Resource Awards ▪ DA Schedules by Market Priority Types ▪ Real-Time Schedules by Market Priority Types ▪ IRU/IRD Overlapping RA Capacity ▪ RCU/RCD Overlapping RA Capacity ▪ IRU/IRD LOC for Overlapping RA Capacity ▪ DA/Base Schedule Forecasted Movement Data ▪ DA Schedule Virtual Forecasted Movement Data ▪ CRR Revenue Adjustments Details ○ MPP 			



ID#	Guidance on Market Participant Impacts	Source System	Sink System	Reason for Potential Scenario
	<ul style="list-style-type: none"> ▪ Shift Factors Data for IR Deployment Scenarios ○ ADS <ul style="list-style-type: none"> ▪ RTM Resource-Specific Market Priority Types Results for HASP Exports ○ Settlements <ul style="list-style-type: none"> ▪ IFM IR & RUC RC Payments ▪ IFM IR & RUC RC Cost Allocation ▪ IR DA and RC RT BCR Settlements ▪ Inclusion of IR & RC in GMC Settlements ▪ IRU/IRD & RCU/RCD Unavailability No-Pay Charges ▪ IR and RC Unavailability No-Pay Charges Priority ▪ IR – FRP RTM Ramp Deviation Settlements ▪ FMM Forecasted Movement Deviation Settlements ▪ Settlements of Overlapping RA Capacity for True-Up Settlements Mechanism ▪ Accounting IRU/IRD in CRR Settlements for CAISO and EDAM BAAs 			
DAME-MSIM-15040	<p>Change Setting of IRU/IRD Deployment Factors</p> <ul style="list-style-type: none"> • Set up a scenario where CAISO set the IRU/IRD Deployment Factors to 50%. • Follow same scenario setup as the one described in DAME-MSIM-15020. 	<ul style="list-style-type: none"> • DAM • SIBR 	<ul style="list-style-type: none"> • CMRI • OASIS • MRI-S 	<ol style="list-style-type: none"> 1. Rule Impacts 2. Interface changes 3. new application /report 4. New system process

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


ID#	Guidance on Market Participant Impacts	Source System	Sink System	Reason for Potential Scenario
DAME-MSIM-15060	<p>Change Set of Activated Transmission Constraints in the IRU/IRD Deployment Scenarios</p> <ul style="list-style-type: none"> • Set up a scenario where CAISO BAA Operator changes set of activated transmission constraints that are monitored in the IRU/IRD deployment scenarios. • Follow same scenario setup as the one described in DAME-MSIM-15020. 	<ul style="list-style-type: none"> • DAM • SIBR 	<ul style="list-style-type: none"> • CMRI • OASIS • MRI-S 	<ol style="list-style-type: none"> 1. Rule Impacts 2. Interface changes 3. new application /report 4. New system process

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


6 Appendices

6.1 Appendix-A – Acronym Definition


Acronym	Definition
A2A	Application-to-Application
ABC	Available Balancing Capacity
ABS	Absolute value
AC	Alternating Current
ACL	Access Control List
ACPF	Alternating Current Power Flow
ADS	Automatic Dispatch System
AGC	Automatic Generation Control
AIM	Access and Identity Management
ALFS	Automated Load Forecast System
Anode	Aggregate Node
API	Application Program Interface
Apnode	Aggregate Pricing Node
AS	Ancillary Services
ASSOC	Ancillary Services State Of Charge
AUX	Auxiliary
B2B	Business-to-Business
BA	Business Analyst
BAA	Balancing Authority Area

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
BAAOP	Balancing Authority Area Operations Portal
BARC	Balancing Area Requirement Calculator
BCR	Bid Cost Recovery
BPM	Business Process Manual
BRS	Business Requirement Specifications
BS	Base Schedule
BSAP	Base Schedule Aggregation Portal
BSC	Base Schedule Coordinator
BSSD	(WEIM) Base Schedule Submission Deadline
CAISO	California Independent System Operator
CB	Convergence Bidding
CC	Commitment Cost
CC	Charge Code
CCDEBE	Commitment Costs and Default Energy Bid Enhancements
CDN	Conformed Dispatch Notice
CF	Capacity Factor
CIDI	Customer Inquiry, Dispute and Information system
CIM	Common Information Model
CIP	Critical Infrastructure Protection
CIRA	Customer Interface for Resource Adequacy
CISO	California Independent System Operator
CLAP	Custom Load Aggregation Point

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
CMRI	Customer Market Results Interface
CMT	Commitment
Cnode	Connectivity Node
COG	Constrained-Output Generator
CPM	Capacity Procurement Mechanism
CRN	Contract Reference Number
CRR	Congestion Revenue Rights
CRR1B	Congestion Revenue Rights Auction Efficiency 1B Project
CRRS	Congestion Revenue Rights Settlements (aka CRR Clawback system)
CSS	Critical Systems Support
CSV	Comma Separated Value
D	Day
D+1	Trading Day plus 1 day
D+2	Trading Day plus 2 days
DA	Day-Ahead
DAB	Default Availability Bid
DACA	Day-Ahead Contingency Analysis
DAES	Day-Ahead Energy Schedule
DAM	Day-Ahead Market
DAME	Day-Ahead Market Enhancements
DART	Day-Ahead Reliability Tool
DASFM	Day Ahead Schedule Forecasted Movement

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
DCC	Default Commitment Cost
DCPA	Dynamic Competitive Path Assessment
DCPF	Direct Current Power Flow
DEB	Default Energy Bid
Dec	Decremental
DER	Distributed Energy Resource
DF	Demand Forecast
DGAP	Default Generation Aggregation Point
DIRD	Imbalance Reserve Down Deployment Factor (used in IRU Deployment Scenarios)
DIRU	Imbalance Reserve Up Deployment Factor (used in IRD Deployment Scenarios)
DMLC	Default Minimum Load Cost
DMM	Department of Market Monitoring
DOP	Dispatch Operating Point
DOT	Dispatch Operating Target
DR	Demand Response
DRP	Demand Response Program
DSA	Dynamic Stability Analysis
DSTC	Default State Transition Cost
DSUC	Default Start Up Cost
DUIT	Detailed Unit Information Tool
EA	Energy + Ancillary Services
ECIC	Energy Costs and Index Calculator

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
ED	Exceptional Dispatch
EDAM	Extended Day-Ahead Market
EDR	Enterprise Data Repository
EE	Expected Energy
EEA	Expected Energy Allocation
EEA	Energy Emergency Alert
EEA2	Energy Emergency Alert Stage-2
EESC	Energy Imbalance Market Entity Scheduling Coordinator
EFC	Effective Flexible Capacity
EMM	Enterprise Model Management
EMMS	Enterprise Model Management System
EMNA	Energy Management Network Application
EMS	Energy Management System
En	Energy
EN	Energy
EPI	Electricity Price Index
ESP	Electronic Security Perimeter
ESR	Energy Storage Resource
ETC	Existing Transmission Contract
ETSR	Energy Transfer System Resources
FERC	Federal Energy Regulatory Commission

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
FIT	Fully Integrated Tracking (ISO reporting tool that provides system operators various reports for RT operations, such as Capacity Forecast, Day Ahead Reports, Load Shedding, Peak Day, Market Impacts Checker, etc.)
FM	Forecasted Movement
FMCA	Fifteen-Minute Contingency Analysis
FMM	Fifteen-Minute Market
FMU	Frequently Mitigated Unit
FNM	Full Network Model
FODD	FERC Outgoing Data Depository
FRCT	Forbidden Region Crossing Time
FRD	Flexible Ramp Down
FRDMP	Flexible Ramp Down Marginal Price
FRP	Flexible Ramp Product
FRU	Flexible Ramp Up
FRUMP	Flexible Ramp Up Marginal Price
GCARM	Generator Contingency and RAS Modeling
GDF	Generation Distribution Factor
GHG	Green House Gas
GIP	Generator Interconnection Procedure
GMC	Grid Management Charge
GPI	Gas Price Index
GRDT	Generator Resource Data Template
GUI	Graphical User Interface

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
h	Trading Hour
HASP	Hour-Ahead Scheduling Process
HAVGC	Heat Average Cost (for non-gas resources)
HR	Heat Rate
ICE	InterContinental Exchange
ICM	Infrastructure Contracts and Management
ID	Identifier
IFM	Integrated Forward Market
Inc	Incremental
ISL	Intertie Scheduling Limit
ISO	California Independent System Operator
Isomon	ISO Monitoring application
IOOC	Integrated Optimal Outage Coordination
IR	Imbalance Reserve
IRD	Imbalance Reserve Down (award)
IRD5	IRD Award 5-minute Ramp-Capable Portion
IRD5+	IRD Award excluding 5-minute Ramp-Capable Portion
IRDC	Imbalance Reserve Down allocated Capacity range
IRDC5	Imbalance Reserve Down allocated Capacity range, for the IRD 5-minute Ramp-Capable Portion.
IRDC5+	Imbalance Reserve Down allocated Capacity range, excluding IRU 5-minute Ramp-Capable Portion.
IRDMP	Imbalance Reserve Down Marginal Price

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
IRDR	Imbalance Reserve Down Requirement
IRDRMP	Imbalance Reserve Down Requirement Marginal Price
IRDS	Imbalance Reserve Down Surplus
IRDSMP	Imbalance Reserve Down Surplus Marginal Price
IRU	Imbalance Reserve Up (award)
IRU5	IRU Award 5-minute Ramp-Capable Portion
IRU5+	IRU Award excluding 5-minute Ramp-Capable Portion
IRUC	Imbalance Reserve Up allocated Capacity range
IRUC5	Imbalance Reserve Up allocated Capacity range, for the IRU 5-minute Ramp-Capable Portion.
IRUC5+	Imbalance Reserve Up allocated Capacity range, excluding IRU 5-minute Ramp-Capable Portion.
IRUMP	Imbalance Reserve Up Marginal Price
IRUR	Imbalance Reserve Up Requirement
IRURMP	Imbalance Reserve Up Requirement Marginal Price
IRUS	Imbalance Reserve Up Surplus
IRUSMP	Imbalance Reserve Up Surplus Marginal Price
ISL	Interchange Scheduling Limit
IT	Information Technology
ITC	Inter-Tie Constraint
ITPD	Information Technology Product Development
ITS	Interchange Transaction Scheduler
ITSM	Information Technology Service Management

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
JOU	Joint Owned Unit
LACA	Look-Ahead Contingency Analysis
LAP	Load Aggregation Point
LCL	Lower Capacity Limit
LDF	Load Distribution Factor
LEL	Lower Economic Limit
LEL _{FMM}	Lower Economic Limit (FMM)
LESR	Limited Energy Storage Resource
LF	Load Forecast
LFD	Load Following Down qualified self-provision capacity
LFD	Load Following Down qualified self-provision capacity
LFDC	Load Following Down allocated Capacity.
LFR	Lower Forbidden Region
LFU	Load Following Up qualified self-provision capacity
LFU	Load Following Up qualified self-provision capacity
LFUC	Load Following Up allocated Capacity.
LMP	Locational Marginal Price
LMPM	Locational Market Power Mitigation
LOC	Lost Opportunity Cost
LOL	Lower Operating Limit
LPF	<i>Loss Penalty Factor</i>
LPT	Low Priority Price Taker

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
LRA	Local Regulatory Authority
LRL	Lower Regulation Limit
LSE	Load Serving Entity
LTCA	Long-Term Contingency Analysis
Max	Maximum
MaxExCap	Maximum Ex-post Capacity
MaxExCap _{FMM}	Maximum Ex-post Capacity (FMM)
MCC	Marginal Congestion Cost
MCI	Model and Contract Implementation
MD	Manual Dispatch
MDT	Minimum Down Time
MDS	Maximum Daily Startups
MF	Master File
MIBP	Maximum Import Bid Price
Min	Minimum
MinExCap	Minimum Ex-post Capacity
MLAC	Minimum Load Average Cost
MLC	Minimum Load Cost
MLHAVGC	Minimum Load Heat Average Cost (for non-gas resources)
MLHR	Minimum Load Heat Rate
MMA	Major Maintenance Adder
MMAMLC	Major Maintenance Adder for Minimum Load Cost

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
MMASUC	Major Maintenance Adder for Start Up Cost
MMASTC	Major Maintenance Adder for MSG State Transition Cost
MMG	Manage Markets & Grid
MMR	Manage Market & Reliability
MOO	Must Offer Obligation
MOS	Manage Operations Support & Settlements
MP	Marginal Price
MP	Market Participant
MPM	Market Power Mitigation
MPP	Market Participant Portal
MQS	Market Quality System
MRID	Master Resource IDentifier
MRI-S	Market Results Interface – Settlements
MSS	Metered Sub System
MSSA	Metered Sub System Agreement
MSG	Multi-Stage Generator
MUT	Minimum Up Time
MV	Materialized View
MV&A	Market Validation & Analysis
MVT	Market Validation Tool
N/A	Not Applicable
NA	Network Application

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
ND	Net Demand
NDAB	Negotiated Default Availability Bid
NDEB	Negotiated Default Energy Bid
NGR	Non-Generating Resource
NM	Network Model
NPM	Nodal Price Model
NQC	Net Qualifying Capacity
NR	Non-Spinning Reserve award
NS	Non-Spinning Reserve award; it includes qualified self-provision capacity
NSC	Non-Spinning Reserve allocated Capacity range
OASIS	Open Access Same-time information System
OATI	Open Access Technology International
OATT	Open Access Transmission Tariff
OC	Opportunity Cost
OCC	Opportunity Cost Calculator
ODCP	On Demand Capacity Procurement
OES	Operations Engineering Services
OMS	Outage Management System
OOM	Out Of Market
OTS	Operations Training Simulator
P97.5	97.5% Percentile
PAC	PacifiCorp

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
PACE	PacifiCorp East
PACW	PacifiCorp West
PAM	Program and Application Management
PBC	Power Balance Constraint
PC	Pre-Calculation
PCA	Price Correction Admin
PDR	Proxy Demand Resource
PF	Power Flow
PI	Plant Information
PL	Participating Load
Pmax	Maximum Generation Capacity
Pmin	Minimum Generation Capacity
PMO	Program Management Office
PNM	Public New Mexico
Pnode	Pricing Node
POC	Point Of Contact
PRSC	Participating Resource Scheduling Coordinator
PSH	Pump Storage Hydro
PSTD	Power Systems Technology Development
PSTO	Power Systems Technology Operations
PT	Price Taker
PT	High Priority Price Taker

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
PTO	Participating Transmission Owner
QRB	Quality Review Board
RA	Resource Adequacy
RAAIM	Resource Adequacy Availability Incentive Mechanism
RAS	Remedial Action Schemes
RC	Reliability Coordinator
RC	Reliability Capacity
RC-BSAP	Reliability Coordinator - Base Schedule Aggregation Portal
RCD	Reliability Capacity Down (award)
RCDC	Reliability Capacity Down allocated Capacity range (FMM).
RCDMP	Reliability Capacity Down Marginal Price
RCSA	Reliability Coordinator Service Agreement
RCU	Reliability Capacity Up (award)
RCUMP	Reliability Capacity Up Marginal Price
RCUC	Reliability Capacity Up allocated Capacity range
RD	Regulation Down (award)
RDC	Regulation Down allocated Capacity.
RDOT	Ramping Dispatch Operating Target (a continuous piecewise linear curve connecting consecutive <i>DOTs</i> using their mid-interval points, from RTD, RTCD, or RTDD runs, as applicable)
RDRR	Reliability Demand Response Resource
RDT	Resource Data Template
RegD	Regulation Down (award)

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
RegU	Regulation Up (award)
REN	Reliability Energy (another alternative terminology of RUC Schedule)
RIG	Remote Intelligent Gateway
RIMS	Resource Interconnection Management System
RMR	Reliability Must Run
ROPR	Operating Reserve Ramp Rate
RR	Ramp Rate
RRD	Ramp Rate that corresponds to $DAES_{DAM} - IRD_{DAM}$
RREG	Regulation Ramp Rate
RRU	Ramp Rate that corresponds to $DAES_{DAM} + IRU_{DAM}$
RSE	Resource Sufficiency Evaluation
RSEE	Resource Sufficiency Evaluation Enhancements
RSEE2	Resource Sufficiency Evaluation Enhancements – Phase-2
RT	Real-Time
RTBS	Real-Time Base Scheduler
RTCA	Real-Time Contingency Analysis
RTCD	Real-Time Contingency Dispatch
RTD	Real-Time Dispatch
RTDD	Real-Time Disturbance Dispatch
RTPD	Real-Time Pre-Dispatch
RTM	Real-Time Market
RTN	Real-Time Nodal (Market)

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023


Acronym	Definition
RTUC	Real-Time Unit Commitment
RU	Regulation Up (award)
RUC	Residual Unit Commitment
RUC	Regulation Up allocated Capacity.
SADS	System And Design Specifications
SC	Scheduling Coordinator
SCME	Scheduling Coordinator Meter Entity
SDF	Solar Distribution Factor
SE	State Estimator
SF	Shift Factor
SIBR	Scheduling Infrastructure and Business Rules
SME	Subject Matter Expert
SOA	Service-Oriented Architecture
SOC	State Of Charge
SP	Scheduling Point
SPCE	Siemens Price Correction Engine
SQMD	Settlements Quality Meter Data
SR	Spinning Reserve (award)
SRC	Spinning Reserve allocated Capacity range
SRS	System Requirement Specifications
SS	Self-Schedule
SSAE	Statement on Standards for Attestation Engagements

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

Acronym	Definition
STC	State Transition Cost
STF	Short-Term Forecast
STC	State Transition Cost
STT	State Transition Time
STUC	Short-Term Unit Commitment
SUC	Start Up Cost
SUE	Start Up Energy
SUF	Start Up Fuel
SURT	Start Up Ramp Time
SUT	Start Up Time
T	Trading Day
TBD	To Be Determined
TEP	Tucson Electric Power
TG	Tie Generator
TNA	Transmission Network Application
TOP	Transmission Operator Provider
TOR	Transmission Ownership Contract
TEE	Total Expected Energy
TTEE	Total Target Expected Energy (based on RDOT)
UAT	User Acceptance Testing
UCL	Upper Capacity Limit
UEL	Upper Economic Limit

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

Acronym	Definition
UFR	Upper Forbidden Region
UI	User Interface
UIE	Uninstructed Energy Imbalance
UL	User Limited
UOL	Upper Operating Limit
URL	Upper Regulation Limit
VER	Variable Energy Resource
VOM	Variable Operations & Maintenance
VOMC	Variable Operations & Maintenance Cost
WDF	Wind Distribution Factor
WebOMS	Web-based Outage Management System
WEIM	Western Energy Imbalance Market
XML	Extensible Markup Language
XSD	XML Schema Definition

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

6.2 Appendix-B: Formulas, Calculation Details, and Examples

6.2.1 Eligibility Tables

6.2.1.1 Resource Eligibility Table

Reference BRQs

- DAME-BRQ-01000
- DAME-BRQ-01010
- DAME-BRQ-04008
- DAME-BRQ-04020


	EN	RCU	RCD	EN needed for RCU/D award	IRU	IRD	EN needed for IRU award	EN needed for IRD award
Non-Participating Load	Yes	Not Eligible	Not Eligible	N/A	Not Eligible	Not Eligible	N/A	N/A
Virtual Supply	Yes	Not Eligible	Not Eligible	N/A	Not Eligible	Not Eligible	N/A	N/A
Virtual Demand	Yes	Not Eligible	Not Eligible	N/A	Not Eligible	Not Eligible	N/A	N/A
Hourly Block Import	Yes	Eligible	Eligible	None	Not Eligible	Not Eligible	N/A	N/A
Hourly Block Export	Yes	Eligible	Eligible	None	Not Eligible	Not Eligible	N/A	N/A
15-Min Import	Yes	Eligible	Eligible	None	Eligible	Eligible	None	EN >= IRD
15-Min Export	Yes	Eligible	Eligible	None	Eligible	Eligible	EN >= IRU	None
Dynamic Import	Yes	Eligible	Eligible	None	Eligible	Eligible	EN >= Pmin	EN <= Pmax



	EN	RCU	RCD	EN needed for RCU/D award	IRU	IRD	EN needed for IRU award	EN needed for IRD award
							EN <= Pmax - IRU	EN >= Pmin + IRD
Long-Start Generator	Yes	Eligible	Eligible	EN >= Pmin	Eligible	Eligible	EN >= Pmin EN <= Pmax - IRU	EN <= Pmax EN >= Pmin + IRD
Short-Start Generator	Yes	Eligible	Eligible	None	Eligible	Eligible	EN >= Pmin EN <= Pmax - IRU	EN <= Pmax EN >= Pmin + IRD
Participating Load w/ 15-Min dispatch capability	Yes	Eligible	Eligible	None	Eligible	Eligible	EN >= Pmin EN <= Pmax - IRU	EN <= Pmax EN >= Pmin + IRD
Participating Load w/ Hourly dispatch capability	Yes	Eligible	Eligible	None	Not Eligible	Not Eligible	N/A	N/A
Variable Energy Resources (Wind/Solar)	Yes	Eligible	Eligible	TBD	Eligible	Eligible	TBD	TBD
Non-Generator	Yes	Eligible	Eligible	N/A	Eligible	Eligible	N/A	N/A



	EN	RCU	RCD	EN needed for RCU/D award	IRU	IRD	EN needed for IRU award	EN needed for IRD award
Resources (Storage)		(only for positive range)	(only for negative range)		(only for positive range)	(only for negative range)		
Hybrid Resource	Yes	Eligible	Eligible	N/A	Eligible	Eligible	N/A	N/A
Co-Located Resource	--- Eligibility determined by individual storage and VER components ---							
Energy Storage Resource	Yes	Eligible	Eligible	N/A	Eligible	Eligible	N/A	N/A
60-Minute Proxy Demand Resource	Yes	Eligible	Eligible	None	Not Eligible	Not Eligible	N/A	N/A
15-Minute Proxy Demand Resource	Yes	Eligible	Eligible	None	Eligible	Eligible	EN >= Pmin EN <= Pmax - IRU	EN <= Pmax EN >= Pmin + IRD
5-Minute Proxy Demand Resource	Yes	Eligible	Eligible	None	Eligible	Eligible	EN >= Pmin EN <= Pmax - IRU	EN <= Pmax EN >= Pmin + IRD
Reliability Demand Response Resource	Yes	Not Eligible	Not Eligible	None	Not Eligible	Not Eligible	N/A	N/A


 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

6.2.1.2 Proposed and Existing DAM Products

Title	Acronym	Time Granularity	Purpose	Eligibility*	Procured In	Status
Energy	EN	Hourly	Energy schedules cleared to meet bid-in demand	All resources	IFM	Existing
Reliability Capacity, Up	RCU	Hourly	Incremental capacity procured to meet the positive difference between the net load forecast and cleared non-VER physical supply	Physical resources based on 60-minute ramp capability	RUC	Replaces RUC awards
Reliability Capacity, Down	RCD	Hourly	Decremental capacity procured to meet the negative difference between net load forecast and cleared non-VER physical supply	Physical resources based on 60-minute ramp capability	RUC	Proposed
Imbalance Reserves, Up	IRU	15-min	Incremental capacity procured relative to the net load forecast to meet the upward uncertainty requirement	15-minute dispatchable physical resources, award based on 15-minute ramp capability	IFM	Proposed





Title	Acronym	Time Granularity	Purpose	Eligibility*	Procured In	Status
Imbalance Reserves, Down	IRD	15-min	Decremental capacity procured relative to the net load forecast to meet the downward uncertainty requirement	15-minute dispatchable physical resources, award based on 15-minute ramp capability	IFM	Proposed
Ancillary Services	AS	10-min	Incremental capacity procured and reserved to meet real-time regulation and contingency reserve requirements	Resources certified to provide the respective service	IFM	Existing

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

6.2.2 Bidding Obligation

6.2.2.1 Day-Ahead Bidding Rules for Imbalance Reserves and Reliability Capacity

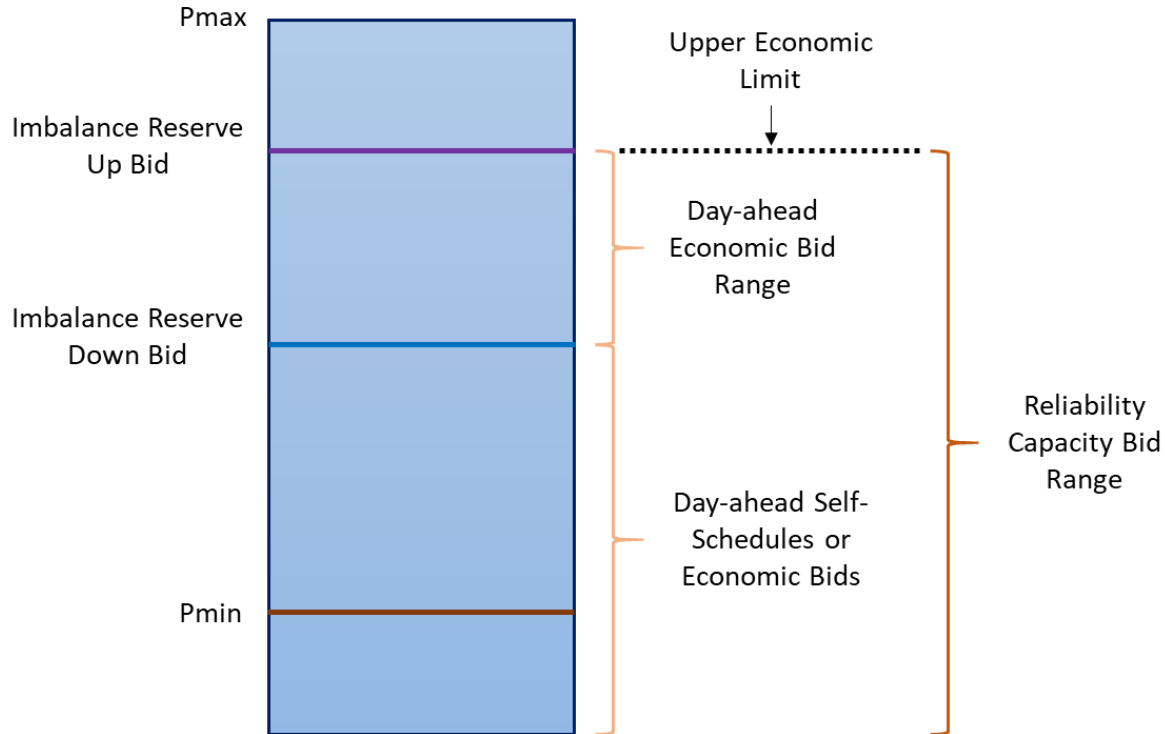

 California ISO	Technology	Template Version:	5.1
		Document Version:	1.7
Day-Ahead Market Enhancements Business Requirements Specification - Planning		Date Created:	7/25/2023

6.2.2.2 Real-Time Bidding Obligations

