


Decision on Seven-Day Advanced Transmission Outage Proposal

Gary DeShazo
Director, Operation Engineering Services

Board of Governors Meeting
General Session
February 16, 2012

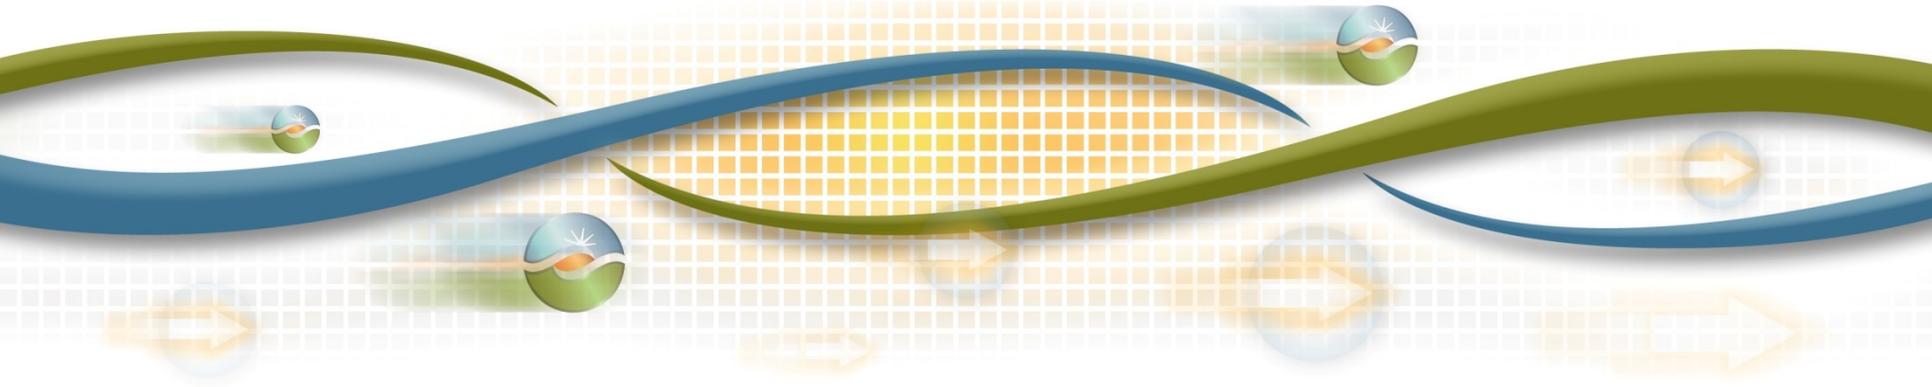

Currently, 24% of transmission outage requests are submitted with less than 7 days notice resulting in challenges with reliable grid operations.

- Existing tariff language was created prior to implementation of ISO wholesale market
 - Provides no authority for ISO to deny untimely submittals
- Current timeframe does not provide sufficient time to include outages in the advanced market analysis
 - Outages must be processed closer to real-time when energy prices are higher

The proposal balances ISOs need for sufficient time to analyze outage requests and PTOs flexibility to plan maintenance work.

- Proposal has been vetted with stakeholders who generally support Management's recommendation.
- Enables all planned transmission outages to be included in the Day+3, Day+2 and Day + 1 binding market runs resulting in the best data to be utilized.