



Market Performance Report November 2017

January 9, 2018

ISO Market Quality and Renewable Integration

CAISO
250 Outcropping Way
Folsom, California 95630
(916) 351-4400

Executive Summary¹

The market performance in November 2017 is summarized below.

CAISO area performance,

- Peak loads for ISO seldom exceeded 30,000 MW in November due to low temperatures as the winter approaches.
- In the integrated forward market (IFM), SCE and SDG&E prices were elevated in a few days due to transmission congestion. In the fifteen-minute market (FMM) and real-time market (RTD), all four DLAP prices were elevated on November 6-7 driven by upward load adjustments, net import reductions, generation outages, and renewable deviations.
- Congestion rents for interties skidded to \$6.00 million from \$13.93 million in October. Majority of the congestion rents in November accrued on MALIN500 (50 percent) intertie and Palo Verde (41 percent) intertie.
- In the congestion revenue rights (CRR) market, revenue adequacy was 76.79 percent, decreasing from 80.27 percent in October. The intertie MALIN500 contributed largely to the revenue shortfall.
- The monthly average ancillary service cost to load dropped to \$0.42/MWh in November from \$0.80/MWh in October. There was one non-spin scarcity event in the ISO expanded system region this month.
- The cleared virtual supply was well above the cleared demand in most days of November. The profits from convergence bidding fell to \$2.41 million from \$5.11 million in October.
- The bid cost recovery dropped to \$5.94 million from \$8.03 million in October.
- The real-time energy offset decreased to \$1.74 million from \$4.99 million in October. The real-time congestion offset cost inched up to \$4.99 million from \$4.30 million in October.
- The volume of exceptional increased to 67,953 MWh from 61,883 MWh in October. The main contributors to this volume were planned transmission outage and load forecast uncertainty. The monthly average of total exceptional dispatch volume as a percentage of load rose to 0.40 percent from 0.31 percent in October.

¹ This report contains the highlights of the reporting period. For a more detailed explanation of the technical characteristics of the metrics included in this report please download the Market Performance Metric Catalog, which is available on the CAISO web site at <http://www.caiso.com/market/Pages/ReportsBulletins/Default.aspx>.

Energy Imbalance market (EIM) performance,

- In the FMM, the prices for AZPS and NEVP were elevated on November 6-7 due to upward load adjustment, net import reduction, generation outage, and renewable deviation. In the RTD, the prices for AZPS and NEVP were elevated on November 7, driven by upward load adjustment, net import reduction, and renewable deviation.
- Bid cost recovery, real-time imbalance energy offset, and real-time congestion offset costs for EIM entities (PACE, PACW, NEVP, AZPS, PSEI, and PGE) were \$1.16 million, \$1.55 million and \$0.64 million respectively.

TABLE OF CONTENTS


Executive Summary	2
Market Characteristics	5
Loads	5
Resource Adequacy Available Incentive Mechanism.....	6
Direct Market Performance Metrics.....	7
Energy.....	7
Day-Ahead Prices.....	7
Real-Time Prices	8
Congestion	11
Congestion Rents on Interties.....	11
Congestion Revenue Rights.....	12
Ancillary Services	16
IFM (Day-Ahead) Average Price.....	16
Ancillary Service Cost to Load.....	17
Scarcity Events	17
Convergence Bidding.....	18
Renewable Generation Curtailment	19
Flexible Ramping Product	20
Flexible Ramping Product Payment.....	21
Indirect Market Performance Metrics	22
Bid Cost Recovery.....	22
Real-time Imbalance Offset Costs.....	33
Market Software Metrics.....	34
Market Disruption.....	34
Manual Market Adjustment.....	36
Exceptional Dispatch	36
Energy Imbalance Market.....	38

Market Characteristics

Loads

Peak loads for ISO seldom exceeded 30,000 MW in November due to low temperatures.

Figure 1: System Peak Load

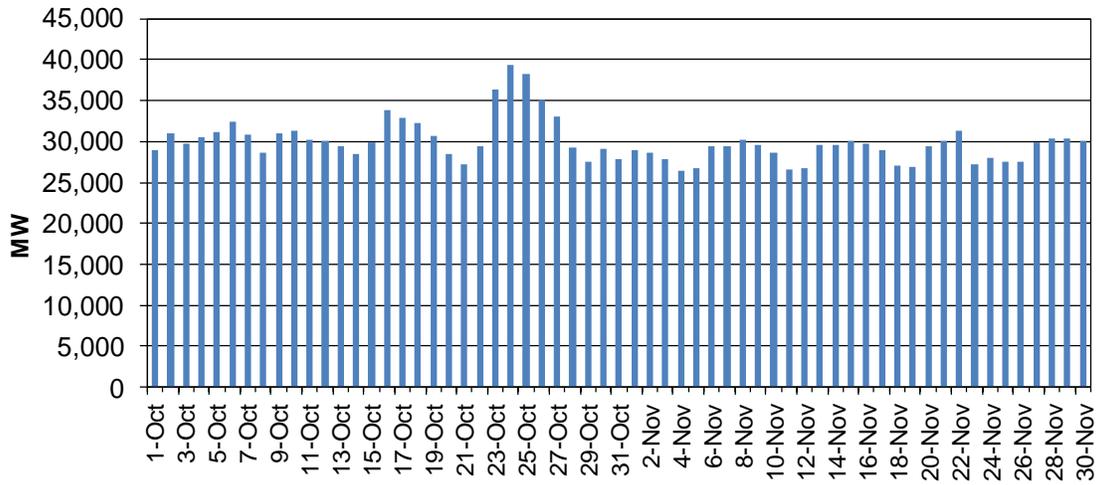

Resource Adequacy Available Incentive Mechanism

Resource Adequacy Availability Incentive Mechanism (RAAIM) was activated on November 1, 2016 to track the performance of Resource Adequacy (RA) Resources. RAAIM is used to determine the availability of resources providing local and/or system Resource Adequacy Capacity and Flexible RA Capacity each month and then assess the resultant Availability Incentive Payments and Non-Availability Charges through the CAISO’s settlements process. Table 1 below shows the monthly average actual availability, total non-availability charge, and total availability incentive payment.²

Table 1: Resource Adequacy Availability and Payment

	Average Actual Availability	Total Non-availability Charge	Total Availability Incentive Payment
Nov-16	92.23%	\$3,616,895	-\$1,678,657
Dec-16	96.25%	\$1,878,503	-\$1,878,503
Jan-17	26.30%	\$49,188,214	-\$5,670
Feb-17	92.31%	\$3,157,590	-\$1,867,721
Mar-17	91.94%	\$3,046,829	-\$1,550,469
Apr-17	89.43%	\$4,096,806	-\$1,543,647
May-17	95.97%	\$1,812,398	-\$1,429,830
Jun-17	95.13%	\$2,426,279	-\$1,422,549
Jul-17	96.11%	\$1,298,826	-\$1,298,826
Aug-17	64.11%	\$29,701,024	-\$19,051
Sep-17	96.52%	\$1,055,396	-\$1,055,396
Oct-17	73.12%	\$12,952,440	-\$26,864
Nov-17	96.15%	\$1,483,755	-\$1,483,755

² On June 21, 2017, the ISO indicated in the market notice that it intended to file a petition with the FERC for a limited tariff waiver on section 40.9.6 to forego assessing any Resource Adequacy Availability Incentive Mechanism (RAAIM) charges for the period April 1, 2017 through December 31, 2017 due to identified implementation issues. This waiver includes April, 2017 and May 2017. The ISO is currently estimating the penalties reflected in the charge code 8830 to be zero pursuant to tariff section 11.29.10.5.

Direct Market Performance Metrics

Energy

Day-Ahead Prices

Figure 2 shows daily prices of four default load aggregate points (DLAPs). Table 2 below lists the binding constraints along with the associated DLAP locations and the occurrence dates when the binding constraints resulted in relatively high or low DLAP prices.

Figure 2: Day-Ahead Simple Average LAP Prices (All Hours)

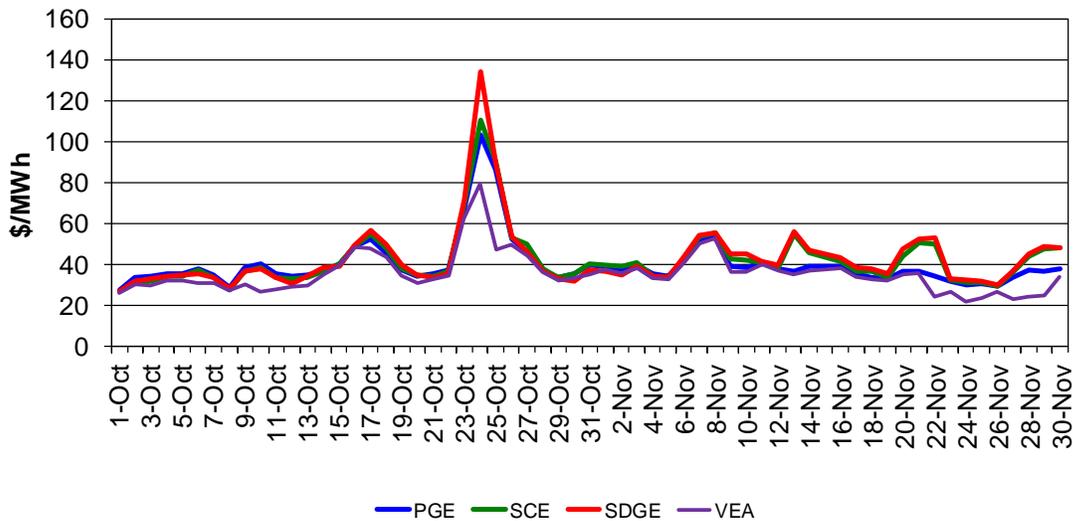


Table 2: Day-Ahead Transmission Constraints

DLAP	Date	Transmission Constraint
SCE, SDG&E	November 13	OMS 4646120 ELD_MKP_SCIT_NG
SCE, SDG&E	November 14, 20-22	OMS 4646120 ELD_MKP_SCIT_NG, SERRANO-SERRANO-500 XFMR
SCE, SDG&E	November 28-30	OMS 4646120 ELD_MKP_SCIT_NG, SERRANO-SERRANO-500 XFMR, OMS 4646112_OP-6610

Real-Time Prices

FMM daily prices of the four DLAPs are shown in Figure 3. Table 3 lists the binding constraints along with the associated DLAP locations and the occurrence dates when the binding constraints resulted in relatively high or low DLAP prices. On November 6-7, all four DLAP prices were elevated due to upward load adjustment, net import reduction, generation outage, and renewable deviation.

Figure 3: FMM Simple Average LAP Prices (All Hours)


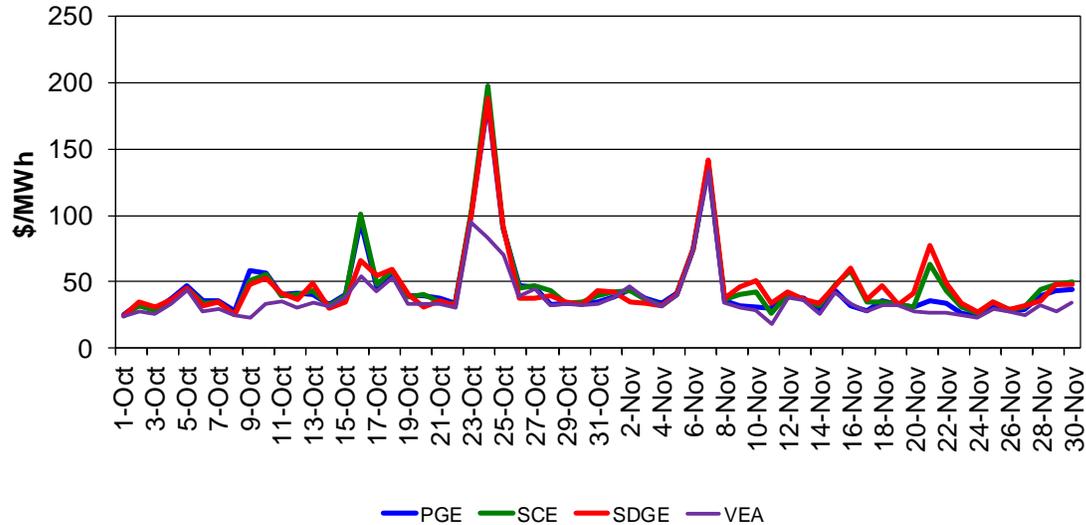


Table 3: FMM Transmission Constraints

DLAP	Date	Transmission Constraint
SCE, SDG&E	November 21-22	OMS 4646120 ELD_MKP_SCIT_NG, SERRANO-SERRANO-500 XFMR

Figure 4 below shows the daily frequency of positive price spikes and negative prices by price range for the default LAPs in the FMM. The cumulative frequency of prices above \$250/MWh continued to decline to 0.47 percent in November from 1.23 percent in October. The cumulative frequency of negative prices increased to 1.08 percent in November from 0.46 percent in October.

Figure 4: Daily Frequency of FMM LAP Positive Price Spikes and Negative Prices

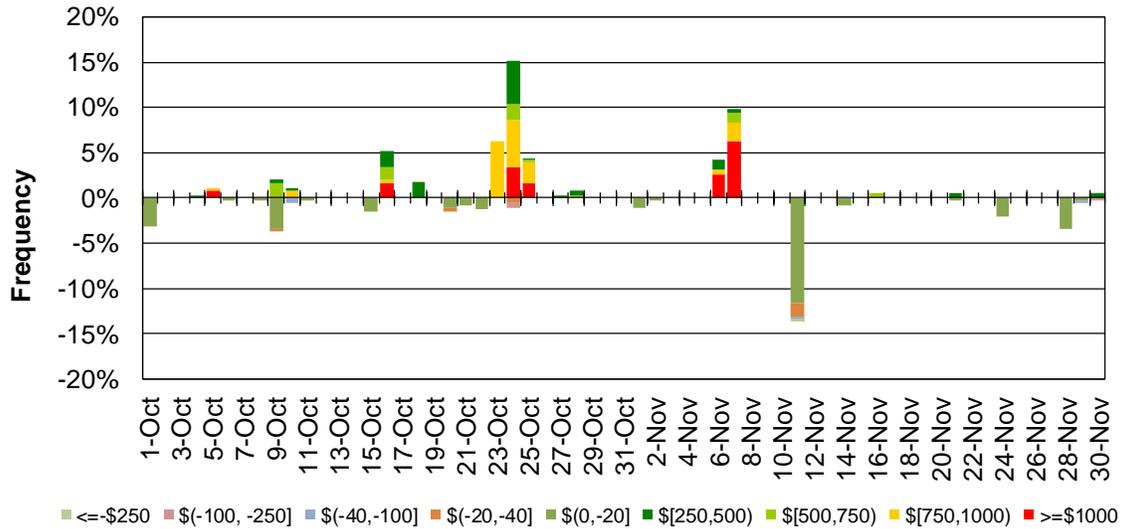

RTD daily prices of the four DLAPs are shown in Figure 5. Table 4 lists the binding constraints along with the associated DLAP locations and the occurrence dates when the binding constraints resulted in relatively high or low DLAP prices. On November 6-7, all four DLAPs were relatively high driven by upward load adjustment, net import reduction, and renewable deviation.

Figure 5: RTD Simple Average LAP Prices (All Hours)


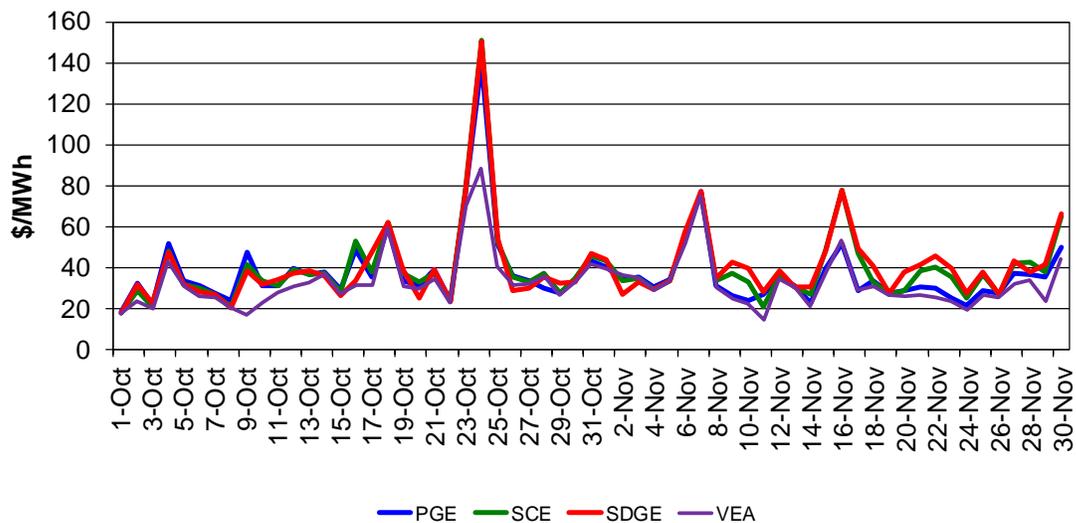


Table 4: RTD Transmission Constraints

DLAP	Date	Transmission Constraint
SCE, SDG&E	November 16-17	OMS 4646120 ELD_MKP_SCIT_NG, SERRANO-SERRANO-500 XFMR

Figure 6 below shows the daily frequency of positive price spikes and negative prices by price range for the default LAPs in RTD. The cumulative frequency of prices above \$250/MWh decreased to 0.76 percent in November from 1.06 percent in October. The cumulative frequency of negative prices edged up to 1.95 percent in November from 1.68 percent in October.

Figure 6: Daily Frequency of RTD LAP Positive Price Spikes and Negative Price

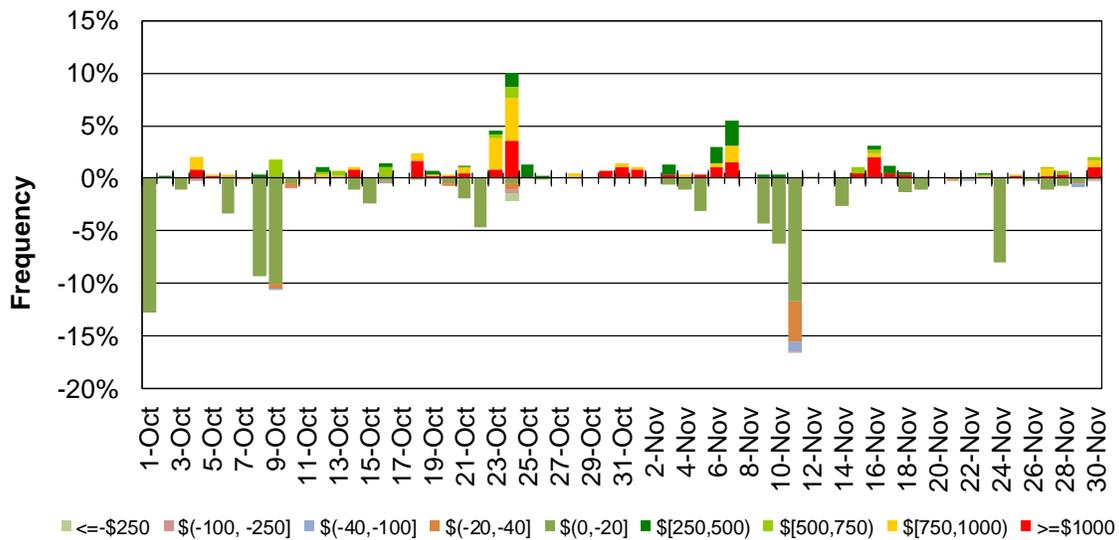


Congestion

Congestion Rents on Interties

Figure 7 below illustrates the daily integrated forward market congestion rents by interties. The cumulative total congestion rent for interties in November skidded to \$6.00 million from \$13.93 million in October. Majority of the congestion rents in November accrued on MALIN500 (50 percent) intertie and Palo Verde (41 percent) intertie.

The congestion rent on MALIN500 dropped to \$2.69 million in November from \$8.62 million in October. The congestion rent on Palo Verde decreased to \$2.45 million in November from \$3.88 million in October.


Figure 7: IFM Congestion Rents by Interties (Import)

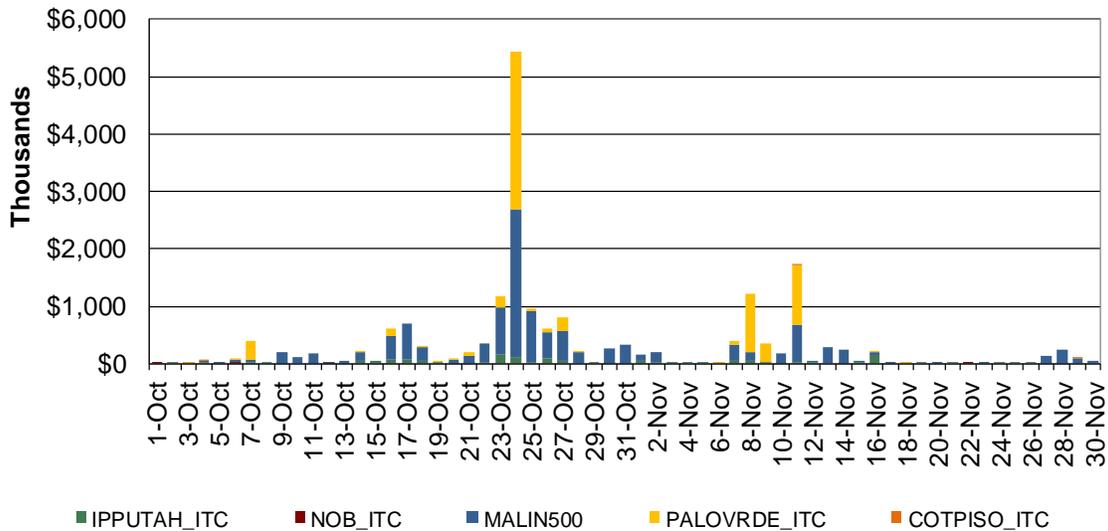

Average Congestion Cost per Load Served

This metric quantifies the average congestion cost for serving one megawatt of load in the ISO system. Figure 8 shows the daily and monthly averages for the day-ahead and real-time markets respectively.

Figure 8: Average Congestion Cost per Megawatt of Served Load

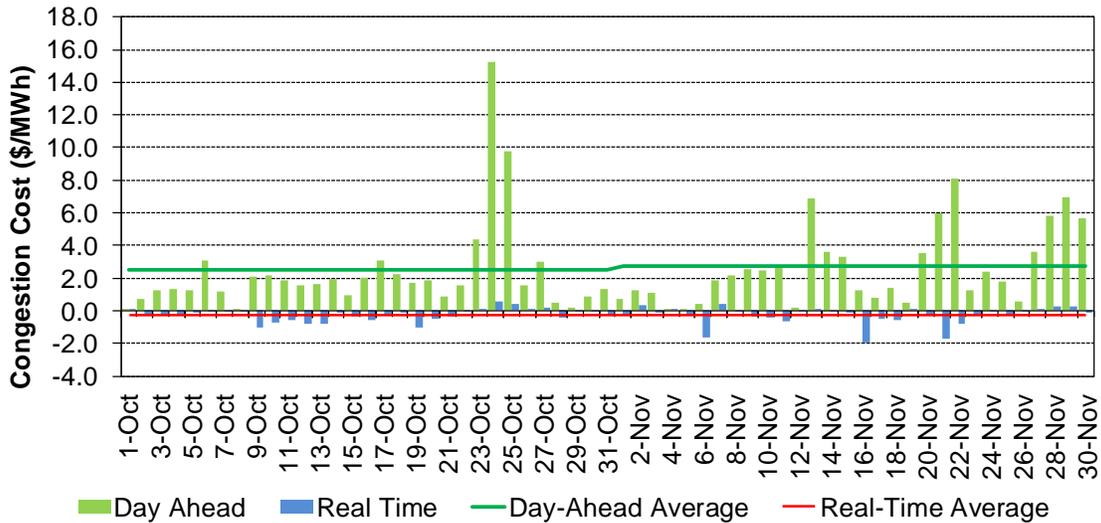


The average congestion cost per MWh of load served in the integrated forward market inched up to \$2.70/MWh in November from \$2.49/MWh in October. The average congestion cost per load served in the real-time market decreased to -\$0.29/MWh in November from -\$0.23/MWh in October.

Congestion Revenue Rights

Figure 9 illustrates the daily revenue adequacy for congestion revenue rights (CRRs) broken out by transmission element. The average CRR revenue deficit in November increased to \$459,465 from the average revenue deficit of \$366,751 in October.

Figure 9: Daily Revenue Adequacy of Congestion Revenue Rights

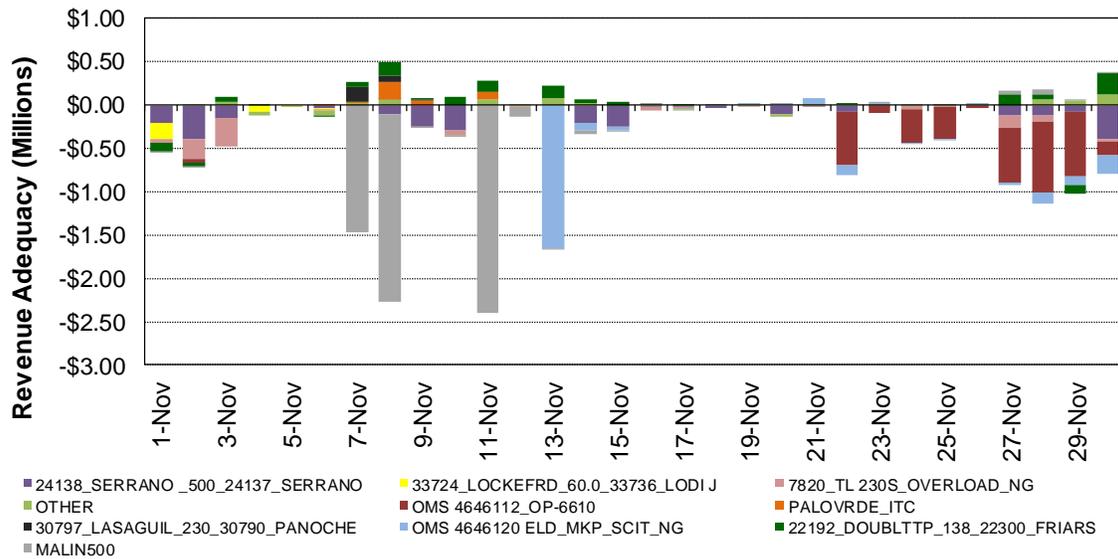


Overall, November experienced a CRR revenue deficit. Revenue shortfalls were observed in most days of November. The main reasons are shown below.

- The intertie MALIN500 was binding in 20 days of this month, resulting in revenue shortfall of \$6.10 million. Malin500 was derated this month due to various outages including the outages of Captin Jack-Olinda 500 kV line, Table Mountain-Tesla 500 kV line, and Vaca Dixon-Tesla 500 kV line.
- The nomogram OMS 4646112_OP-6610 was binding in 11 days of this month, resulting in revenue shortfall of \$3.86 million.

The shares of the revenue surplus and deficit accruing on various congested transmission elements for the reporting period are shown in Figure 10 and the monthly summary for CRR revenue adequacy is provided in Table 5.

Figure 10: CRR Revenue Adequacy by Transmission Element

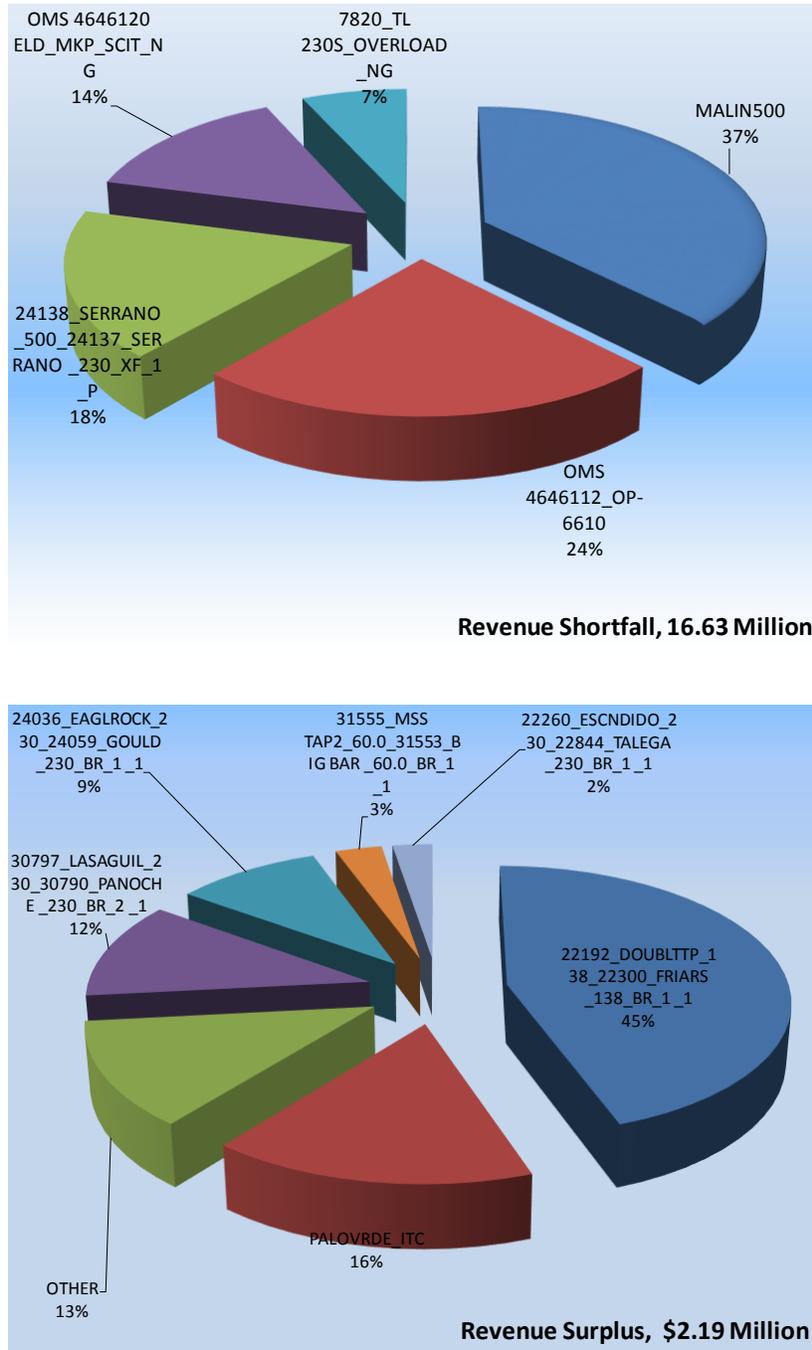

Overall, the total amount collected from the IFM was not sufficient to cover the net payments to congestion revenue right holders and the cost of the exemption for existing rights. The revenue adequacy level was 76.79 percent in November. Out of the total congestion rents, 5.11 percent was used to cover the cost of existing right exemptions. Net total congestion revenues in November were in deficit by \$13.78 million, compared to the deficit of \$11.37 million in October. The auction revenues credited to the balancing account for November were \$5.53 million. As a result, the balancing account for November had a deficit of approximately \$7.98 million, which will be allocated to measured demand.

Table 5: CRR Revenue Adequacy Statistics

IFM Congestion Rents	\$48,059,605.32
Existing Right Exemptions	-\$2,454,799.76
Available Congestion Revenues	\$45,604,805.57
CRR Payments	\$59,388,750.99
CRR Revenue Adequacy	-\$13,783,945.43
Revenue Adequacy Ratio	76.79%
Annual Auction Revenues	\$3,046,545.98
Monthly Auction Revenues	\$2,485,102.64
CRR Settlement Rule	\$275,681.28
Allocation to Measured Demand	-\$7,976,615.52

Ancillary Services

IFM (Day-Ahead) Average Price


Table 6 shows the monthly IFM average ancillary service procurements and the monthly average prices. In November the monthly average procurement decreased for all four types of ancillary services.

Table 6: IFM (Day-Ahead) Monthly Average Ancillary Service Procurement

	Average Procured				Average Price			
	Reg Up	Reg Dn	Spinning	Non-Spinning	Reg Up	Reg Dn	Spinning	Non-Spinning
Nov-17	315	383	716	716	\$8.02	\$6.61	\$5.14	\$0.47
Oct-17	336	394	768	765	\$12.66	\$5.97	\$9.65	\$4.17
Percent Change	-6.27%	-2.91%	-6.83%	-6.44%	-36.62%	10.71%	-46.75%	-88.71%

The monthly average prices increased for regulation down in November. Figure 11 shows the daily IFM average ancillary service prices. The average prices for regulation up, spinning and non-spinning reserves were relatively high on November 7-8 due to high opportunity cost of energy.


Figure 11: IFM (Day-Ahead) Ancillary Service Average Price

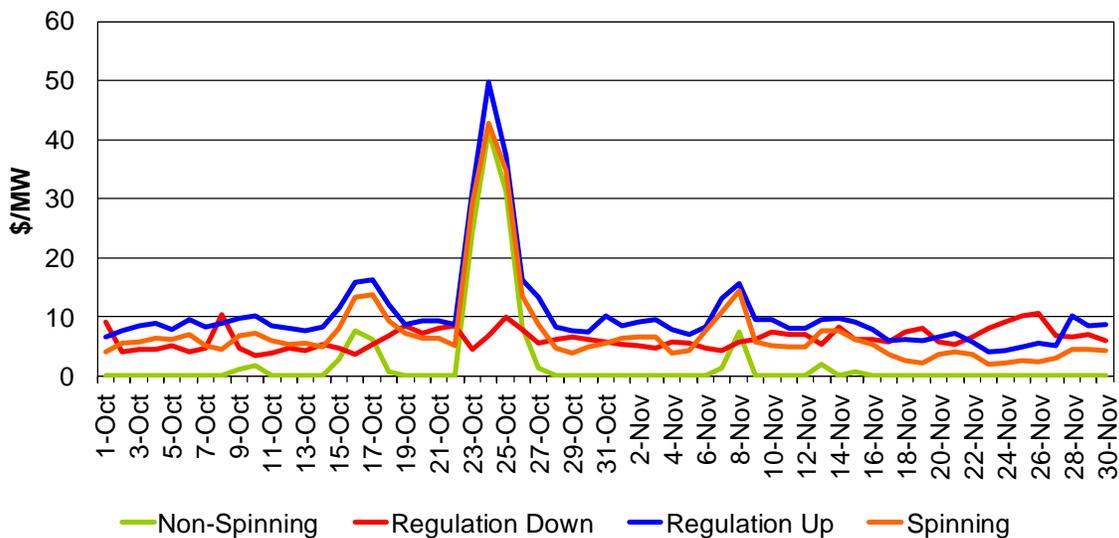

Ancillary Service Cost to Load

The monthly average cost to load dropped to \$0.42/MWh in November from \$0.80/MWh in October. November 7-8 saw relatively high average cost driven by high regulation up, spinning and non-spinning prices on those days in day-ahead market.

Figure 12: System (Day-Ahead and Real-Time) Average Cost to Load

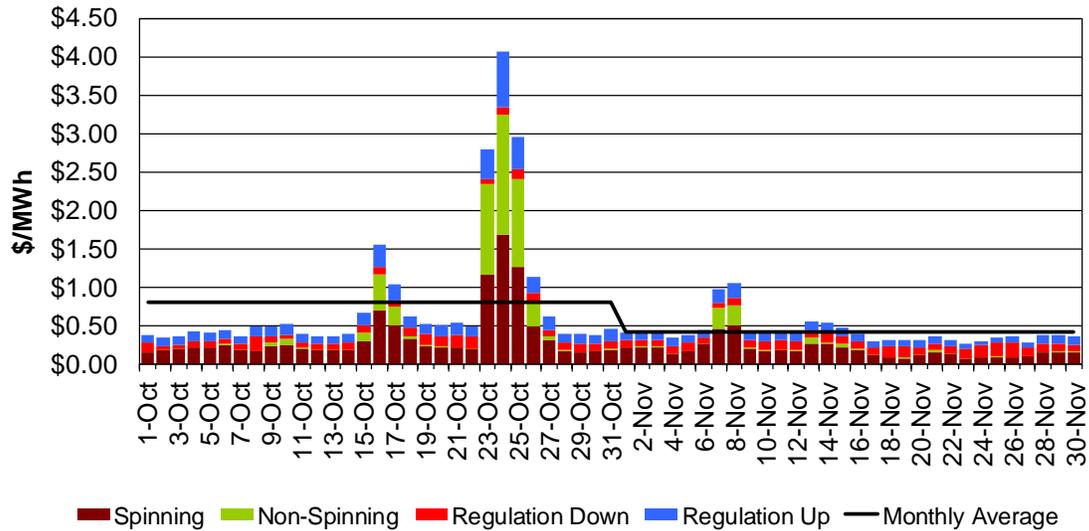


Scarcity Events

The ancillary services scarcity pricing mechanism is triggered when the ISO is not able to procure the target quantity of one or more ancillary services in the IFM and real-time market runs. On November 7, 2017, a non-spin scarcity occurred in the 15-minute market run in the ISO expanded system region for hour ending 19 interval 1. The procurement shortfall was 64 MW or 7.8% of the target procurement quantity in the interval.

Convergence Bidding

Figure 13 below shows the daily average volume of cleared virtual bids in IFM for virtual supply and virtual demand. The cleared virtual supply was well above the cleared demand in most days of November.

Figure 13: Cleared Virtual Bids

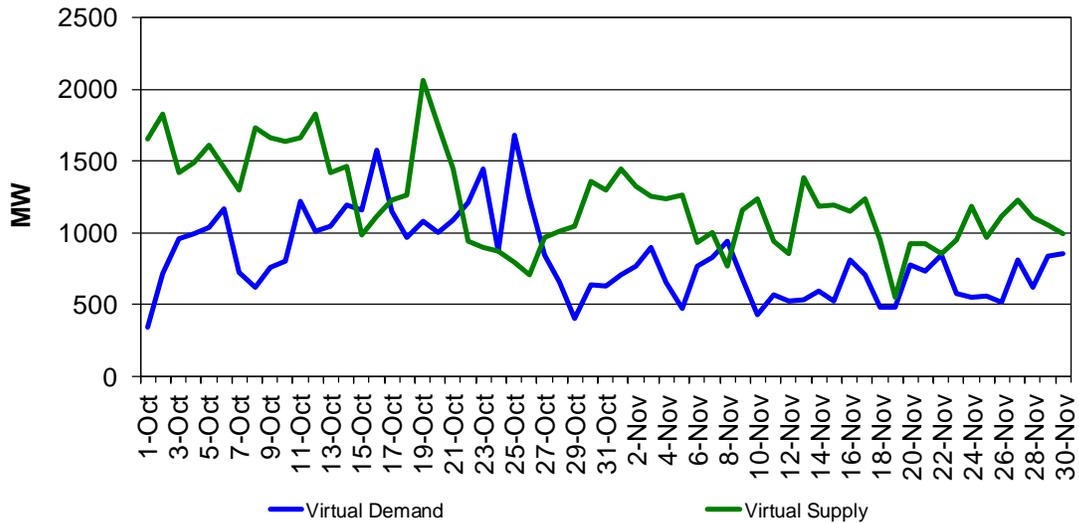

Convergence bidding tends to cause the day-ahead market and real-time market prices to move closer together, or “converge”. Figure 14 shows the energy prices (namely the energy component of the LMP) in IFM, hour ahead scheduling process (HASP), FMM, and RTD.

Figure 14: IFM, HASP, FMM, and RTD Prices


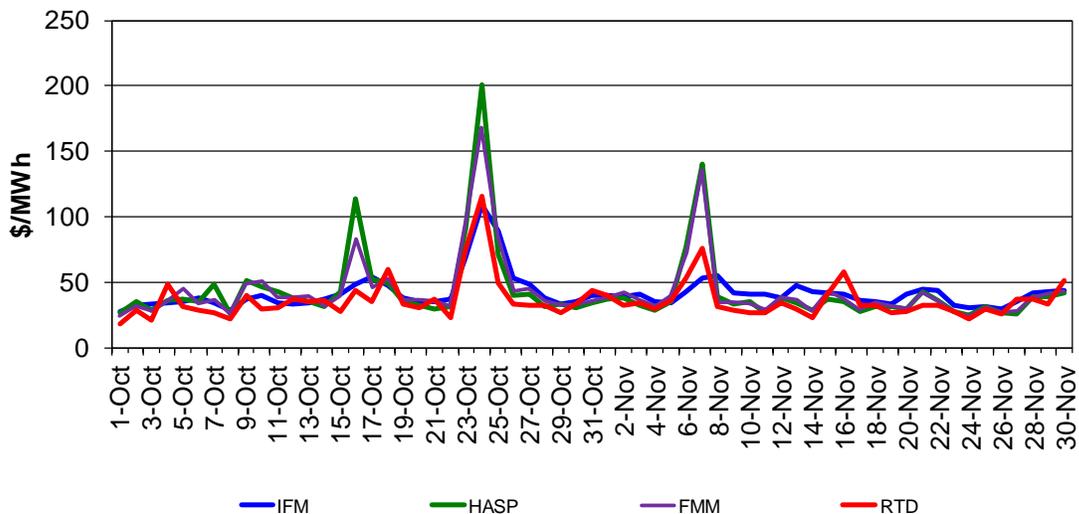


Figure 15 shows the profits that convergence bidders receive from convergence bidding. The total profits from convergence bidding fell to \$2.41 million in November from \$5.11 million in October.

Figure 15: Convergence Bidding Profits

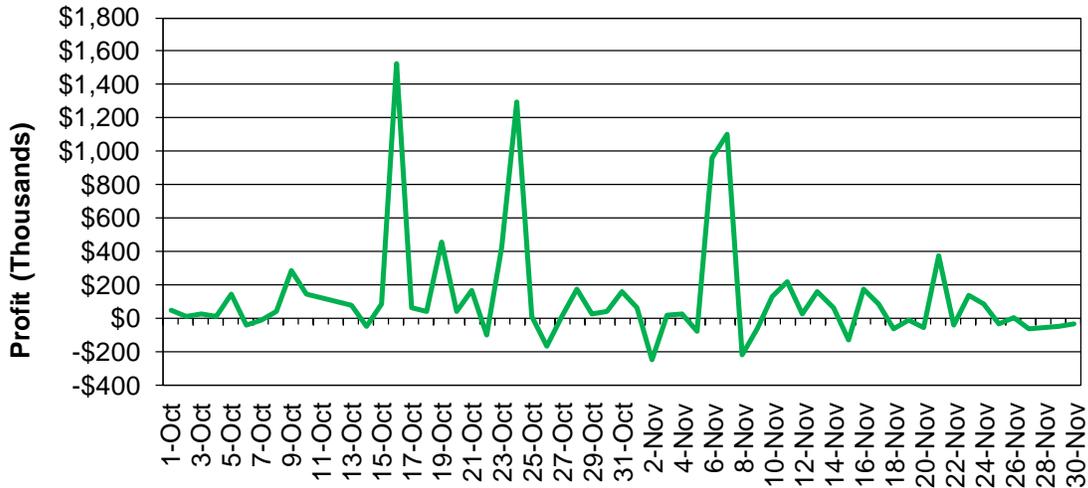

Renewable Generation Curtailment

Figure 16 below shows the monthly wind and solar VERs (variable energy resource) curtailment due to system wide condition or local congestion in RTD. Figure 17 shows the monthly wind and solar VERs (variable energy resource) curtailment by resource type in RTD. Economic curtailment is defined as the resource’s dispatch upper limit minus its RTD schedule when the resource has an economic bid. Dispatch upper limit is the maximum level the resource can be dispatched to when various factors are take into account such as forecast, maximum economic bid, generation outage, and ramping capacity. Self-schedule curtailment is defined as the resource’s self-schedule minus its RTD schedule when RTD schedule is lower than self-schedule. When a VER resource is exceptionally dispatched, then exceptional dispatch curtailment is defined as the dispatch upper limit minus the exceptional dispatch value.

As Figure 16 and Figure 17 below indicate, the renewable curtailment continued to decline in November. The majority of the curtailments was economic.

Figure 16: Renewable Curtailment by Reason


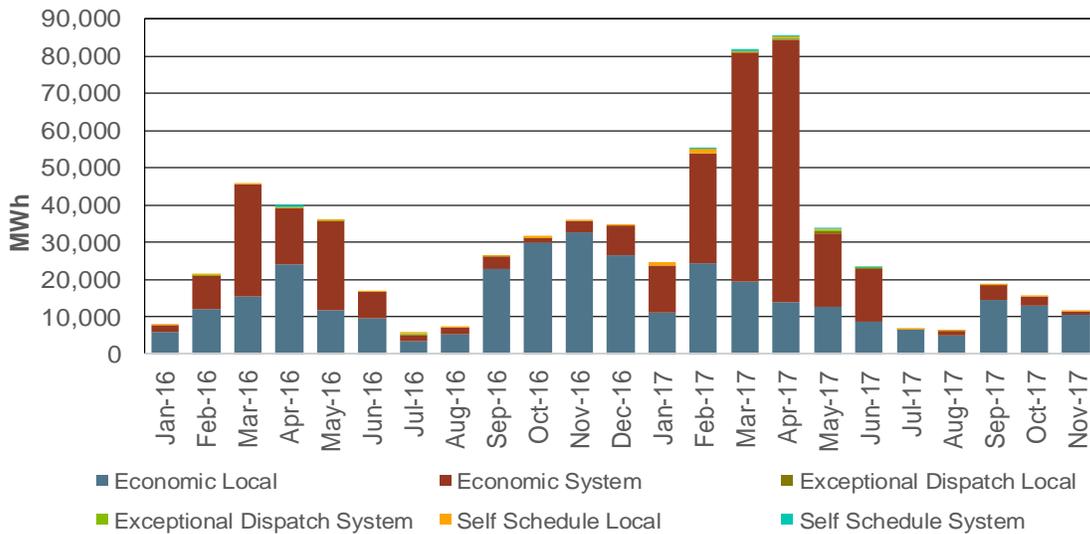


Figure 17: Renewable Curtailment by Resource Type

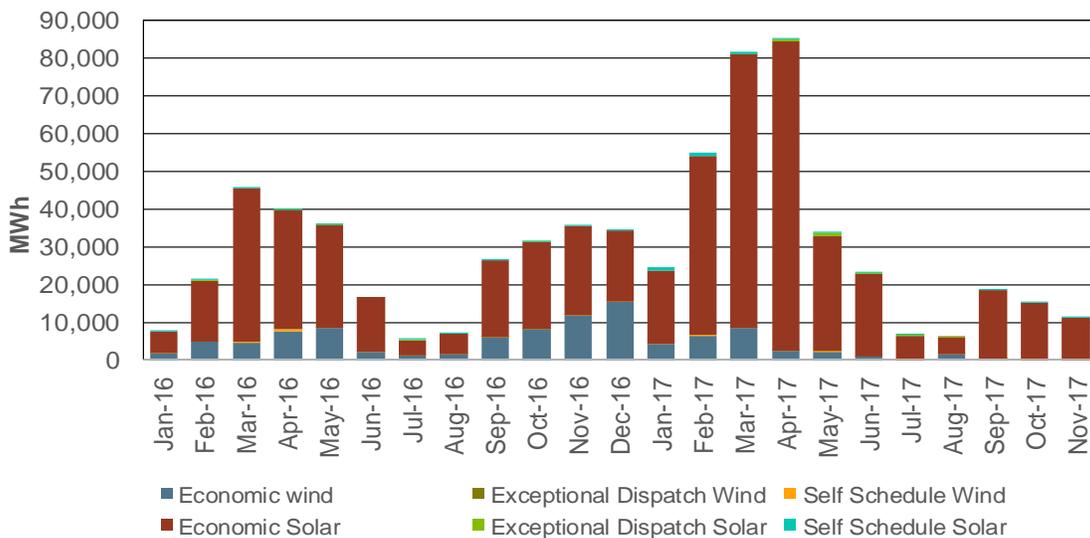

Flexible Ramping Product

On November 1, 2016 the ISO implemented two market products in the 15-minute and 5-minute markets: Flexible Ramping Up and Flexible Ramping Down uncertainty awards. These products provide additional upward and downward flexible ramping capability to account for uncertainty due to demand and renewable forecasting errors. In addition, the existing flexible ramping sufficiency test was extended to ensure feasible ramping capacity for real-time interchange schedules.

Flexible Ramping Product Payment

Figure 18 shows the flexible ramping up and down uncertainty payments. Flexible ramping up uncertainty payment fell to \$0.37 million in November from \$0.80 million in October. Flexible ramping down uncertainty payment decreased to -\$17 in November from \$4,280 in October.

Figure 18: Flexible Ramping Up/down Uncertainty Payment


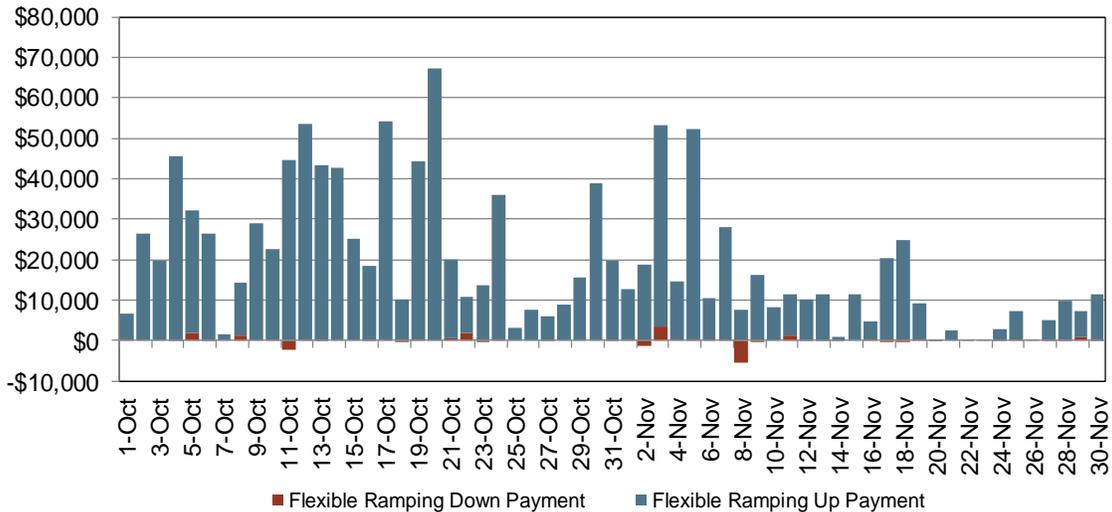


Figure 19 shows the flexible ramping forecast payment. Flexible ramping forecast payment skidded to -\$5,357 this month from \$90,615 in October.

Figure 19: Flexible Ramping Forecast Payment

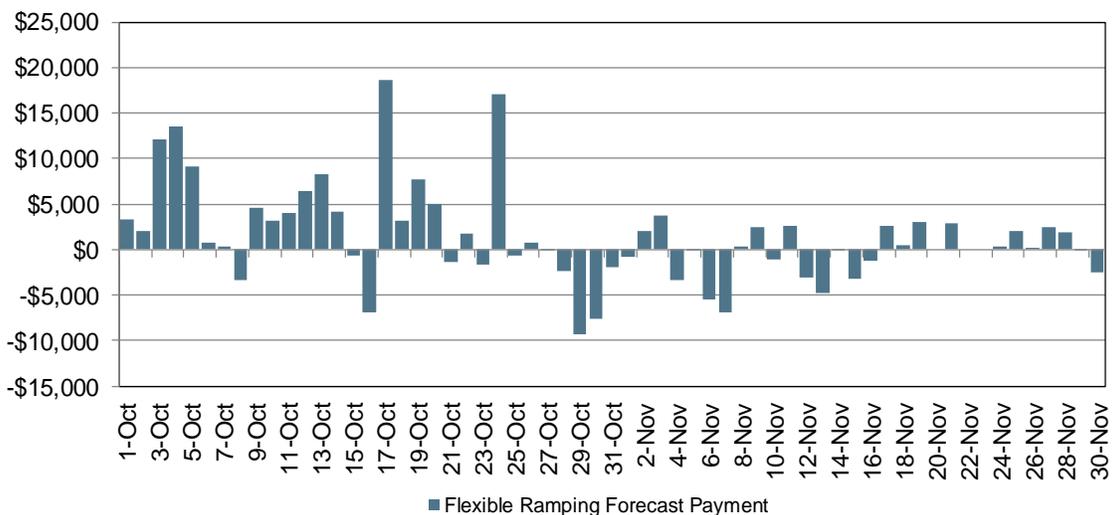

Indirect Market Performance Metrics

Bid Cost Recovery

Figure 20 shows the daily uplift costs due to exceptional dispatch payments. The monthly uplift costs in November declined to \$0.34 million from \$1.31 million in October.

Figure 20: Exceptional Dispatch Uplift Costs

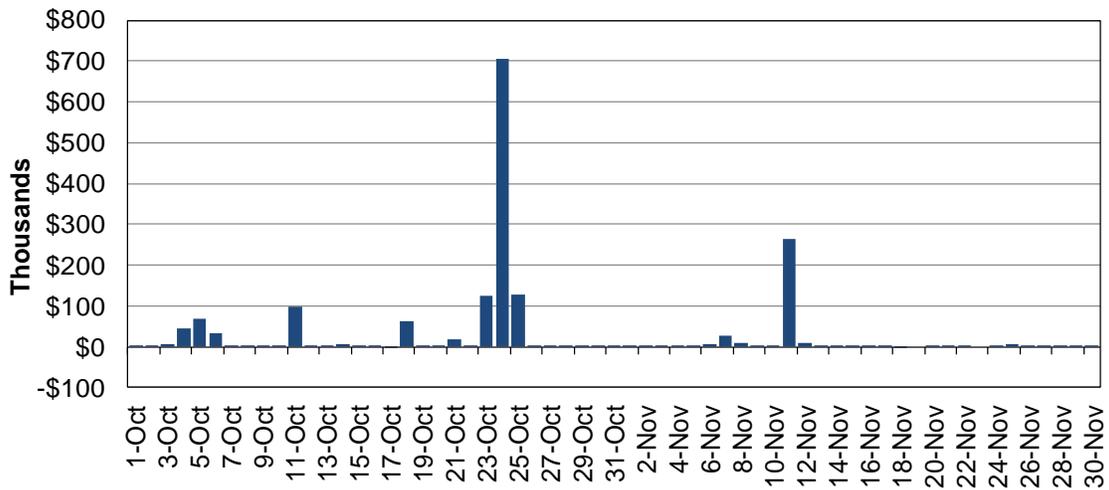


Figure 21 shows the allocation of bid cost recovery payment in the IFM, residual unit commitment (RUC) and RTM markets. The total bid cost recovery for November dropped to \$5.94 million from \$8.03 million in October. Out of the total monthly bid cost recovery payment for the three markets in November, the IFM market contributed 10 percent, RTM contributed 83 percent, and RUC contributed 7 percent of the total bid cost recovery payment.

Figure 21: Bid Cost Recovery Allocation

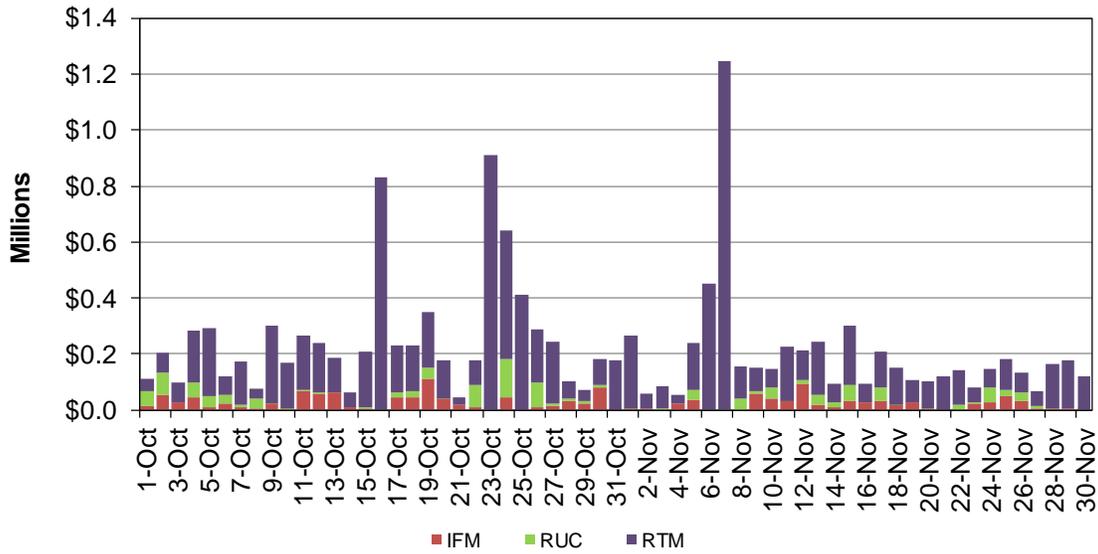


Figure 22 and Figure 23 show the daily and monthly BCR cost by local capacity requirement area (LCR) respectively.

Figure 22: Bid Cost Recovery Allocation by LCR

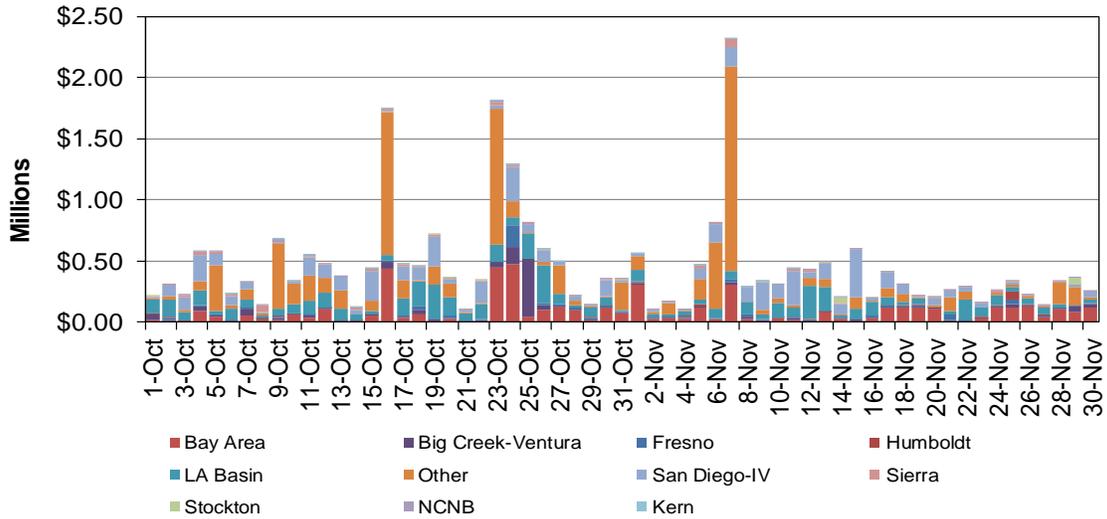


Figure 23: Monthly Bid Cost Recovery Allocation by LCR

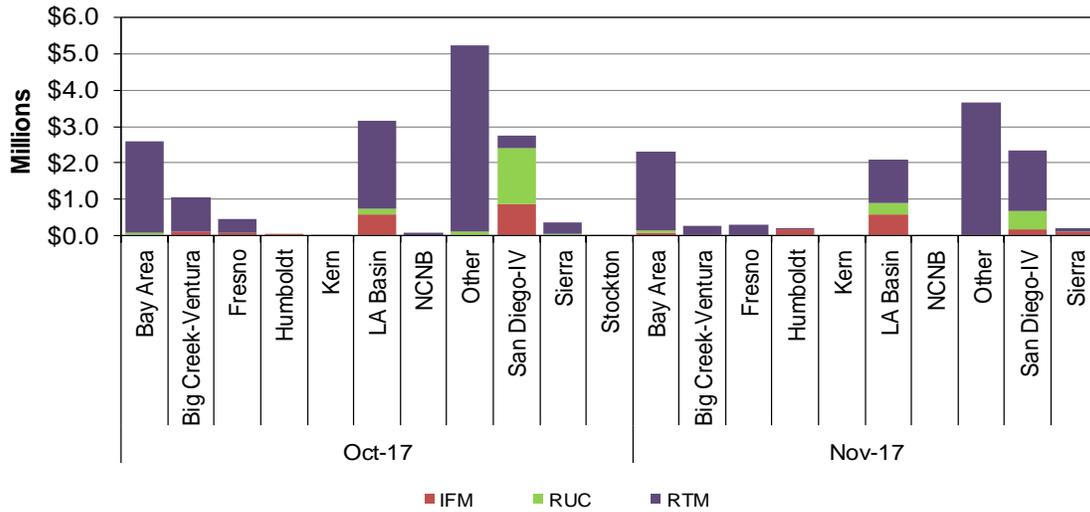


Figure 24 and Figure 25 show the daily and monthly BCR cost by utility distribution company (UDC) respectively.

Figure 24: Bid Cost Recovery Allocation by UDC

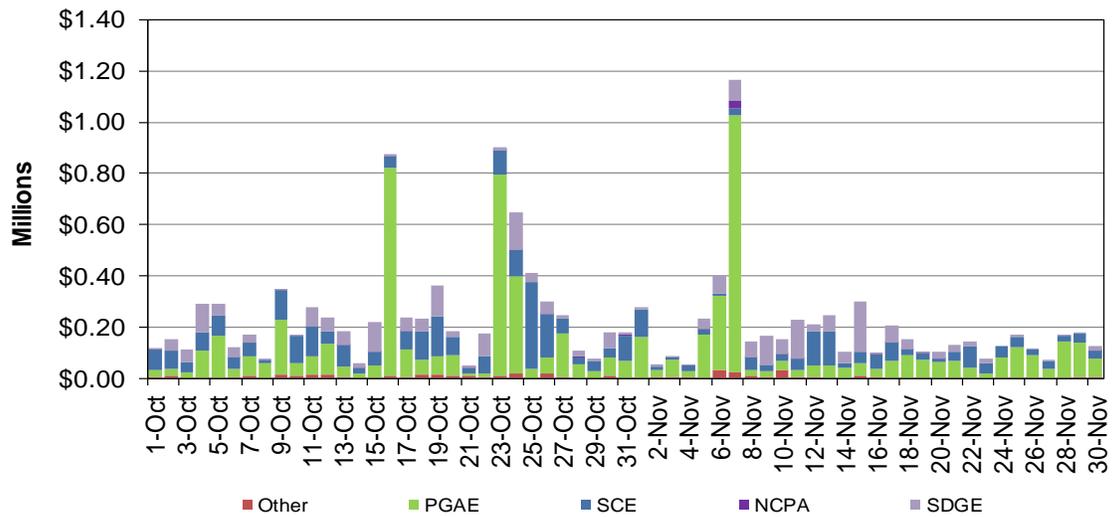


Figure 25: Monthly Bid Cost Recovery Allocation by UDC

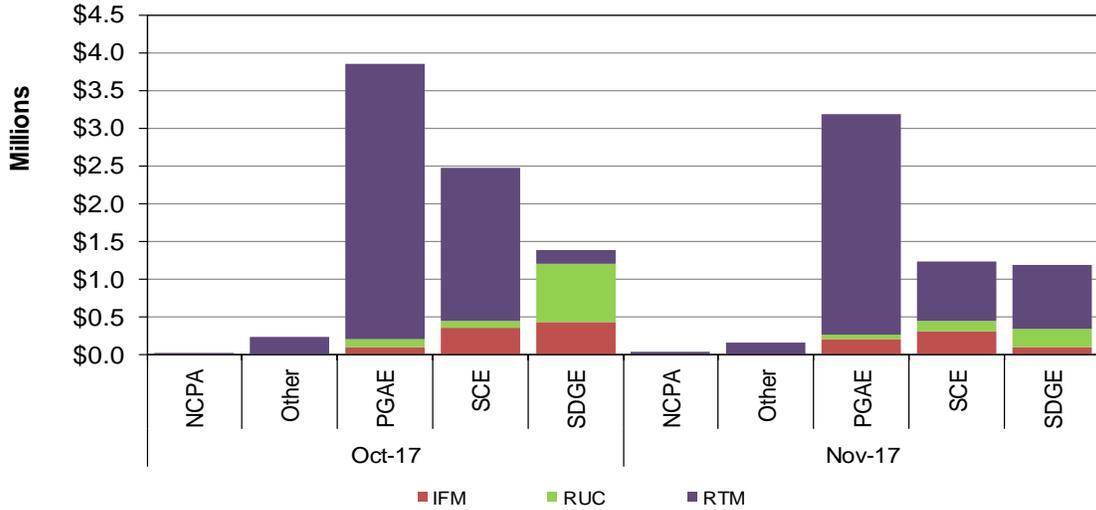


Figure 26 shows the cost related to BCR by cost type in RUC, which in November was mainly driven by minimum load cost (MLC).

Figure 26: Cost in RUC

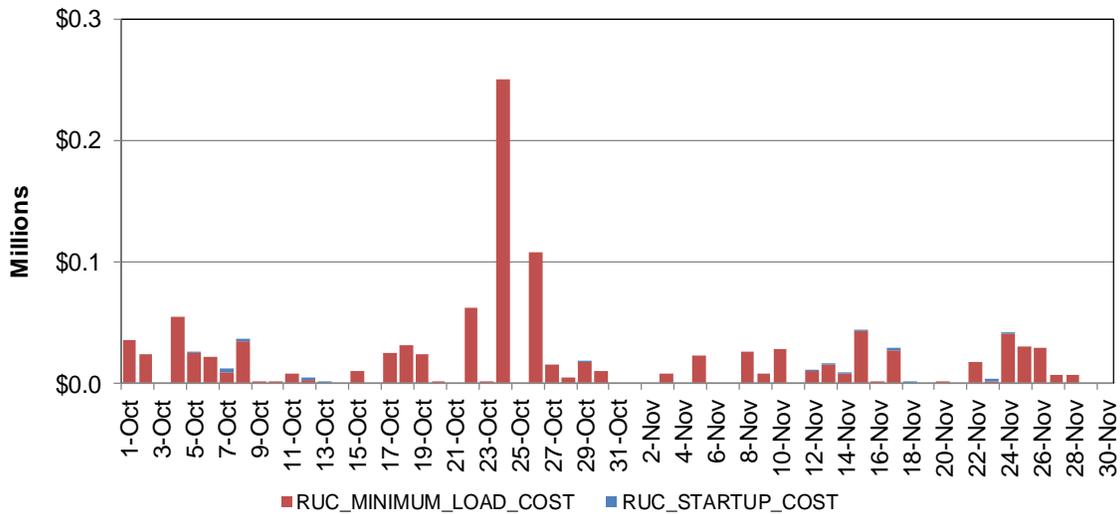


Figure 27 and Figure 28 show the daily and monthly cost related to BCR by type and LCR in RUC respectively.

Figure 27: Cost in RUC by LCR

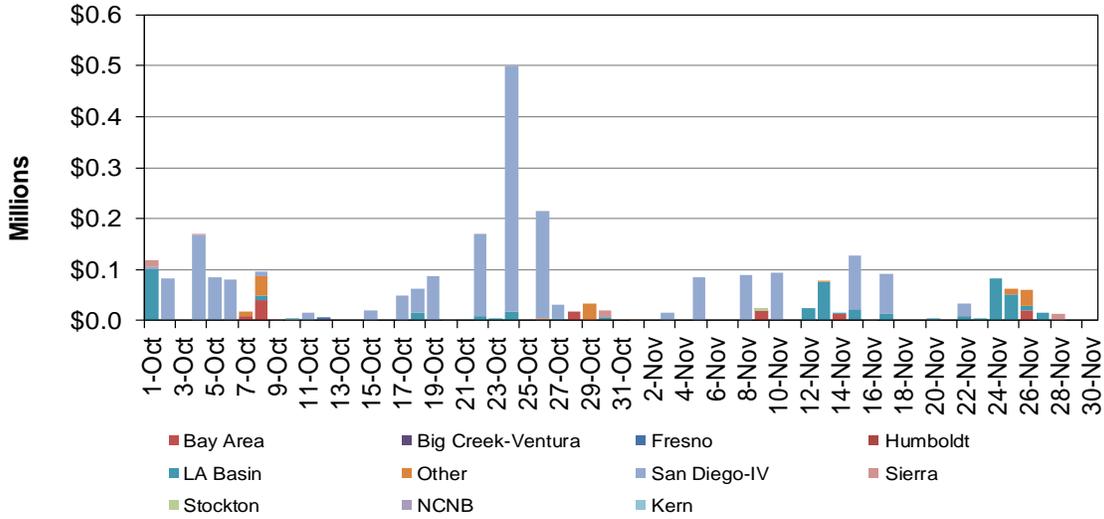


Figure 28: Monthly Cost in RUC by LCR

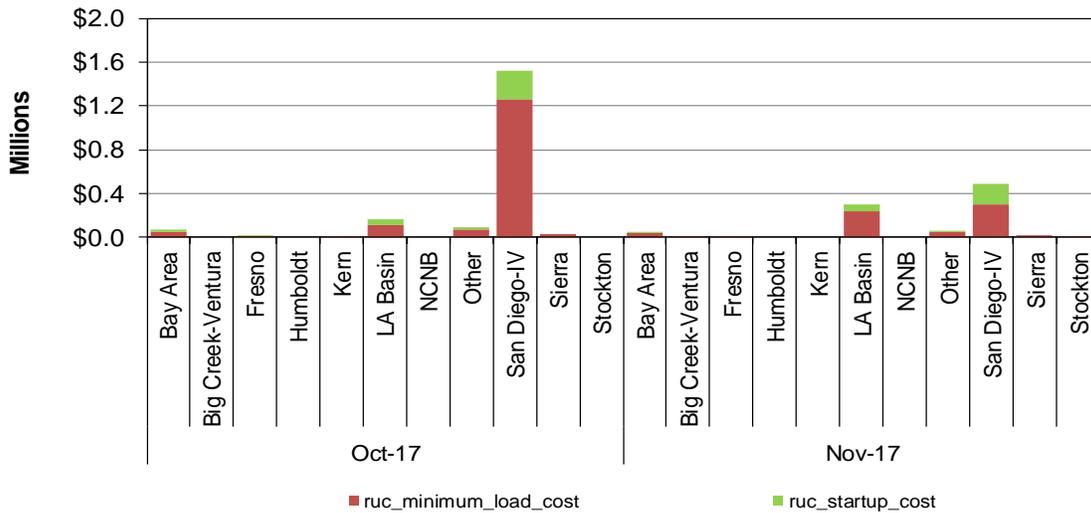


Figure 29 and Figure 30 show the daily and monthly cost related to BCR by type and UDC in RUC respectively.

Figure 29: Cost in RUC by UDC

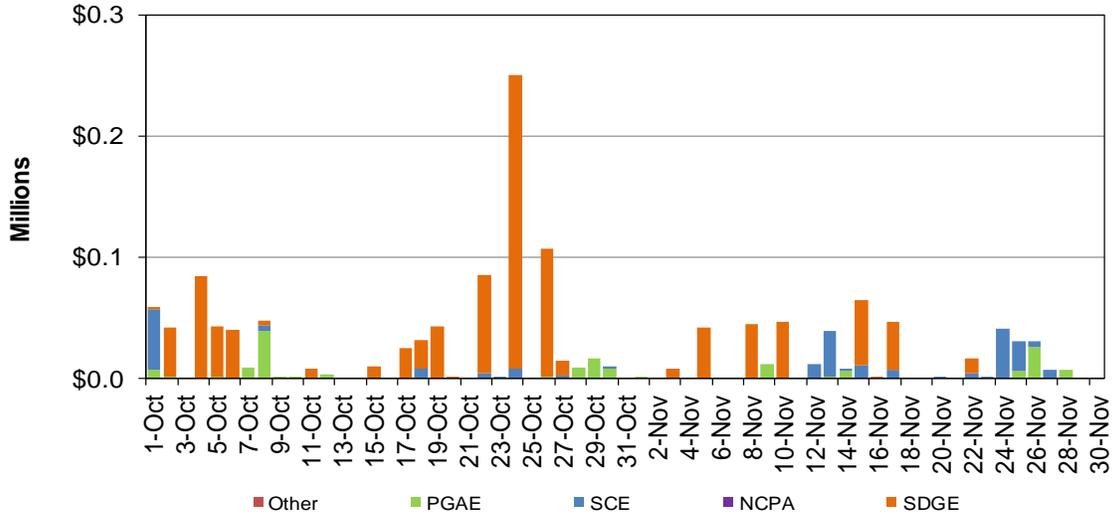


Figure 30: Monthly Cost in RUC by UDC

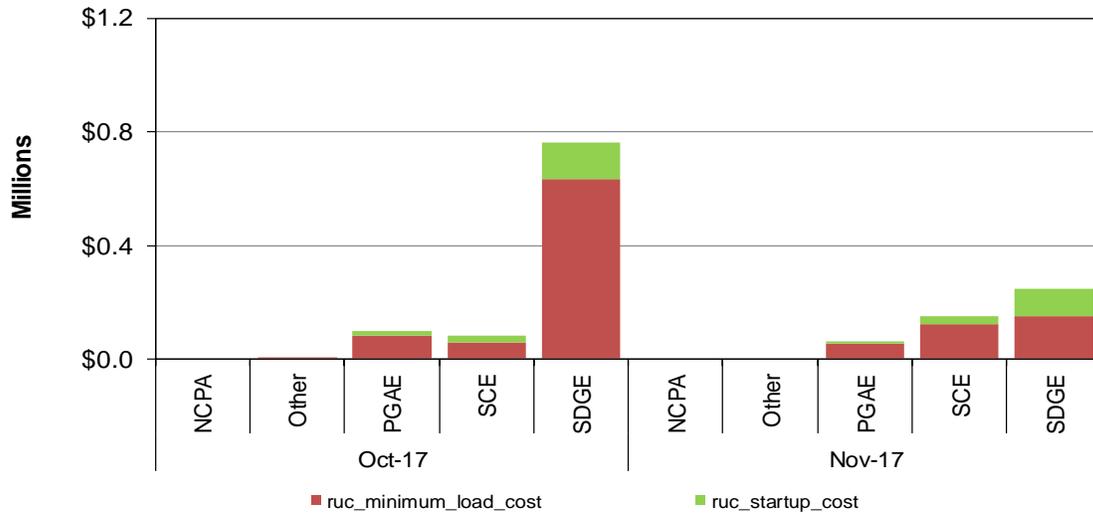


Figure 31 shows the cost related to BCR in real time by cost type. Minimum load cost and energy cost contributed mostly to the real time cost this month.

Figure 31: Cost in Real Time

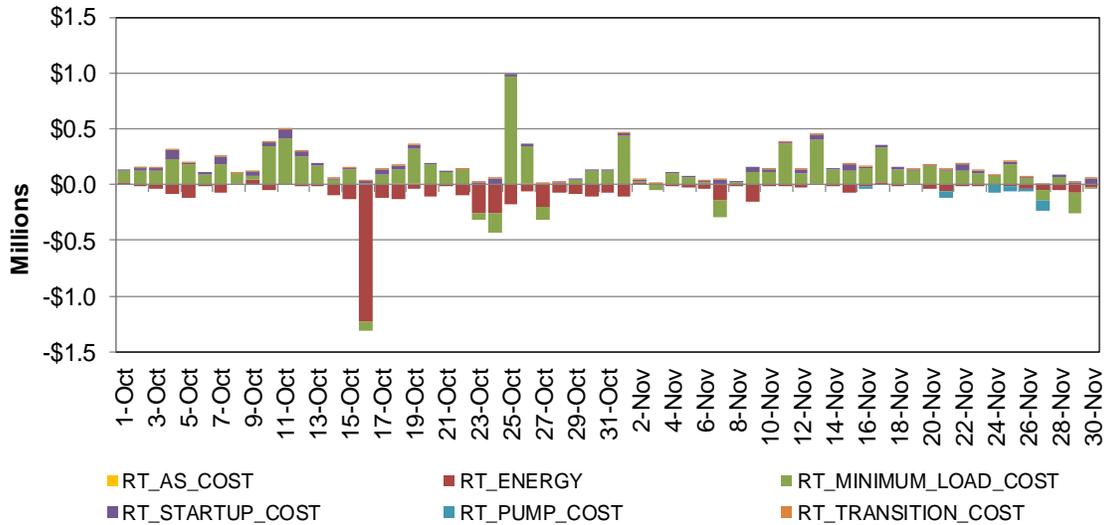


Figure 32 and Figure 33 show the daily and monthly cost related to BCR by type and LCR in real time respectively.

Figure 32: Cost in Real Time by LCR

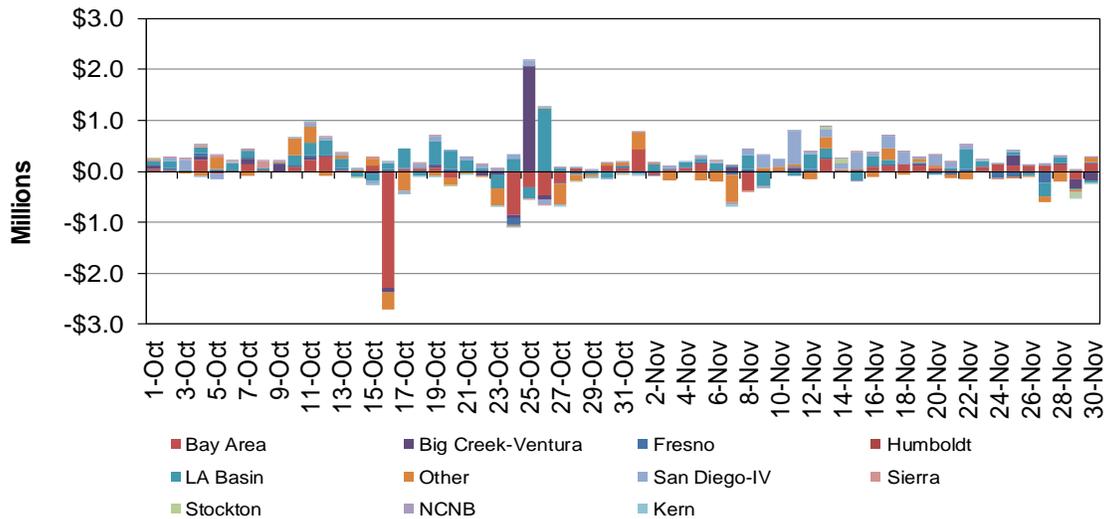


Figure 33: Monthly Cost in Real Time by LCR

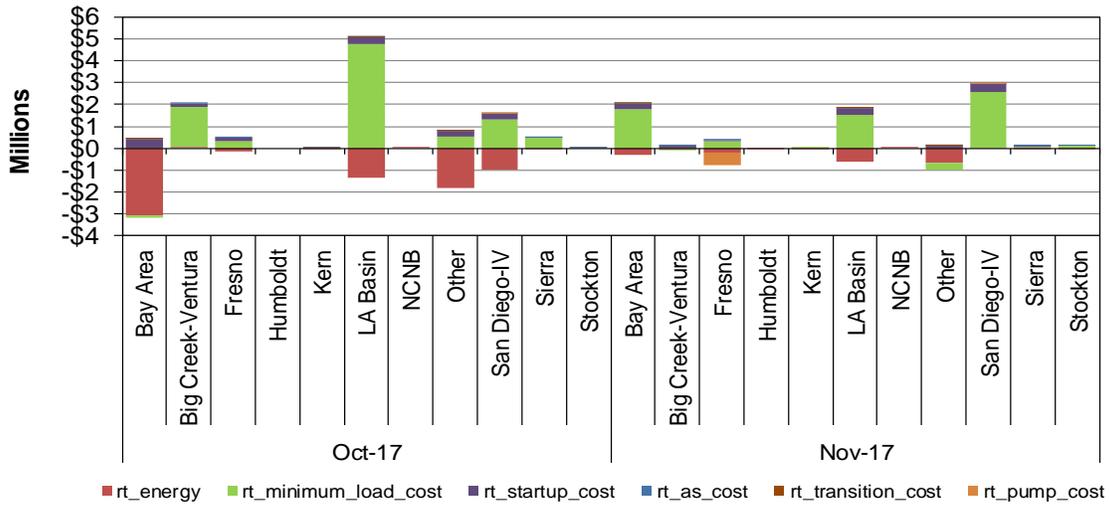


Figure 34 and Figure 35 show the daily and monthly cost related to BCR by type and UDC in Real Time respectively.

Figure 34: Cost in Real Time by UDC

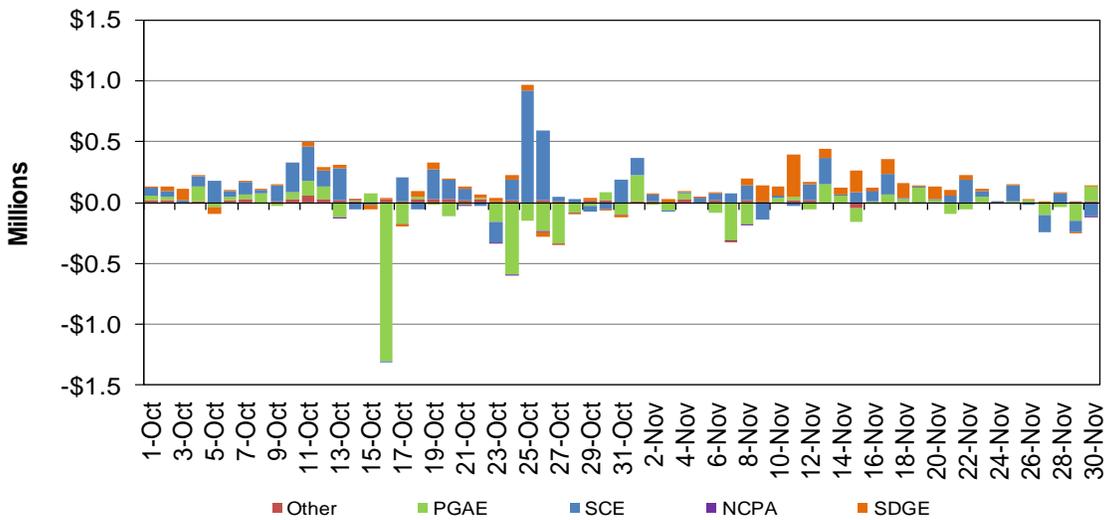


Figure 35: Monthly Cost in Real Time by UDC

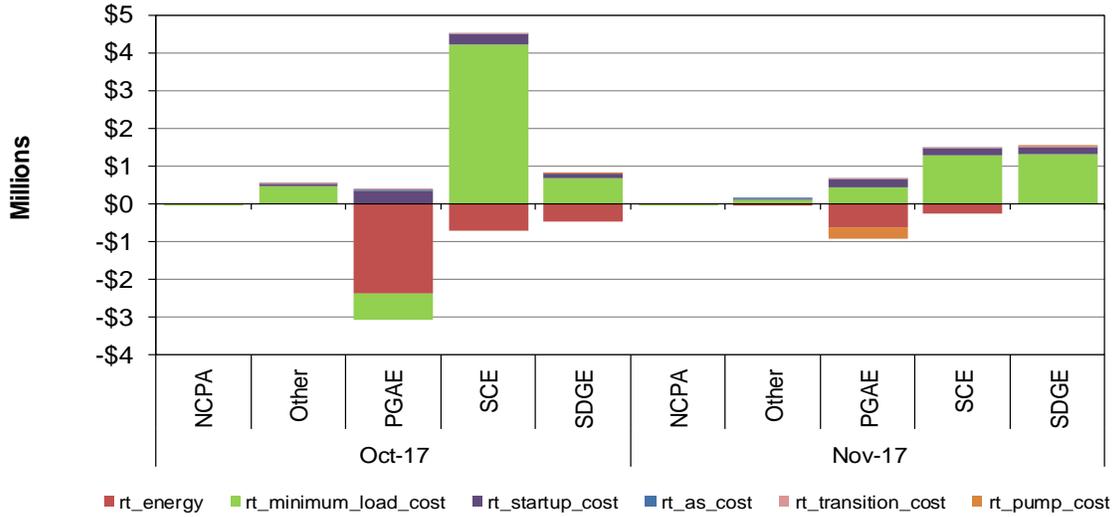


Figure 36 shows the cost related to BCR in IFM by cost type. Minimum Load cost and energy cost contributed largely to the cost in IFM this month.

Figure 36: Cost in IFM

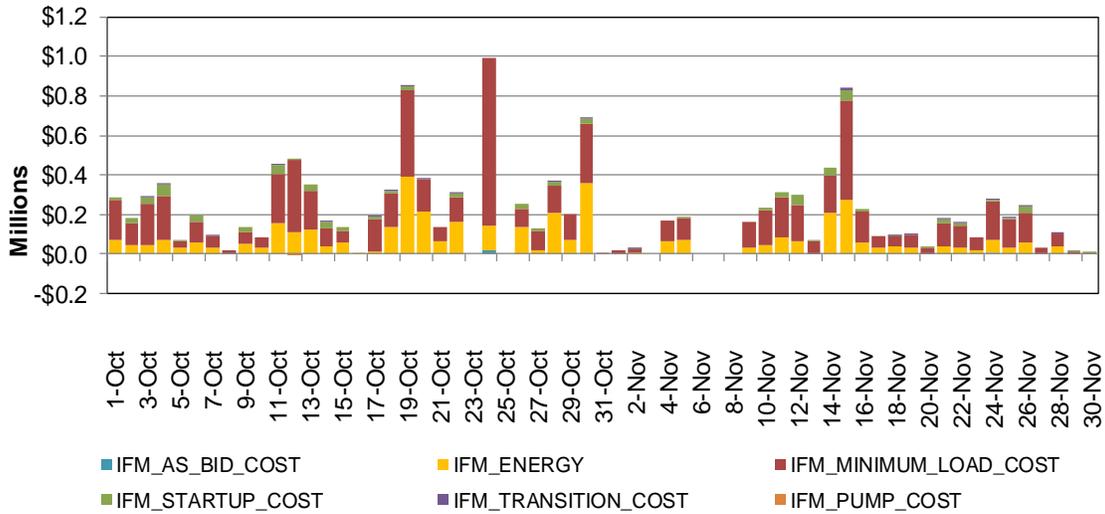


Figure 37 and Figure 38 show the daily and monthly cost related to BCR by type and location in IFM respectively.

Figure 37: Cost in IFM by LCR

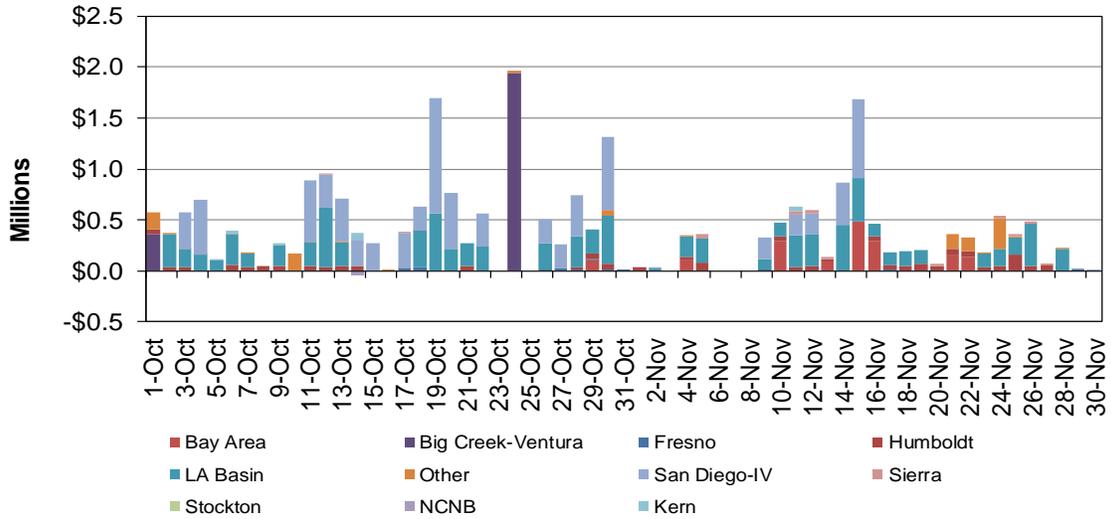


Figure 38: Monthly Cost in IFM by LCR

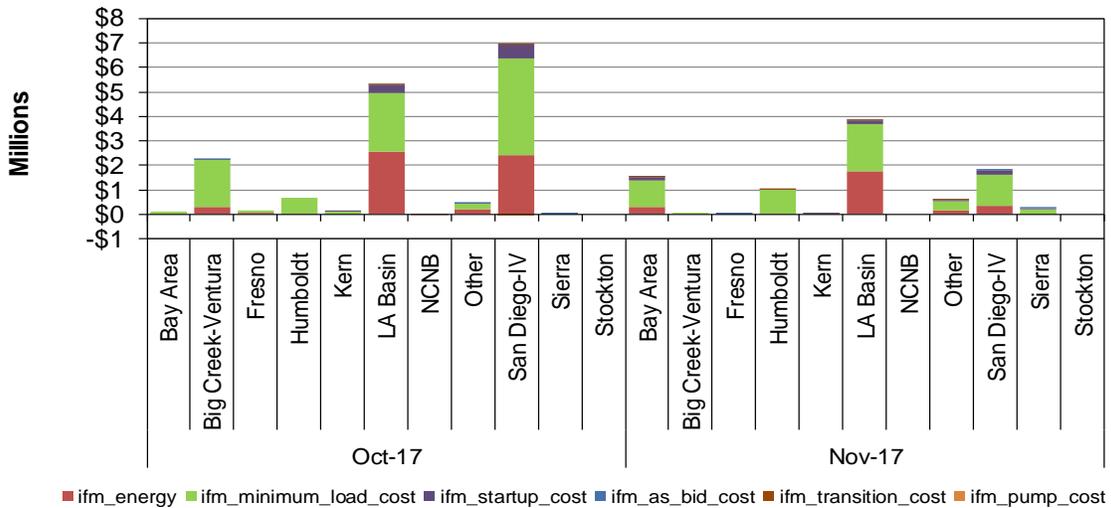


Figure 39 and Figure 40 show the daily and monthly cost related to BCR by type and UDC in IFM respectively.

Figure 39: Cost in IFM by UDC


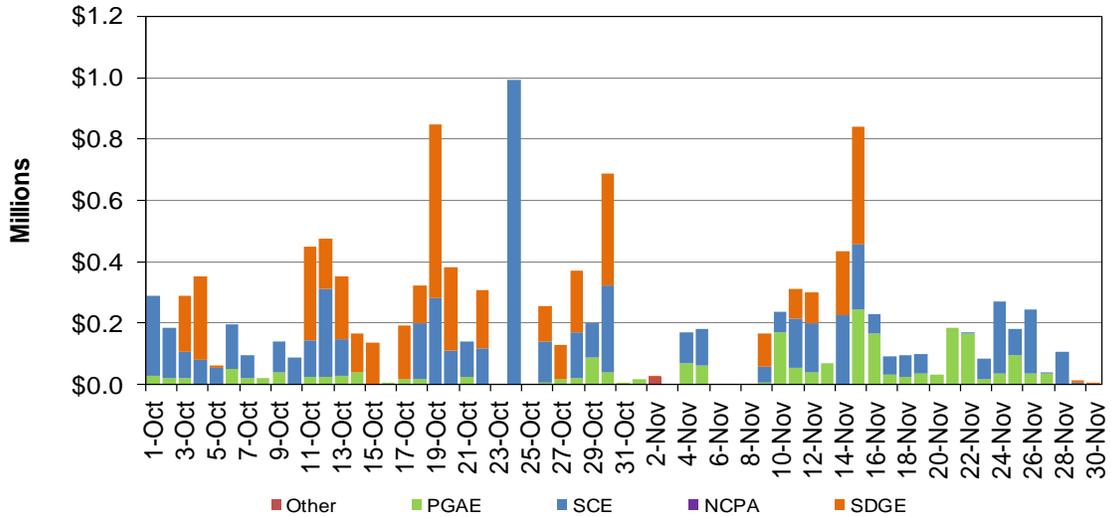



Figure 40: Monthly Cost in IFM by UDC

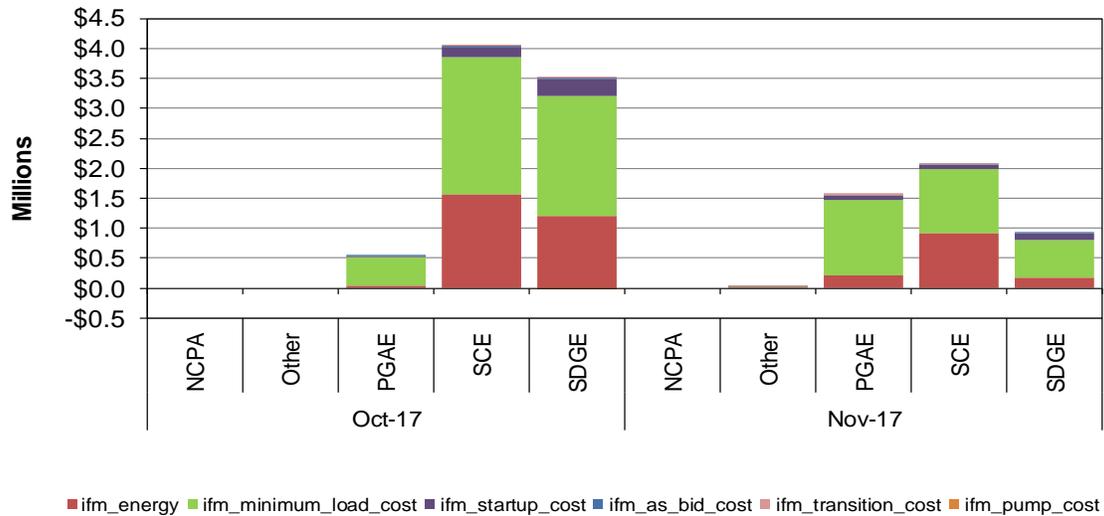

Real-time Imbalance Offset Costs

Figure 41 shows the daily real-time energy and congestion imbalance offset costs. Real-time energy offset cost decreased to \$1.74 million in November from \$4.99 million in October. Real-time congestion offset cost inched up to \$4.99 million in November from \$4.30 million in October.

Figure 41: Real-Time Energy and Congestion Imbalance Offset

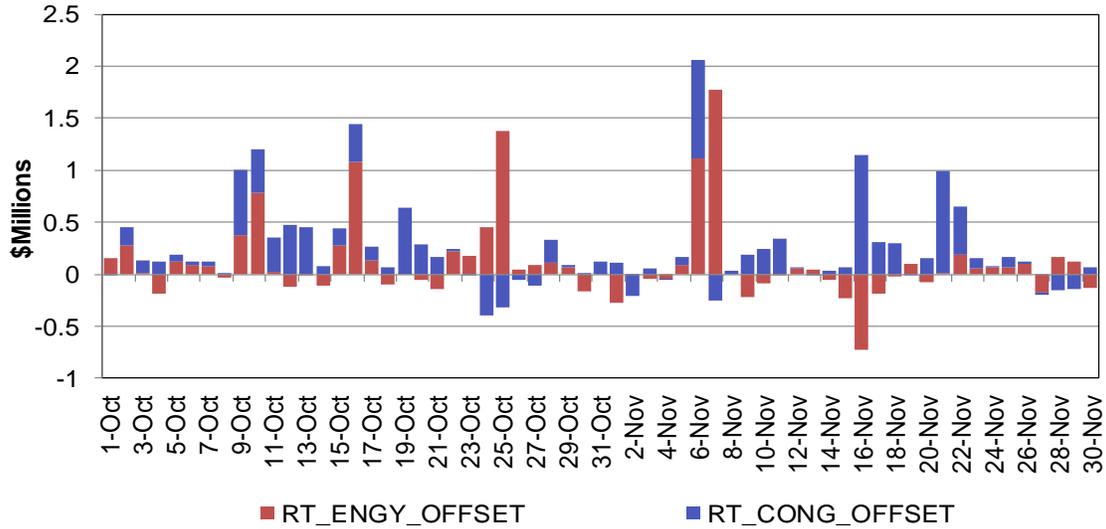

Market Software Metrics

Market performance can be confounded by software issues, which vary in severity levels with the failure of a market run being the most severe.

Market Disruption

A market disruption is an action or event that causes a failure of an ISO market, related to system operation issues or system emergencies.³ Pursuant to section 7.7.15 of the ISO tariff, the ISO can take one or more of a number of specified actions to prevent a market disruption, or to minimize the extent of a market disruption.

There were a total of 39 market disruptions in September. Table 7 lists the number of market disruptions and the number of times that the ISO removed bids (including self-schedules) in any of the following markets in this month. The ISO markets include IFM, RUC, FMM and RTD processes.


Table 7: Summary of Market Disruption

Type of CAISO Market	Market Disruption or Reportable	Removal of Bids (including Self-Schedules)
Day-Ahead		
IFM	0	0
RUC	0	0
Real-Time		
FMM Interval 1	4	0
FMM Interval 2	3	0
FMM Interval 3	1	0
FMM Interval 4	4	0
Real-Time Dispatch	27	0

Figure 42 shows the frequency of IFM, HASP (FMM interval 2), FMM (intervals 1, 3 and 4), and RTD failures. On November 16, one HASP, three FMM and 6 RTD disruptions occurred due to application not being running. On November 20, one HASP, two FMM and 6 RTD disruptions occurred due to application not being running.

³ These system operation issues or system emergencies are referred to in Sections 7.6 and 7.7, respectively, of the ISO tariff.

Figure 42: Frequency of Market Disruption

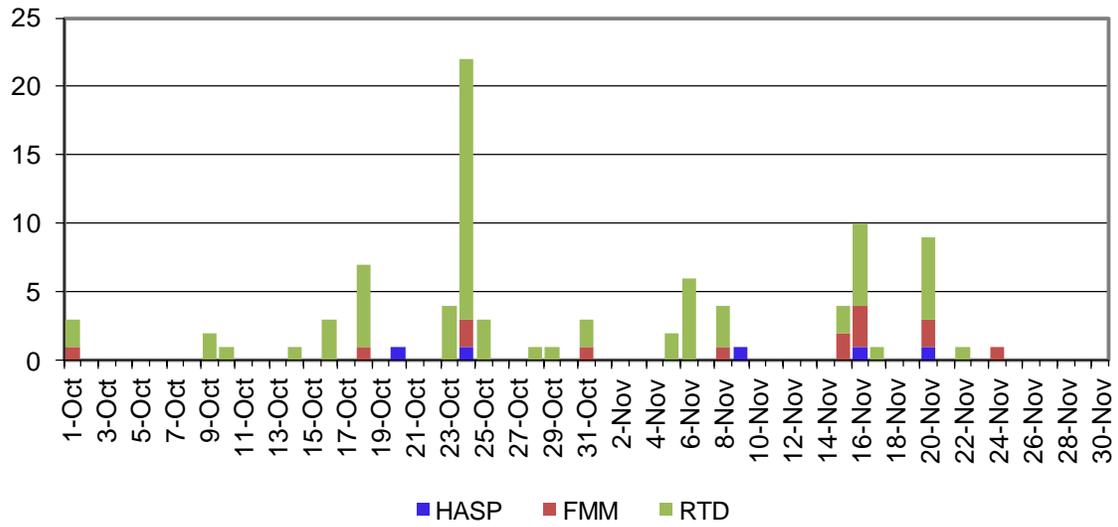

Manual Market Adjustment

Exceptional Dispatch

Figure 43 shows the daily volume of exceptional dispatches, broken out by market type: real-time incremental dispatch and real-time decremental dispatch. The real-time exceptional dispatches are among one of the following types: a unit commitment at physical minimum; an incremental dispatch above the day-ahead schedule and a decremental dispatch below the day-ahead schedule.

The total volume of exceptional dispatch in November increased to 67,953 MWh from 61,883 MWh in October.

Figure 43: Total Exceptional Dispatch Volume (MWh) by Market Type

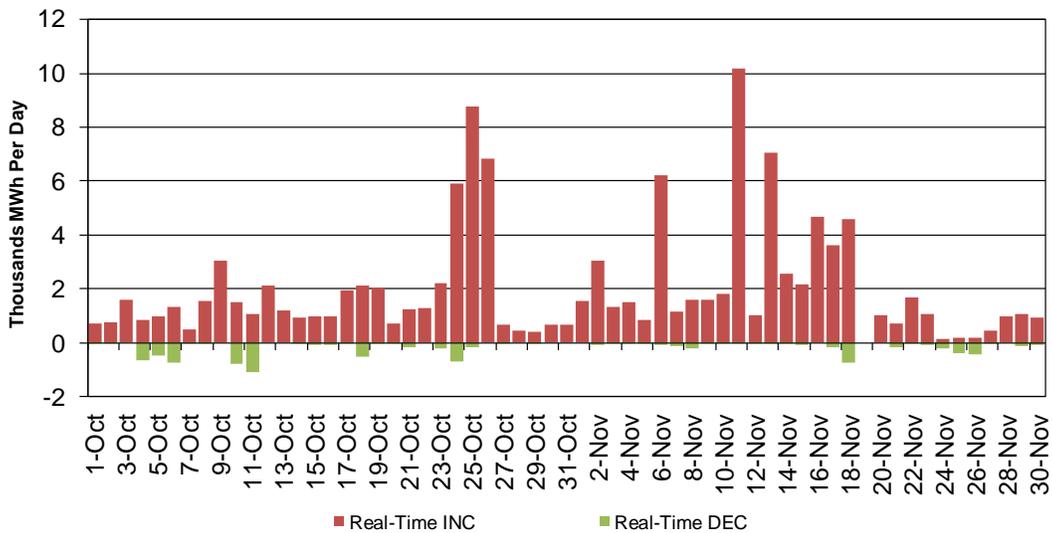


Figure 44 shows the volume of the exceptional dispatch broken out by reason.⁴ The majority of the exceptional dispatch volumes in November were driven by load forecast uncertainty (26 percent), planned transmission outage and constraint (52 percent), and unit testing (6 percent).

⁴ For details regarding the reasons for exceptional dispatch please read the white paper at this link: <http://www.caiso.com/1c89/1c89d76950e00.html>.

Figure 44: Total Exceptional Dispatch Volume (MWh) by Reason


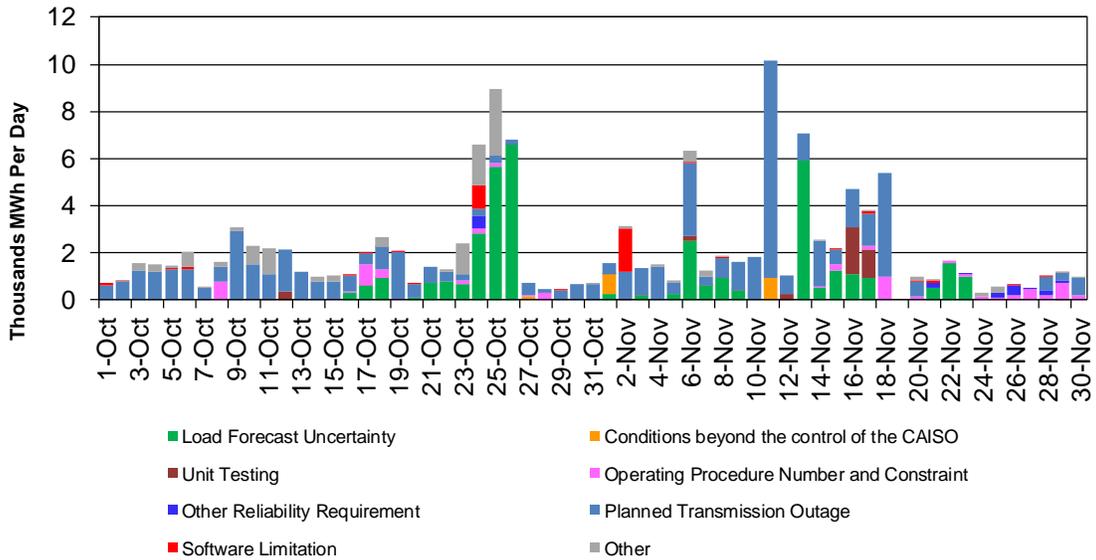


Figure 45 shows the total exceptional dispatch volume as a percent of load, along with the monthly average. The monthly average percentage rose to 0.40 percent in November from 0.31 percent in October.

Figure 45: Total Exceptional Dispatch as Percent of Load

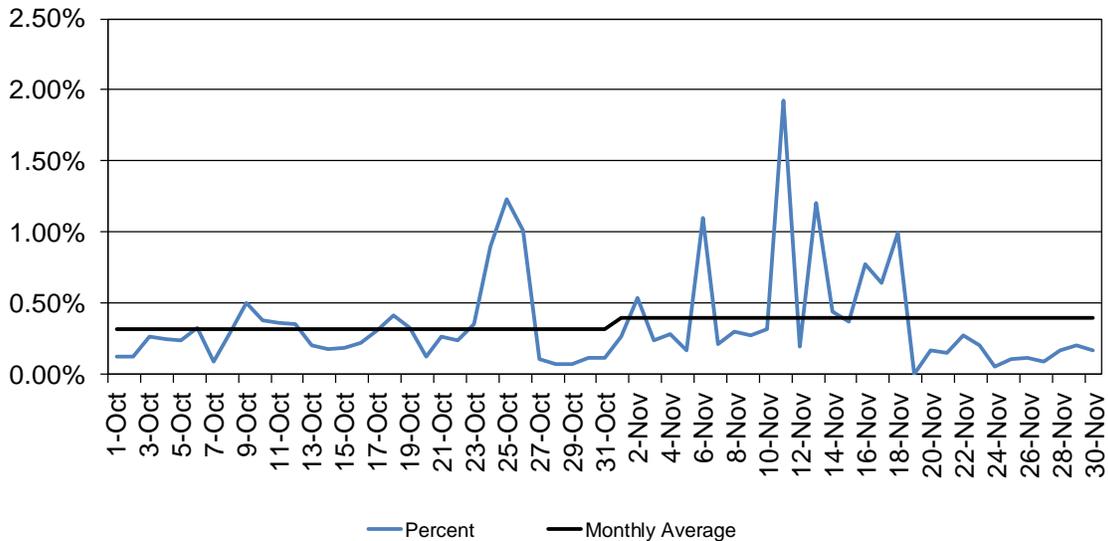

Energy Imbalance Market

On November 1, 2014, the California Independent System Operator Corporation (ISO) and Portland-based PacifiCorp fully activated the Energy Imbalance Market (EIM). This real-time market is the first of its kind in the West. EIM covers six western states: California, Oregon, Washington, Utah, Idaho and Wyoming.

On December 1, 2015, NV Energy, the Nevada-based utility successfully began participating in the western Energy Imbalance Market (EIM). On October 1, 2016, Phoenix-based Arizona Public Service (AZPS) and Puget Sound Energy (PSEI) of Washington State successfully began full participation in the western Energy Imbalance Market.

On October 1, 2017, Portland General Electric Company (PGE) became the fifth western utility to successfully begin full participation in the western Energy Imbalance Market (EIM). PGE joins Arizona Public Service, Puget Sound Energy, NV Energy, PacifiCorp and the ISO, together serving over 38 million consumers in eight states: California, Arizona, Oregon, Washington, Utah, Idaho, Wyoming and Nevada.

Figure 46 shows daily simple average ELAP prices for PacifiCorp east (PACE), PacifiCorp West (PACW), NV Energy (NEVP), Arizona Public Service (AZPS), Puget Sound Energy (PSEI), and Portland General Electric Company (PGE) for all hours in FMM. The prices for AZPS and NEVP were elevated on November 6-7 due to upward load adjustment, net import reduction, generation outage, and renewable deviation.

Figure 46: EIM Simple Average LAP Prices (All Hours) in FMM

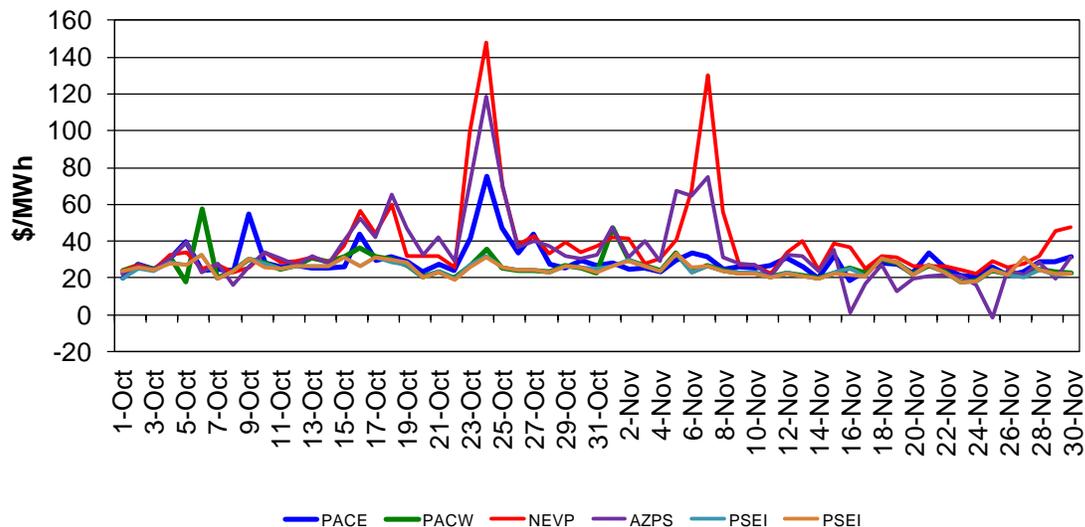


Figure 47 shows daily simple average ELAP prices for PACE, PACW, NEVP, AZPS, PSEI, and PGE for all hours in RTD. The prices for AZPS and NEVP were elevated on November 7 driven by upward load adjustment, net import reduction, and renewable deviation.

Figure 47: EIM Simple Average LAP Prices (All Hours) in RTD

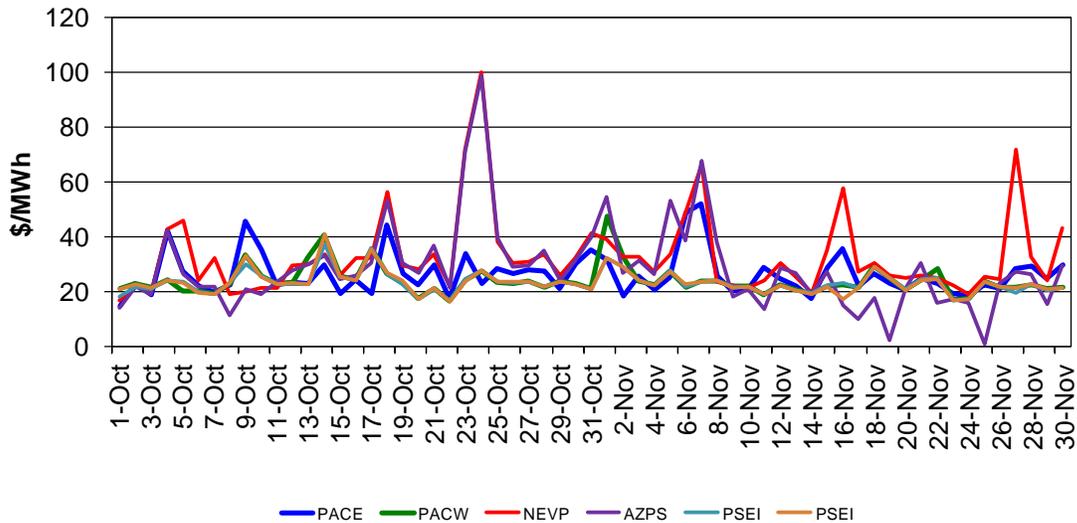


Figure 48 shows the daily price frequency for prices above \$250/MWh and negative prices in FMM for PACE, PACW, NEVP, AZPS, PSEI, and PGE. The cumulative frequency of prices above \$250/MWh inched down to 0.35 percent in November from 0.67 percent in October. The cumulative frequency of negative prices increased to 1.15 percent in November from 0.52 percent in October.

Figure 48: Daily Frequency of EIM LAP Positive Price Spikes and Negative Prices in FMM

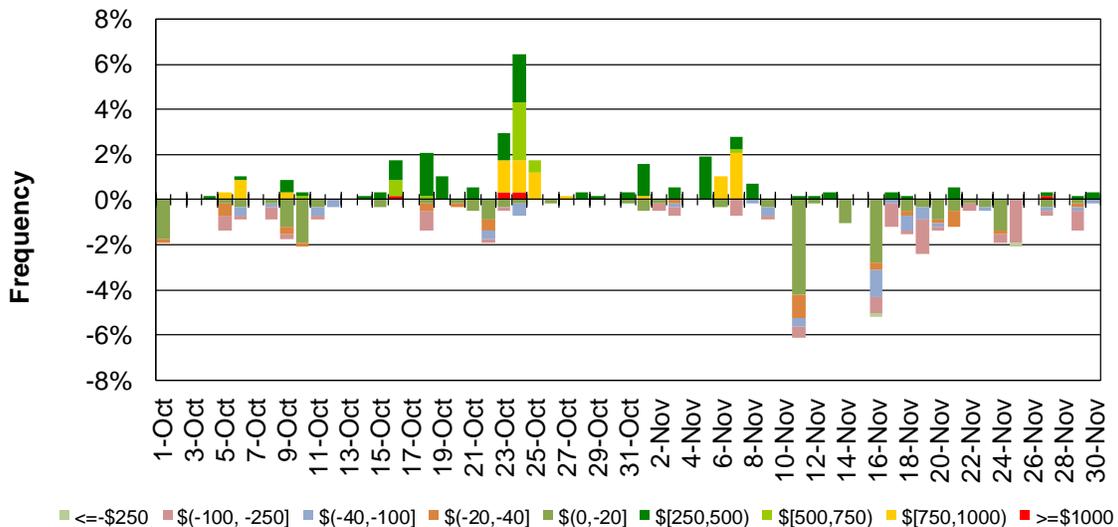


Figure 49 shows the daily price frequency for prices above \$250/MWh and negative prices in RTD for PACE, PACW, NEVP, AZPS, PSEI, and PGE. The cumulative frequency of prices above \$250/MWh edged down to 0.31 percent in November from 0.49 percent in October. The cumulative frequency of negative prices rose to 1.71 percent in November from 1.27 percent in October.

Figure 49: Daily Frequency of EIM LAP Positive Price Spikes and Negative Prices in RTD

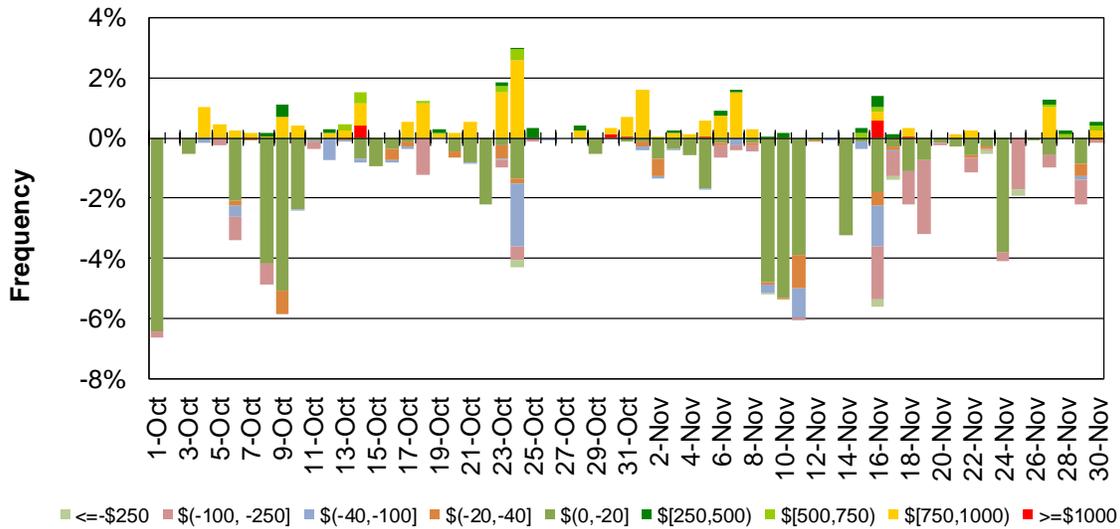


Figure 50 shows the daily volume of EIM transfer for CAISO in FMM. “Import” represents the total EIM transfer from other balancing areas (BAs) into CAISO. “Export” represents the total EIM transfer out of CAISO to other BAs in FMM.

Figure 50: EIM Transfer for CAISO in FMM

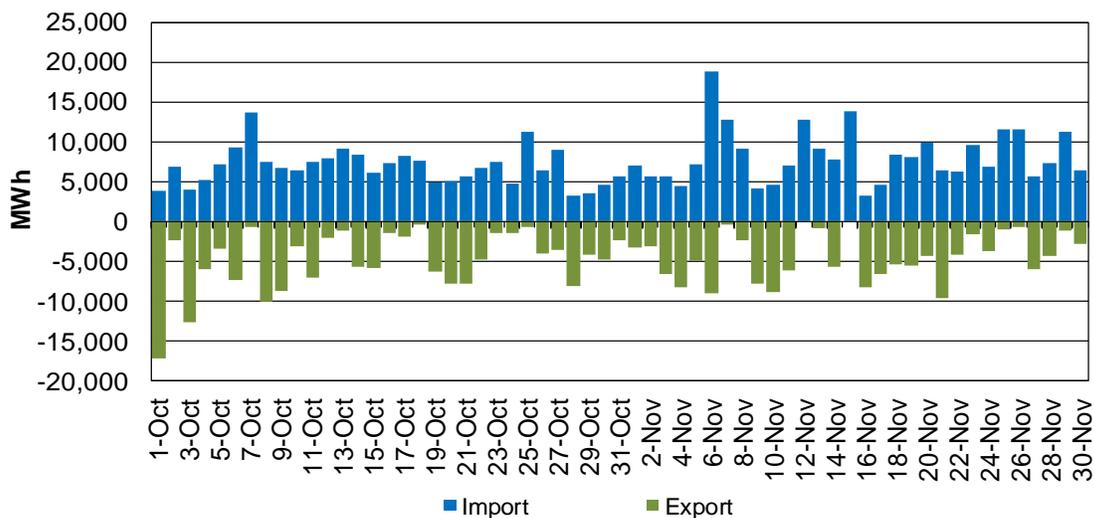


Figure 51 shows the daily volume of EIM transfer for PACE in FMM. Figure 52 shows the daily volume of EIM transfer for PACW in FMM.

Figure 51: EIM Transfer for PACE in FMM

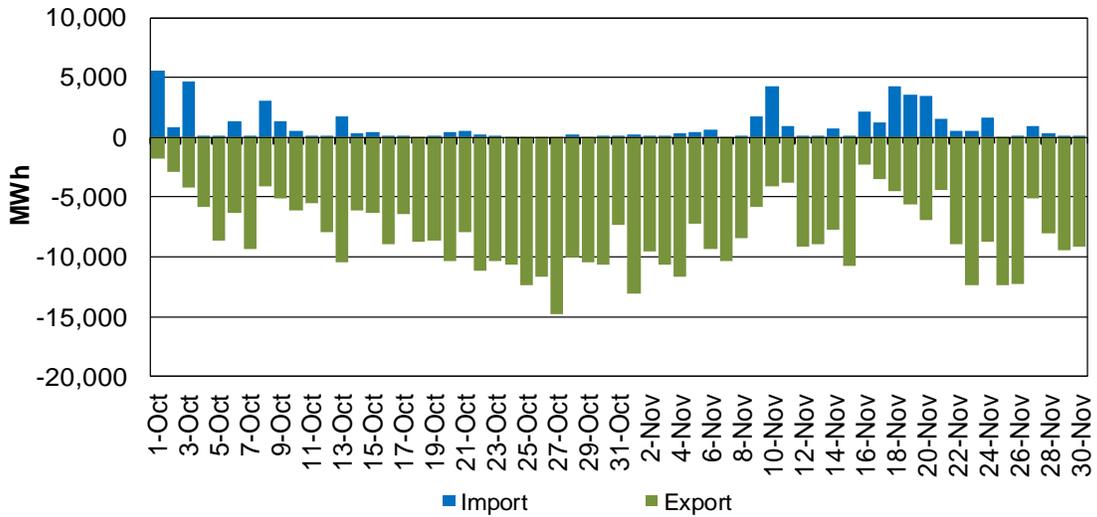


Figure 52: EIM Transfer for PACW in FMM

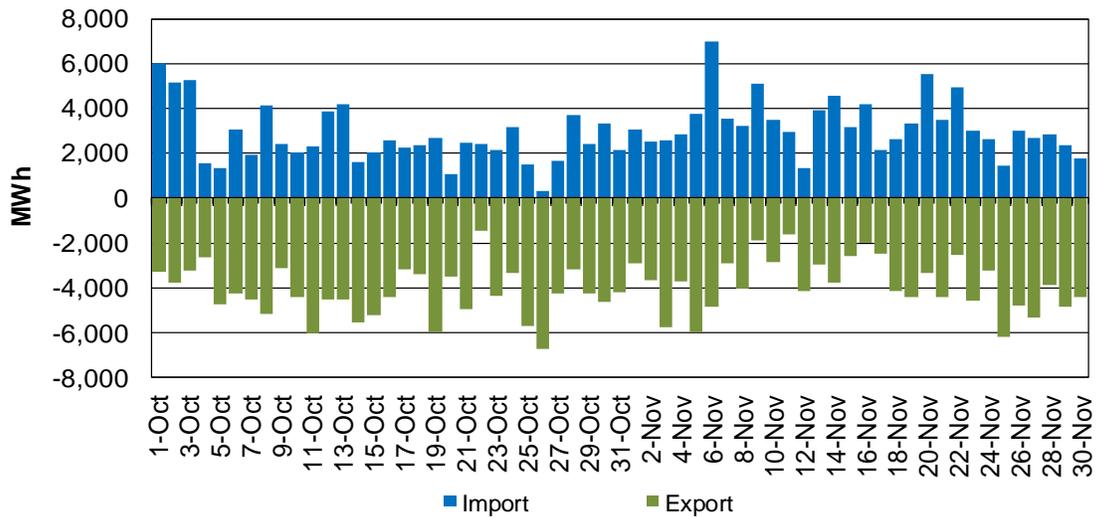


Figure 53 shows the daily volume of EIM transfer for NEVP in FMM.

Figure 53: EIM Transfer for NEVP in FMM

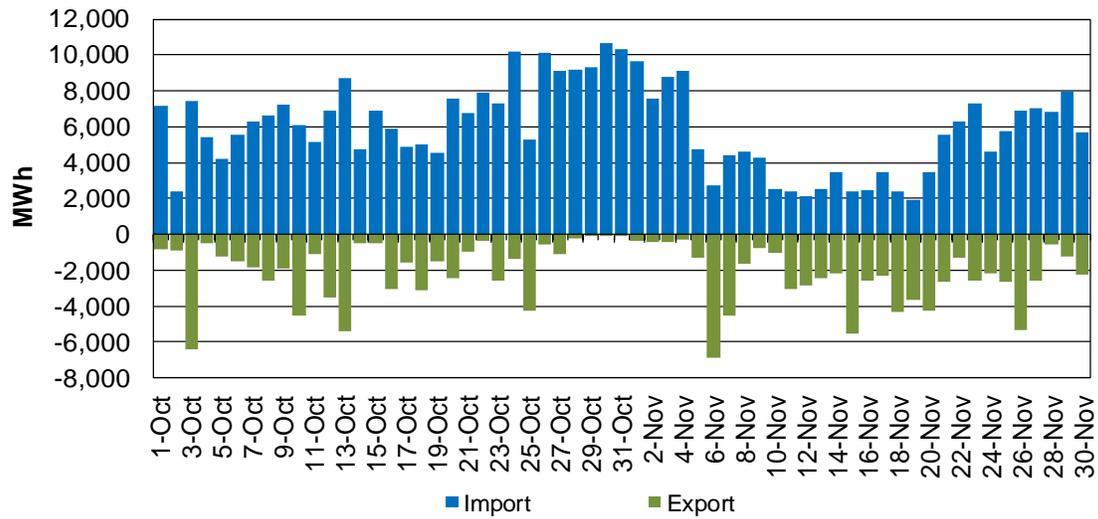


Figure 54 shows the daily volume of EIM transfer for AZPS in FMM.

Figure 54: EIM Transfer for AZPS in FMM

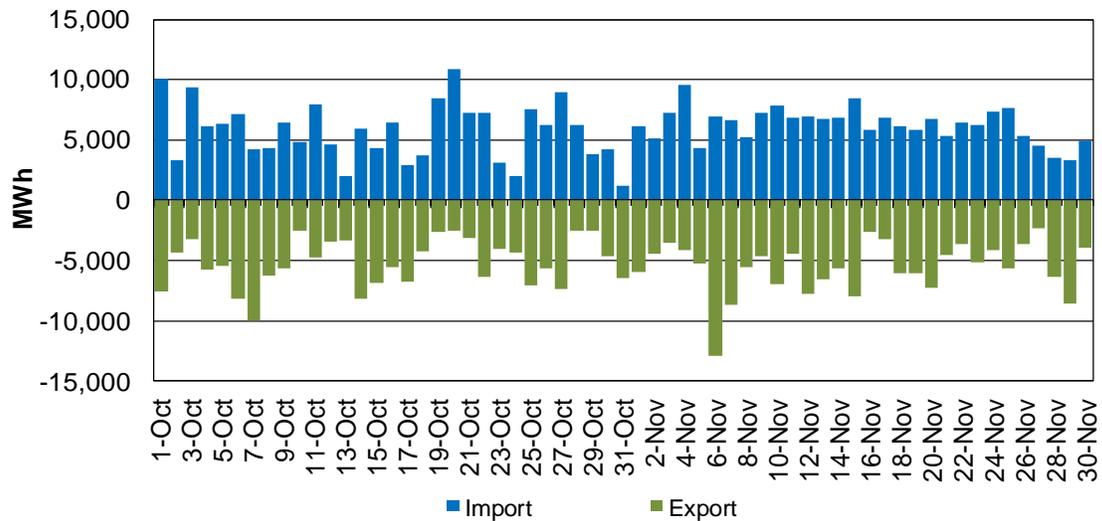


Figure 55 shows the daily volume of EIM transfer for PSEI in FMM.

Figure 55: EIM Transfer between for PSEI in FMM

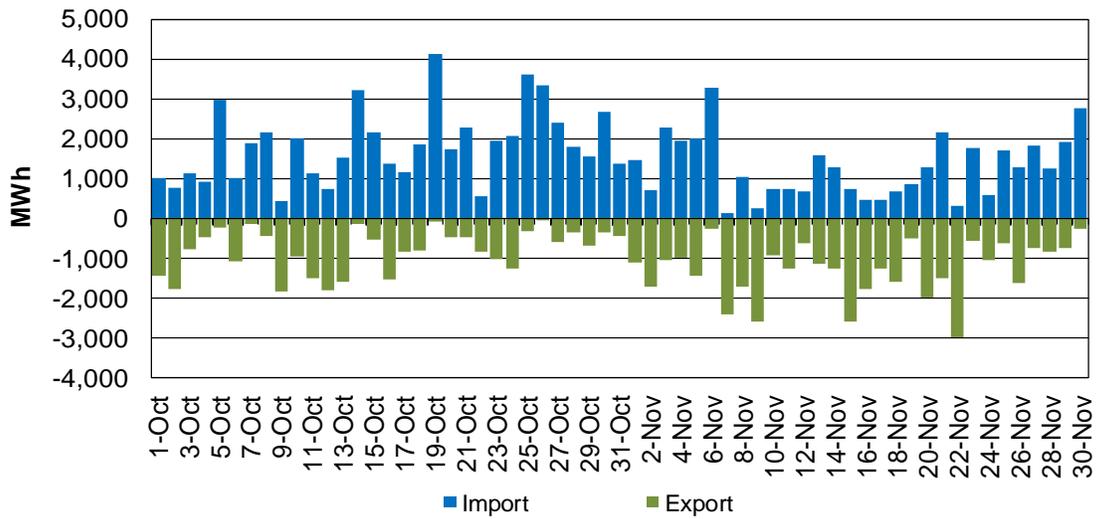


Figure 56 shows the daily volume of EIM transfer for PGE in FMM.

Figure 56: EIM Transfer between for PGE in FMM

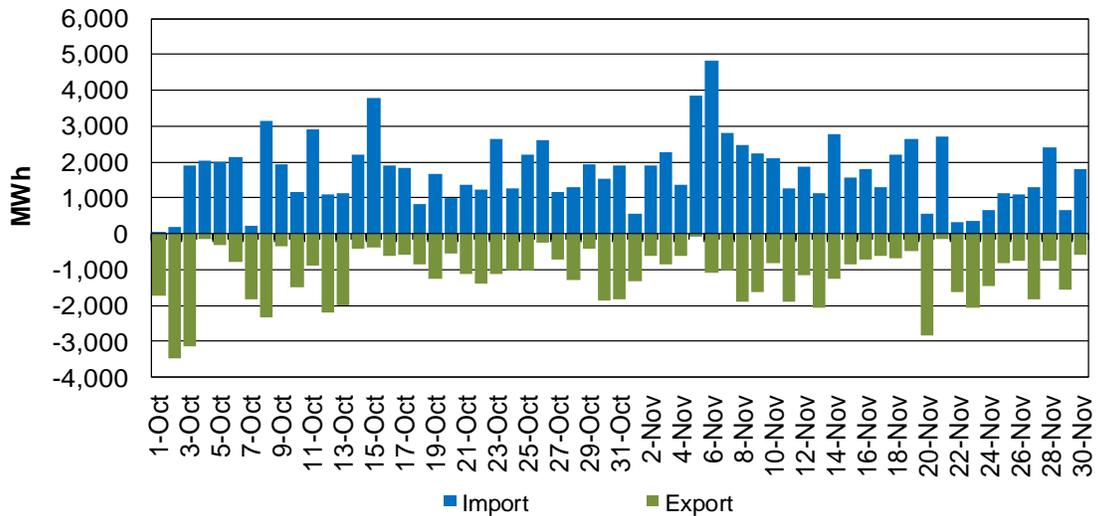


Figure 57 shows the daily volume of EIM for ISO in RTD.

Figure 57: EIM Transfer for CAISO in RTD

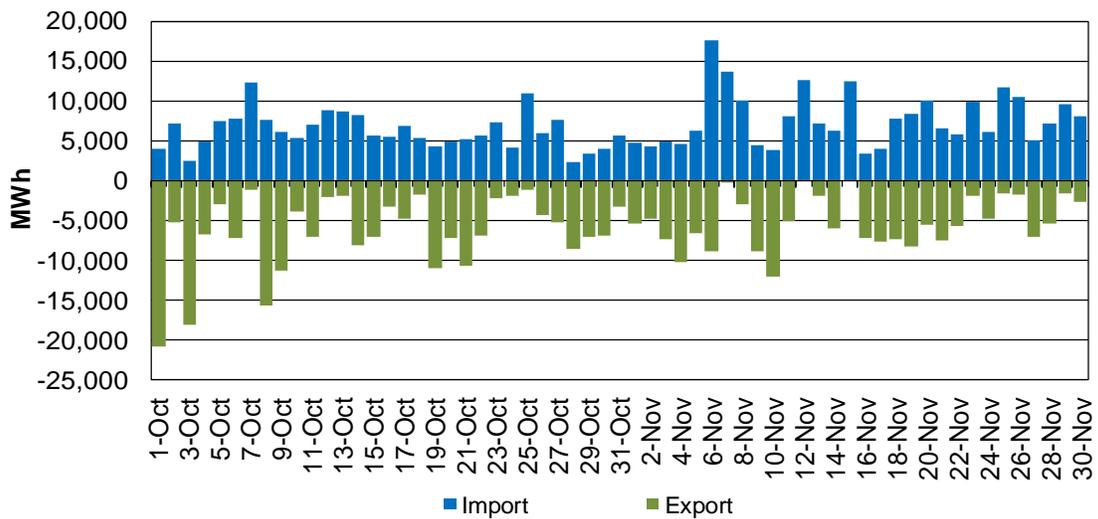


Figure 58 shows the daily volume of EIM transfer for PACE in RTD. Figure 59 shows the daily EIM transfer volume for PACW in RTD.

Figure 58: EIM Transfer for PACE in RTD

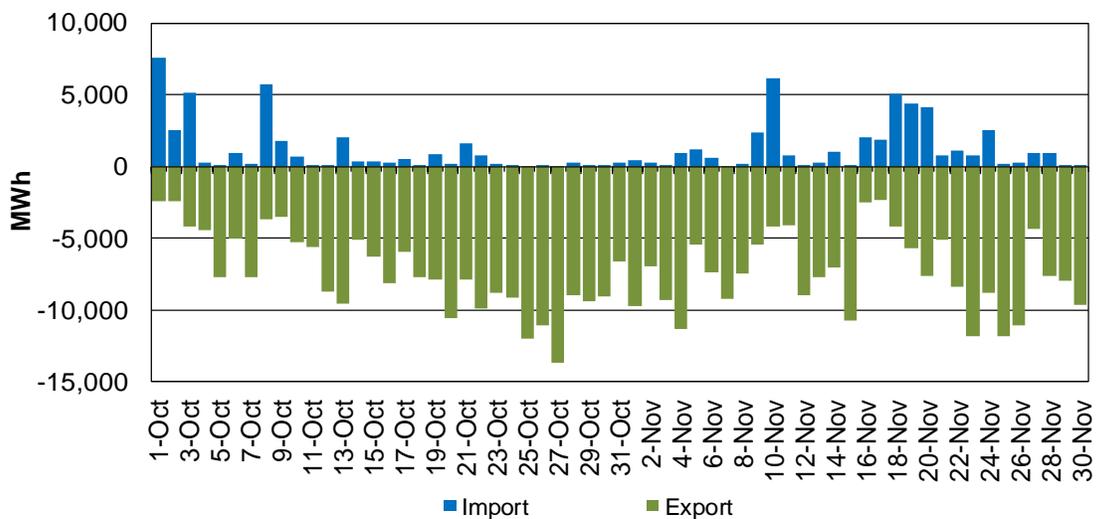


Figure 59: EIM Transfer for PACW in RTD

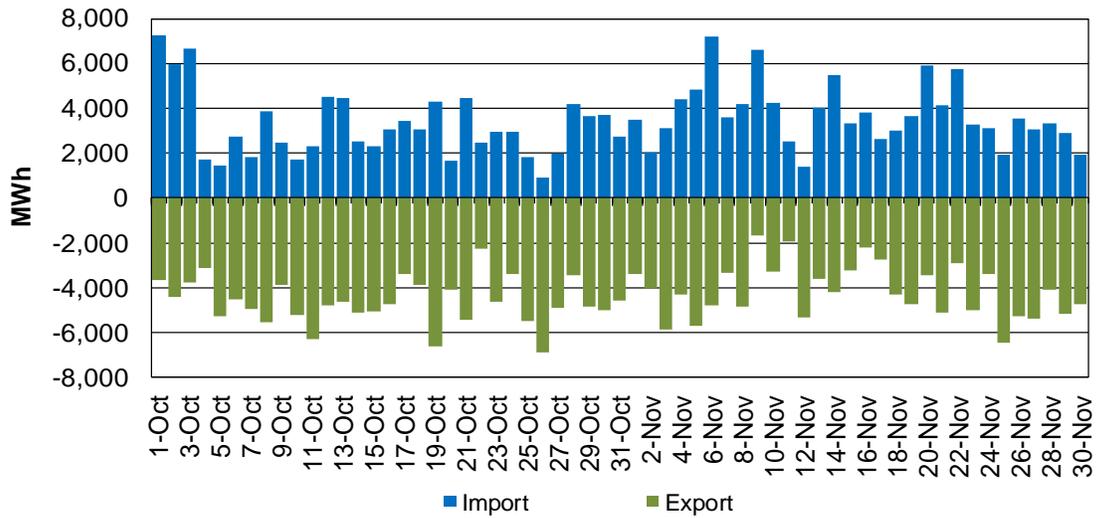


Figure 60 shows the daily EIM transfer volume for NEVP in RTD.

Figure 60: EIM Transfer for NEVP in RTD

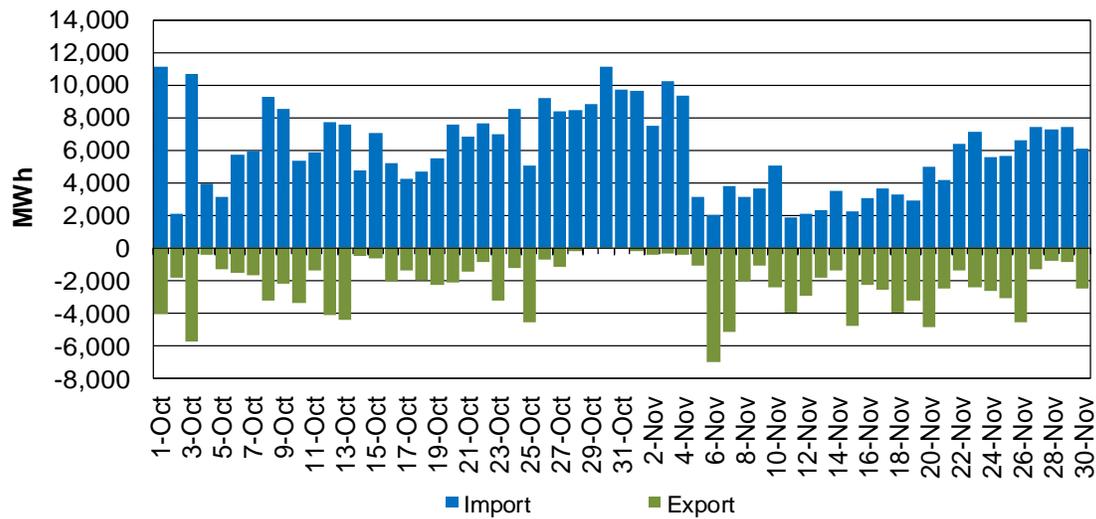


Figure 61 shows the daily volume EIM transfer for AZPS in RTD.

Figure 61: EIM Transfer for AZPS in RTD

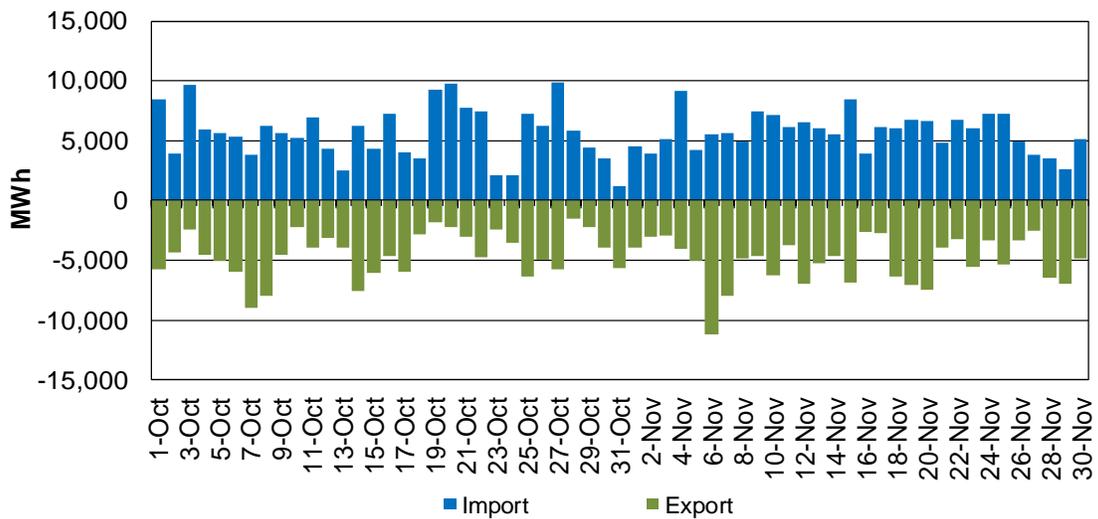


Figure 62 shows the daily volume EIM transfer for PSEI in RTD.

Figure 62: EIM Transfer for PSEI in RTD

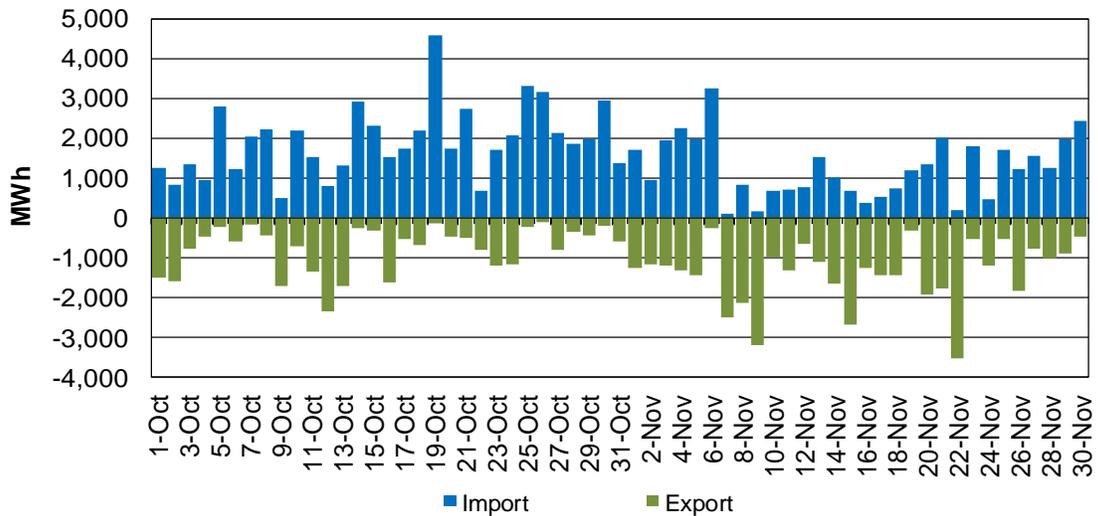


Figure 63 shows the daily volume EIM transfer for PGE in RTD.

Figure 63: EIM Transfer for PGE in RTD

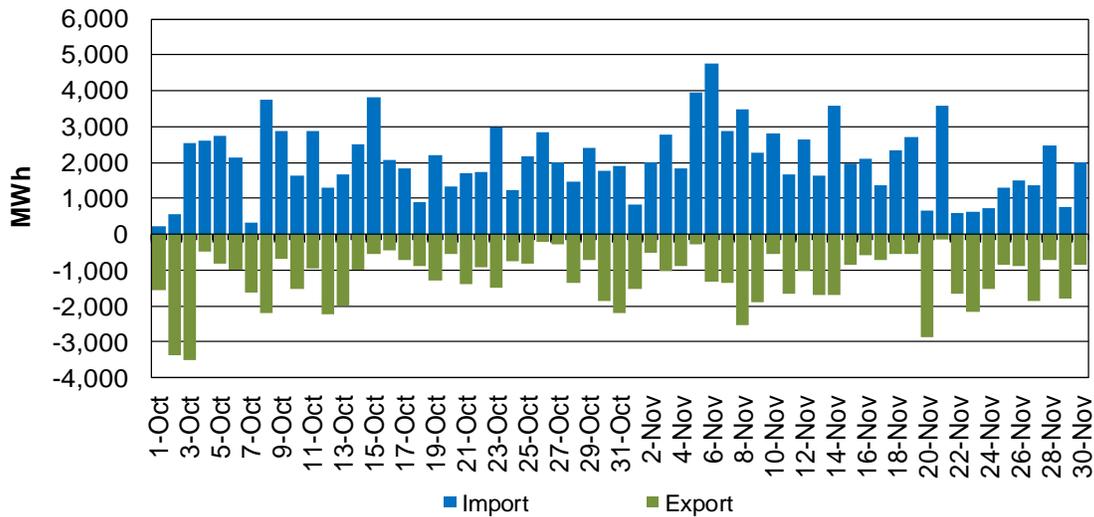


Figure 64 shows daily real-time imbalance energy offset cost (RTIEO) for PACE, PACW, NEVP, AZPS, PSEI, and PGE respectively. Total RTIEO was \$1.55 million in November, increasing from -\$0.23 million in October.

Figure 64: EIM Real-Time Imbalance Energy Offset by Area

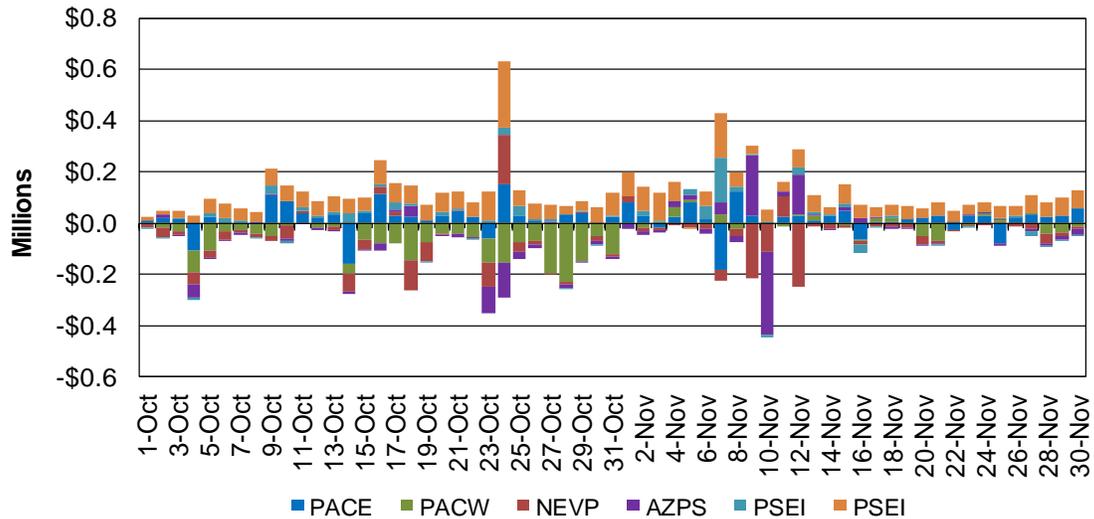


Figure 65 shows daily real-time congestion offset cost (RTCO) for PACE, PACW, NEVP, AZPS, PSEI, and PGE respectively. Total RTCO tumbled to \$0.64 million in November from \$9.24 million in October.

Figure 65: EIM Real-Time Congestion Imbalance Offset by Area

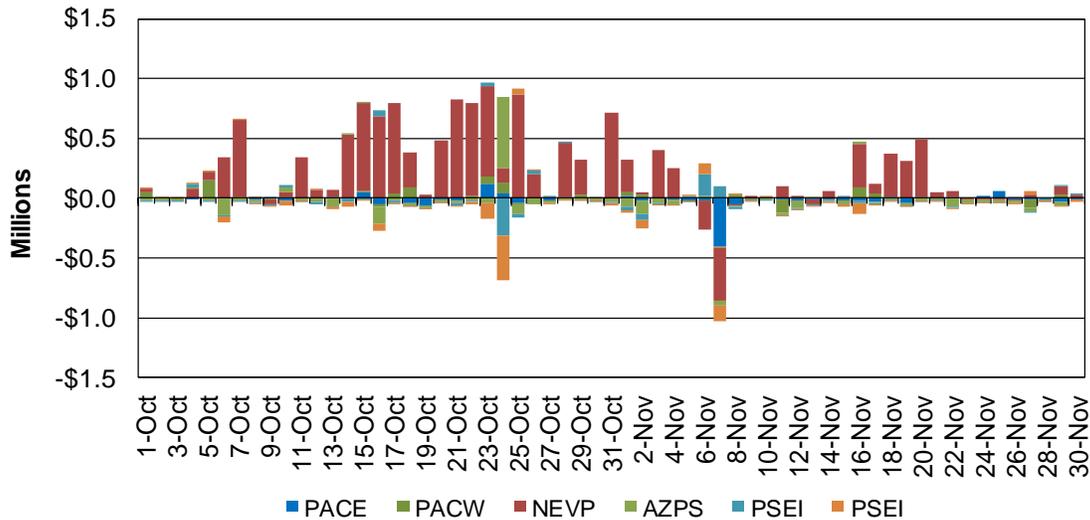


Figure 66 shows daily bid cost recovery for PACE, PACW, NEVP, AZPS, PSEI, and PGE respectively. Total BCR increased to \$1.16 million in November from \$0.84 million in October.

Figure 66: EIM Bid Cost Recovery by Area

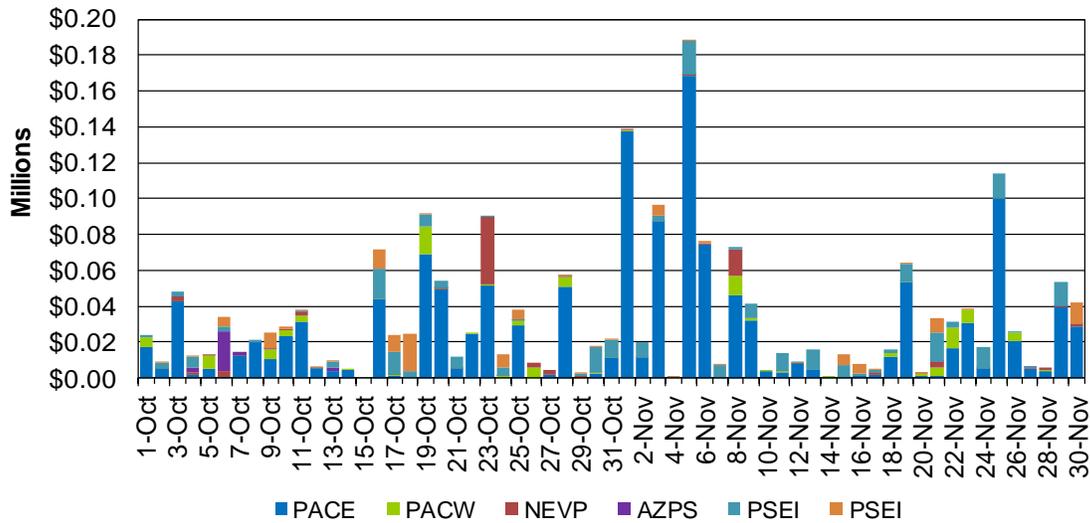


Figure 67 shows the flexible ramping up uncertainty payment for PACE, PACW, NEVP, AZPS, PSEI, and PGE respectively. Total flexible ramping up uncertainty payment in November fell to \$0.37 million from \$0.89 million in October.

Figure 67: Flexible Ramping Up Uncertainty Payment

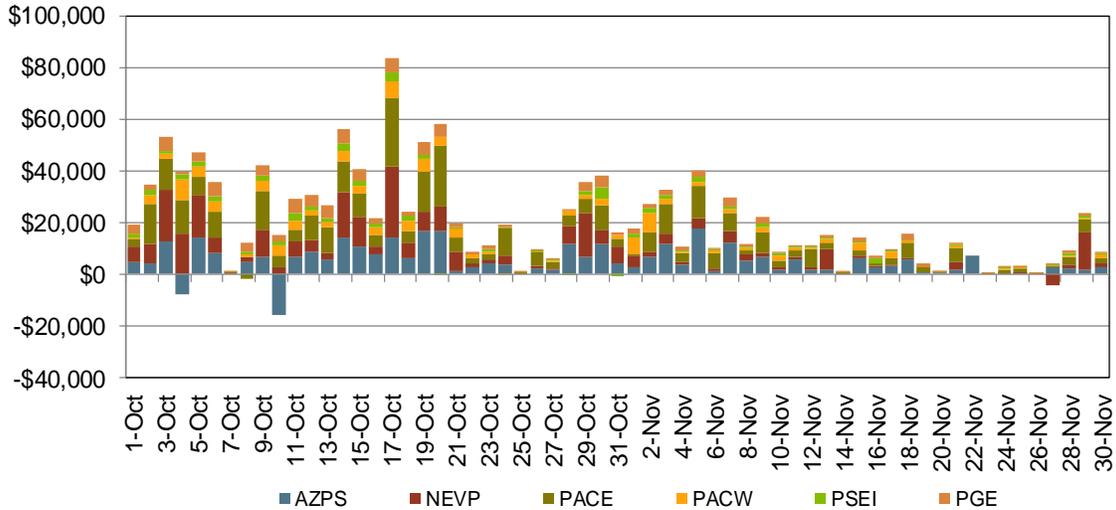


Figure 68 shows the flexible ramping down uncertainty payment for PACE, PACW, NEVP, AZPS, PSEI, and PGE respectively. Total flexible ramping down uncertainty payment in November increased to \$3,433 from -\$1,057 million in October.

Figure 68: Flexible Ramping Down Uncertainty Payment


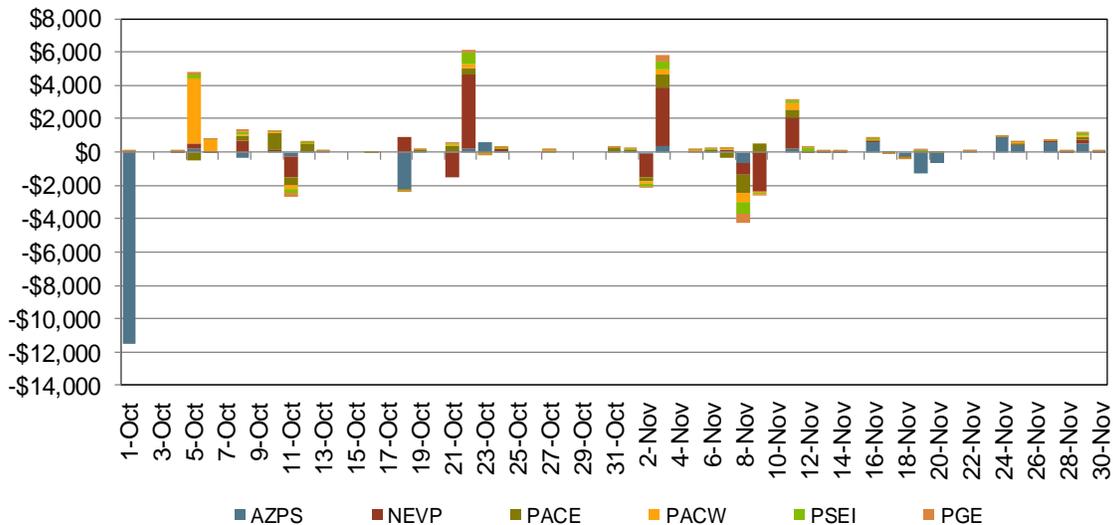


Figure 69 shows the flexible ramping forecast payment for PACE, PACW, NEVP, AZPS, PSEI, and PGE respectively. Total forecast payment in November declined to \$0.30 million from \$0.48 million in October.


Figure 69: Flexible Ramping Forecast Payment

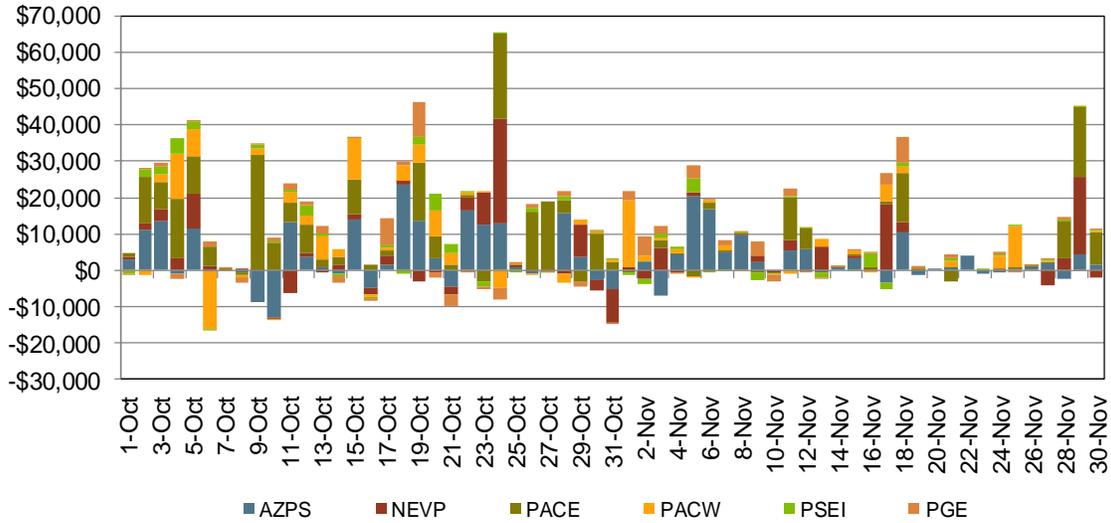

The ISO’s Energy Imbalance Market Business Practice Manual⁵ describes the methodology for determining whether an EIM participating resource is dispatched to support transfers to serve California load. The methodology ensures that the dispatch considers the combined energy and associated marginal greenhouse gas (GHG) compliance cost based on submitted bids⁶.

In the first two months of EIM operations (November and December 2014), EIM startup issues related to processing GHG bid adder resulted in the dispatch of coal generation to support transfers into California. Once the adders were properly accounted for, beginning in January 2015, almost all of the EIM dispatches to support transfers into the ISO were from resources other than coal, as documented in Figure 70 and Table 8 below.

Figure 70: Percentage of EIM Transfer into ISO by Fuel Type

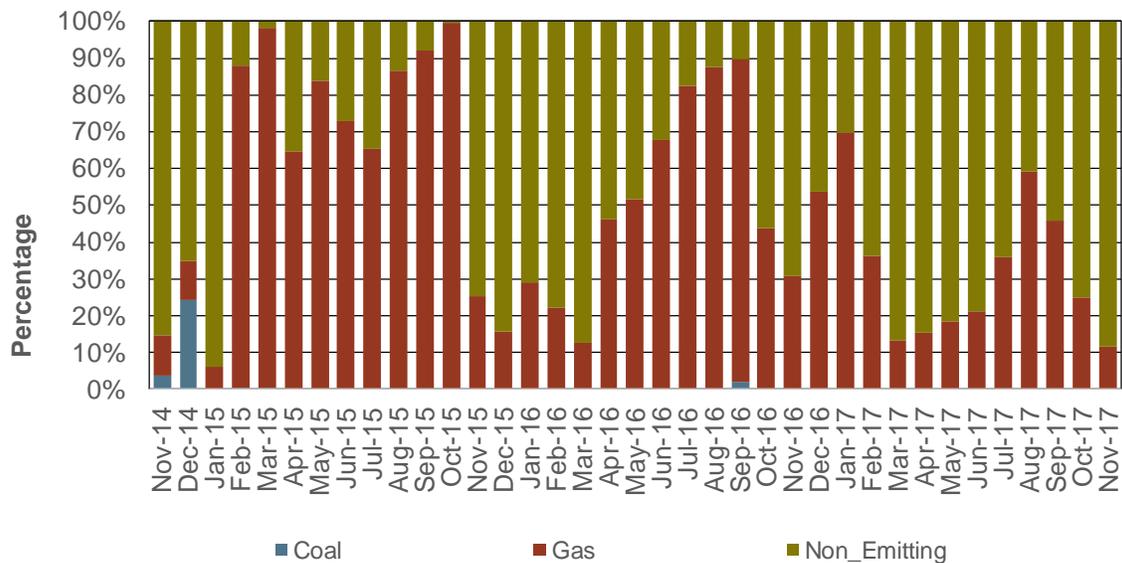

⁵ See the Energy Imbalance Market Business Practice Manual for a description of the methodology for making this determination, which begins on page 42 -- [http://bpmcm.caiso.com/Pages/BPMDetails.aspx?BPM=Energy Imbalance Market](http://bpmcm.caiso.com/Pages/BPMDetails.aspx?BPM=Energy%20Imbalance%20Market).

⁶ A submitted bid may reflect that a resource is not available to support EIM transfers to California.

Table 8: EIM Transfer into ISO by Fuel Type

Month	Coal (%)	Gas (%)	Non-Emitting (%)	Total
Nov-14	3.66%	11.12%	85.22%	100%
Dec-14	24.18%	10.78%	65.04%	100%
Jan-15	0.07%	6.22%	93.71%	100%
Feb-15	0.32%	87.72%	11.96%	100%
Mar-15	0.48%	97.94%	1.58%	100%
Apr-15	0.12%	64.56%	35.32%	100%
May-15	0.00%	83.83%	16.17%	100%
Jun-15	0.00%	72.88%	27.12%	100%
Jul-15	0.00%	65.41%	34.59%	100%
Aug-15	0.02%	86.51%	13.48%	100%
Sep-15	0.00%	92.13%	7.87%	100%
Oct-15	0.10%	99.70%	0.20%	100%
Nov-15	0.00%	25.25%	74.75%	100%
Dec-15	0.00%	15.79%	84.21%	100%
Jan-16	0.00%	28.96%	71.04%	100%
Feb-16	0.00%	22.21%	77.79%	100%
Mar-16	0.00%	12.72%	87.28%	100%
Apr-16	0.00%	46.26%	53.74%	100%
May-16	0.00%	51.63%	48.37%	100%
Jun-16	0.00%	67.89%	32.11%	100%
Jul-16	0.00%	82.42%	17.58%	100%
Aug-16	0.00%	87.59%	12.41%	100%
Sep-16	1.98%	87.68%	10.34%	100%
Oct-16	0.00%	43.82%	56.18%	100%
Nov-16	0.00%	30.74%	69.26%	100%
Dec-16	0.00%	53.77%	46.23%	100%
Jan-17	0.00%	69.88%	30.12%	100%
Feb-17	0.00%	36.42%	63.58%	100%
Mar-17	0.00%	13.37%	86.63%	100%
Apr-17	0.00%	15.47%	84.53%	100%
May-17	0.00%	18.47%	81.53%	100%
Jun-17	0.00%	21.33%	78.67%	100%
Jul-17	0.00%	36.08%	63.92%	100%
Aug-17	0.00%	59.20%	40.80%	100%
Sep-17	0.00%	45.94%	54.06%	100%
Oct-17	0.00%	24.85%	75.15%	100%
Nov-17	0.00%	11.57%	88.43%	100%